



**E2 MEZZANINE STEP**  
SCALE: 1/12" = 1'-0"

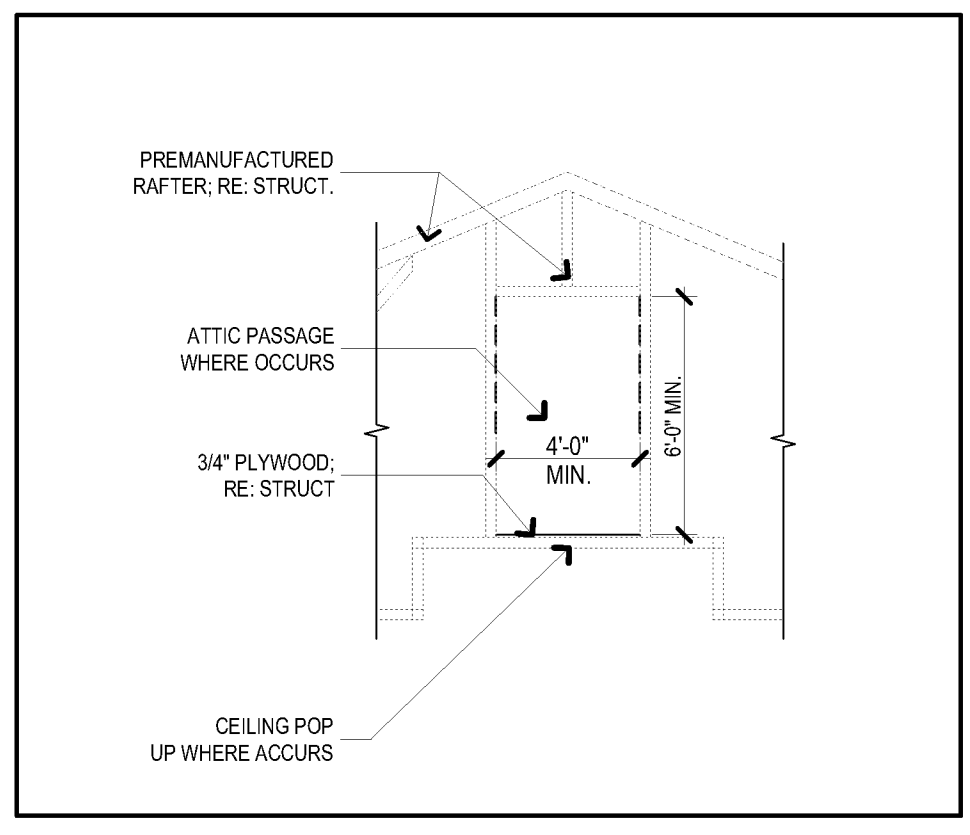

**E3 TYPICAL CATWALK SECTION A**  
SCALE: 3/16" = 1'-0"

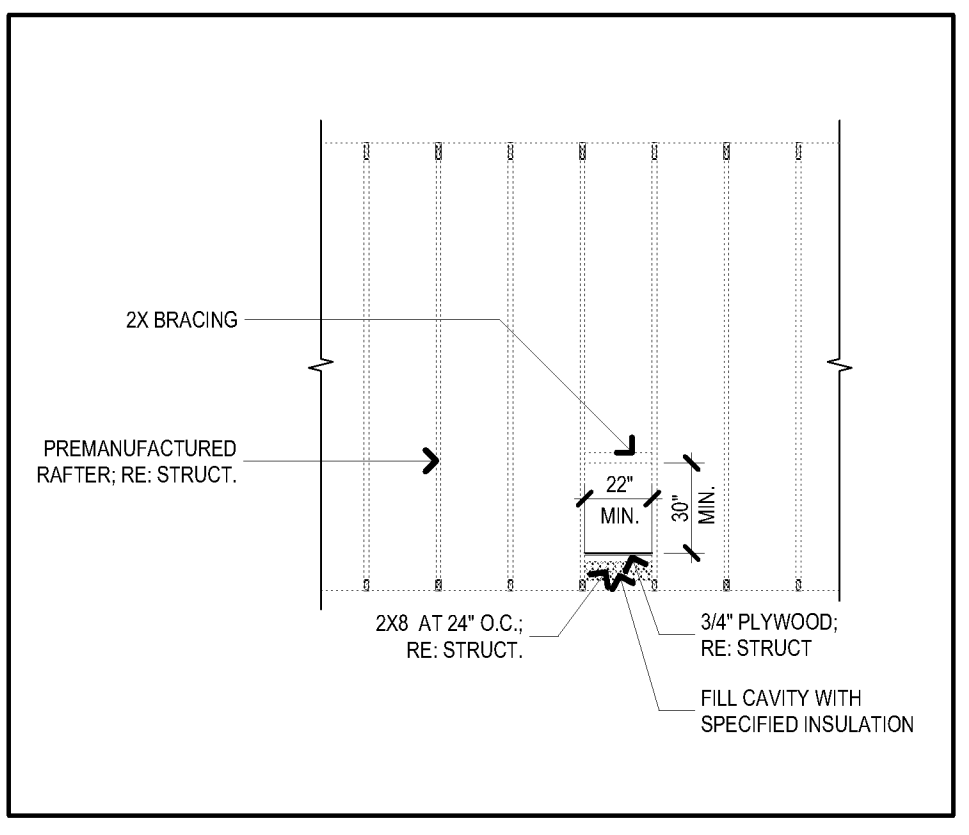

**E4 TYPICAL CATWALK SECTION B**  
SCALE: 3/16" = 1'-0"

**ATTIC PLAN GENERAL NOTES**

- GENERAL NOTES APPLY TO ALL DRAWINGS.
- COORDINATE CATWALK LOCATION W/ MECHANICAL, STRUCTURAL, AND TRUSS MANUFACTURER.
- CATWALK TO BE COVERED WITH PLYWOOD DECKING, RE. STRUCTURAL.
- COORDINATE INSULATION TO BE INSTALLED UNDER CATWALK DECKING ASSEMBLY PRIOR TO PLYWOOD DECKING.
- PLYWOOD DECKING AT CATWALK TO BE 3/4" CDX.

**ATTIC PLAN KEYED NOTES**


- EXTEND FIRE WALL FROM EXTERIOR WALL TO EXTERIOR WALL AND TO UNDERSIDE OF ROOF SHEATHING. PROTECT ROOF WITH 5/8" TYPE 'X' GYPSUM BOARD DIRECTLY BENEATH THE UNDERSIDE OF THE ROOF DECK, SUPPORTED BY LEDGES ATTACHED TO THE SIDES OF THE ROOF FRAMING MEMBERS FOR A MINIMUM DISTANCE OF 4'-0" ON BOTH SIDES OF THE FIRE WALL.
- EXISTING ROOF AND NEW ROOF CONNECTION. PROVIDE NEW WALL SEPARATION WHERE ONE DOES NOT ALREADY EXIST AND PROVIDE SPRAY-ON INSULATION ON INTERIOR SIDE OF NEW WALL.

**FLOOR PLAN WALL LEGEND**

- NEW WALL PARTITION, AS TYPICAL @ TYPE I-A CONSTRUCTION, AND A4 TYPICAL @ TYPE I-A CONSTRUCTION, U.A.O.
- 1 HR FIRE BARRIER CONTINUOUS TO UNDERSIDE OF FLOOR / ROOF DECK #U305
- 1 HR FIRE/SMOKE BARRIER CONTINUOUS TO UNDERSIDE OF FLOOR / ROOF DECK #U305
- 2 HR AREA SEPARATION WALL CONTINUOUS TO UNDERSIDE OF ROOF DECK PER #U305
- MASONRY BLOCK WALL UL #U305
- 2 LAYERS TYPE 'X' GYP TO UNDERSIDE OF CEILING

**ATTIC PLAN LEGEND**

- 20' X 30' 1 HR ATTIC ACCESS
- 22' X 48' 1 HR RATED RETRACTABLE ATTIC ACCESS
- ATTIC CATWALK AREA
- FIRE TREATED SHEATHING AT ROOF DECK
- 1 HR FIRE/SMOKE BARRIER TO UNDERSIDE OF ROOF DECK PER UL #U305
- 1 HR SMOKE BARRIER WALL TO RATED CEILING PER UL #U305
- AIR HANDLING UNIT REF: MEP

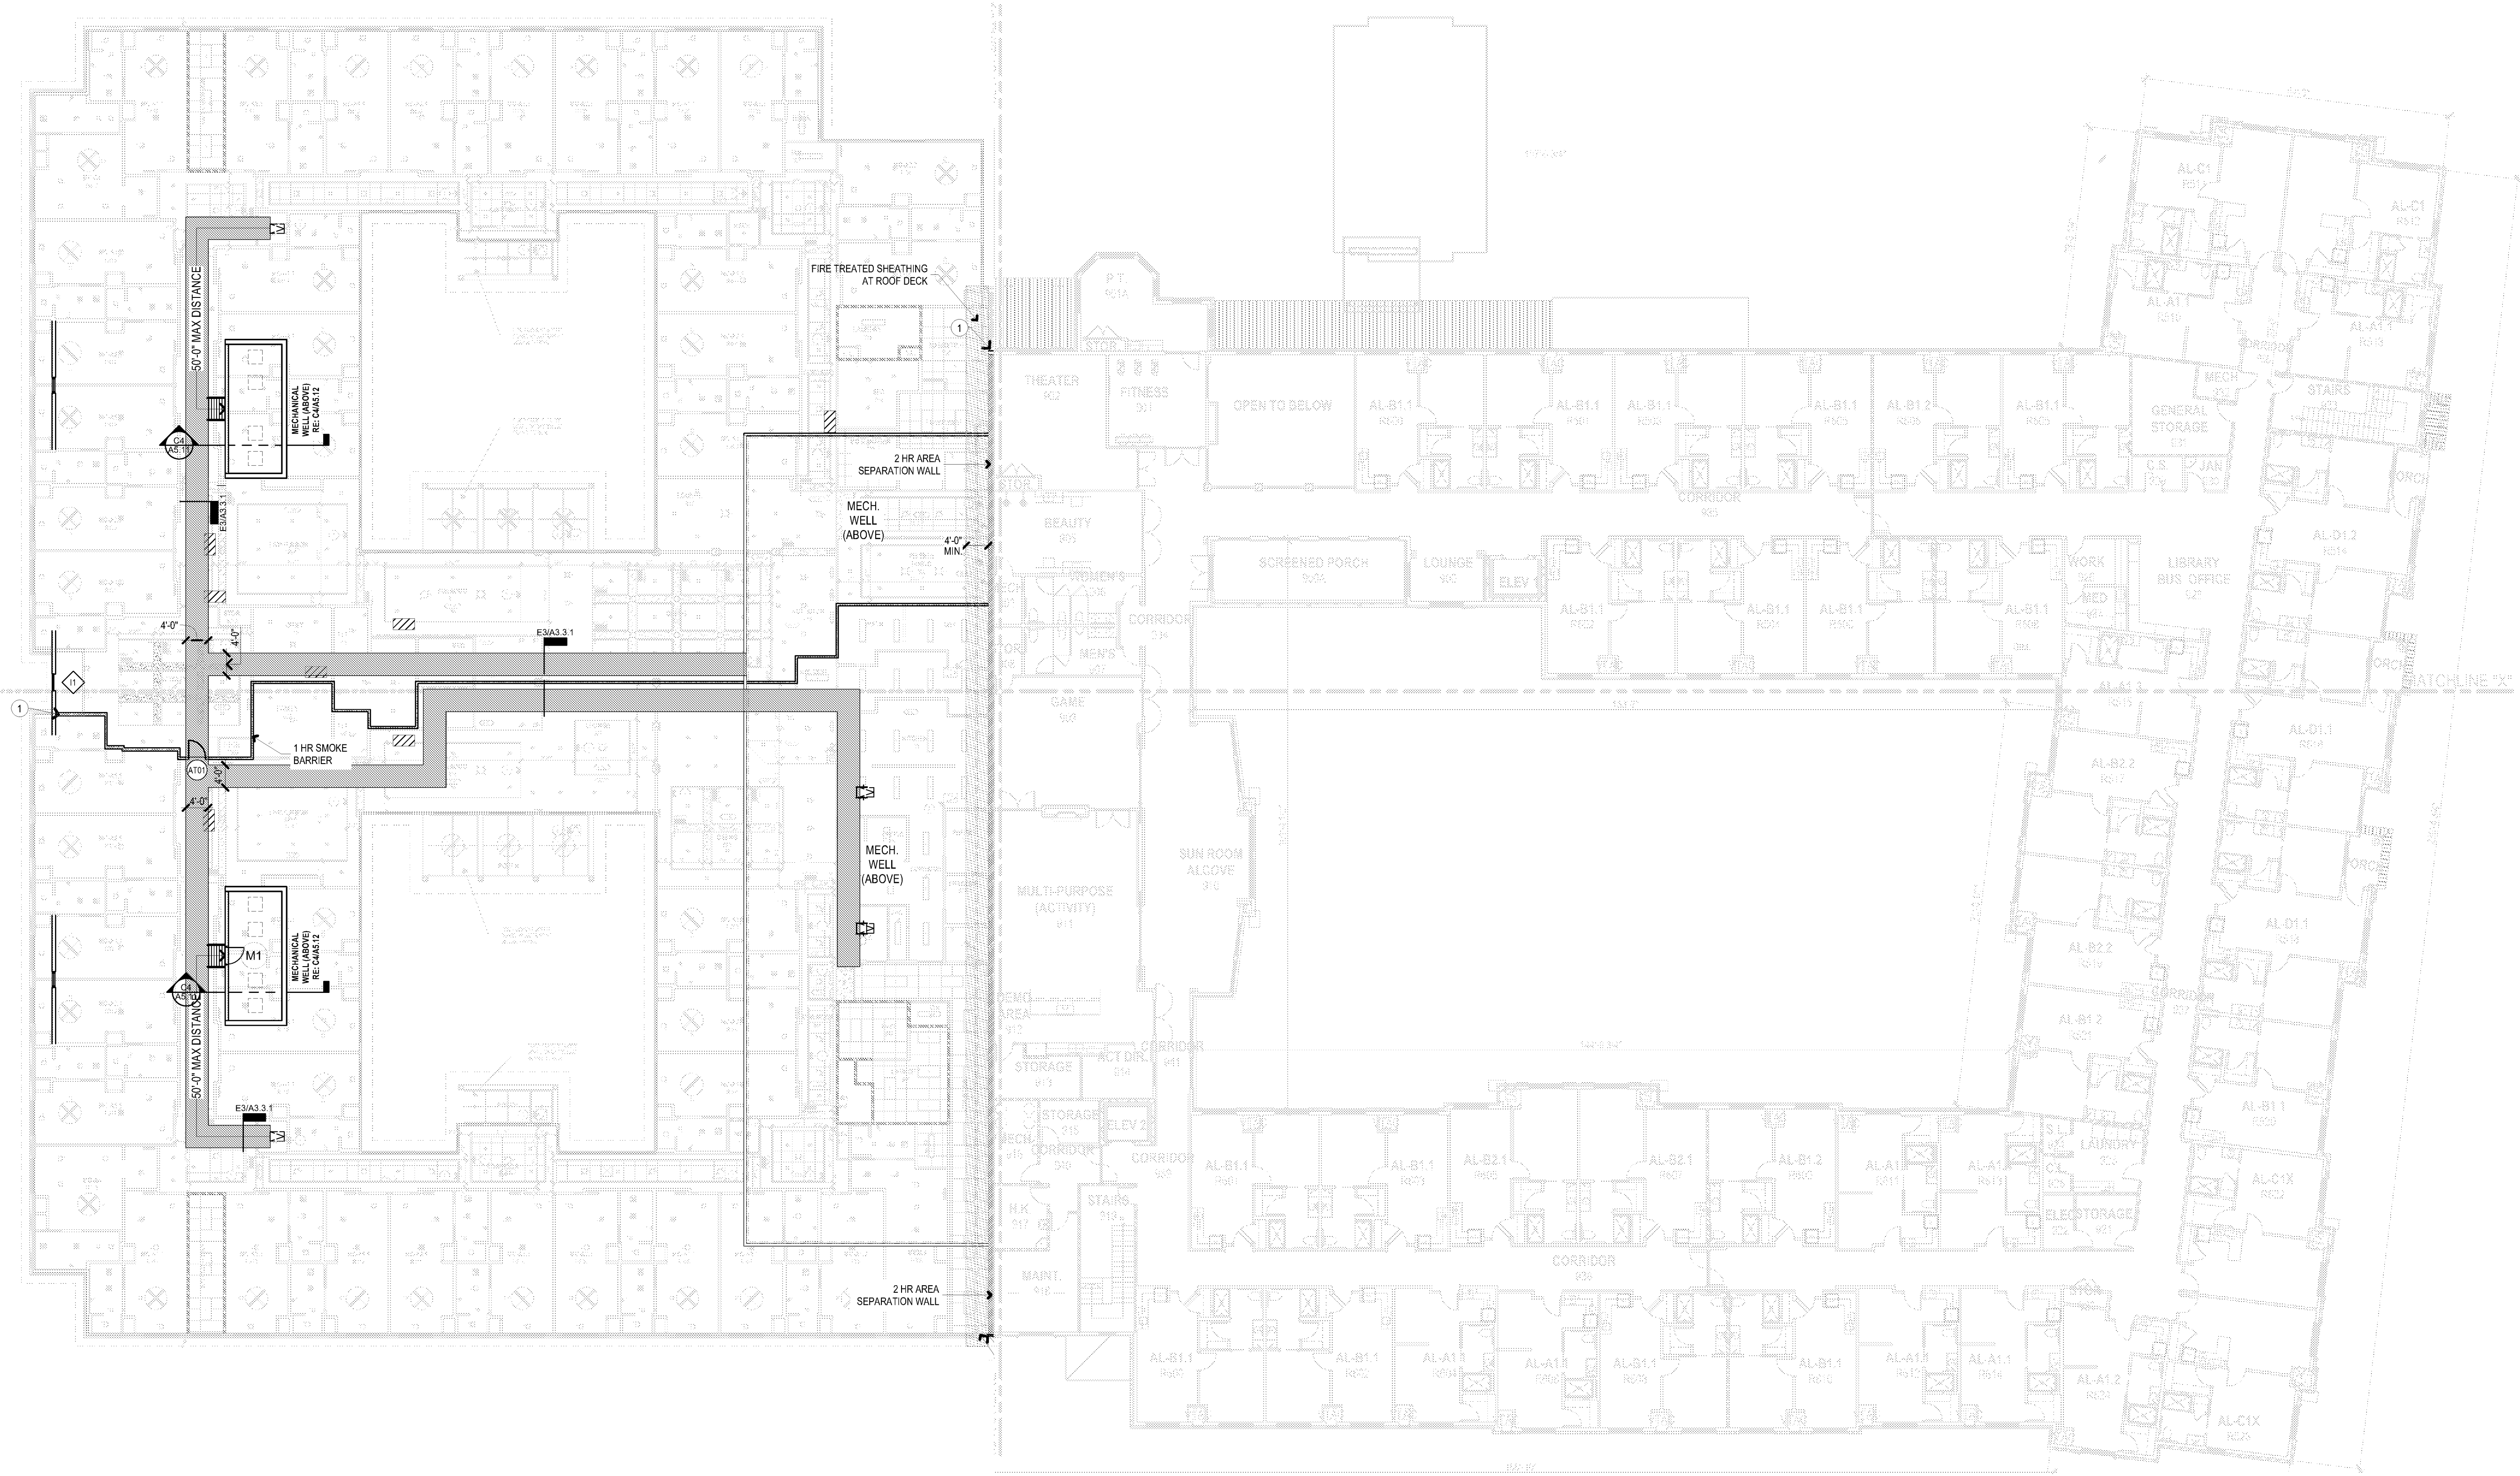

**A1 ATTIC PLAN**  
SCALE: 1/16" = 1'-0"

