

BIM Server: SERVER2015 - BIM Server 19/14017 Concordia Baton Rouge | Ver. 19.001 | Friday, April 01, 2016 | 11:49 AM

ATTIC PLAN GENERAL NOTES

1. GENERAL NOTES APPLY TO ALL DRAWINGS.
2. COORDINATE CATWALK LOCATION W/ MECHANICAL, STRUCTURAL, AND TRUSS MANUFACTURER.
3. CATWALK TO BE COVERED WITH PLYWOOD DECKING, RE. STRUCTURAL.
4. COORDINATE INSULATION TO BE INSTALLED UNDER CATWALK DECKING ASSEMBLY PRIOR TO PLYWOOD DECKING.
5. PLYWOOD DECKING AT CATWALK TO BE 3/4" CDX.

ATTIC PLAN KEYED NOTES


1. EXTEND FIRE WALL FROM EXTERIOR WALL TO EXTERIOR WALL AND TO UNDERSIDE OF ROOF SHEATHING. PROTECT ROOF WITH 5/8" TYPE 'X' GYPSUM BOARD DIRECTLY BENEATH THE UNDERSIDE OF THE ROOF DECK, SUPPORTED BY LEDGES ATTACHED TO THE SIDES OF THE ROOF FRAMING MEMBERS FOR A MINIMUM DISTANCE OF 4'-0" ON BOTH SIDES OF THE FIRE WALL.
2. EXISTING ROOF AND NEW ROOF CONNECTION. PROVIDE NEW WALL SEPARATION WHERE ONE DOES NOT ALREADY EXIST AND PROVIDE SPRAY-ON INSULATION ON INTERIOR SIDE OF NEW WALL.

FLOOR PLAN WALL LEGEND

- NEW WALL PARTITION, AS TYPICAL @ TYPE I-II-A CONSTRUCTION, AND A4 TYPICAL @ TYPE I-A CONSTRUCTION, U.A.O.
- 1 HR FIRE BARRIER CONTINUOUS TO UNDERSIDE OF FLOOR / ROOF DECK #U305
- 1 HR FIRE/SMOKE BARRIER CONTINUOUS TO UNDERSIDE OF FLOOR / ROOF DECK #U305
- 2 HR AREA SEPARATION WALL CONTINUOUS TO UNDERSIDE OF ROOF DECK PER UL #U305
- MASONRY BLOCK WALL UL #U305
- 2 LAYERS TYPE 'X' GYP TO UNDERSIDE OF CEILING

ATTIC PLAN LEGEND

- 20' X 30" 1 HR ATTIC ACCESS
- 22' X 48" 1 HR RATED RETRACTABLE ATTIC ACCESS
- ATTIC CATWALK AREA
- FIRE TREATED SHEATHING AT ROOF DECK
- 1 HR FIRE/SMOKE BARRIER TO UNDERSIDE OF ROOF DECK PER UL #U305
- 1 HR SMOKE BARRIER WALL TO RATED CEILING PER UL #U305
- AIR HANDLING UNIT REF: MEP

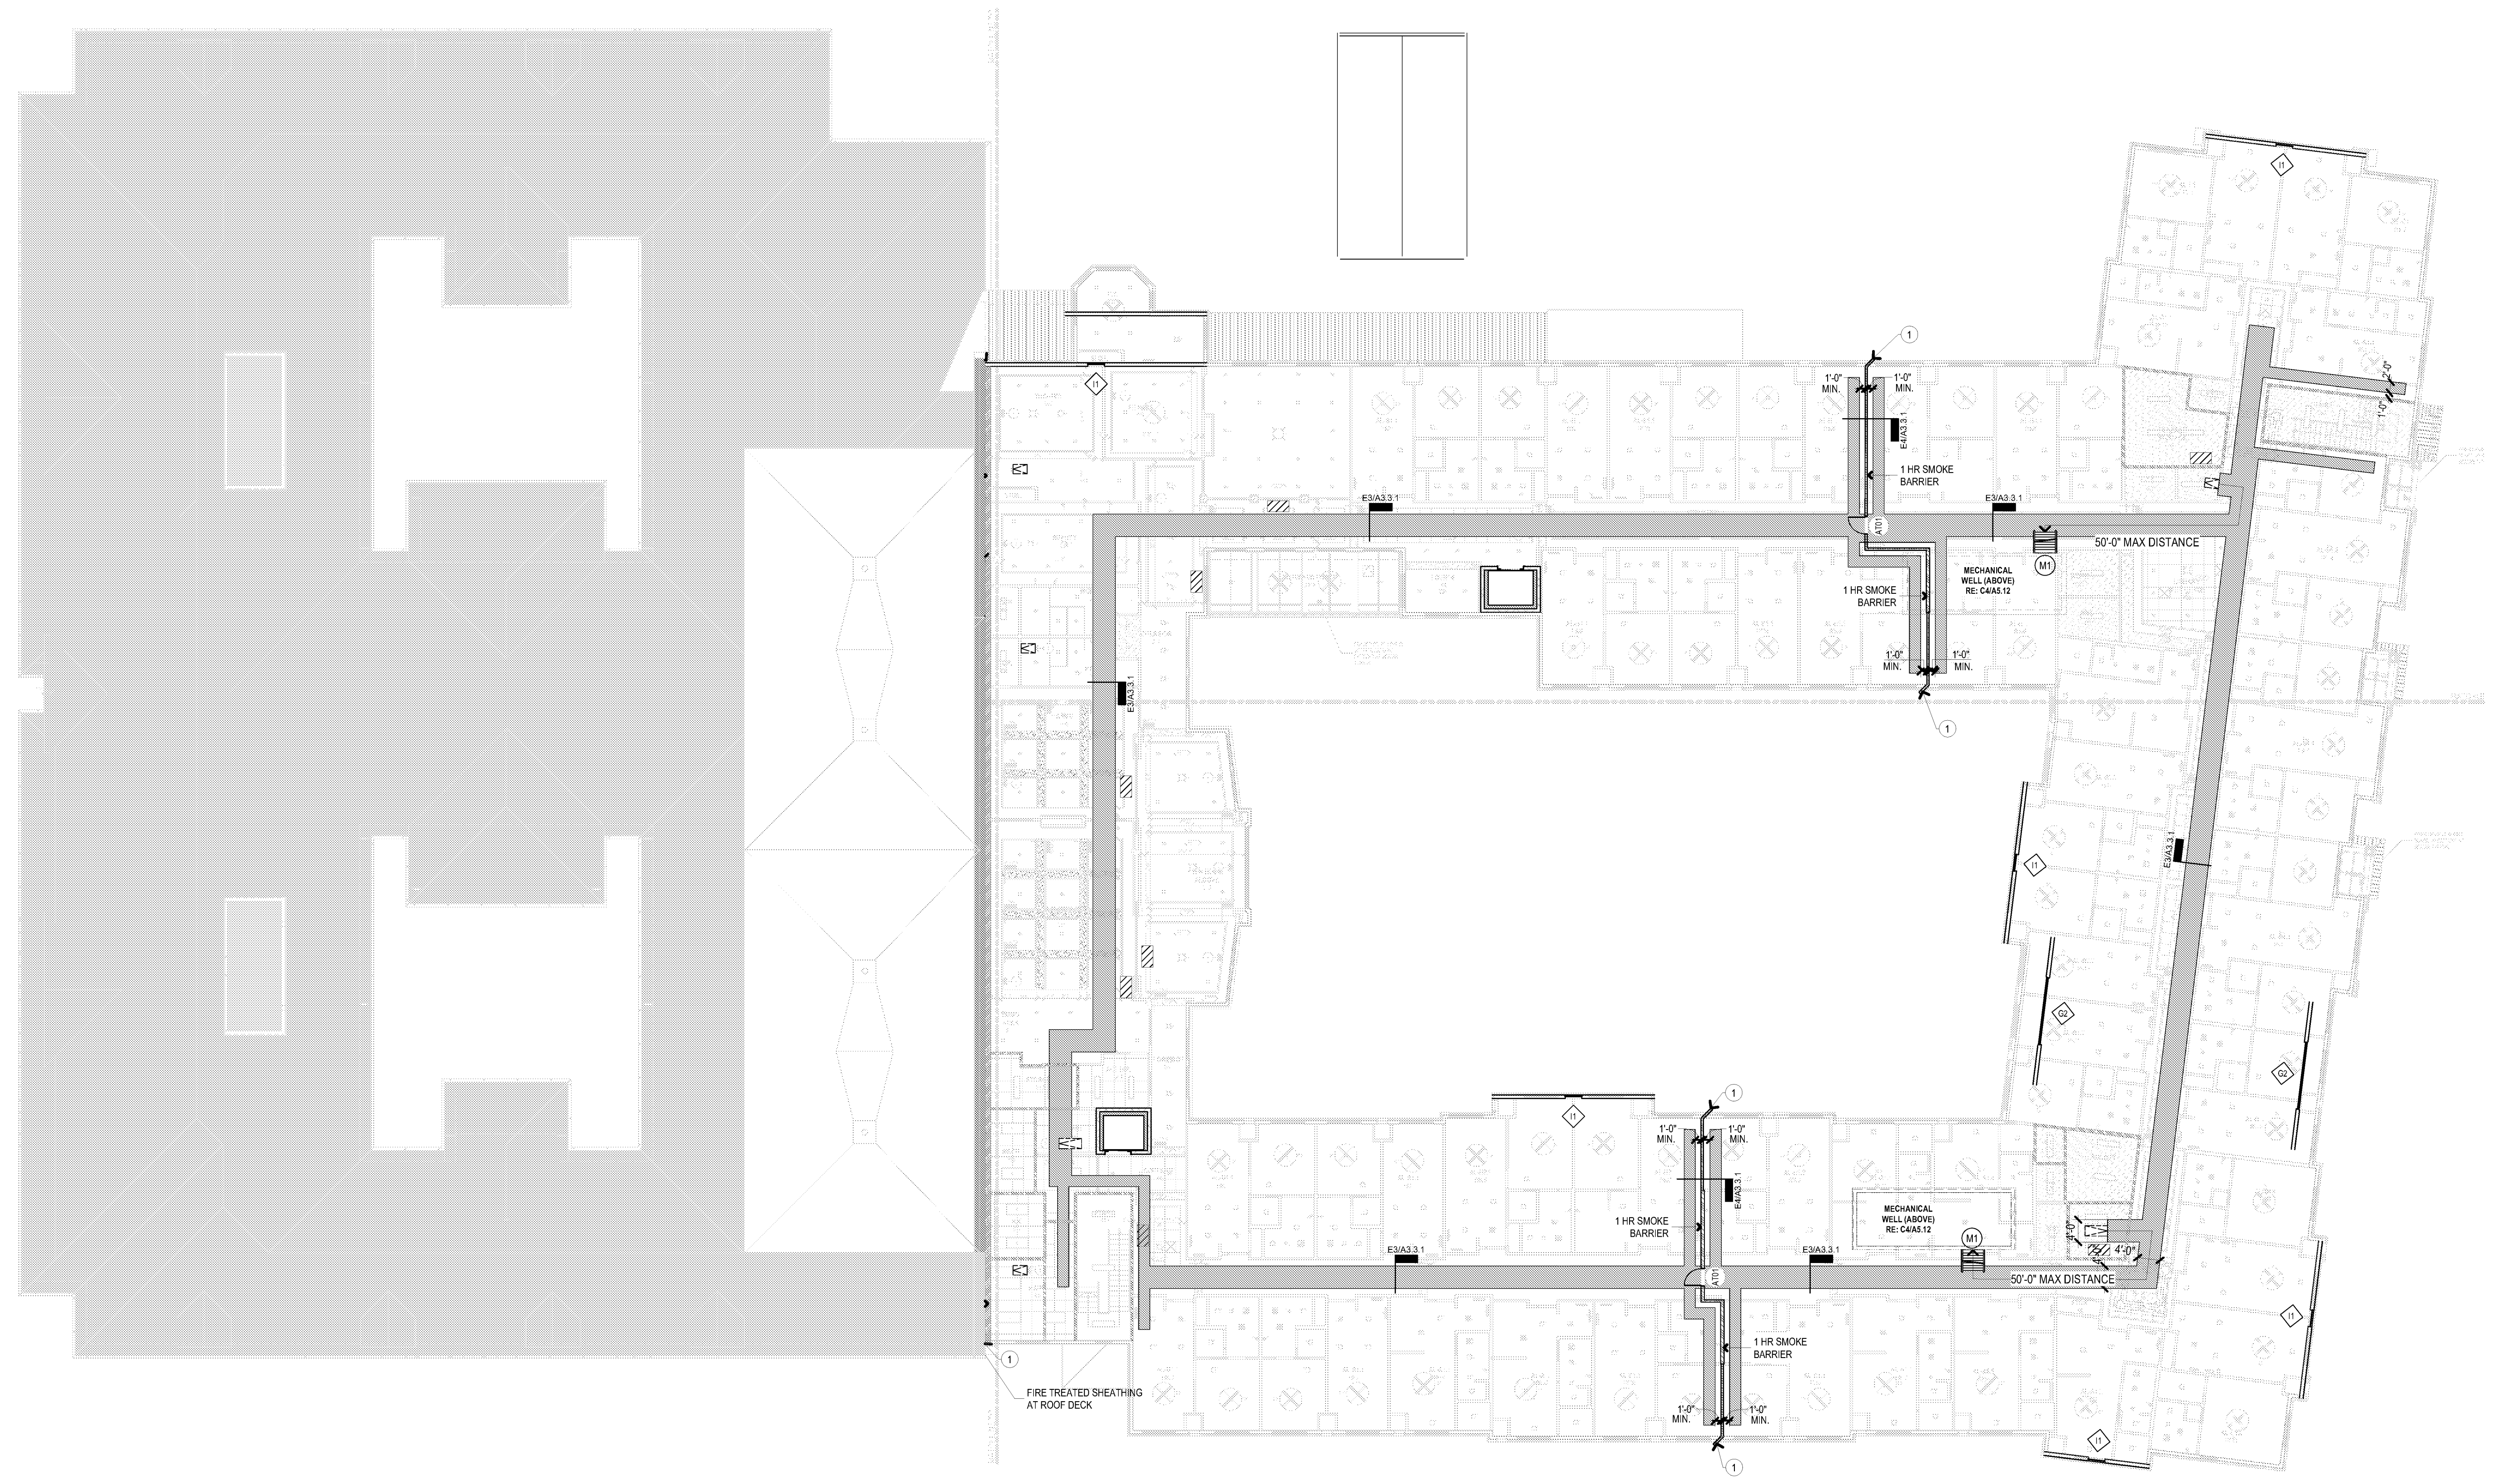

A3 ATTIC PLAN
SCALE: 1/16" = 1'-0"

