


BIM Server: Save/2012 - BIM Server (18/01/14/17 Concordia Baton Rouge) [Ver: 18.001] [Wednesday, September 02, 2015] 4:04 PM

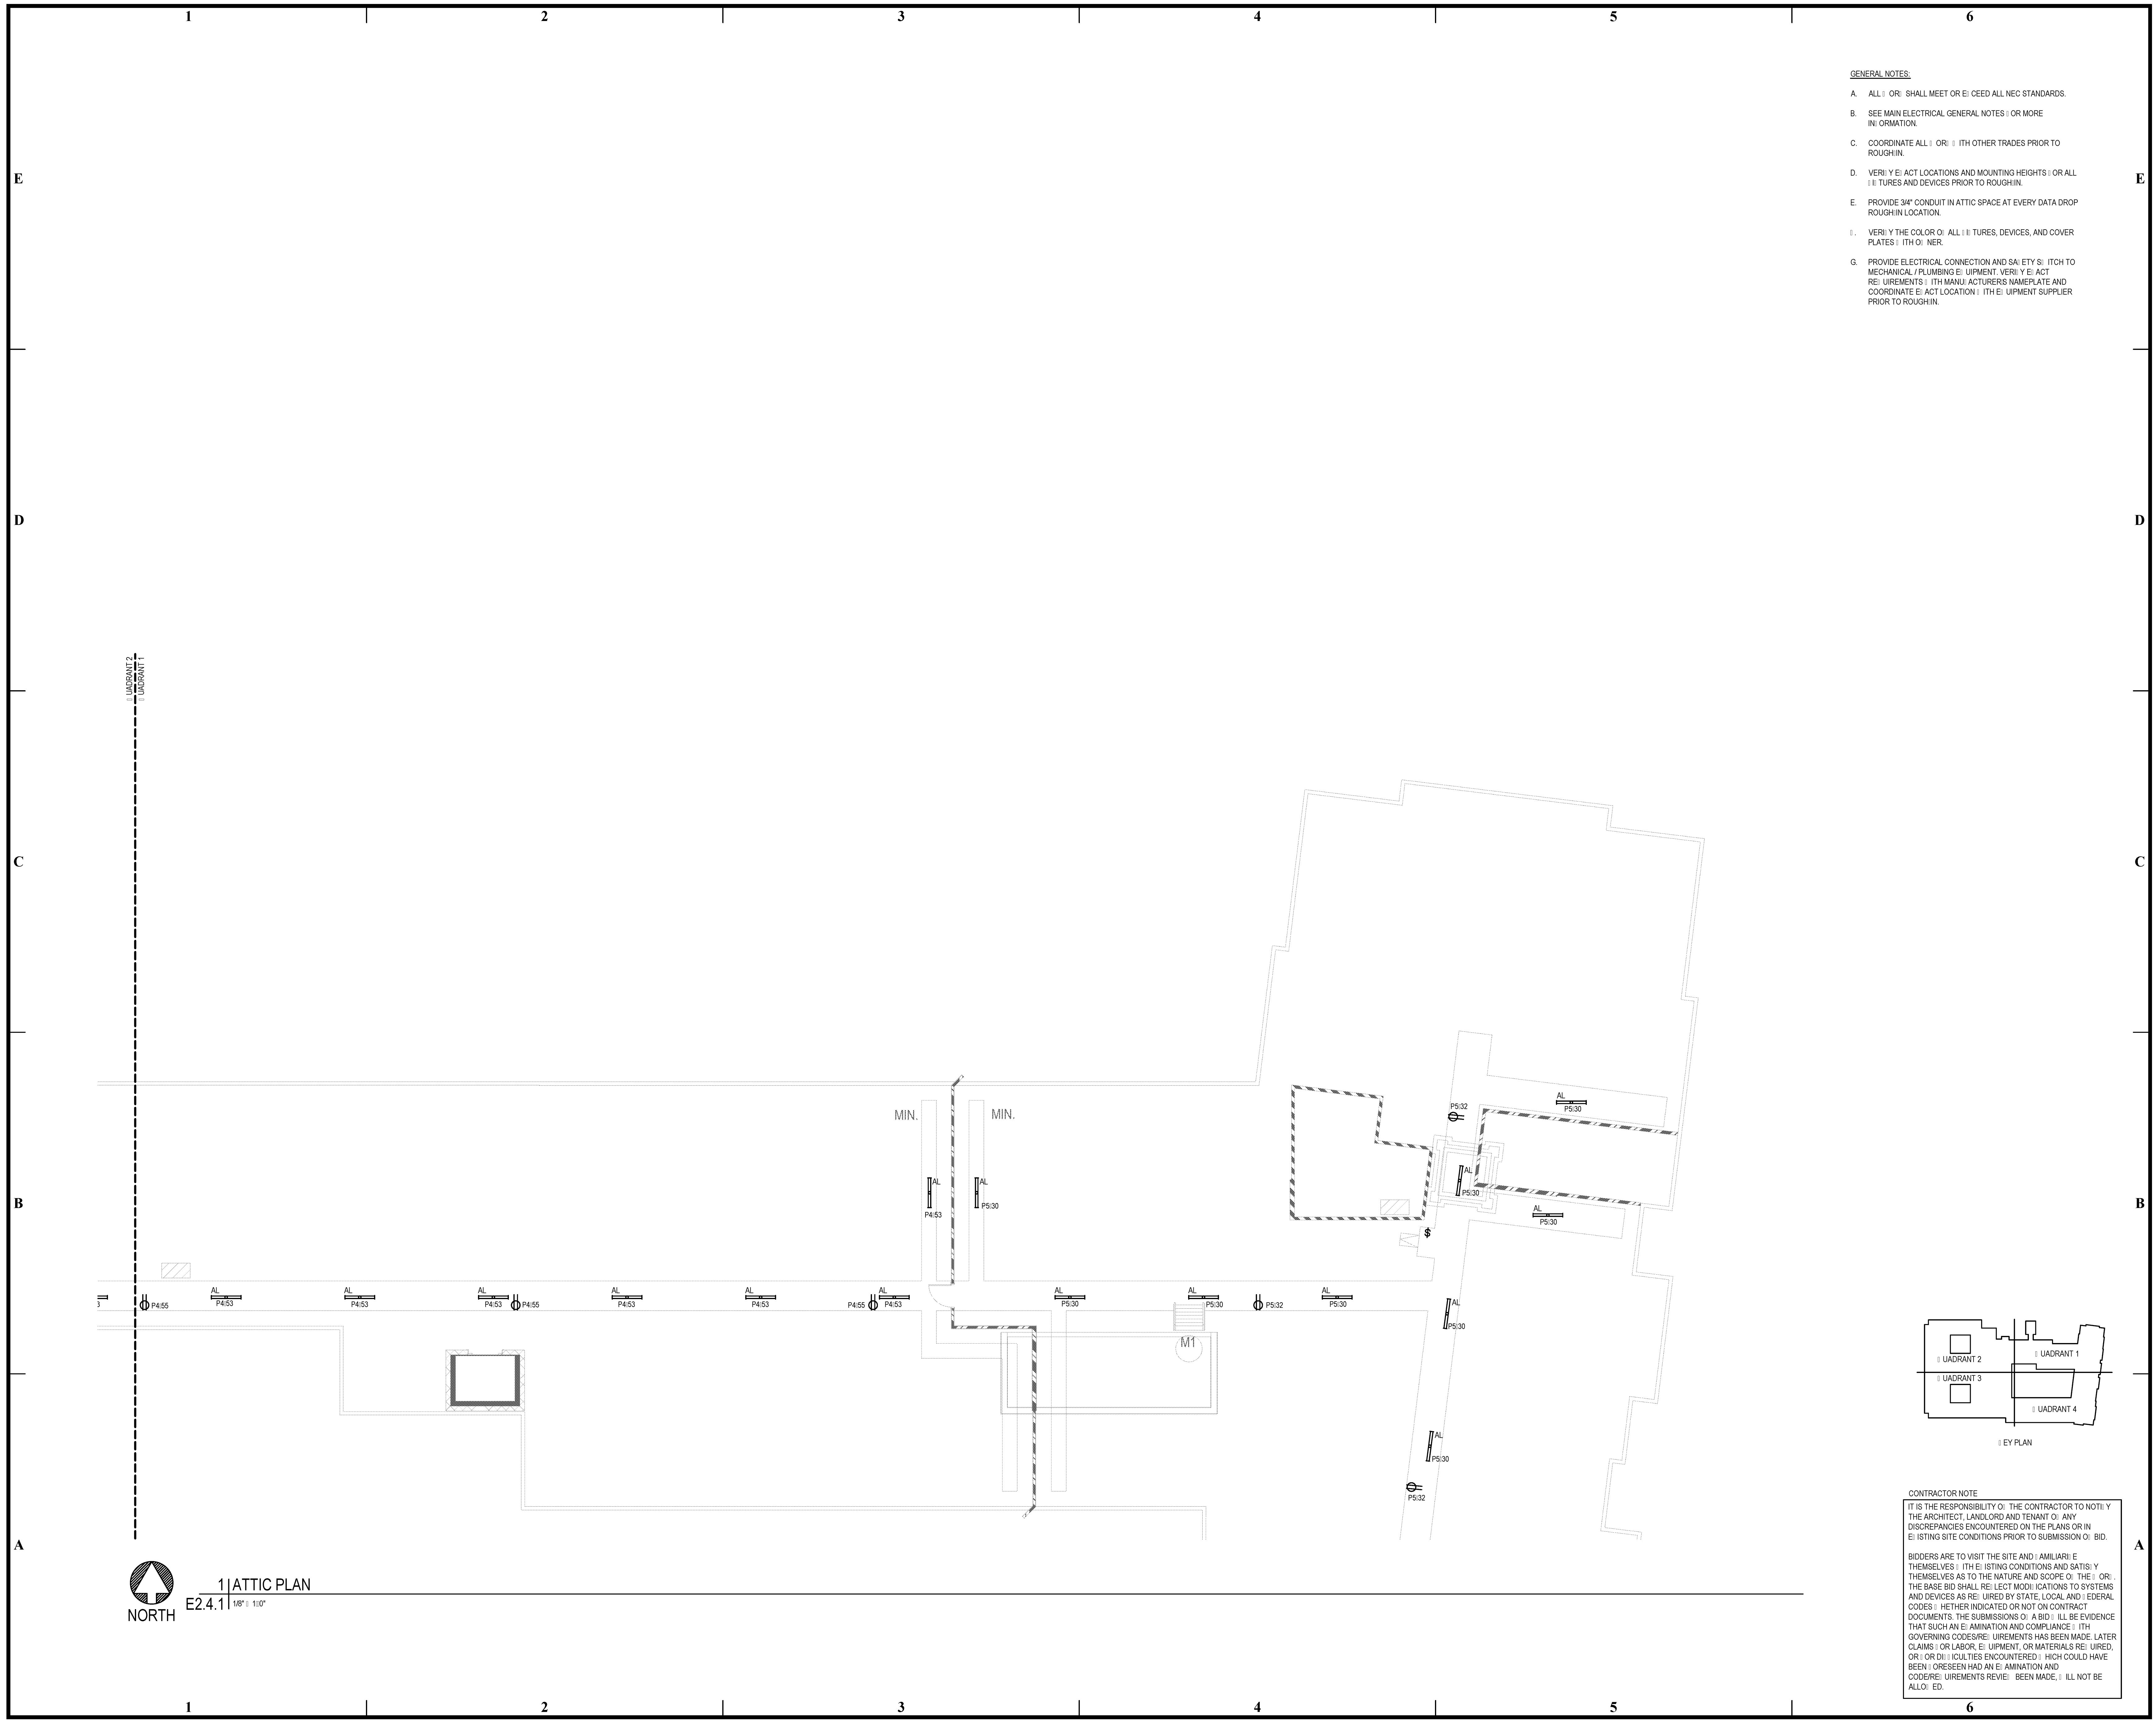

1 | ATTIC PLAN
E2.4.1 | 1/8" = 1'-0"
NORTH


- GENERAL NOTES:
- A. ALL WORK SHALL MEET OR EXCEED ALL NEC STANDARDS.
 - B. SEE MAIN ELECTRICAL GENERAL NOTES FOR MORE INFORMATION.
 - C. COORDINATE ALL WORK WITH OTHER TRADES PRIOR TO ROUGH-IN.
 - D. VERIFY THE ACT LOCATIONS AND MOUNTING HEIGHTS OR ALL DEVICES PRIOR TO ROUGH-IN.
 - E. PROVIDE 3/4" CONDUIT IN ATTIC SPACE AT EVERY DATA DROP ROUGH-IN LOCATION.
 - F. VERIFY THE COLOR OF ALL DEVICES, AND COVER PLATES WITH OWNER.
 - G. PROVIDE ELECTRICAL CONNECTION AND SAFETY SWITCH TO MECHANICAL / PLUMBING EQUIPMENT. VERIFY THE ACT REQUIREMENTS WITH MANUFACTURER'S NAMEPLATE AND COORDINATE THE ACT LOCATION WITH THE EQUIPMENT SUPPLIER PRIOR TO ROUGH-IN.

pi architects
3500 Jefferson St. Suite 303
Austin, TX 78731
P: (512) 231-1910
F: (512) 231-1950
www.piarch.com

architecture + master interior + landscape architecture

PE Services
ENGINEERS FOR THE SOUTH
1-800-397-6600
www.pe-services.com


These plans have been properly examined by the undersigned. I have determined that they comply with existing local Louisiana codes, and have been properly site adapted to use in this area.

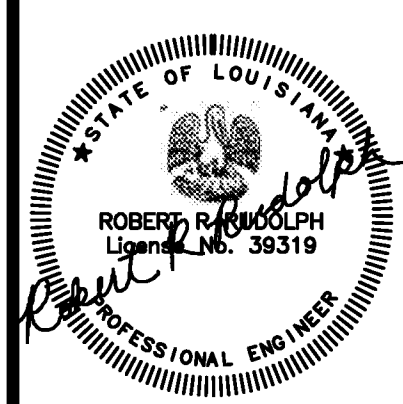

WATERSTONE AT BATON ROUGE ASSISTED LIVING & MEMORY CARE
SIEGEN LANE
BATON ROUGE, LA 70810

ISSUE: PERMIT SET

©2015 PI ARCHITECTS, INC.
REVISIONS:

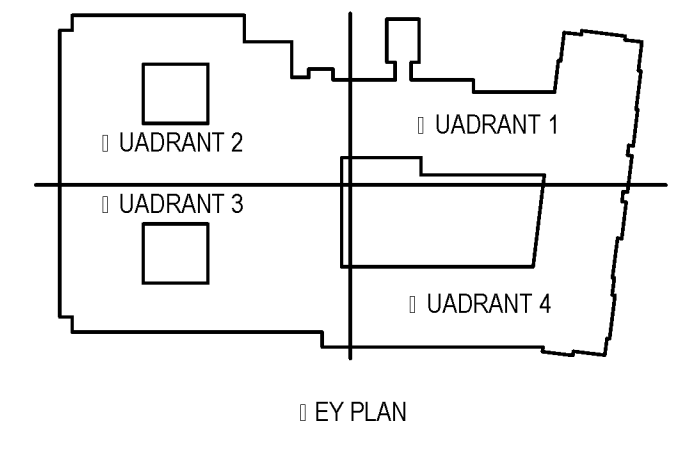

CONTRACTOR NOTE

IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO NOTIFY THE ARCHITECT, LANDLORD AND TENANT OF ANY DISCREPANCIES ENCOUNTERED ON THE PLANS OR IN EXISTING SITE CONDITIONS PRIOR TO SUBMISSION OF BID.

BIDDERS ARE TO VISIT THE SITE AND FAMILIARIZE THEMSELVES WITH EXISTING CONDITIONS AND SATISFY THEMSELVES AS TO THE NATURE AND SCOPE OF THE WORK. THE BASE BID SHALL REFLECT MODIFICATIONS TO SYSTEMS AND DEVICES AS REQUIRED BY STATE, LOCAL AND FEDERAL CODES. WHETHER INDICATED OR NOT ON CONTRACT DOCUMENTS. THE SUBMISSION OF A BID WILL BE EVIDENCE THAT SUCH AN EXAMINATION AND COMPLIANCE WITH GOVERNING CODES/REGULATIONS HAS BEEN MADE. LATER CLAIMS FOR LABOR, EQUIPMENT, OR MATERIALS REQUIRED, OR OMISSIONS ENCOUNTERED WHICH COULD HAVE BEEN OBSERVED HAD AN EXAMINATION AND CODES/REGULATIONS REVIEW BEEN MADE, WILL NOT BE ALLOWED.

DATE: 03/31/2016
PROJECT NUMBER: PES 15090
SHEET TITLE:

ATTIC PLAN

SHEET: **E2.4.1**