




1 | POLE BASE DETAIL - PARALLEL LOT  
E5.3 | NTS

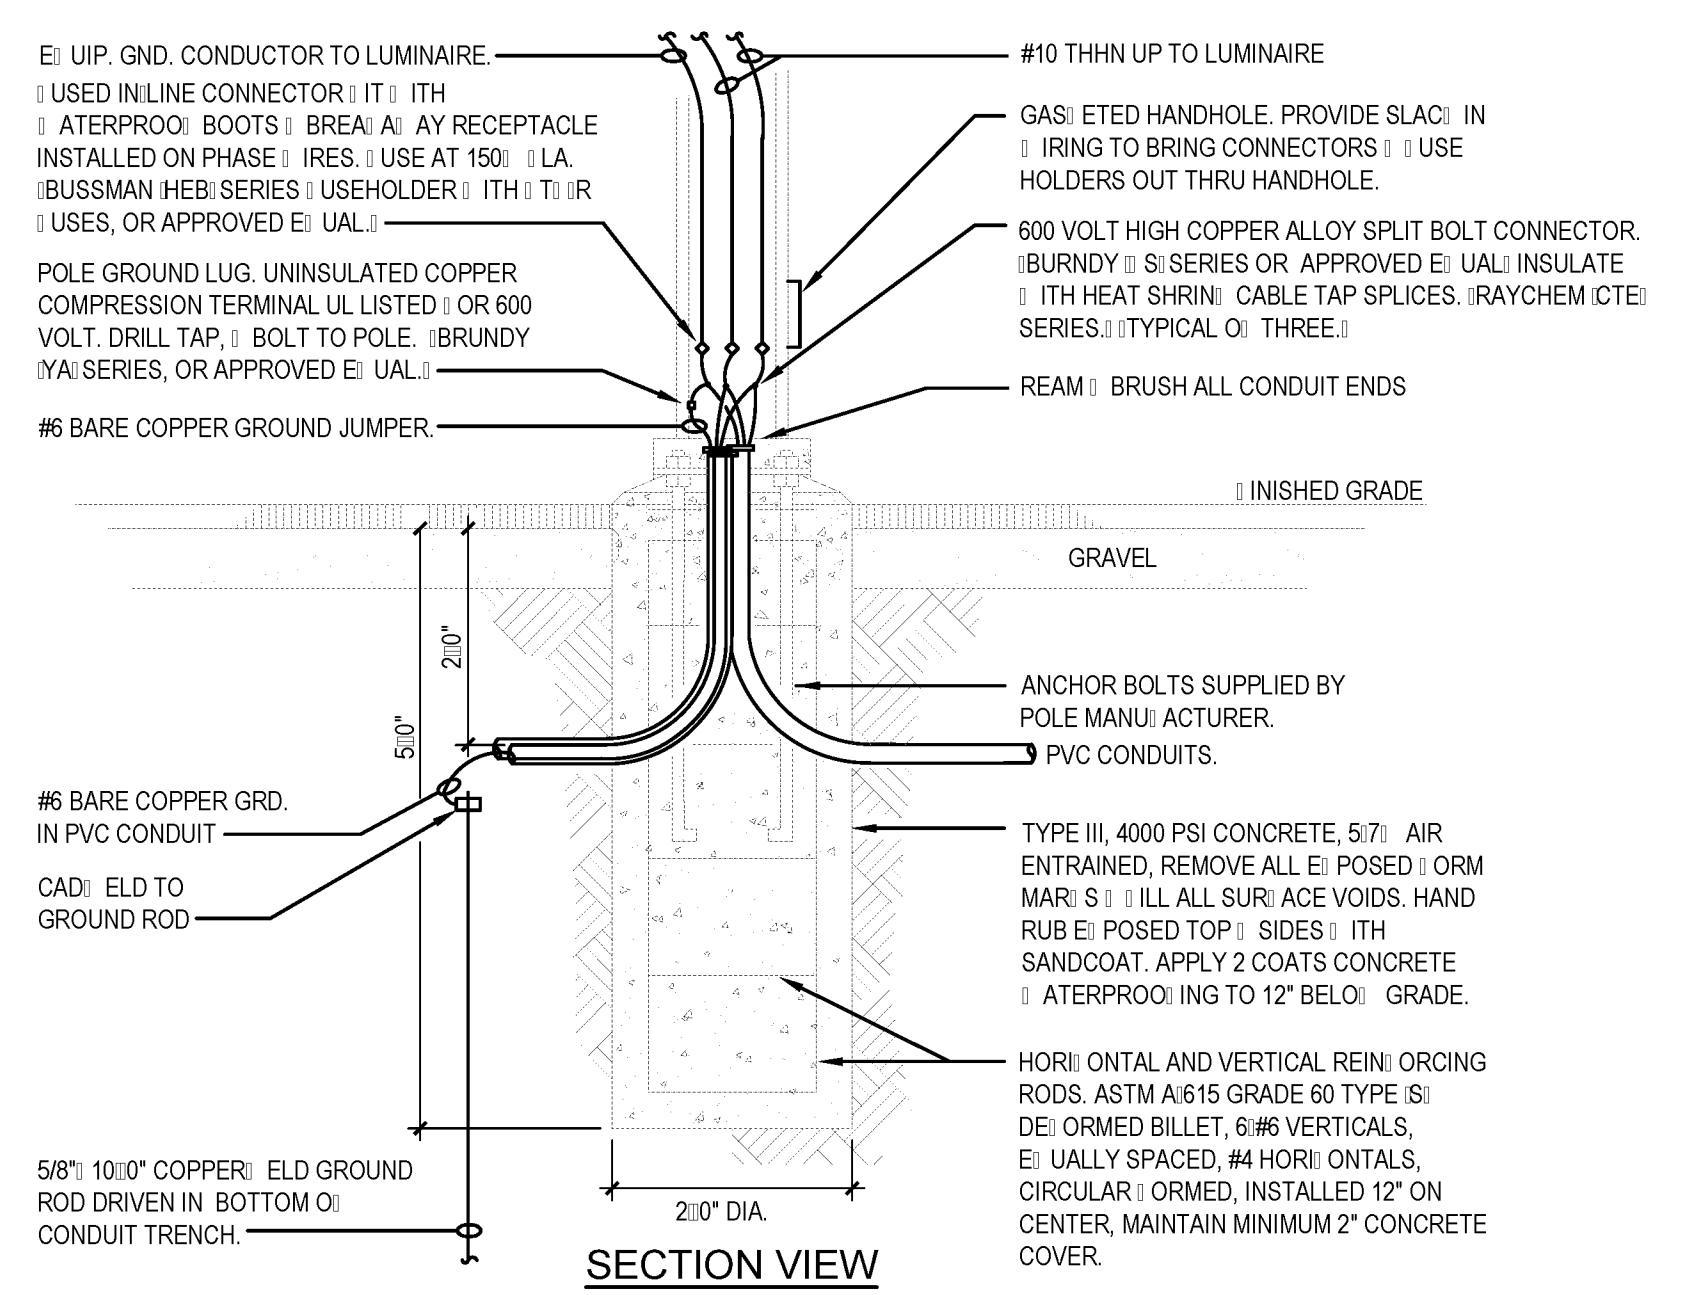


2 | POLE BASE DETAIL - SIDE AL  
E5.3 | NTS

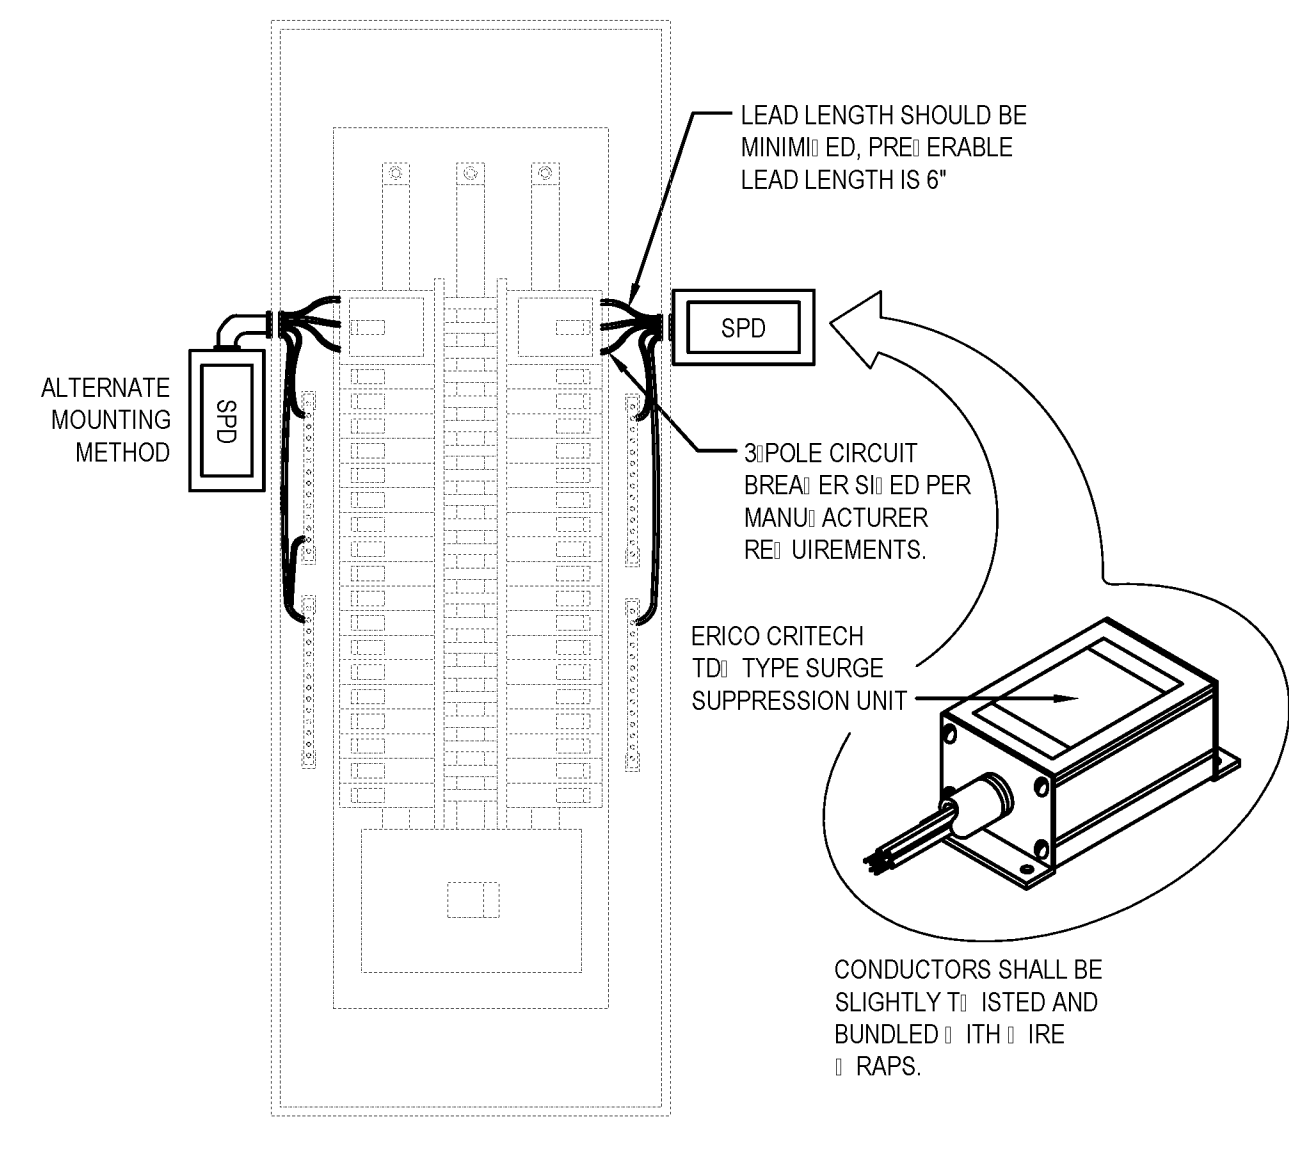


3 | SPD INSTALLATION DETAIL  
E5.3 | NTS

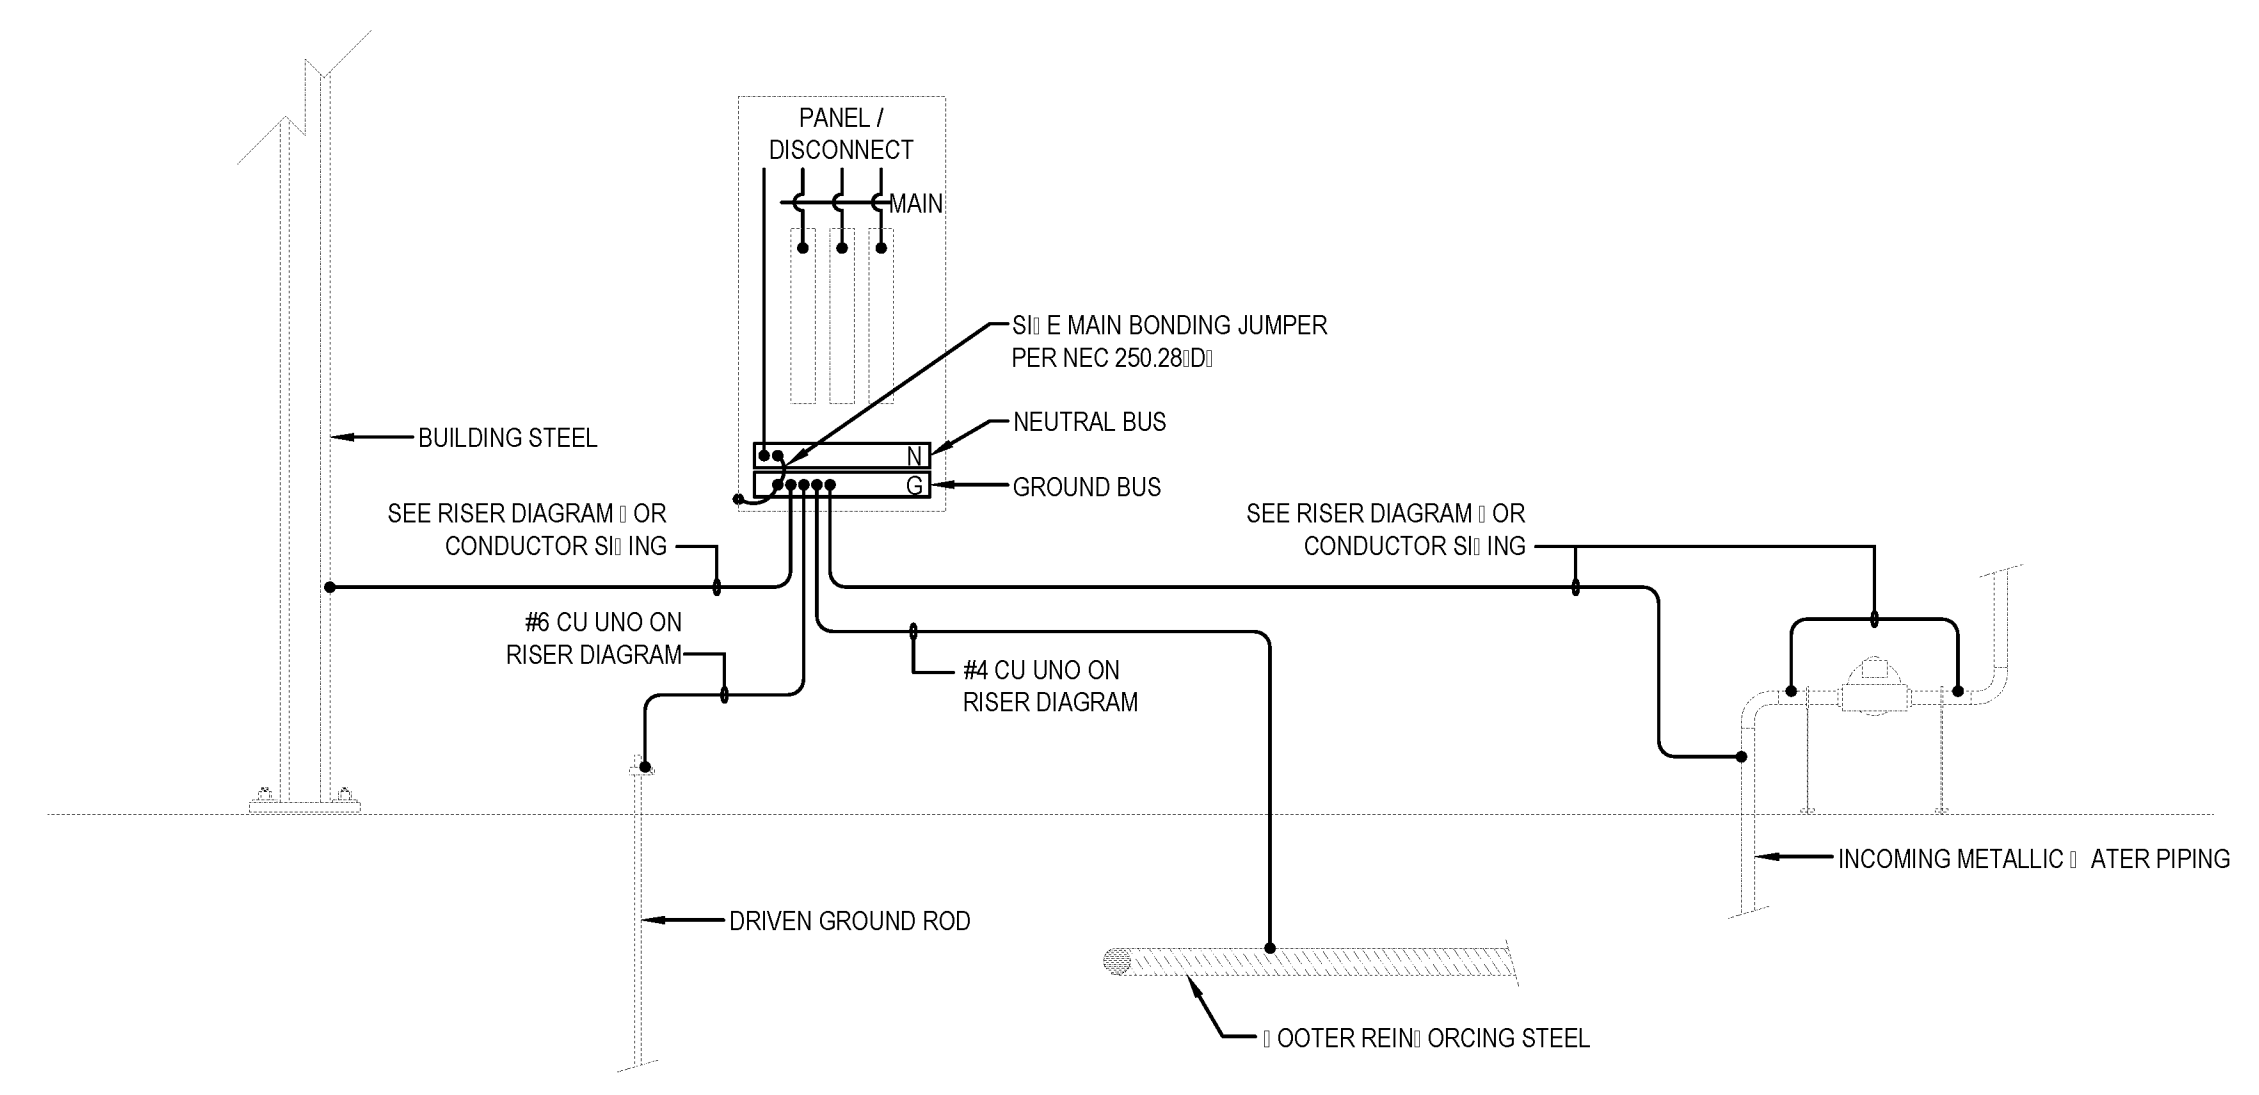

4 | GROUNDING ELECTRODE SYSTEM AT SERVICE MAIN DETAIL  
E5.3 | NTS

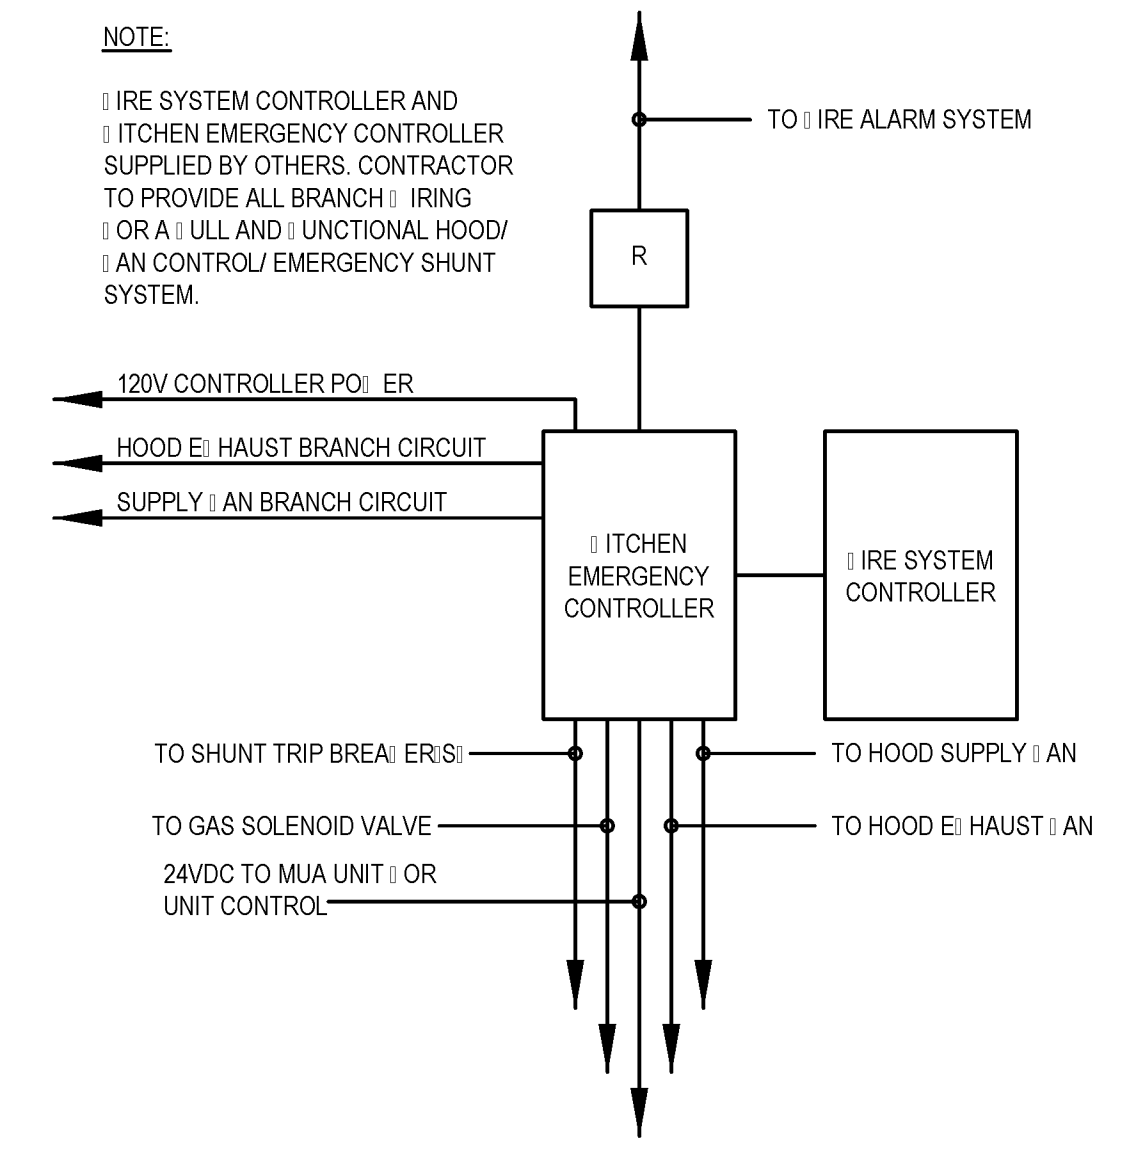

5 | KITCHEN CONTROLLER DETAIL  
E5.3 | NTS

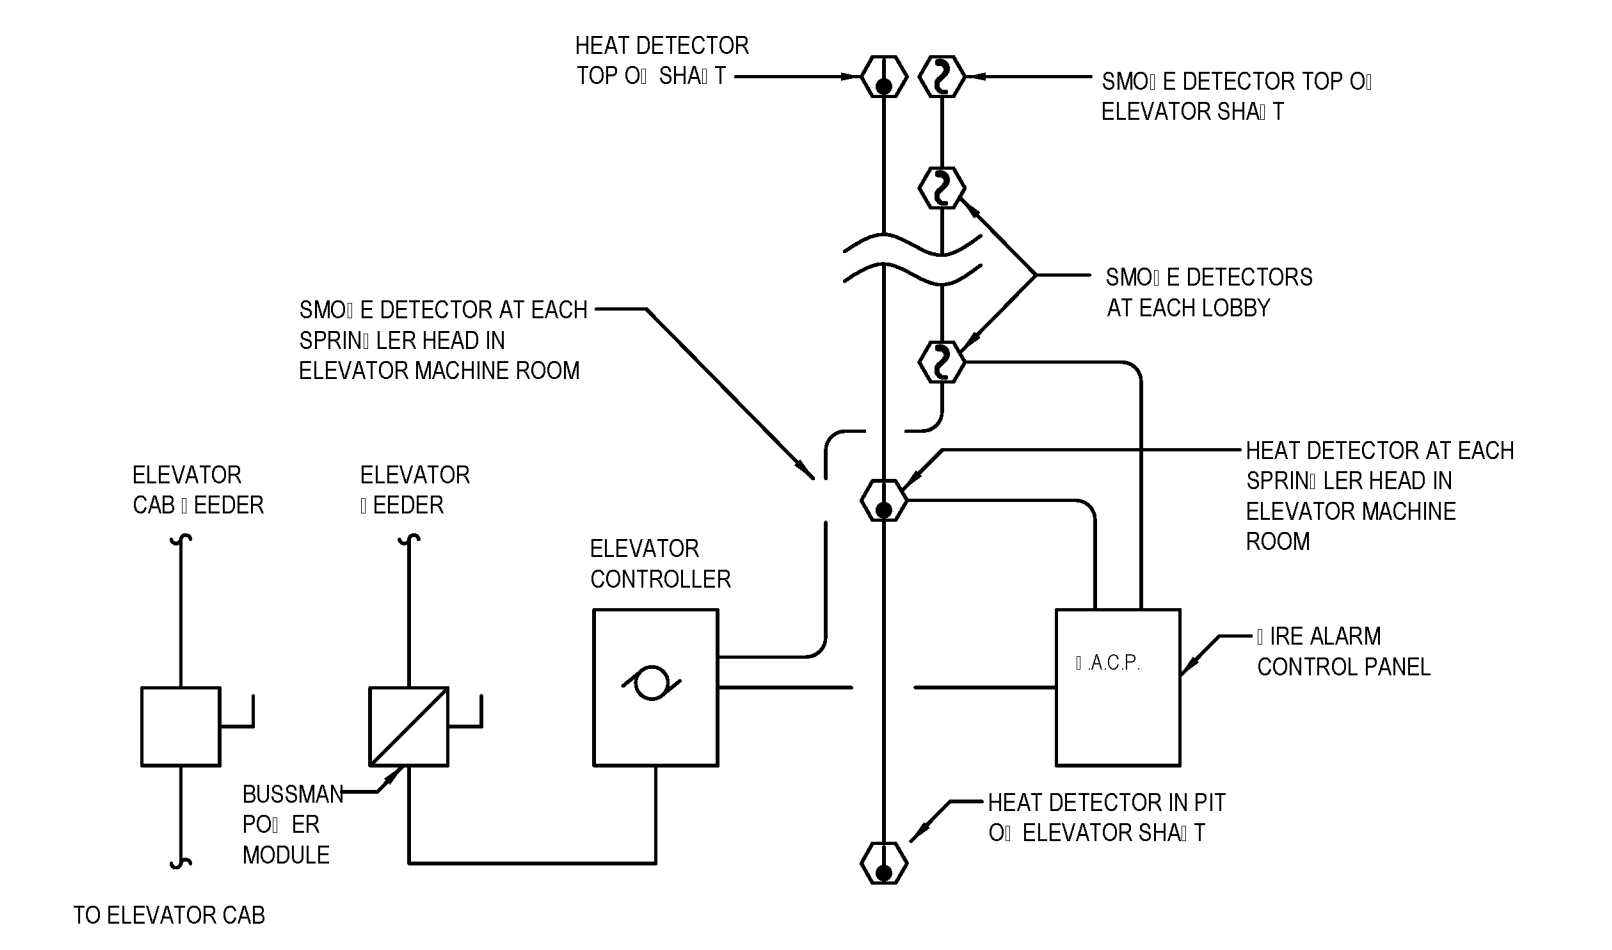

- NOTES:
1. WIRING IS TYPICAL FOR EACH ELEVATOR.
  2. COORDINATE OPERATION OF ELEVATOR WITH AUTHORITY HAVING JURISDICTION OR USE AS A MEANS OF EGRESS.
  3. EACH SMO DETECTOR SHALL HAVE A CONTACT CONNECTED TO EACH ELEVATOR CONTROLLER IN THE BANK OF ELEVATORS.
  4. HEAT DETECTORS SHALL HAVE AUXILIARY CONTACT TO SHUNT TRIP ELEVATOR CONTROLLER POWER UPON ACTIVATION.

6 | ELEVATOR CONTROL SCHEMATIC  
E5.3 | NTS

CONTRACTOR NOTE

IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO NOTIFY THE ARCHITECT, LANDLORD AND TENANT OF ANY DISCREPANCIES ENCOUNTERED ON THE PLANS OR IN THE EXISTING SITE CONDITIONS PRIOR TO SUBMISSION OF BID.

BIDDERS ARE TO VISIT THE SITE AND FAMILIARIZE THEMSELVES WITH THE EXISTING CONDITIONS AND SATISFY THEMSELVES AS TO THE NATURE AND SCOPE OF THE WORK. THE BASE BID SHALL REFLECT MODIFICATIONS TO SYSTEMS AND DEVICES AS REQUIRED BY STATE, LOCAL AND FEDERAL CODES, WHETHER INDICATED OR NOT ON CONTRACT DOCUMENTS. THE SUBMISSIONS OF A BID WILL BE EVIDENCE THAT SUCH AN EXAMINATION AND COMPLIANCE WITH GOVERNING CODES/REGULATIONS HAS BEEN MADE. LATER CLAIMS OF LABOR, EQUIPMENT, OR MATERIALS REQUIRED, OR UNEXPECTED DIFFICULTIES ENCOUNTERED WHICH COULD HAVE BEEN FORESEEN HAD AN EXAMINATION AND CODE/REGULATIONS REVIEW BEEN MADE, WILL NOT BE ALLOWED.

BIM Server: Server2012 - BIM Server (18/01/14017 Concordia Baton Rouge) [Ver: 18.001] Wednesday, September 02, 2015 14:04 PM