

NEW ORLEANS PELICANS CAMPUS IMPROVEMENTS

METAIRIE, LOUISIANA




woodward design group
1000 S. NORMAN C. FRANCIS PARKWAY
NEW ORLEANS, LA 70125
WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA

Metairie, Louisiana

WDG PROJECT NO | AR2315



no.	descripton	date
	accoptom	dati
_		
_		
_		
_		
_		
_		
_		
_		
_		
_		
-		
-		
-		
-		
_		

TITLE SHEET

RAWN BY I WDG GO.00

DRAWING	PINDEY			
Sheet No	Sheet Name	Revision No.	Date	Description
GENERAL	Sheet name	Revision No.	Date	Description
G0.00	TITLE SHEET			
G0.01 G0.02	PROJECT INFO PROJECT INFO			
G0.03	CAMPUS DEVELOPMENT PLAN			
G0.04 G1.00	ADAAG DETAILS LIFE SAFETY AND CODE INFORMATION			
G1.01	FIRST FLOOR LIFE SAFETY PLAN			
G1.02 DEMOLITION	SECOND FLOOR LIFESAFETY PLAN			
D1.00	FLOOR 1 DEMOLITION PLAN			
D1.01 D1.02	DEMO PLAN DEMO PLAN			
D1.03	DEMO PLAN			
D1.04 D2.00	DEMO PLAN DEMO EXTERIOR ELEVATIONS			
D7.00	OVERALL DEMO RCP			
D7.01	DEMO RCP			
D7.02 D7.03	DEMO RCP DEMO RCP			
ARCHITECTURE			I	I
A0.01 A0.02	ARCHITECTRUAL SITE PLAN SITE DETAILS			
A1.00	OVERALL PLAN			
A1.01 A1.02	FLOOR PLANS FLOOR PLANS			
A1.03	FLOOR PLANS			
A1.04 A1.05	FLOOR PLANS FLOOR PLANS			
A1.06	FLOOR PLANS			
A1.07 A1.08	FLOOR PLANS WEIGHT ROOM EQUIPMENT PLAN			
A1.30	ROOF PLAN			
A2.00	EXTERIOR ELEVATIONS			
A2.01 A3.00	EXTERIOR ELEVATIONS BUILDING SECTIONS			
A3.01	BUILDING SECTIONS			
A3.10 A3.11	WALL SECTIONS WALL SECTIONS			
A4.00	VERTICAL CIRCULATION			
A4.01 A5.00	VERTICAL CIRCULATION SECTION DETAILS			
A5.00 A5.01	SECTION DETAILS SECTION DETAILS			
A6.00	PARTITION TYPES			
A6.20 A6.21	DOOR SCHEDULE DOOR DETAILS			
A6.30	WINDOW SCHEDULE			
A6.31 A6.50	WINDOW DETAILS FINISH SCHEDULE			
A6.51	FINISH KEY PLAN			
A6.52 A6.53	FINISH FLOOR PLANS FINISH FLOOR PLANS			
A6.54	FINISH FLOOR PLANS			
A6.55	FINISH FLOOR PLANS			
A6.56 A6.57	FINISH FLOOR PLANS FINISH FLOOR PLANS			
A7.00	REFLECTED CEILING KEY PLAN			
A7.01 A7.02	ENLARGED REFLECTED CEILING PLANS ENLARGED REFLECTED CEILING PLANS			
A7.03	ENLARGED REFLECTED CEILING PLANS			
A7.04 A7.05	ENLARGED REFLECTED CEILING PLANS ENLARGED REFLECTED CEILING PLANS			
A7.06	ENLARGED REFLECTED CEILING PLANS			
A8.01 A8.02	INTERIOR ELEVATIONS & DETAILS			
A8.02 A8.03	INTERIOR ELEVATIONS & DETAILS INTERIOR ELEVATIONS & DETAILS			
A8.04	INTERIOR ELEVATIONS & DETAILS			
A8.05 A8.06	INTERIOR ELEVATIONS & DETAILS INTERIOR ELEVATIONS & DETAILS			
A8.07	INTERIOR ELEVATIONS & DETAILS			
A8.08 A8.09	INTERIOR ELEVATIONS & DETAILS INTERIOR ELEVATIONS & DETAILS			
A8.20	MILLWORK SECTIONS & DETAILS			
A8.21 A8.22	MILLWORK SECTIONS & DETAILS MILLWORK SECTIONS & DETAILS			
A8.23	MILLWORK SECTIONS & DETAILS MILLWORK SECTIONS & DETAILS			
STRUCTURE	OFNIFDAL NOTES			
\$0.00 \$1.00	GENERAL NOTES OVERALL PLAN			
S1.01	FOUNDATION AND FRAMING PLAN			
\$1.02 \$1.03	FOUNDATION AT OUTDOOR TRAINING AREA FRAMING PLAN AREA B			
S1.04	ROOF PLAN AT CAFETERIA MECHANICAL EQUIPMENT			
\$1.05 \$2.00	OUTDOOR PAVER AREA FOUNDATION DETAILS & SECTIONS			
S3.00	TYPICAL STEEL FRAMING DETAILS			
S3.01 S4.01	TYPICAL NOTES AND DETAILS ENLARGED PLANS, SECTIONS AND DETAILS			
S4.02	ENLARGED PLANS, SECTIONS AND DETAILS			
S5.00	TYPICAL COLD-FORMED FRAMING DETAILS			
S6.00 MECHANICAL	TYPICAL CONCRETE MASONRY DETAILS			
M0.00	MECHANICAL SPECS			
M0.01 M0.02	HVAC SYMBOLOGY, SCHEDULES, NOTES & DETAILS HVAC - HOOD SECTIONS, DETAILS, & IOS'S			
M1.00	OVERALL PLAN - HVAC			
M1.01 M1.02	ROOF PLAN - HVAC EQUIPMENT FLOOR PLANS - HVAC CONFERENCE ROOM AND VIEWING AREA			
M1.02 M1.03	FLOOR PLANS - HVAC NUTRITION AND RECOVERY			
M1.04 M1.05	FLOOR PLANS - HVAC PLAYERS CAFÉ AND DINING AREA FLOOR PLANS - HVAC COACHES' LOCKER ROOM			
M1.05 M1.06	FLOOR PLANS - HVAC COACHES' LOCKER ROOM FLOOR PLANS - HVAC PLAYERS' RESTROOM			
M2.01	BUILDING SECTIONS - CONFERENCE ROOM AND VIEWING AREA			
ELECTRICAL E0.00	ELECTRICAL SCHEDULES			
E0.01	ELECTRICAL SPECIFICATIONS			
E0.02 E1.00	LIGHTING FIXTURE SCHEDULE OVERALL ELECTRICAL PLAN			
E1.01	ELECTRICAL FIRST FLOOR PLAN			
E1.02 E1.03	ELECTRICAL MEZZANINE PLAN			
E1.03 E1.04	ELECTRICAL PLAYERS BATHROOM PLAN ELECTRICAL PLAYER CAFÉ AND DINING ROOM			
E1.05	ELECTRICAL TRAINING PLAN			
E1.06 E1.07	COACHES LOCKER ROOM ELECTRICAL PLAN ELECTRICAL ROOF PLAN			
E2.01	ELECTRICAL ONE LINE AND PANEL SCHEDULES			
ED1.01	ELECTRICAL DEMO PLAN			


PLUMBING		
P0.00	PLUMBING SPECS	
P0.01	PLUMBING SCHEDULES	
P0.02	PLUMBING DETAILS	
P1.00	OVERALL PLAN - UNDERGROUND PLUMBING	
P1.01	OVERALL PLAN - ABOVEGROUND PLUMBING	
P1.02	FLOOR PLANS - PLUMBING CONFERENCE ROOM	
P1.03	FLOOR PLANS - PLUMBING NUTRITION AND RECOVERY - UNDERGROUND	
P1.04	FLOOR PLANS - PLUMBING NUTRITION AND RECOVERY - ABOVEGROUND	
P1.05	PLUMBING ISO - NUTRITION AND RECOVERY	
P1.06	FLOOR PLANS - PLUMBING PLAYERS CAFÉ UNDERGROUND	
P1.07	FLOOR PLANS - PLUMBING PLAYERS CAFÉ ABOVEGROUND	
P1.08	PLUMBING ISO - PLAYERS CAFÉ	
P1.09	FLOOR PLANS - PLUMBING - PLAYERS TOILETS	
FOOD SER	VICE	
FS-1	FOOD EQUIPMENT FLOOR PLAN	
FS-2	FOOD EQUIPMENT ELEVATIONS	
FS-3	FOOD SERVICE PLUMBING FLOOR PLAN	
FS-4	FOOD SERVICE ELECTRICAL FLOOR PLAN	
FS-5	FOOD SERVICE SPECIAL CONDITIONS F.P.	
FS-6	PMG SUBMITTAL COVER PAGE	
FS-7	PLAN, ELEVATION, ISO - SNEEZE GUARD	
FS-8	PLAN, ELEVATION, ISO - SNEEZE GUARD	
FS-9	PLAN, ELEVATION, ISO - SNEEZE GUARD	
FS-10	COUNTER LAYOUT - SNEEZE GUARD	
FS-11	UNDER-COUNTER MOUNT - SNEEZE GUARD	
FS-12	ELECTRICAL SCHEMATICS - SNEEZE GUARD	
FS-13	ACCUREX - KH-1	
FS-14	ACCUREX - KEF-1	
FS-15	ACCUREX - KSF-1	
FS-16	ACCUREX - ELEC-1	




PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024



no.	descripton	date

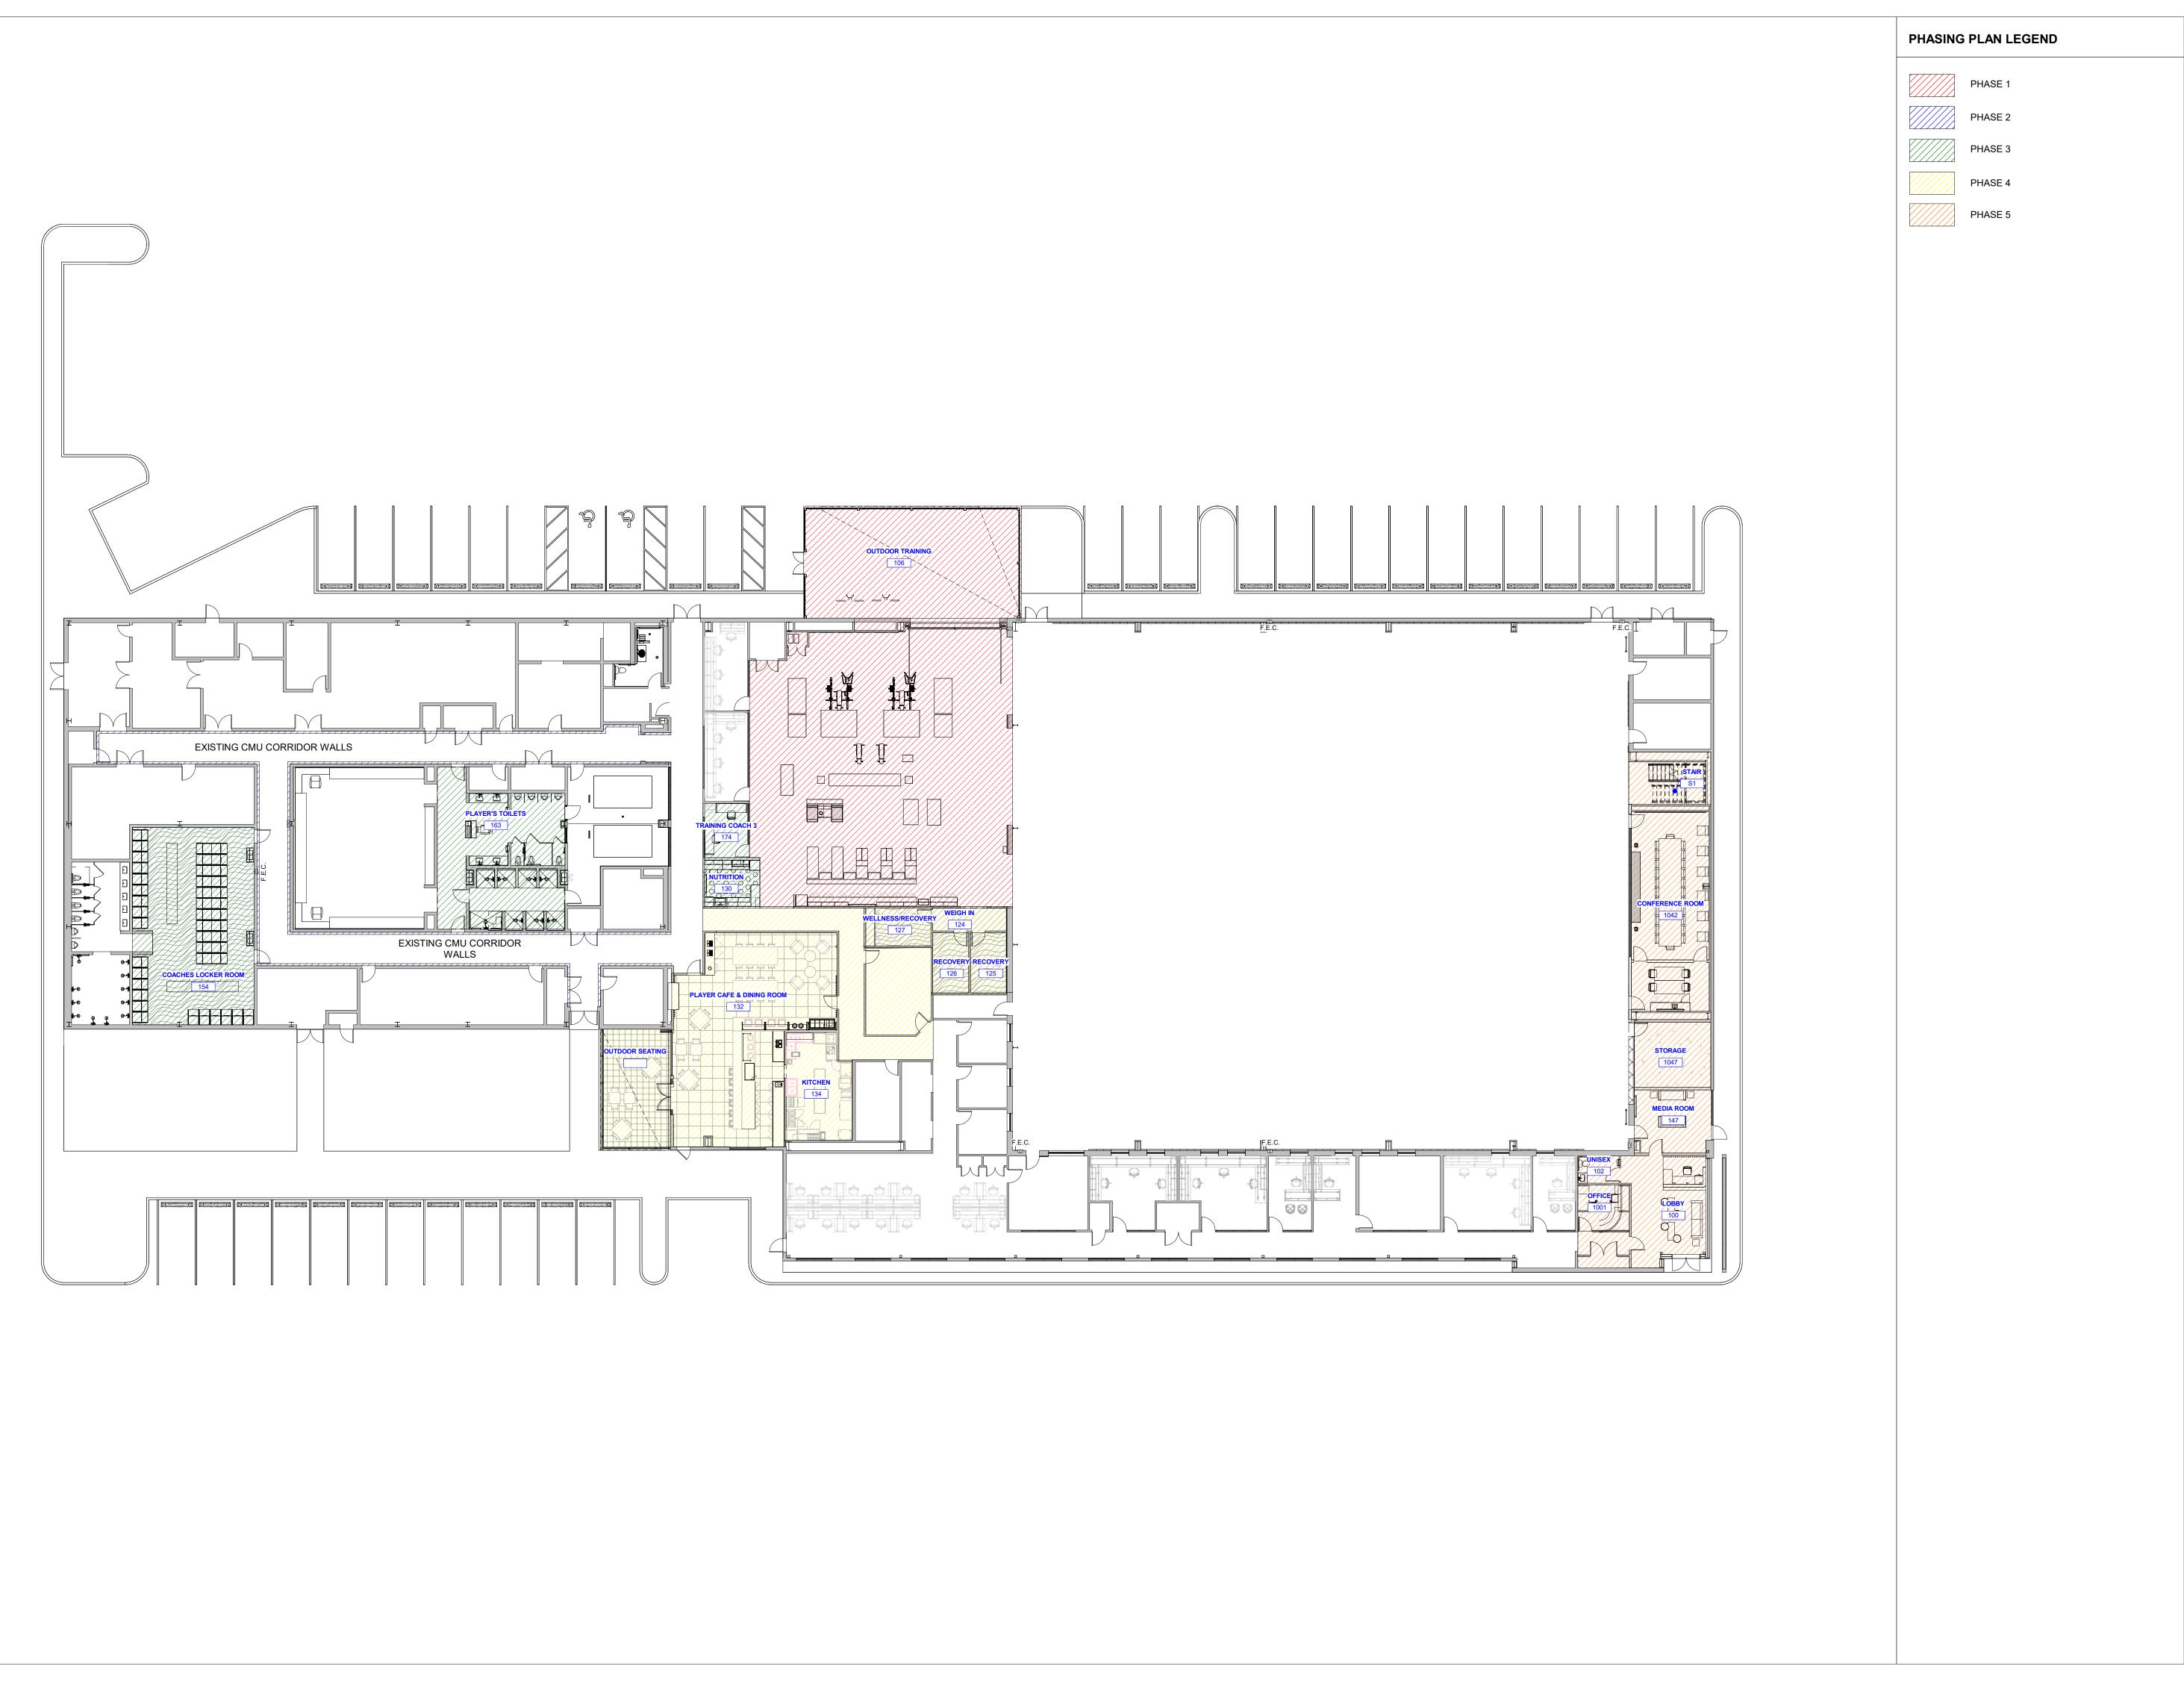


PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024

CAMPUS DEVELOPMENT PLAN

DRAWN BY I WDG G0.03

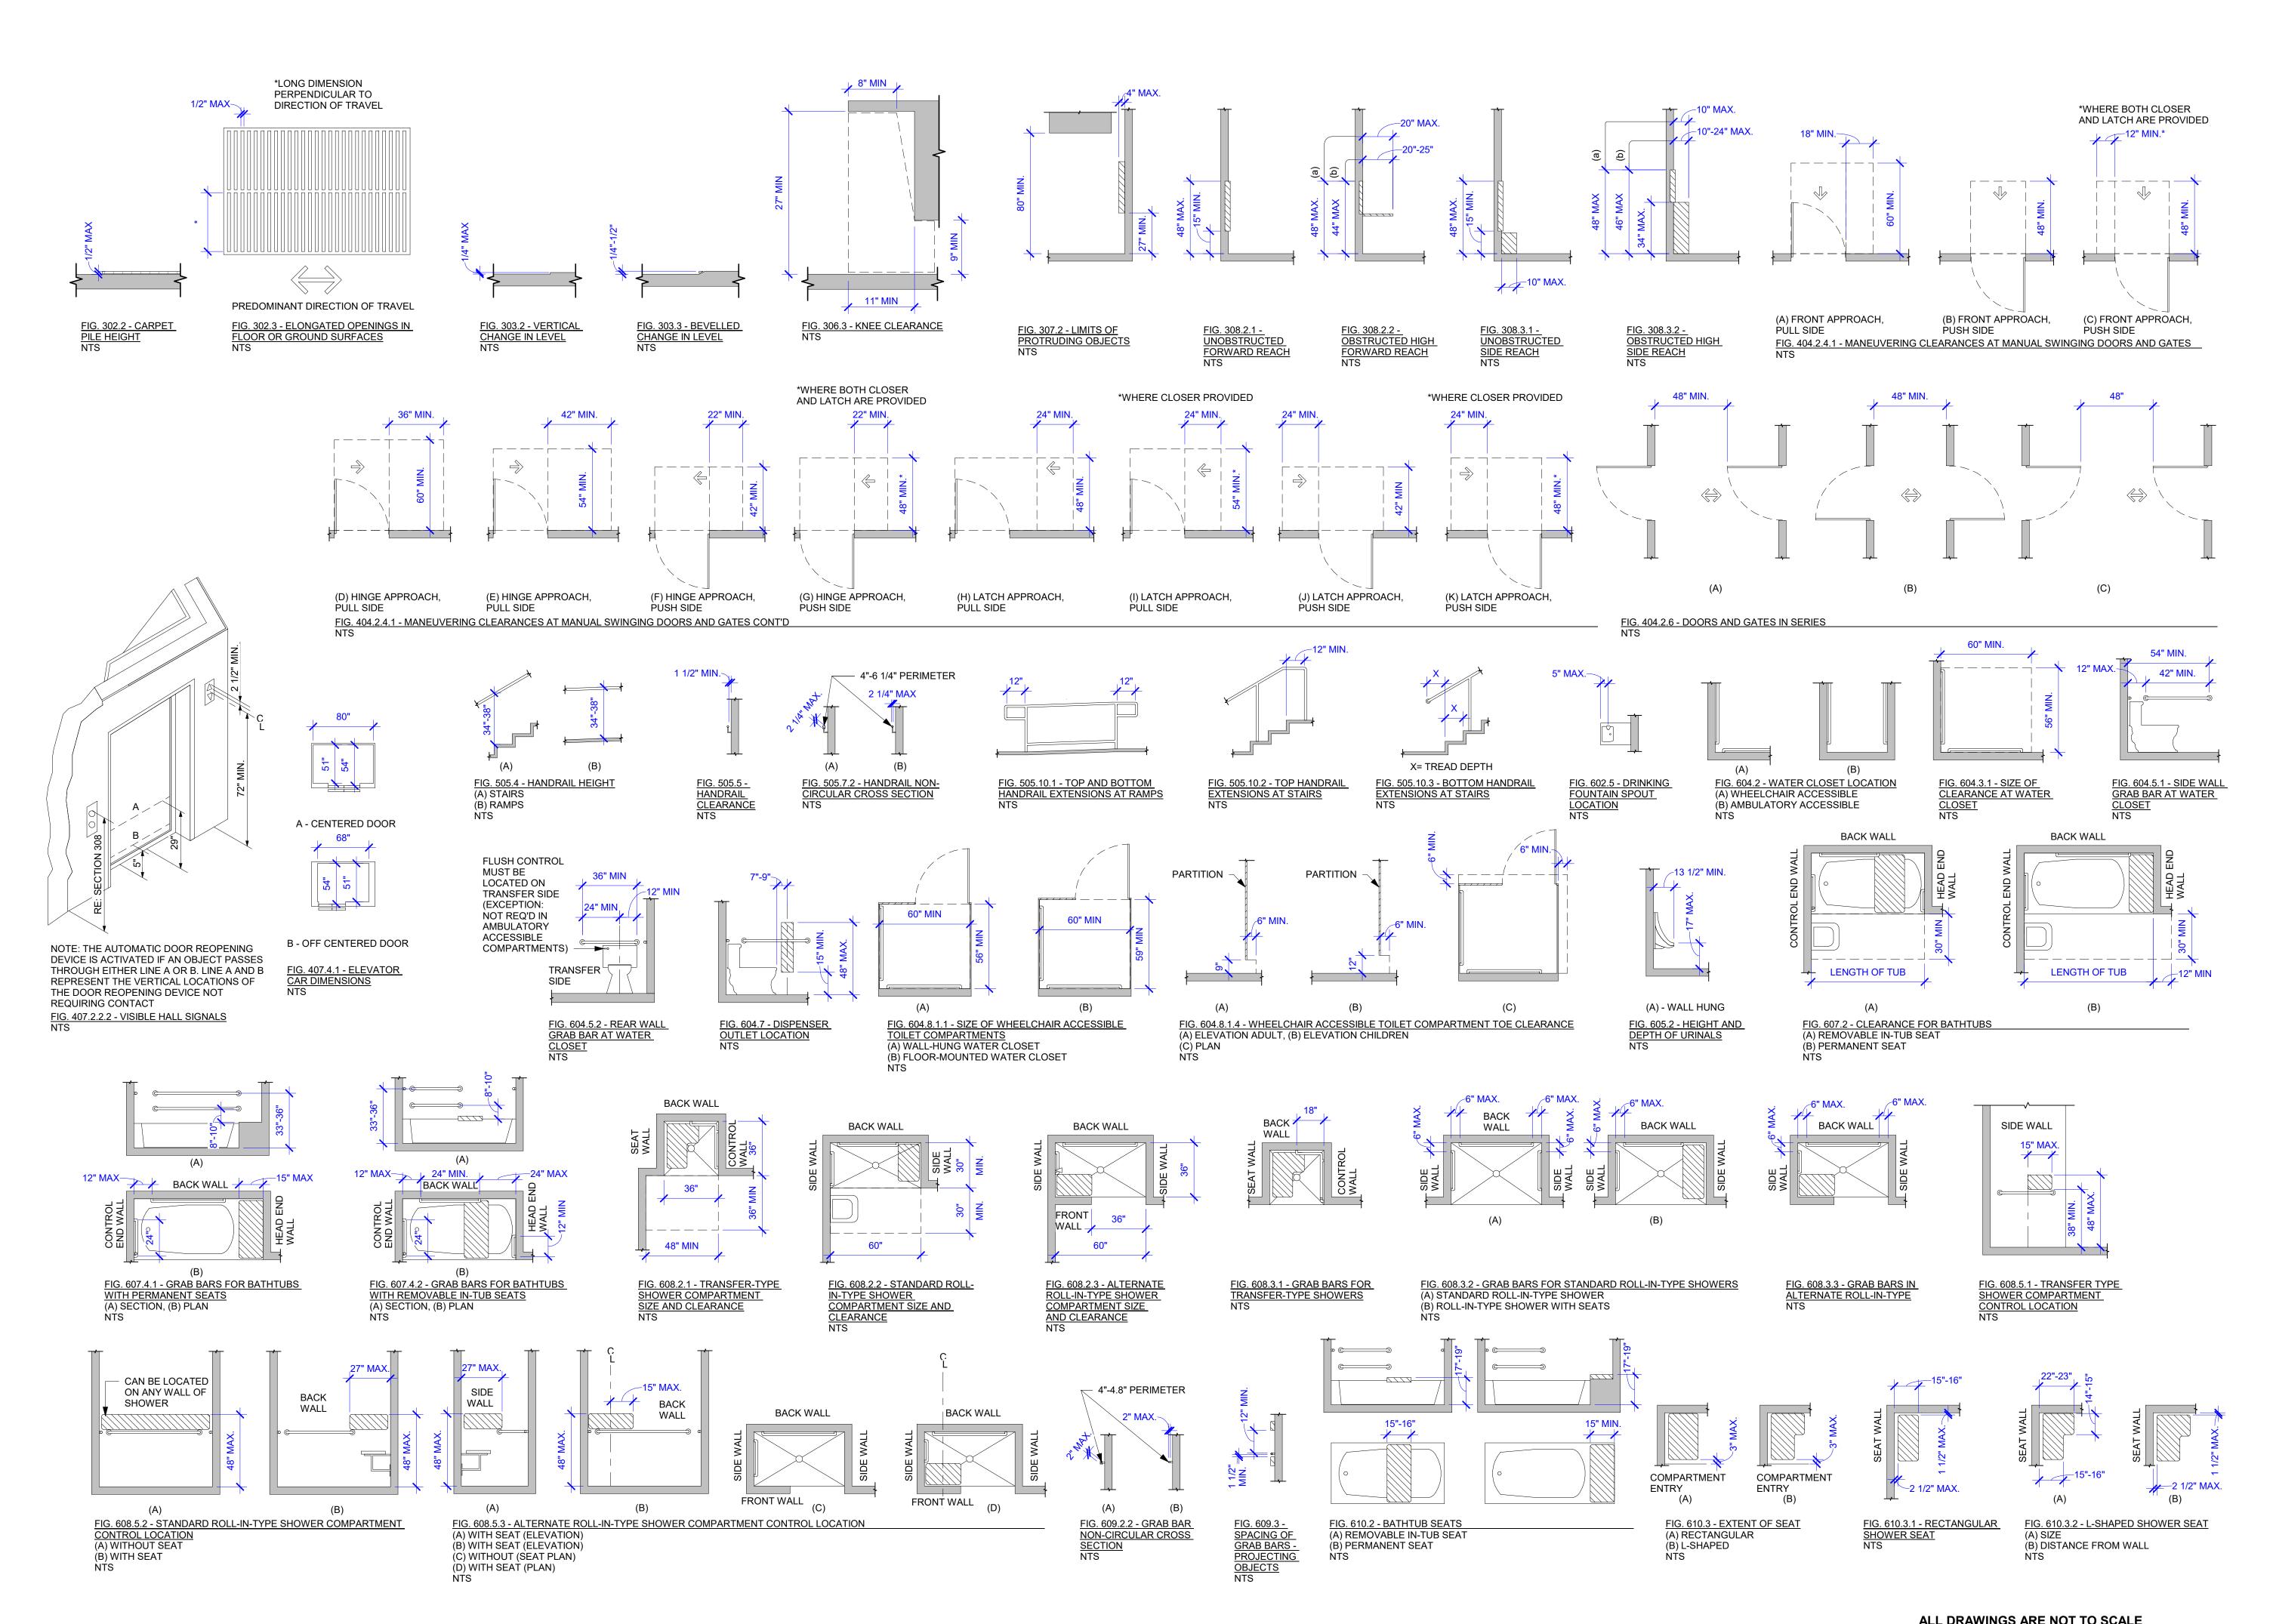

PELICANS CAMPUS IMPROVEMENTS

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024

ADAAG DETAILS

National Fire Protection Act (NFPA) 10 National Fire Protection Act (NFPA) 13 National Fire Protection Act (NFPA) 72

OTHER CODES:

2010 Americans with Disabilites Act (ADAAG)

CONSTRUCTION TYPE AND INFORMATION

Type Of Construction:

New Construction: Type IIB (IBC) / Type II(000) (NFPA) Existing: IIB (IBC) / II(000) (NFPA)

Automatic Fire Suppression:Yes Fire Alarm:Yes High Rise Construction: No Risk Category(1604.5): III Wind Load (IBC 1609): Exposure B Wind Speed (1609B): 153 mph Factory Mutual: No

(IBC 304, NFPA 6.1.11)

Business/Assembly

303.1.2 Small assembly spaces. A room or space used for assembly purposes with an occupant load of leass than 50 persons and accessory to another occupancy shall be classified as a Group B occupancy or as part of that occupancy. A room or space used for assembly purposes that is less than 750 square feet in area and accessory to another occupancy shall be classified as a Group B occupancy or as part of that occupancy.

Hazard of Contents: (NFPA 6.2.2.3)

Ordinary

Project Area:

Allowable Heights and Areas:

Allowable Height Above Grade Plane(IBC 504): 75'/3 Stories 43,500/Story 130,500 total Allowable Area (IBC 506.2): Actual Height: 26'=0" / 1 Story

Actual Building Area:

OCCUPANCY SEPARATIONS

508.3.3 Separation. No separation is required between nonseparated occupancies. **508.4 Separated occupancies.** Buildings or portions of buildings that comply with the provisions of this section shall be considered as separated occupancies.

3,239 SF

45,322 SF

508.4.1 Occupancy classification. Separated occupancies shall be individually classified in accordance with Section 302.1. Each separated space shall comply with this code based on the occupancy classification of that portion of the building. **508.4.2 Allowable building area.** In each story, the building area shall be such that the sum of the ratios of the actual building area of each separated occupancy divided by the allowable building area of each separated occupancy shall not exceed 1. 508.4.3 Allowable height. Each separated occupancy shall comply with the building height limitations based on the type of construction of the building in accordance with Section 503.1.

Exception: Special provisions of Section 510 shall permit occupancies at building heights other than provided in Section

508.4.4 Separation. Individual occupancies shall be separated from adjacent occupancies in accordance with Table 508.4 **508.4.4.1 Construction.** Required separations shall be fire barriers constructed in accordance with Section 707 or horizontal assemblies constructed in accordance with Section 711, or both, so as to completely separate adjacent occupancies.

Table 508.4 Req'd Separation of Occupancies

Business to F-1 0 Hour Rated

Table 509: Incidental Uses: Furnace Room with EQ of 400,000 Btu/HR input

1 HR or Automatic Sprinkler

1 HR or Automatic Sprinkler Rooms with boilers where largest EQ over 15 psi and 10 HP

1 HR or Automatic Sprinkler In Group B occupancies, Labs and vocational shops not classified as Group H

NFPA 14.3.2.1 (1) Such rooms or spaces separated from the remainder of the building by fire barriers having a minimum 1-hour FRR or protected by automatic extinguishing system

<u>Fire Protection Requirements for Type IIB/ II(000)</u> <u>Fire Ratings for Exterior Walls Based on Fire Separation Distance</u>

(a)Boiler and furnace rooms, unless such rooms enclose only air-handling eq. (d)Janitor Closets

(2) Such rooms or spaces separated from the remainder of the building by fire barriers having a minimum 1-hour FRR and protected by automatic extinguishing system (b) Maintenance shops, including woodworking and painting areas

FIRE RATING OF BUILDING ELEMENTS

(IBC 601; NFPA A.8.2.1.2)		(IBC 601; NFP	A A.8.2.1.2)	
Primary Structural Frame	0	FSD=X(FT)	Type	Occ.A, B, E, F-2, I, R,
Exterior Bearing Walls	0	S-2, U		
Interior Bearing Walls	0			
Nonbearing Walls and Partitions-Interior	0	X< 5b	All	1
Floor Construction & Secondary Members	0	5≤ X< 10	IA	1
Roof Construction & Secondary Members	0		Others	1
•		10≤ X< 30	IA, IB,	1°
Exterior Bearing Walls	0		IIB, VB	0
Interior Bearing Walls	0		Others	1 ^c
Coumns	0	X ≥30	All	0
Beams, Girders, Trusses & Arches	0			
Floor-Ceiling Assemblies	0			
Roof-Ceiling Assemblies	0	Max Area of E	xt. Wall Openings Ba	ased on Fire Separation Distance
Interior Nonbearing Walls	0	and Degree of		
Exterior Nonbearing Walls	0	(IBC 705.8)		
Fire Protection Requirements for Type IIIB/	III(200)	FSD	DoP	Allowable Area (%)
(IBC 601; NFPA A.8.2.1.2)				
		0 - <3	UP, NS	NP
Primary Structural Frame	0		UP, S	NP
Exterior Bearing Walls	2		Р	NP
Interior Bearing Walls	0	3 - <5	UP, NS	NP
Nonbearing Walls and Partitions-Interior	0		UP, S	15
Floor Construction & Secondary Members	0		Р	15
Roof Construction & Secondary Members	0	5 - <10	UP, NS	10
			UP, S	25
Exterior Bearing Walls	2		Р	25
Interior Bearing Walls	0	10 - <15	UP, NS	15
Coumns	0		UP, S	45
Beams, Girders, Trusses & Arches	0		Р	45
Floor-Ceiling Assemblies	0	15 - <20	UP, NS	25
Roof-Ceiling Assemblies	0		UP, S	75
Interior Nonbearing Walls	0		Р	75
Exterior Nonbearing Walls	0	20 - <25	UP, NS	45
			UP, S	NL
			Р	NL
		25 - <30	UP, NS	70
			UP, S	NL
			Р	NL
		30 or greater	UP, NS	NL
1			115 0	.

UP, S

FIRE RATING OF BUILDING ELEMENTS CONT

706 FIRE WALLS

706.1 General. Each portion of a building separated by one or more fire walls that comply with the provisions of this section shall be considered a separate building. The extent and location of such fire walls shall provide a complete separation. Where a fire wall separates occupancies that are required to be separated by a fire barrier wall, the most restrictive requirements of each separation shall apply.

706.2 Structural stability. Fire walls shall be designed and constructed to allow collapse of the structure on either side without collapse of the wall under fire conditions. Fire walls designed and constructed in accordance with NFPA 221 shall be deemed to comply with this section.

Fire Wall Fire-Resistance Ratings

Fire-Resistance Rating

a. In Type II or V construction, walls shall be permitted to have a 2-hour fire-resistance rating.

712.1.7 Atriums. In other than Group H occupancies, atriums complying with Section 404 shall be permitted.

712.1.9 Two-story openings. In other than Groups I-2 and I-3, a vertical opening that is not used as one of the applications

complies with all of the items below:

listed in this section shall be permitted if the opening Does not connect more than two stories.

Does not penetrate a horizontal assembly that separates fire areas or smoke barriers that separate smoke

- Is not concealed within the construction of a wall or a floor/ceiling assembly. Is not open to a corridor in Group I and R occupancies.
- Is not open to a corridor on non-sprinklered floors. Is separated from floor openings and air transfer openings serving other floors by construction conforming to required shaft enclosures.

713.4 Fire-resistance rating. Shaft enclosures shall have afire-resistance rating of not less than 2 hours where connecting four stories or more, and not less than 1 hour where connecting less than four stories. The number of stories connected by the shaft enclosure shall include any basements but not any mezzanines. Shaft enclosures shall have a fire-resistance rating not less than the floor assembly penetrated but need not exceed 2 hours. Shaft enclosures shall meet the requirements of Section

Opening Protectives

IBC: see Table 716.5 **NFPA:** See table 8.3.4.2

MEANS OF EGRESS

IBC Table 1004.5

Function	OLF SF/perso
Assembly without fixed seats	-
Concentrated (chairs only)	7 net
Standing Space	5 net
Unconcentrated (tables and chairs)	15 net
Business Areas	150 gross
Locker Rooms	50 gross
Accessory storage areas, mechanical equipment room	300 gross
Group H-5 Fabrication and manufacturing areas	200 gross

NFPA Table 7.3.1.2(12.1.7,14.1.7)

Function	OLF (SF/pers
Assembly	-
Concentrated, w/o fixed seats	7 net
Less concentrated, w/o fixed seats	15 net
Business	100
Industrial	100

IBC 1005.3.1, 1005.3.2

Component	Width/Person (in)
Stairways	0.3
Door	0.2

NFPA 7.3.3.1

Component	Width/Person (
Stairways	0.3
Level and Ramps	0.2

Max Common Path of Travel (w/ Sprinkler)

oc .	Length (ft)
	100 (IBC)
	100 (NFPA)
	100 (IBC)

NUMBER OF EXITS AND SEPERATION **IBC:** 2 required (1006.3.1), 1/3 diagonal when equipped with automatic sprinkler system (1007.1.1 x 2) NFPA: 2 required (7.4.1.1) 1/3 diagonal when equipped with automatic sprinkler system (7.5.1.3.3) Re: **IBC 1007.1.1.1** for measurement point requirements

1008 MEANS OF EGRESS ILLUMINATION

IBC 1008.2.1 Not less than 1fc at means of egress

- NFPA 7.8.13.
 - Stairs at least 10 fc Floors and other walking surfaces at least 1 fc
 - Assembly Occupancies walking surface of exit access at least 0.2 fc

1009 ACCESSIBLE MEANS OF EGRESS

1009.1 Accessible means of egress required. Accessible means of egress shall comply with this section. Accessible spaces shall be provided with not less than one accessible means of egress. Where more than one means of egress are required by Section 1006.2 or 1006.3 from any accessible space, each accessible portion of the space shall be served by not less than two accessible means of egress.

1009.3 Stairways. In order to be considered part of an accessible means of egress, a stairway between stories shall have a clear width of 48 inches (1219 mm) minimum between hand-rails and shall either incorporate an area of refuge within an enlarged floorlevel landing or shall be accessed from an area of refuge complying with Section 1009.6.

Exceptions: 2. The clear width of 48 inches (1219 mm) between handrails is not required in buildings equipped throughout with an automatic sprinkler system installed in accordance with Section 903.3.1.1 or 903.3.1.2. 4. Areas of refuge are not required at exit access stairways where two-way communication is provided at the elevator

100 (NFPA)

landing in accordance with Section 1009.8. 5. Areas of refuge are not required at stairways in buildings equipped throughout with an automatic sprinkler system installed in accordance with Section 903.3.1.1 or 903.3.1.2. NFPA 7.2.12.1.2 and commentary regarding area of refuge as part of accessible means of egress

1009 ACCESSIBLE MEANS OF EGRESS (RE: NFPA 7.5.4)

1011.2 Width and capacity. The required capacity of stair-ways shall be determined as specified in Section 1005.1, but the minimum width shall be not less than 44 inches

1015 GUARDS 1015.2 Where required.

Exception: Guards are not required for the following

- 2. On the audience side of stages and raised platforms, including stairs leading up to the stage and raised platforms. 3. On raised stage and platform floor areas, such as runways, ramps and side stages used for entertainment or
- 4. At vertical openings in the performance area of stages and platforms. 5. At elevated walking surfaces appurtenant to stages and platforms for access to and utilization of special lighting or

MEANS OF EGRESS CONT

1015.6 Mechanical equipment, systems and devices. Guards shall be provided where various components that require service are located within 10 feet (3048 mm) of a roof edge or open side of a walking surface and such edge or open side is located more than 30 inches (762 mm) above the floor, roof or grade below. The guard shall extend not less than 30

inches (762 mm) beyond each end of such components. The guard shall be constructed so as to prevent the passage of a sphere 21 inches (533 mm) in diameter. **Exception:** Guards are not required where permanent fall arrest/restraint anchorage connector devices that comply with ANSI/ASSE Z 359.1 are affixed for use during the entire roof covering lifetime. The devices shall be reevaluated

for possible replacement when the entire roof covering is replaced. The devices shall be placed not more than 10 feet (3048 mm) on center along hip and ridge lines and placed not less than 10 feet (3048 mm) from the roof edge or open side of the walking surface. 1015.7 Roof access. Guards shall be provided where the roof hatch opening is located within 10 feet (3048 mm) of a roof

edge or open side of a walking surface and such edge or open side is located more than 30 inches (762 mm) above the floor, roof or grade below. The guard shall be constructed so as to prevent the passage of a sphere 21 inches (533 mm) in diameter **Exception:** Guards are not required where permanent fall arrest/restraint anchorage connector devices that comply with ANSI/ASSE Z 359.1 are affixed for use during the

entire roof covering lifetime. The devices shall be reevaluated for possible replacement when the entire roof covering is replaced. The devices shall be placed not more than 10 feet (3048 mm) on center along hip and ridge lines and placed not less than 10 feet (3048 mm) from the roof edge or open side of the walking surface.

Exit Access Travel Distance (w/ Sprinkler) (IBC 1017.2, NFPA A7.6)

250 (IBC) 300 (NFPA) 250 (NFPA) 250 (NFPA)

1020 CORRIDORS

1020.1 Construction. Shall be fire-resistance rated in accordance with Table 1020.1. Walls required to be fire-resistance rated shall comply with Secton 708 for fire partitions.

1. A fire-resistance rating is not required for corridors in an occupancy in Group E where each room that is used for instruction has not less than one door opening directly to the exterior and rooms for assembly purposes have not less than one-half of the required means of egress doors opening directly to the exterior. Exterior doors specified in this exception are required to be at ground level.

IBC TABLE 1020.1 CORRIDOR FIRE-RESISTANCE RATING

Occ	OL Served	Rating	
		w/o Sprinkler	w/Sprinkle
В	>30	1	0
F	>30	1	0

NFPA 7.1.3.1: 1HR when used as exit access and occupant load exceeding 30 NFPA 12.3.6(2): Protection not req'd in buildings protected throughout by sprinkler system. NFPA 14.3.6 (2): Protection not req'd in buildings protected throughout by sprinkler system, provide walls form smoke partitions in accordance with 8.4

NFPA 138.3.6 (3): Protection not req'd in buildings protected throughout by sprinkler system in accordance with 9.7.1.1 (1)

MINIMUM CORRIDOR WIDTH

Occupancy	Min Width(in)	Code	
Any not listed below	44	IBC 1020.2	
B > 100	72		
В	72	NFPA 14.2.3.2	
F > 100	72		
I	72	NFPA 14.2.3.2	

DEAD END LIMIT (W SPRINKLER)

Occupancy	Lengin (ii)	Code
В	50	IBC 1020.4x2
В	50	NFPA A.7.6
F	50	IBC 1020.4x2
	50	NFPA A.7.6
I .		

EXIT & SHAFT ENCLOSURE

IBC: 2 hour fire-resistance rating when connecting 4 stories or more, 1 hour when connecting less than 4 stories. (1023.2) NFPA: 2 hour fire-resistance rating when connecting 4 stories or more, 1 hour when connecting less than 4 stories. (7.1.3.2.1(1), 8.6.5(1), 7.2.3.3.1, 7.2.3.3.3)

MEANS OF EGRESS CONT

505 MEZZANINES AND EQUIPMENT PLATFORMS

505.1 General. *Mezzanines* shall comply with Section 505.2. Equipment platforms shall comply with Section 505.3.

505.2 Mezzanines. A mezzanine or mezzanines in compli- ance with Section 505.2 shall be considered a portion of the story below. Such *mezzanines* shall not contribute to either the *building area* or number of *stories* as regulated by Section 503.1. The area of the *mezzanine* shall be included in deter- mining the *fire area*. The clear height above and below the

mezzanine floor construction shall be not less than 7 feet (2134 mm). 505.2.1 Area limitation. The aggregate area of a mezza- nine or mezzanines within a room shall be not greater than one-third of the floor area of that room or space in which they are located. The enclosed portion of a room shall not be included in a

determination of the floor area of the room in which the *mezzanine* is located. In determining the allowable *mezzanine* area, the area of the *mezzanine* shall not be included in the floor area of the room. Where a room contains both a *mezzanine* and an *equip-ment platform*, the aggregate area of the two raised floor levels shall be not greater than two-thirds of the floor area of that room or space in which they are located. **Exceptions:**

- The aggregate area of *mezzanines* in buildings and structures of Type I or II construction for special industrial occupancies in accordance with Section 503.1.1 shall be not greater than two- thirds of the floor area of the
- The aggregate area of mezzanines in buildings and structures of Type I or II construction shall be not greater than one-half of the floor area of the room in buildings and structures equipped throughout with an approved automatic sprinkler system in accordance with Section 903.3.1.1 and an approved emergency voice/alarm communica- tion system in accordance with Section 907.5.2.2.

505.2.2 Means of egress. The *means of egress* for *mezza- nines* shall comply with the applicable provisions of Chapter 10.

IBC Commentary: A single exit is allowed when occupant load is less than 49 and common path of egress travel from the most remote point on the mezzanine to the bottom of the stair does not exceed 75'.

505.2.3 Openness. A *mezzanine* shall be open and unob- structed to the room in which such *mezzanine* is located except for walls not more than 42 inches (1067 mm) in height, columns and posts.

- Mezzanines or portions thereof are not required to be open to the room in which the mezzanines are located, provided that the occupant load of the aggregate area of the enclosed space is not greater than 10.
- A mezzanine having two or more exits or access to exits is not required to be open to the room in which the
- Mezzanines or portions thereof are not required to be open to the room in which the mezzanines are located. provided that the aggregate floor area of the enclosed space is not greater than 10 percent of the mezzanine
- In industrial facilities, mezzanines used for con- trol equipment are permitted to be glazed on all sides.
- In occupancies other than Groups H and I, that are no more than two stories above grade plane and equipped throughout with an automatic sprinkler system in accordance with Section 903.3.1.1, a mezzanine having two or more means of egress shall not be required to be open to the room in which the mezzanine is located.

woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY WOODWARDDESIGNBUILD.COM | 504-822-6443 Erik Wismar, AIA

PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana


WDG PROJECT NO LAR2315

CONSTRUCTION DOCUMENTS 04.15.2024

INFORMATION

LIFE SAFETY AND CODE

G1.00

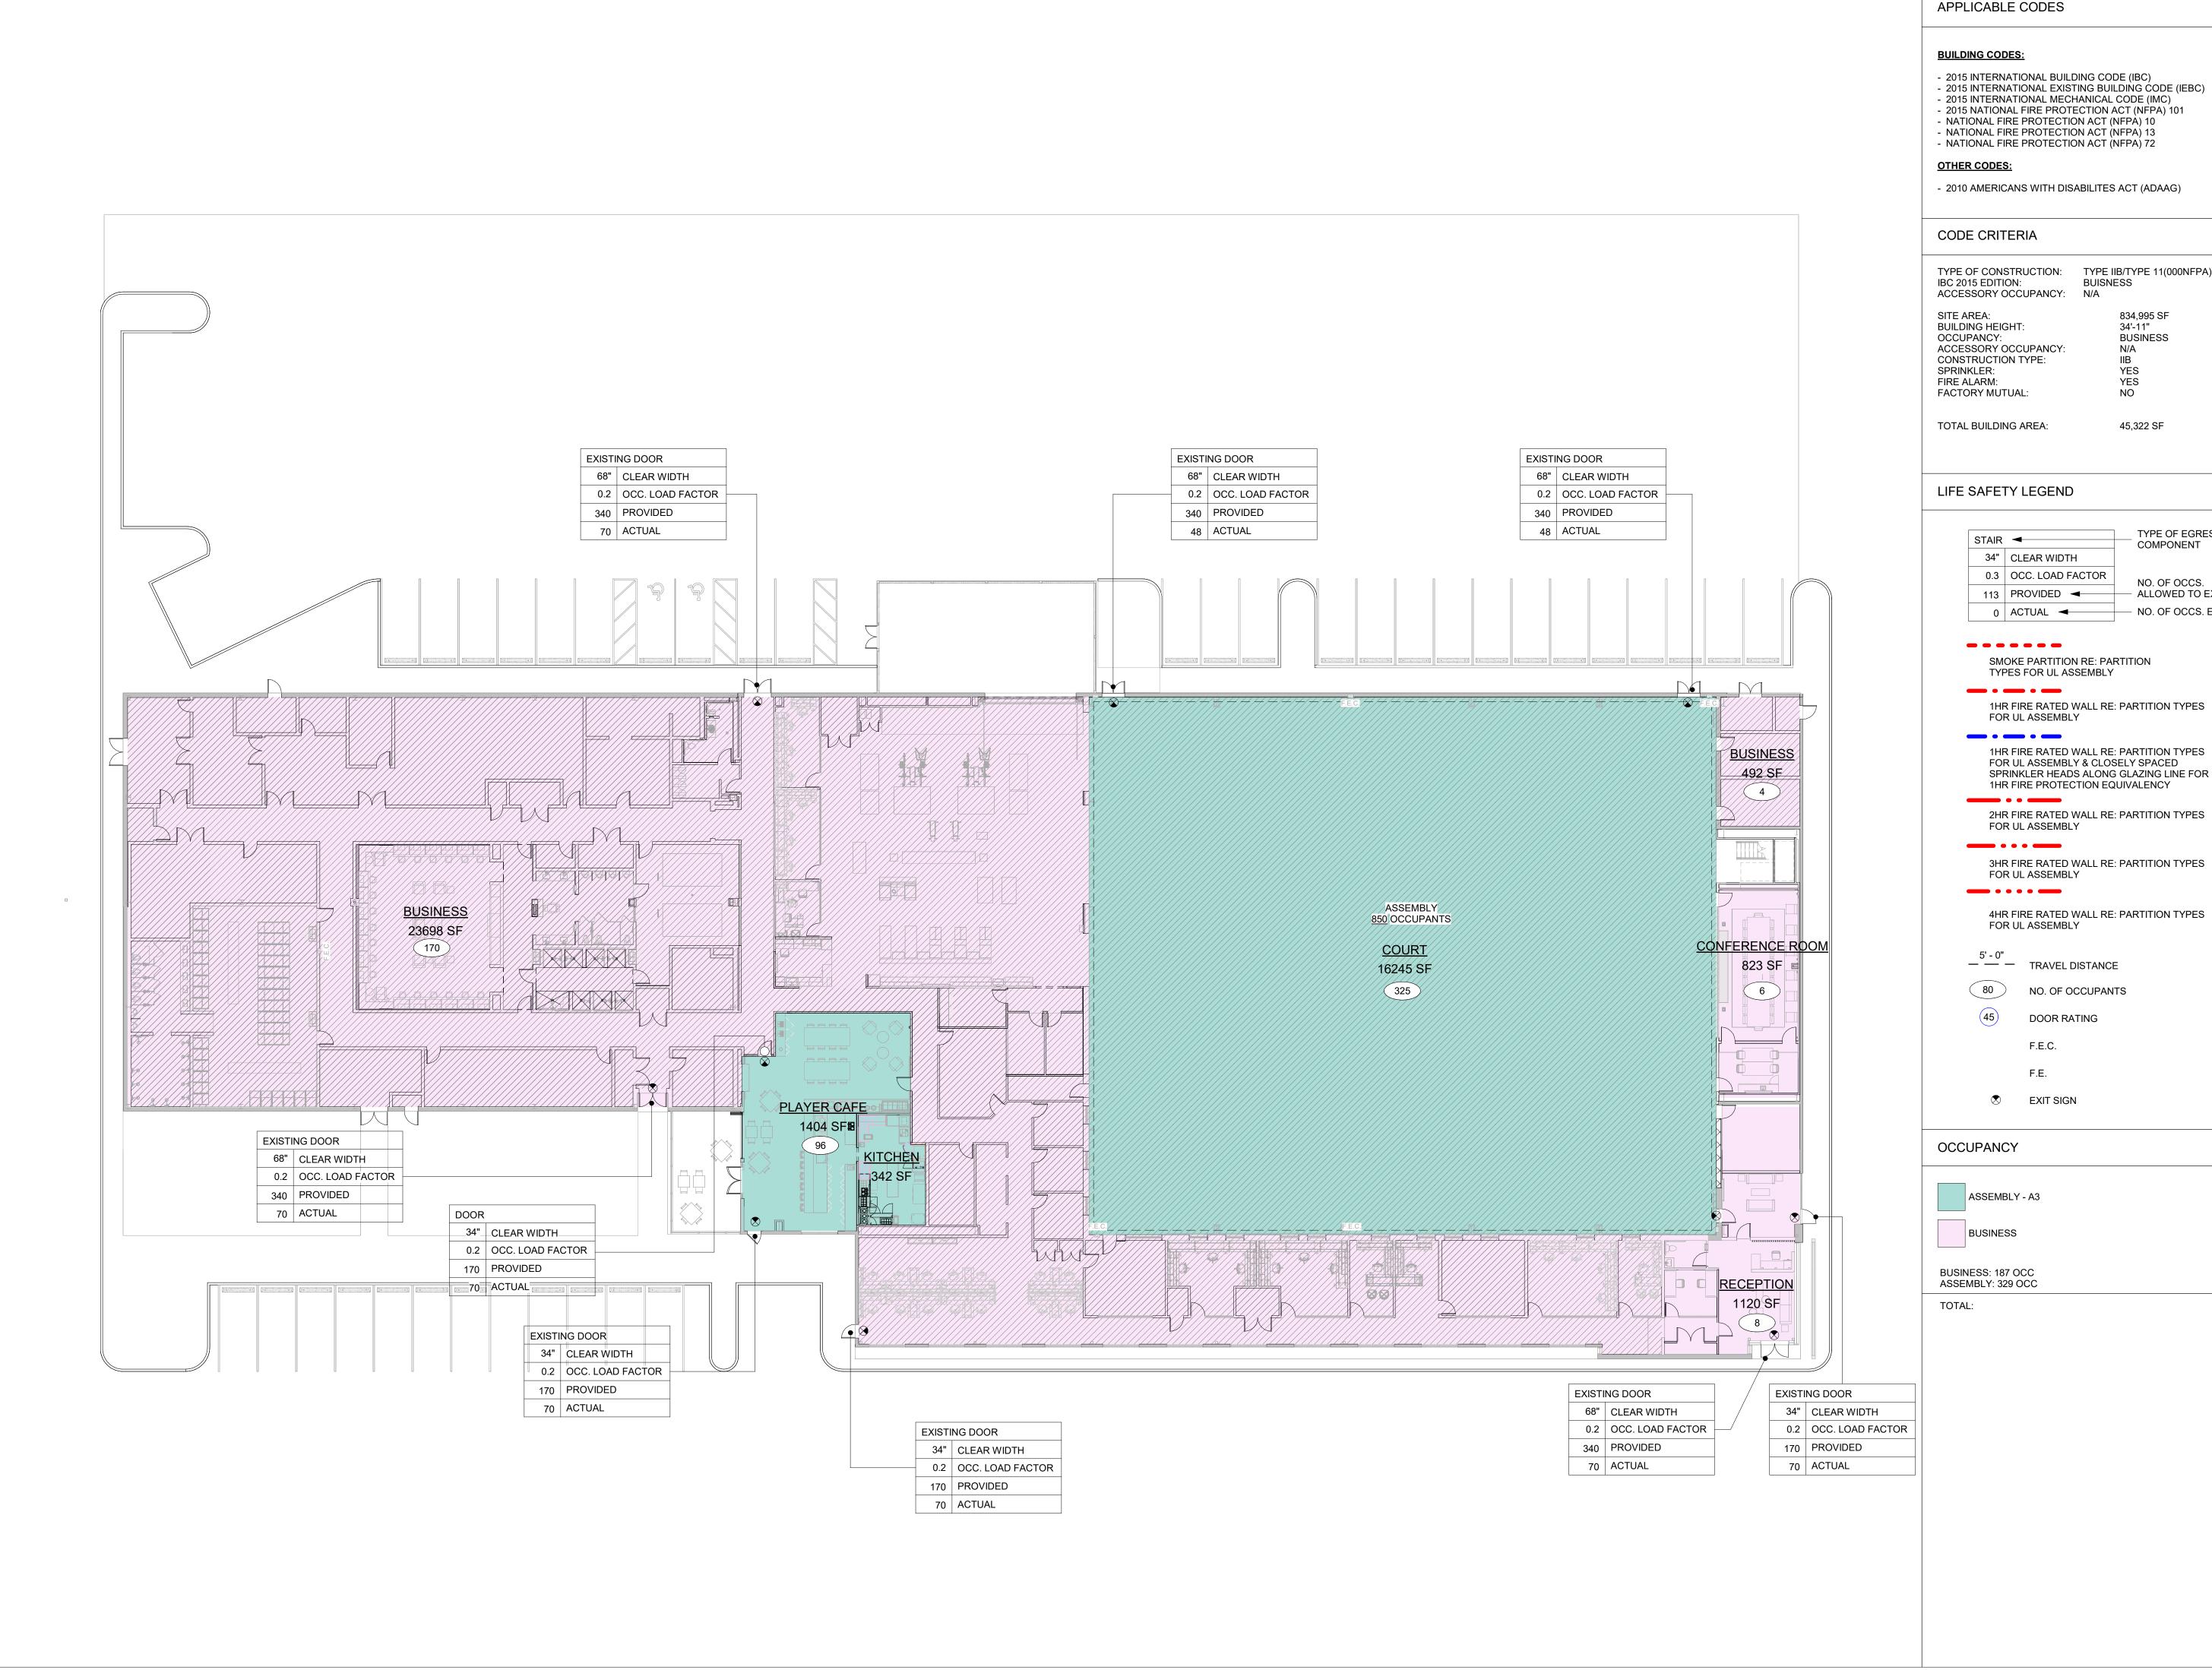

- 2015 INTERNATIONAL BUILDING CODE (IBC) - 2015 INTERNATIONAL EXISTING BUILDING CODE (IEBC) - 2015 INTERNATIONAL MECHANICAL CODE (IMC) - 2015 NATIONAL FIRE PROTECTION ACT (NFPA) 101
- NATIONAL FIRE PROTECTION ACT (NFPA) 10 - NATIONAL FIRE PROTECTION ACT (NFPA) 13 - NATIONAL FIRE PROTECTION ACT (NFPA) 72

- 2010 AMERICANS WITH DISABILITES ACT (ADAAG)

TYPE OF CONSTRUCTION: TYPE IIB/TYPE 11(000NFPA) BUISNESS ACCESSORY OCCUPANCY: N/A 834,995 SF

34'-11" BUSINESS N/A IIB YES YES NO

45,322 SF

COMPONENT 34" CLEAR WIDTH 0.3 OCC. LOAD FACTOR NO. OF OCCS. 113 PROVIDED ◀ ALLOWED TO EXIT 0 ACTUAL ◀ NO. OF OCCS. EXITING

TYPE OF EGRESS

SMOKE PARTITION RE: PARTITION TYPES FOR UL ASSEMBLY

FOR UL ASSEMBLY

1HR FIRE RATED WALL RE: PARTITION TYPES FOR UL ASSEMBLY & CLOSELY SPACED SPRINKLER HEADS ALONG GLAZING LINE FOR 1HR FIRE PROTECTION EQUIVALENCY

2HR FIRE RATED WALL RE: PARTITION TYPES

FOR UL ASSEMBLY

3HR FIRE RATED WALL RE: PARTITION TYPES

4HR FIRE RATED WALL RE: PARTITION TYPES FOR UL ASSEMBLY

NO. OF OCCUPANTS

DOOR RATING

F.E.C.

EXIT SIGN

PELICANS CAMPUS IMPROVEMENTS


woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024



FIRST FLOOR LIFE SAFETY PLAN



APPLICABLE CODES

BUILDING CODES:

- 2015 INTERNATIONAL BUILDING CODE (IBC)
 2015 INTERNATIONAL EXISTING BUILDING CODE (IEBC)
 2015 INTERNATIONAL MECHANICAL CODE (IMC)
 2015 NATIONAL FIRE PROTECTION ACT (NFPA) 101
- NATIONAL FIRE PROTECTION ACT (NFPA)
 NATIONAL FIRE PROTECTION ACT (NFPA) 10
 NATIONAL FIRE PROTECTION ACT (NFPA) 13
 NATIONAL FIRE PROTECTION ACT (NFPA) 72

OTHER CODES:

- 2010 AMERICANS WITH DISABILITES ACT (ADAAG)

woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY
NEW ORLEANS, LA 70125
WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA

CODE CRITERIA

TYPE OF CONSTRUCTION: TYPE IIB/TYPE 11(000NFPA) IBC 2015 EDITION: BUISNESS ACCESSORY OCCUPANCY: N/A 834,995 SF 34'-11" SITE AREA: BUILDING HEIGHT: OCCUPANCY: BUSINESS ACCESSORY OCCUPANCY: N/A CONSTRUCTION TYPE: IIB YES YES NO SPRINKLER: FIRE ALARM: FACTORY MUTUAL:

TOTAL BUILDING AREA: 45,322 SF

LIFE SAFETY LEGEND

TYPE OF EGRESS STAIR ◀ COMPONENT 34" CLEAR WIDTH 0.3 OCC. LOAD FACTOR NO. OF OCCS. ALLOWED TO EXIT 113 PROVIDED ◀ 0 ACTUAL ◀ NO. OF OCCS. EXITING -----SMOKE PARTITION RE: PARTITION TYPES FOR UL ASSEMBLY _._. 1HR FIRE RATED WALL RE: PARTITION TYPES FOR UL ASSEMBLY 1HR FIRE RATED WALL RE: PARTITION TYPES FOR UL ASSEMBLY & CLOSELY SPACED SPRINKLER HEADS ALONG GLAZING LINE FOR 1HR FIRE PROTECTION EQUIVALENCY

2HR FIRE RATED WALL RE: PARTITION TYPES FOR UL ASSEMBLY

3HR FIRE RATED WALL RE: PARTITION

3HR FIRE RATED WALL RE: PARTITION TYPES FOR UL ASSEMBLY

4HR FIRE RATED WALL RE: PARTITION TYPES FOR UL ASSEMBLY

-5'-0" TRAVEL DISTANCE

80 NO. OF OCCUPANTS

door rating

F.E.C. F.E.

EXIT SIGN

PELICANS CAMPUS IMPROVEMENTS
Metairie, Louisiana

OCCUPANCY

ASSEMBLY - A3

WDG PROJECT NO | AR2315


CONSTRUCTION DOCUMENTS 04.15.2024



REVISIONS

no. descripton date

SECOND FLOOR LIFE SAFETY PLAN

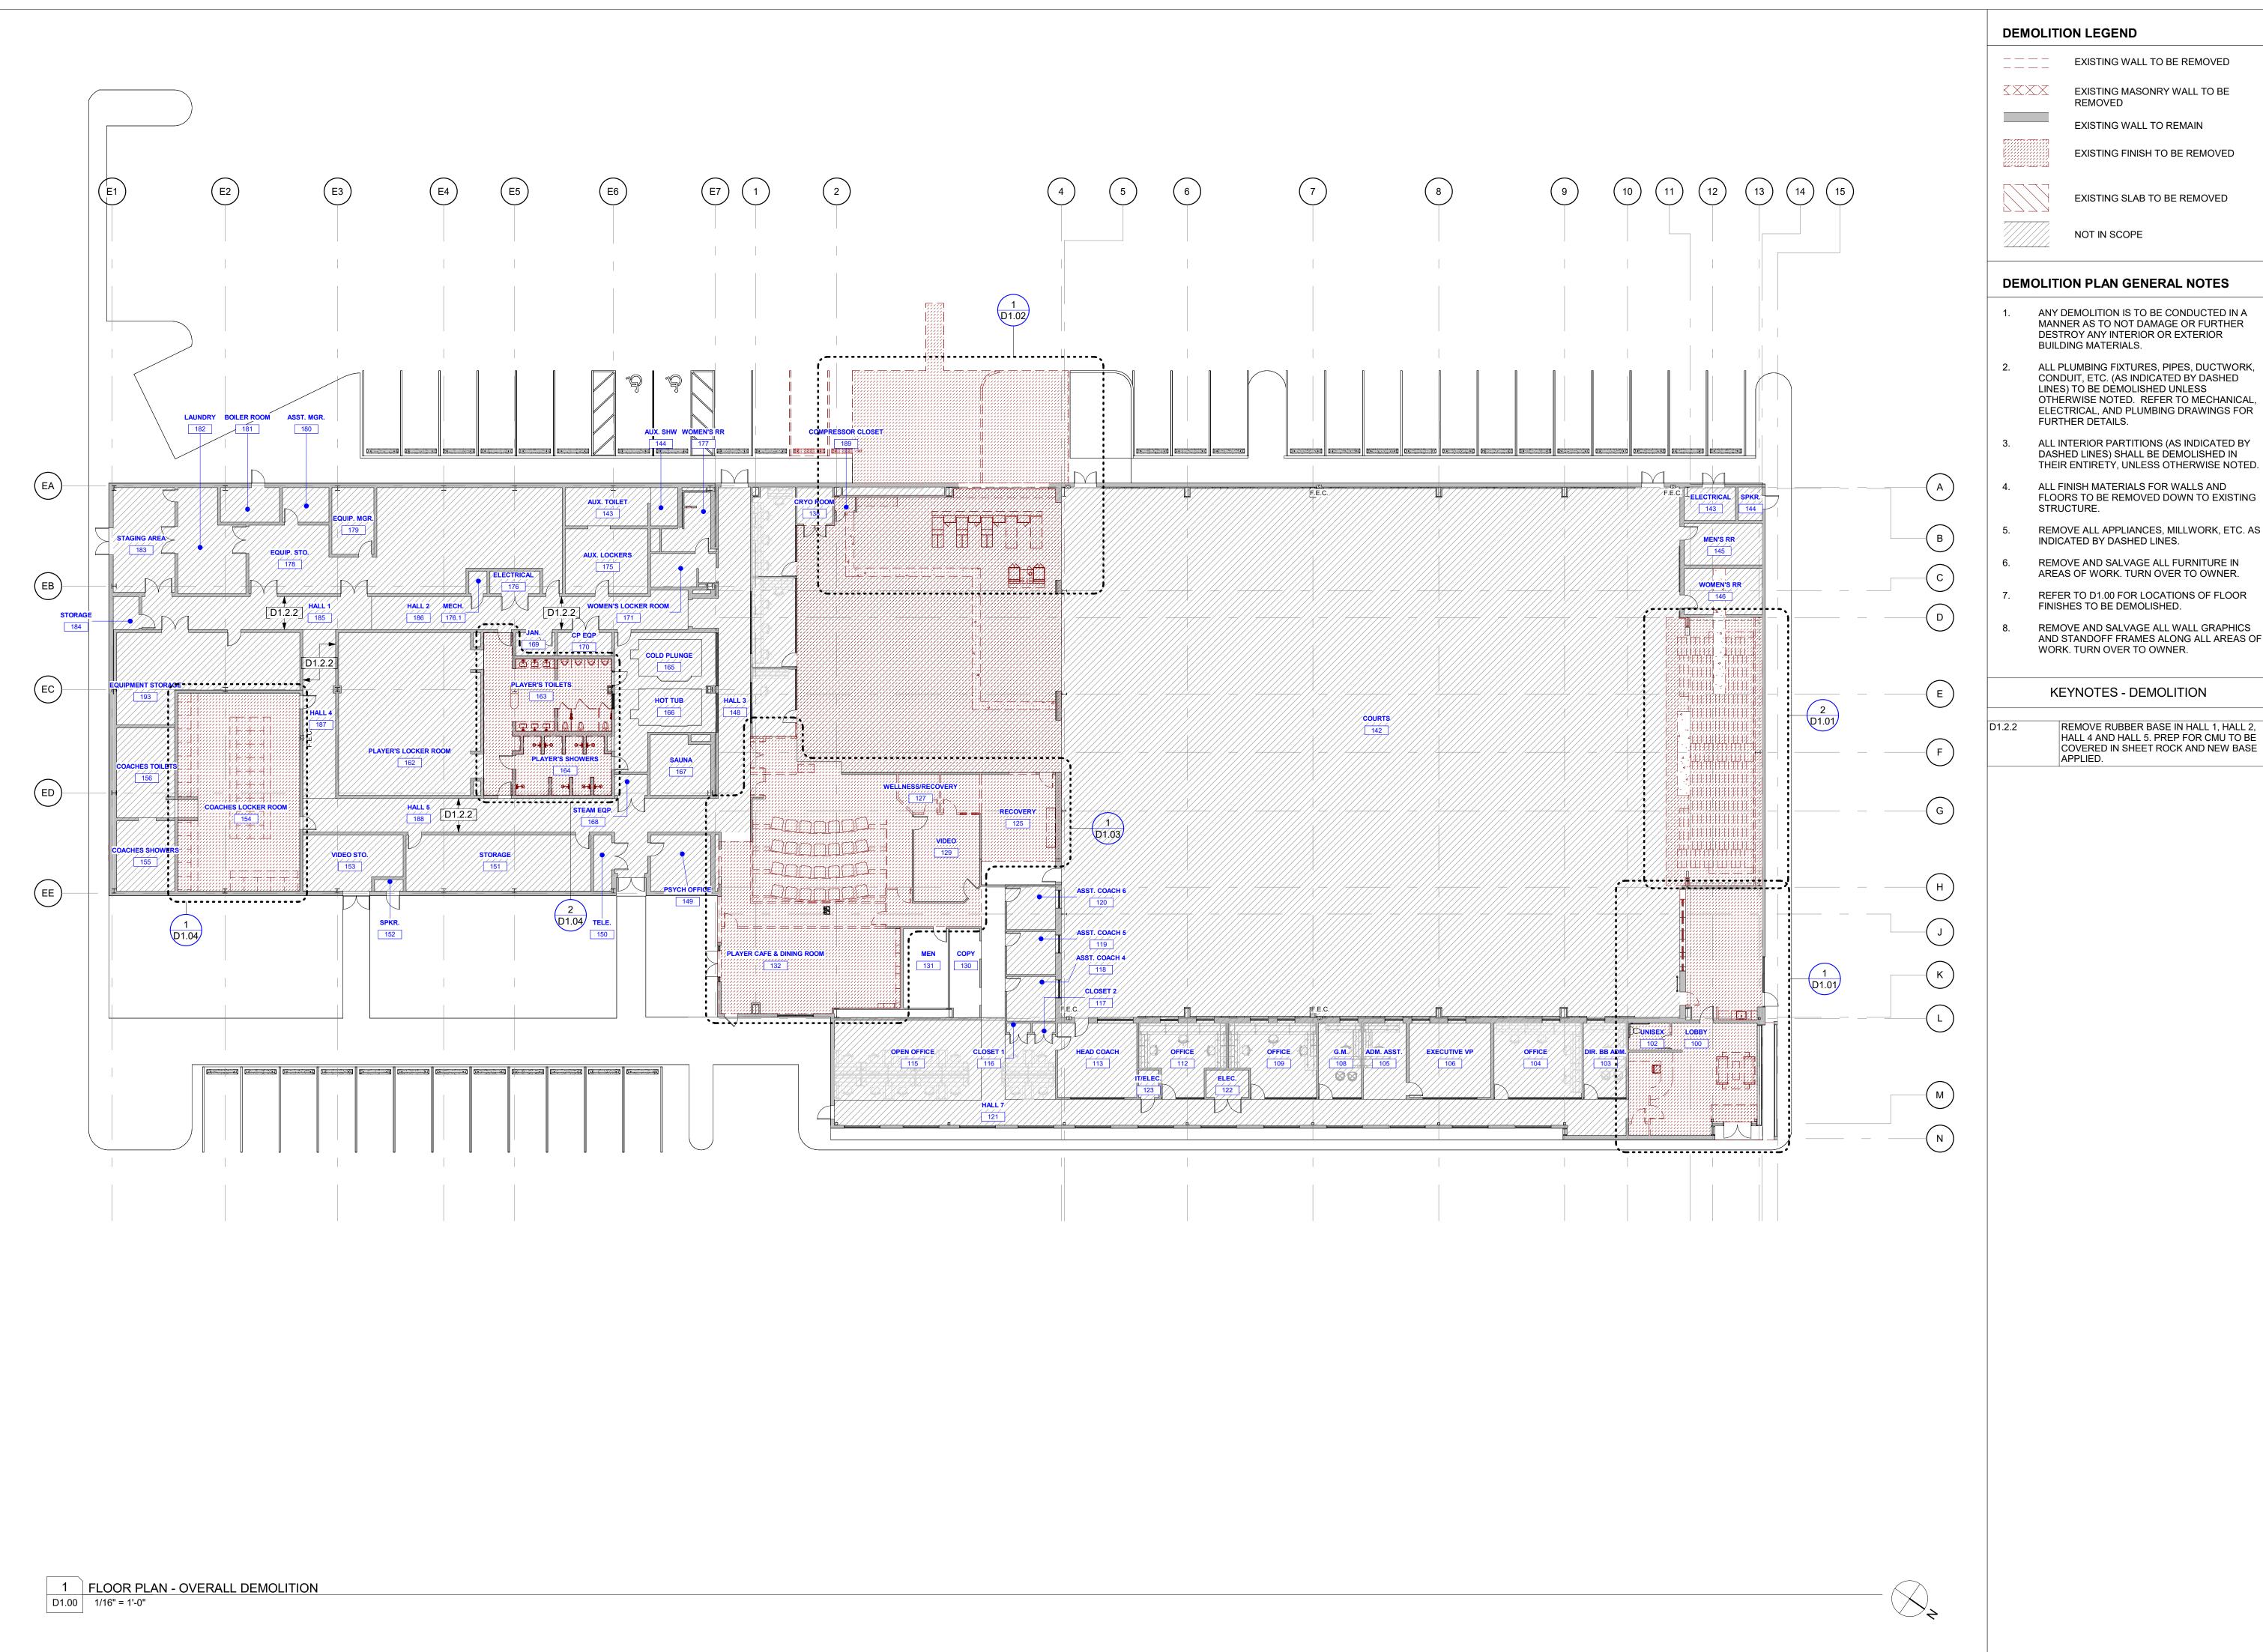

EXISTING MASONRY WALL TO BE



EXISTING FINISH TO BE REMOVED

EXISTING SLAB TO BE REMOVED

DEMOLITION PLAN GENERAL NOTES

 ANY DEMOLITION IS TO BE CONDUCTED IN A MANNER AS TO NOT DAMAGE OR FURTHER DESTROY ANY INTERIOR OR EXTERIOR

ALL PLUMBING FIXTURES, PIPES, DUCTWORK, CONDUIT, ETC. (AS INDICATED BY DASHED LINES) TO BE DEMOLISHED UNLESS OTHERWISE NOTED. REFER TO MECHANICAL, ELECTRICAL, AND PLUMBING DRAWINGS FOR

> ALL INTERIOR PARTITIONS (AS INDICATED BY DASHED LINES) SHALL BE DEMOLISHED IN

ALL FINISH MATERIALS FOR WALLS AND FLOORS TO BE REMOVED DOWN TO EXISTING

REMOVE ALL APPLIANCES, MILLWORK, ETC. AS INDICATED BY DASHED LINES.

REMOVE AND SALVAGE ALL FURNITURE IN AREAS OF WORK. TURN OVER TO OWNER.

REFER TO D1.00 FOR LOCATIONS OF FLOOR FINISHES TO BE DEMOLISHED.

REMOVE AND SALVAGE ALL WALL GRAPHICS AND STANDOFF FRAMES ALONG ALL AREAS OF WORK. TURN OVER TO OWNER.

KEYNOTES - DEMOLITION

REMOVE RUBBER BASE IN HALL 1, HALL 2, HALL 4 AND HALL 5. PREP FOR CMU TO BE COVERED IN SHEET ROCK AND NEW BASE

> PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana


woodward design group


1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA

WDG PROJECT NO | AR2315 CONSTRUCTION DOCUMENTS 04.15.2024

FLOOR 1 DEMOLITION PLAN

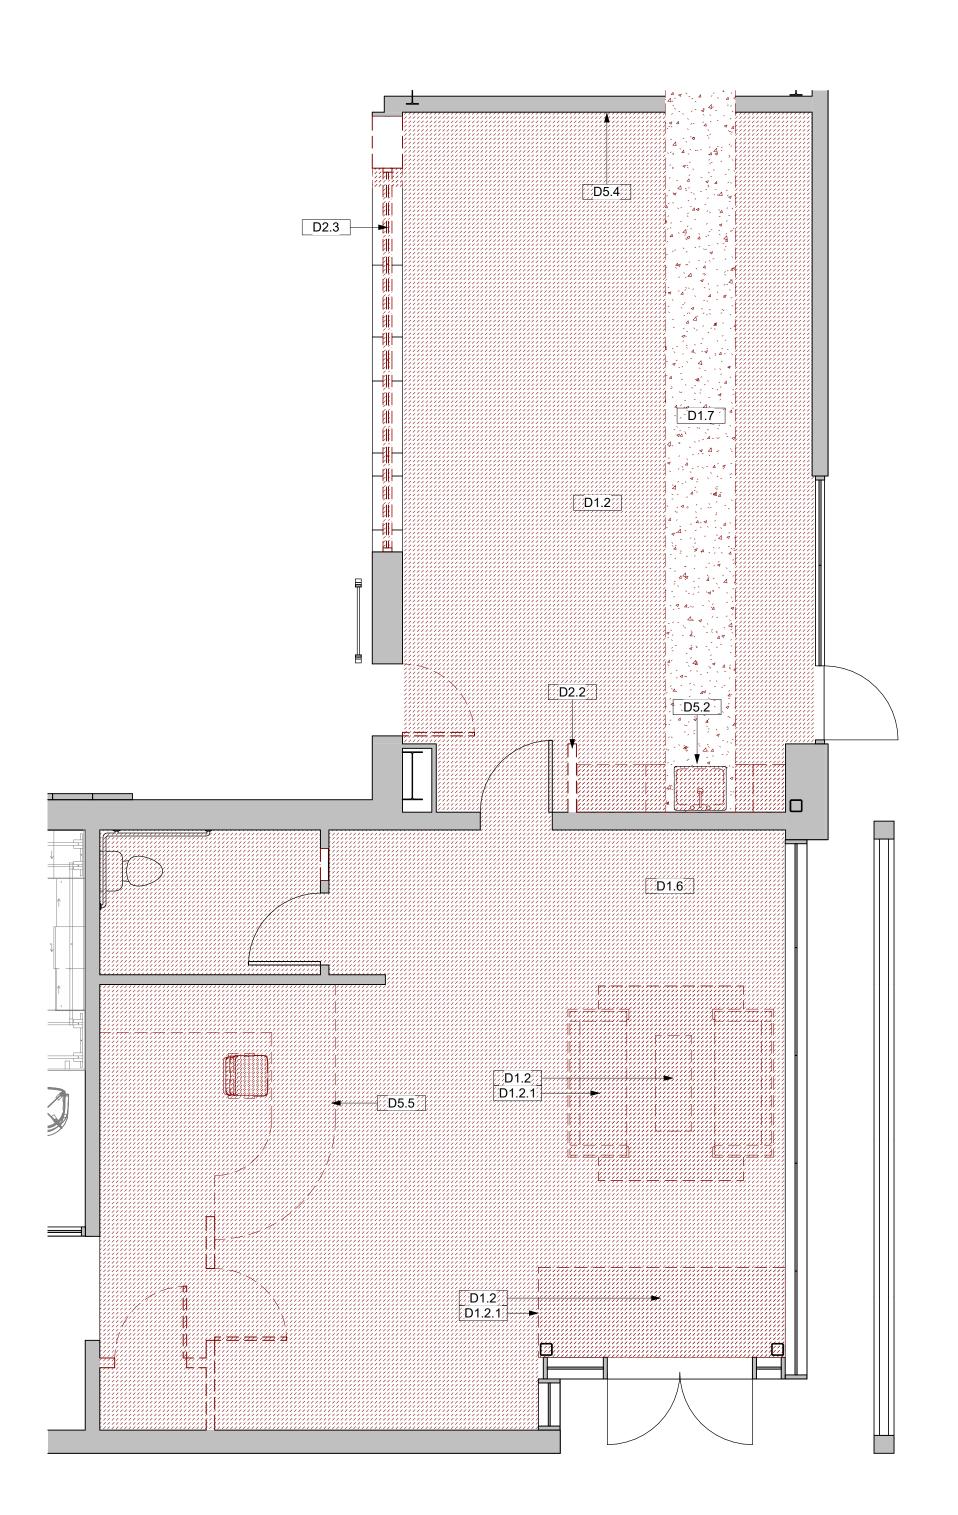

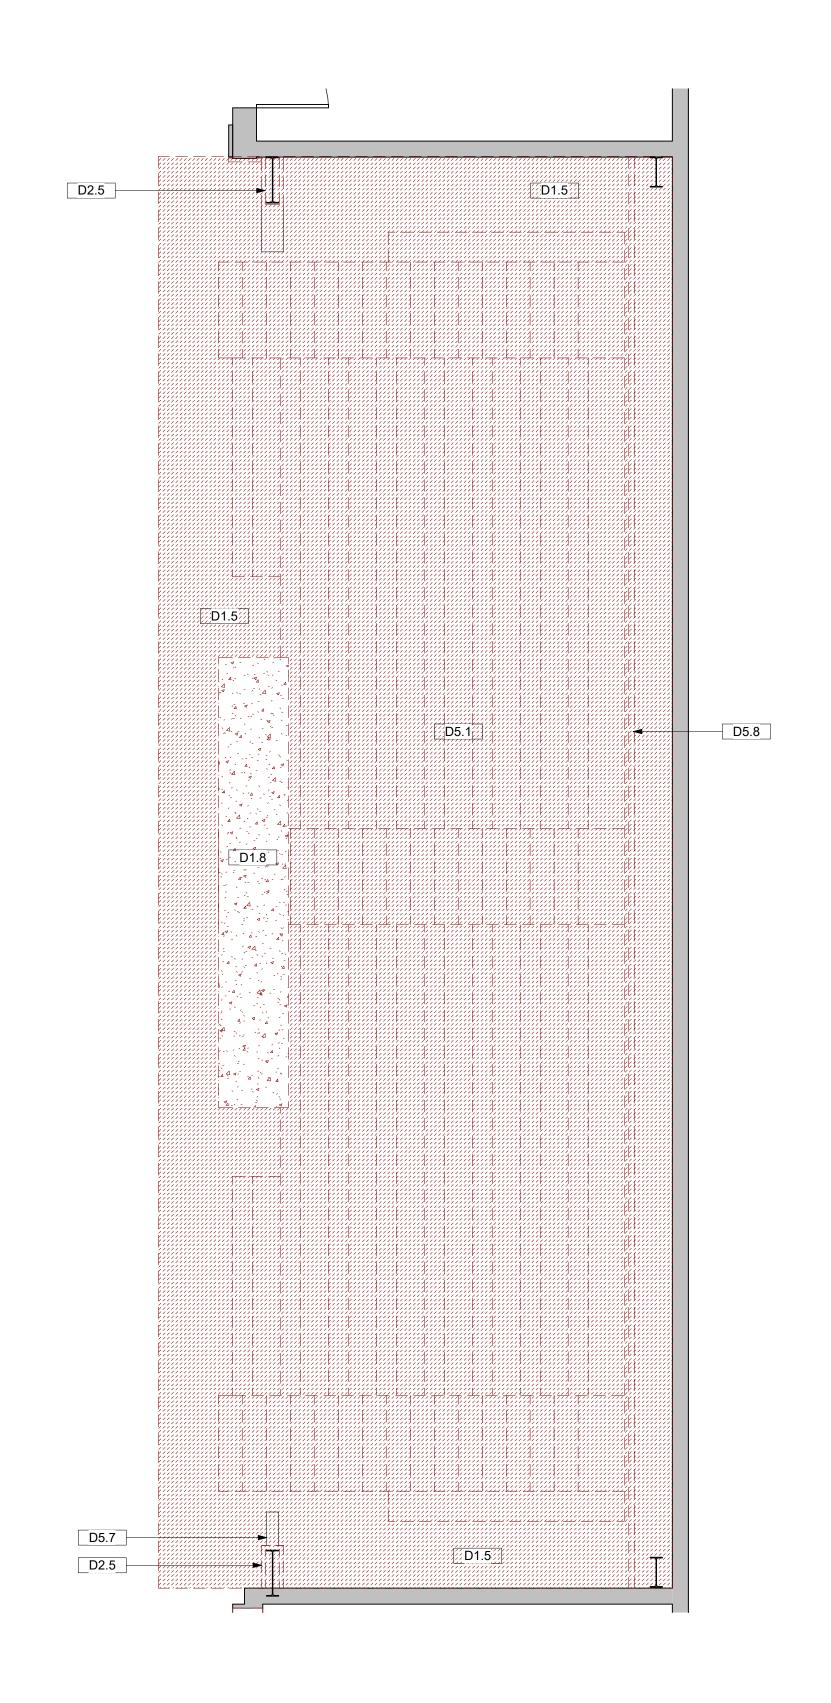

1 DEMO PLAN - LOBBY & MEDIA ROOM

D1.01 1/4" = 1'-0"

2 DEMO PLAN - EXISTING BLEACHERS D1.01 1/4" = 1'-0"

DEMOLITION LEGEND

EXISTING WALL TO BE REMOVED




EXISTING MASONRY WALL TO BE REMOVED





EXISTING FINISH TO BE REMOVED





DEMOLITION PLAN GENERAL NOTES

- 1. ANY DEMOLITION IS TO BE CONDUCTED IN A MANNER AS TO NOT DAMAGE OR FURTHER DESTROY ANY INTERIOR OR EXTERIOR BUILDING MATERIALS.
- 2. ALL PLUMBING FIXTURES, PIPES, DUCTWORK, CONDUIT, ETC. (AS INDICATED BY DASHED LINES) TO BE DEMOLISHED UNLESS OTHERWISE NOTED. REFER TO MECHANICAL, ELECTRICAL, AND PLUMBING DRAWINGS FOR FURTHER DETAILS.
- 3. ALL INTERIOR PARTITIONS (AS INDICATED BY DASHED LINES) SHALL BE DEMOLISHED IN THEIR ENTIRETY, UNLESS OTHERWISE NOTED.
- 4. ALL FINISH MATERIALS FOR WALLS AND FLOORS TO BE REMOVED DOWN TO EXISTING STRUCTURE.
- REMOVE ALL APPLIANCES, MILLWORK, ETC. AS INDICATED BY DASHED LINES.
- REMOVE AND SALVAGE ALL FURNITURE IN AREAS OF WORK. TURN OVER TO OWNER.
- REFER TO D1.00 FOR LOCATIONS OF FLOOR FINISHES TO BE DEMOLISHED.
- REMOVE AND SALVAGE ALL WALL GRAPHICS AND STANDOFF FRAMES ALONG ALL AREAS OF WORK. TURN OVER TO OWNER.

KEYNOTES - DEMOLITION

D1.2	REMOVE CARPET FLOORING
D1.2.1	REMOVE METAL TRANSITION STRIPS AT (E) FLOORING INSET TO BE DEMOLISHED
D1.5	REMOVE RESILIENT FLOORING
D1.6	REMOVE TILE FLOORING
D1.7	DEMOLISH CONCRETE SLAB IN THIS AREA FOR NEW PLUMBING; RE: PLUMBING
D1.8	DEMOLISH CONCRETE SLAB IN THIS AREA FOR NEW STRUCTURAL WORK; RE: STRUCT

D2.2 DEMOLISH STUD WALL D2.3 DEMOLISH INTERIOR STOREFRONT D2.5 REMOVE PADDED WALL PANELS AND SALVAGE FOR

OWNER STOCK D5.1 DEMOLISH BLEACHERS D5.2 DEMOLISH CASEWORK, COUNTERTOP AND PLUMBING FIXTURES

D5.4 REMOVE WALL-MOUNTED TV DISPLAYS AND SALVAGE FOR OWNER STOCK D5.5 DEMOLISH RECEPTION DESK D5.7 REMOVE SPEAKER AND MOUNTING HARDWARE;

SALVAGE FOR OWNER STOCK D5.8 OVERHEAD SPRINKLER PIPE TO BE RELOCATED; NEW LOCATION TO BE COORDINATED W/ SPRINKLER SUBCONTRACTOR

> PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana


woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443


Erik Wismar, AIA

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024

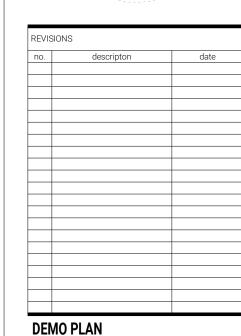

D1.01

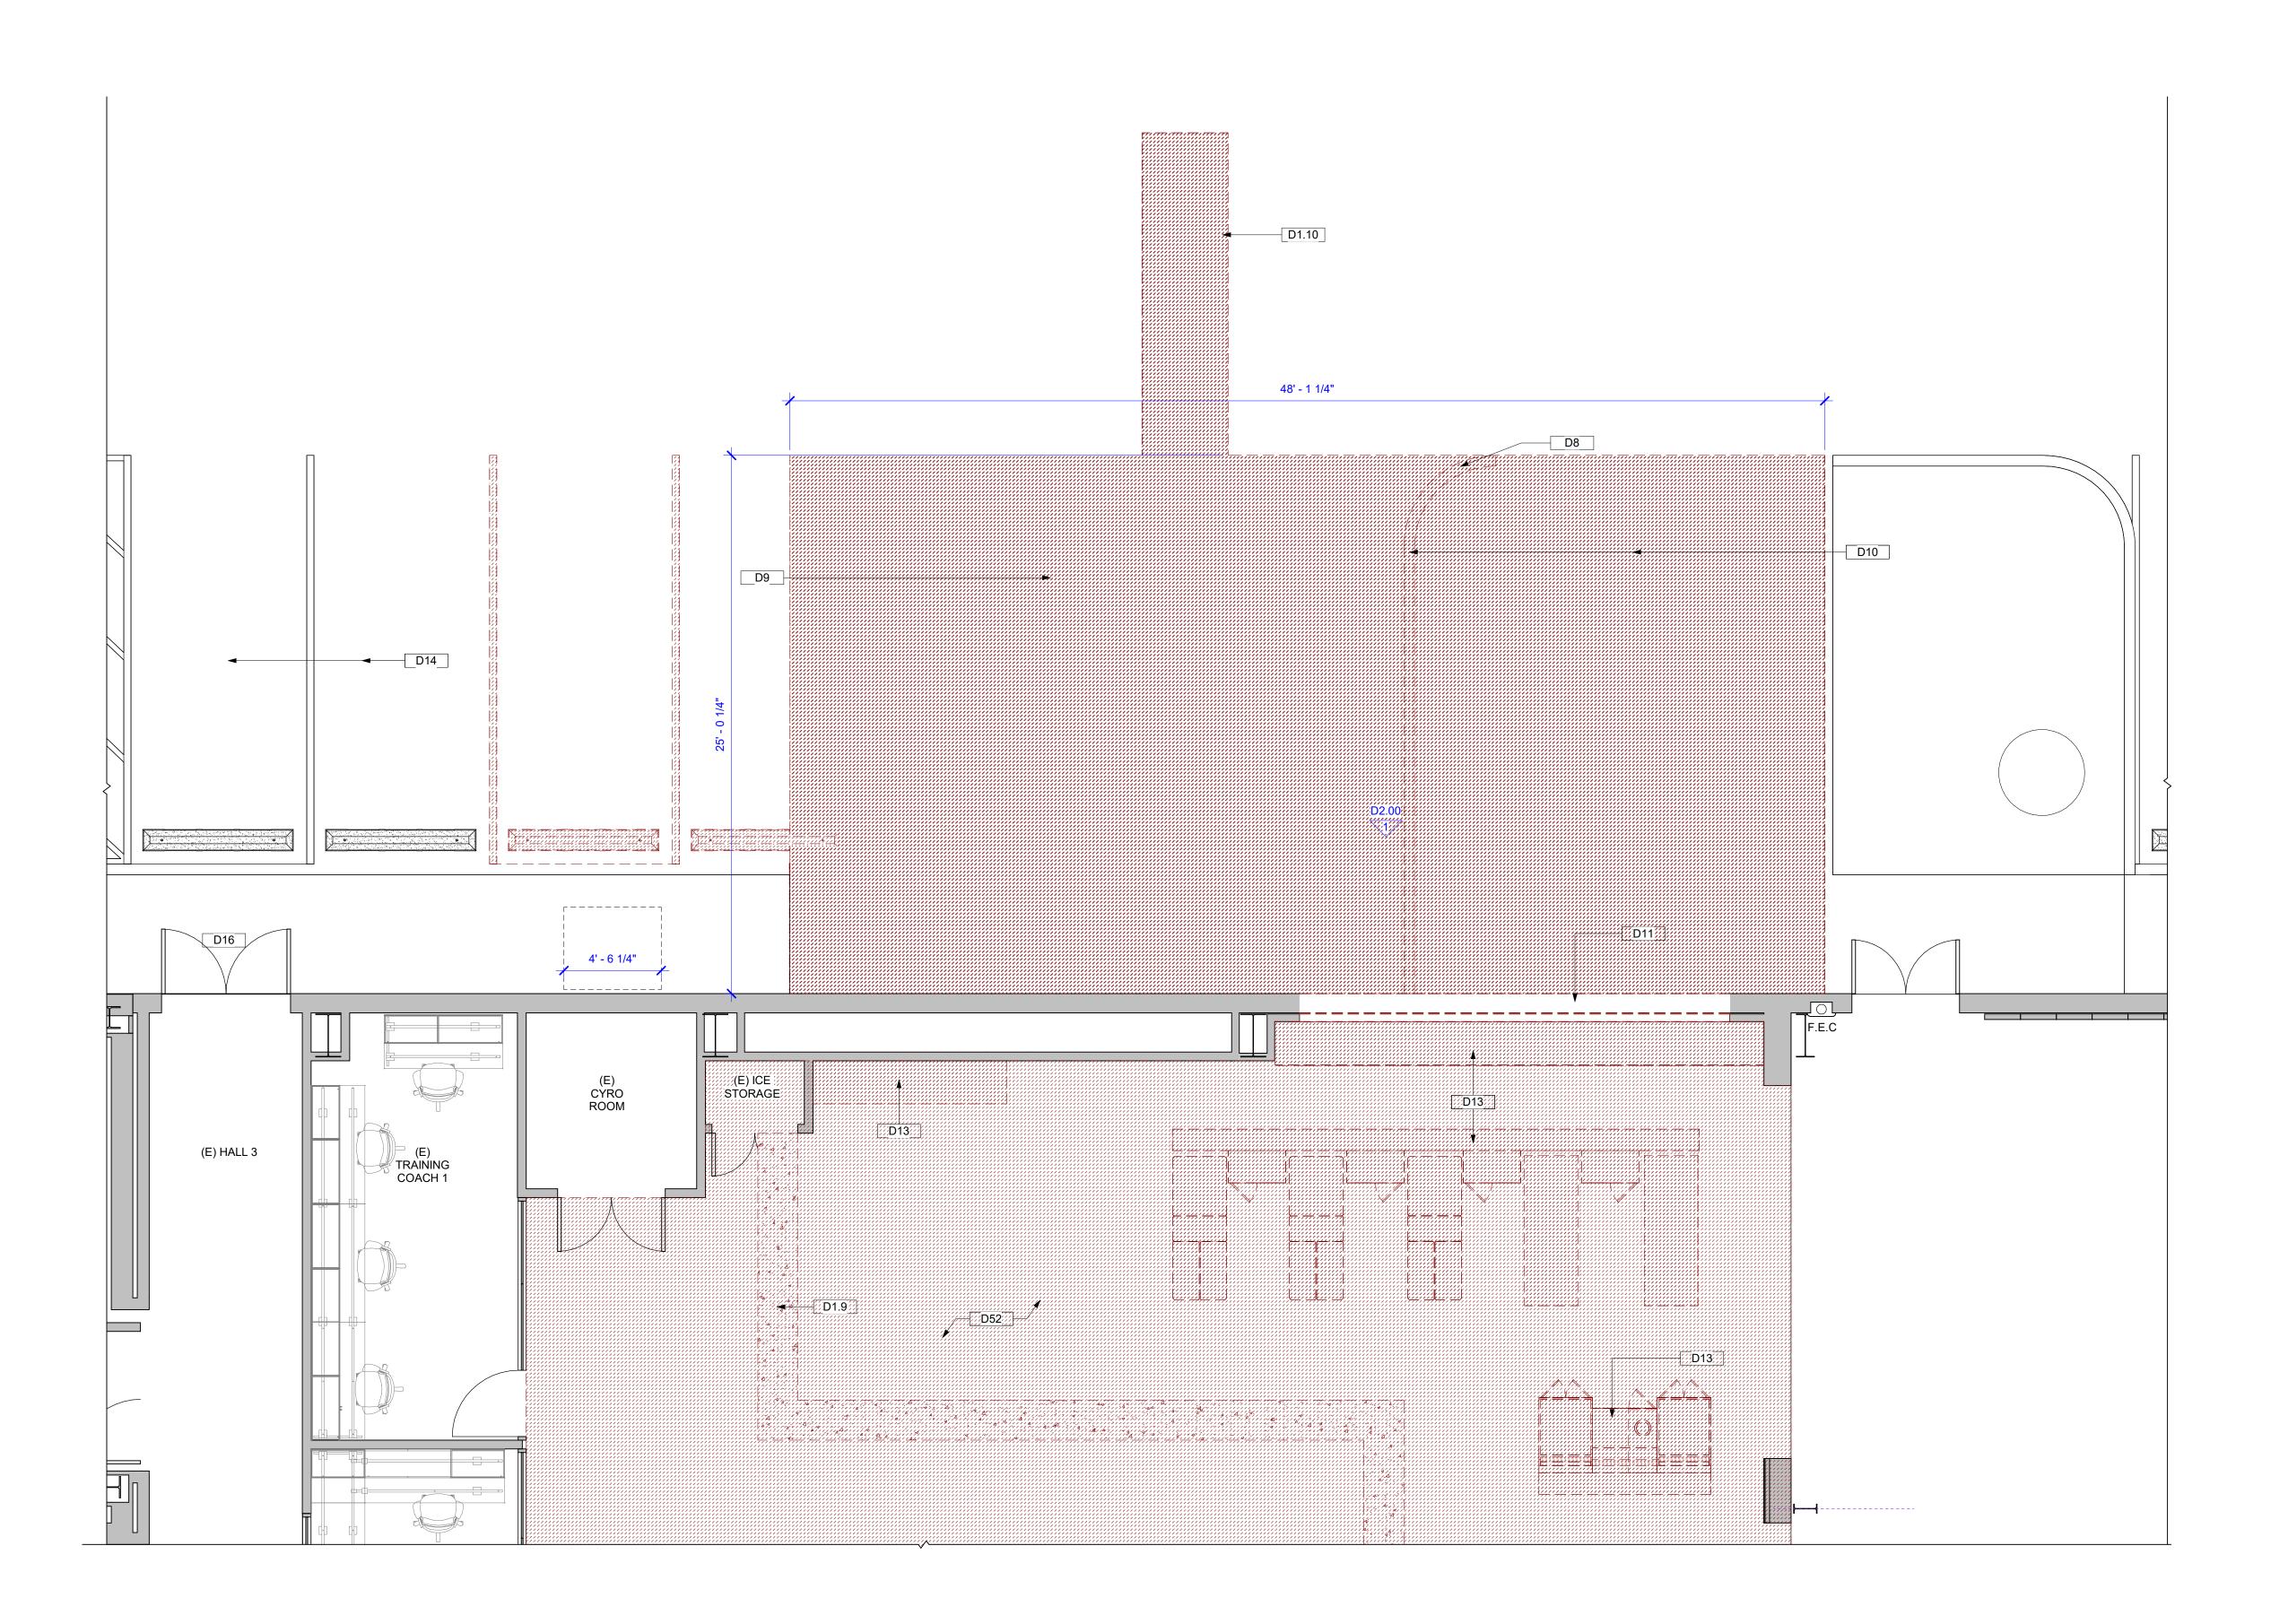

1 DEMO PLAN - OUTDOOR TRAINING
D1.02 1/4" = 1'-0"

DEMOLITION LEGEND

EXISTING WALL TO BE REMOVED



EXISTING MASONRY WALL TO BE REMOVED




EXISTING WALL TO REMAIN

EXISTING FINISH TO BE REMOVED







DEMOLITION PLAN GENERAL NOTES

- ANY DEMOLITION IS TO BE CONDUCTED IN A MANNER AS TO NOT DAMAGE OR FURTHER DESTROY ANY INTERIOR OR EXTERIOR BUILDING MATERIALS.
- 2. ALL PLUMBING FIXTURES, PIPES, DUCTWORK, CONDUIT, ETC. (AS INDICATED BY DASHED LINES) TO BE DEMOLISHED UNLESS OTHERWISE NOTED. REFER TO MECHANICAL, ELECTRICAL, AND PLUMBING DRAWINGS FOR FURTHER DETAILS.
- 3. ALL INTERIOR PARTITIONS (AS INDICATED BY DASHED LINES) SHALL BE DEMOLISHED IN THEIR ENTIRETY, UNLESS OTHERWISE NOTED.
- 4. ALL FINISH MATERIALS FOR WALLS AND FLOORS TO BE REMOVED DOWN TO EXISTING STRUCTURE.
- REMOVE ALL APPLIANCES, MILLWORK, ETC. AS INDICATED BY DASHED LINES.
- REMOVE AND SALVAGE ALL FURNITURE IN AREAS OF WORK. TURN OVER TO OWNER.
- REFER TO D1.00 FOR LOCATIONS OF FLOOR FINISHES TO BE DEMOLISHED.
- REMOVE AND SALVAGE ALL WALL GRAPHICS AND STANDOFF FRAMES ALONG ALL AREAS OF WORK. TURN OVER TO OWNER.

KEYNOTES - DEMOLITION

D1.9	DEMOLISH CONCRETE SLAB IN THIS AREA FOR NI COMPRESSOR AND ELEC. RE: MECH
D1.10	DEMOLISH CONCRETE PARKING TO CONNECT NE AREA DRAINS TO EXIST. STORM WATER LINE IN PARKING LOT
D8	(E) CONCRETE CURB
D9	DEMOLISH PORTION OF SLAB
D10	REMOVE (E) GRAVEL & CONCRETE CURBS
D11	DEMOLISH PORTION OF WALL; PREP FOR

INSTALLATION OF NEW OVERHEAD DOORS D13 SALVAGE AND RELOCATE (E) WEIGHT ROOM MILLWORK & FURNITURE. RE: NEW FLOOR PLANS

D14 (E) PARKING SPACES TO REMAIN (E) DOOR TO REMAIN EXISTING WEIGHT ROOM FLOORING TO BE REMOVED


PELICANS CAMPUS IMPROVEMENTS

woodward design group


1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA

WDG PROJECT NO | AR2315



no. descripton da	

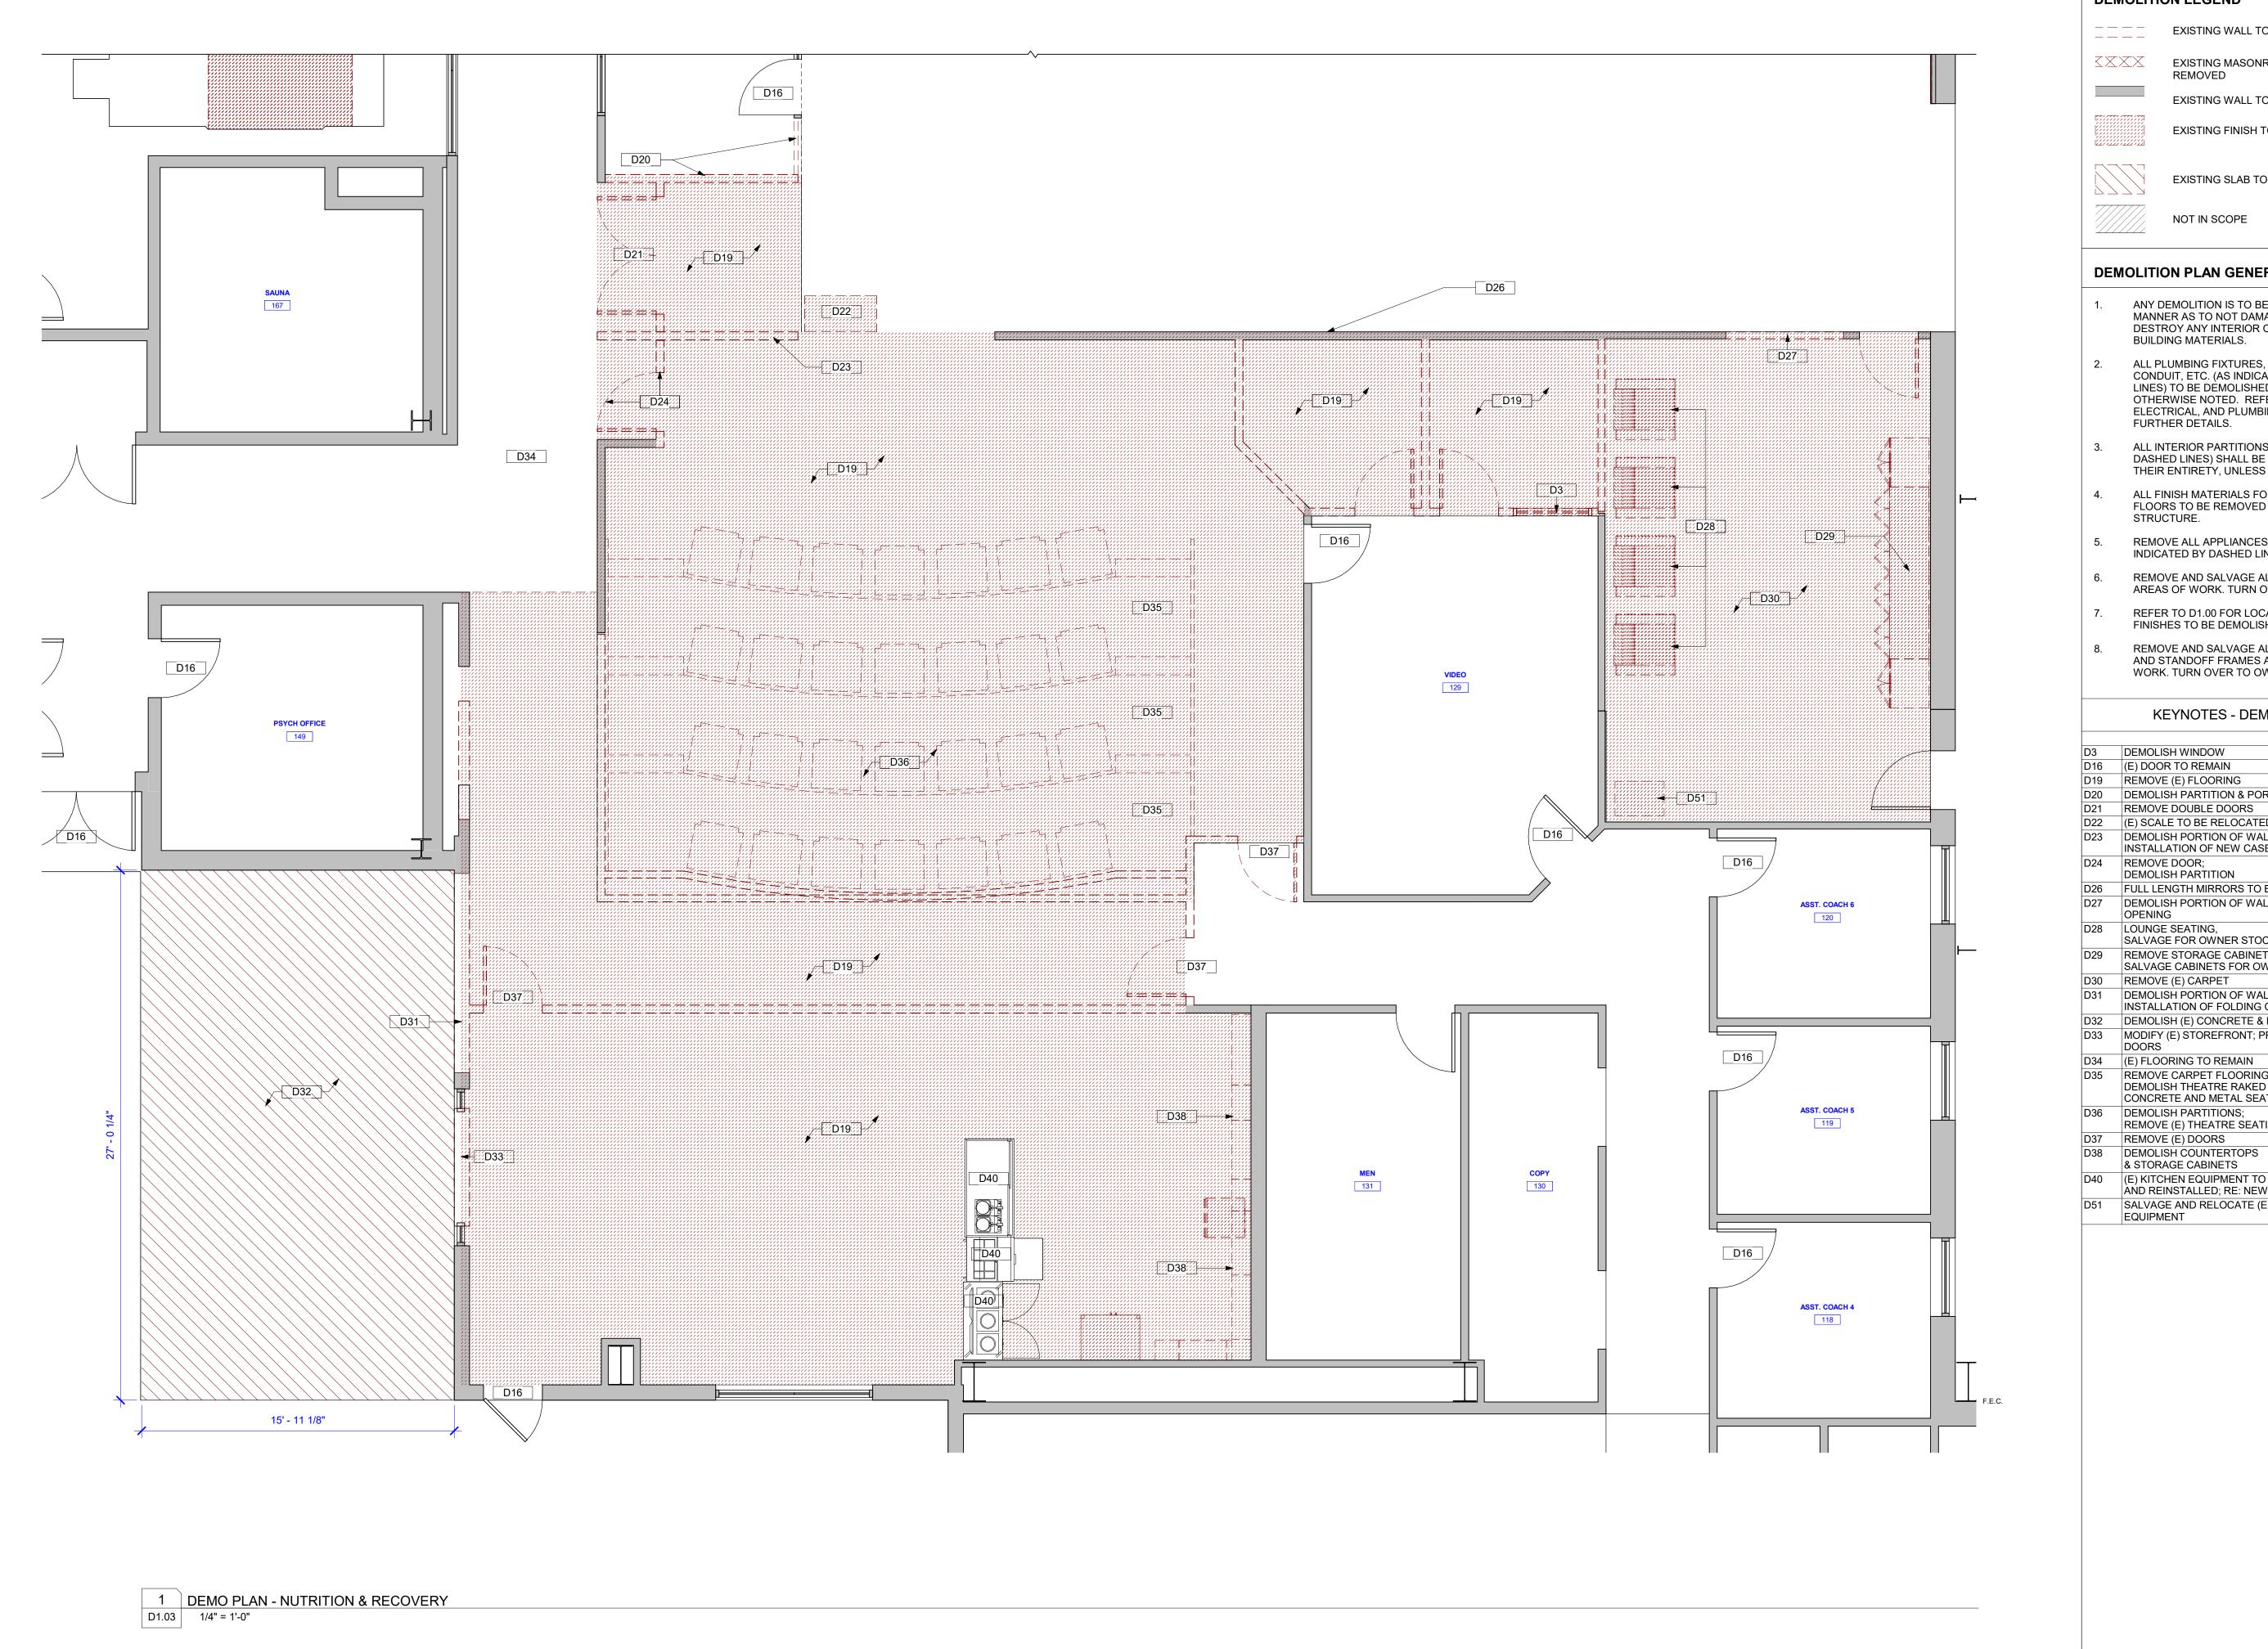


DEMOLITION LEGEND


EXISTING WALL TO BE REMOVED



ZXXX EXISTING MASONRY WALL TO BE REMOVED



EXISTING WALL TO REMAIN



EXISTING SLAB TO BE REMOVED

DEMOLITION PLAN GENERAL NOTES

- ANY DEMOLITION IS TO BE CONDUCTED IN A MANNER AS TO NOT DAMAGE OR FURTHER DESTROY ANY INTERIOR OR EXTERIOR BUILDING MATERIALS.
- 2. ALL PLUMBING FIXTURES, PIPES, DUCTWORK, CONDUIT, ETC. (AS INDICATED BY DASHED LINES) TO BE DEMOLISHED UNLESS OTHERWISE NOTED. REFER TO MECHANICAL, ELECTRICAL, AND PLUMBING DRAWINGS FOR FURTHER DETAILS.
- 3. ALL INTERIOR PARTITIONS (AS INDICATED BY DASHED LINES) SHALL BE DEMOLISHED IN THEIR ENTIRETY, UNLESS OTHERWISE NOTED.
- 4. ALL FINISH MATERIALS FOR WALLS AND FLOORS TO BE REMOVED DOWN TO EXISTING STRUCTURE.
- REMOVE ALL APPLIANCES, MILLWORK, ETC. AS INDICATED BY DASHED LINES.
- REMOVE AND SALVAGE ALL FURNITURE IN AREAS OF WORK. TURN OVER TO OWNER.
- REFER TO D1.00 FOR LOCATIONS OF FLOOR FINISHES TO BE DEMOLISHED.
- REMOVE AND SALVAGE ALL WALL GRAPHICS AND STANDOFF FRAMES ALONG ALL AREAS OF WORK. TURN OVER TO OWNER.

KEYNOTES - DEMOLITION

D3	DEMOLISH WINDOW
D16	(E) DOOR TO REMAIN
D19	REMOVE (E) FLOORING
D20	DEMOLISH PARTITION & PORTION OF STOREFRONT
D21	REMOVE DOUBLE DOORS
D22	(E) SCALE TO BE RELOCATED
D23	DEMOLISH PORTION OF WALL; PREP FOR INSTALLATION OF NEW CASED OPENING
D24	REMOVE DOOR; DEMOLISH PARTITION
D26	FULL LENGTH MIRRORS TO BE REMOVED
D27	DEMOLISH PORTION OF WALL FOR NEW CASED OPENING
D28	LOUNGE SEATING, SALVAGE FOR OWNER STOCK
D29	REMOVE STORAGE CABINETS & COUNTERTOP; SALVAGE CABINETS FOR OWNER STOCK
D30	REMOVE (E) CARPET
D31	DEMOLISH PORTION OF WALL; PREP FOR INSTALLATION OF FOLDING GLASS WALL
D32	DEMOLISH (E) CONCRETE & LANDSCAPING
D33	MODIFY (E) STOREFRONT; PREP FOR NEW DOUBLE DOORS
D34	(E) FLOORING TO REMAIN
D35	REMOVE CARPET FLOORING; DEMOLISH THEATRE RAKED FLOOR & STEPPED CONCRETE AND METAL SEATING STRUCTURE
D36	DEMOLISH PARTITIONS; REMOVE (E) THEATRE SEATING
D37	REMOVE (E) DOORS

(E) KITCHEN EQUIPMENT TO BE SALVAGED, STORED AND REINSTALLED; RE: NEW FLOOR PLAN

SALVAGE AND RELOCATE (E) THERALIGHT

EQUIPMENT

PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana

woodward design group


1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA


WDG PROJECT NO | AR2315





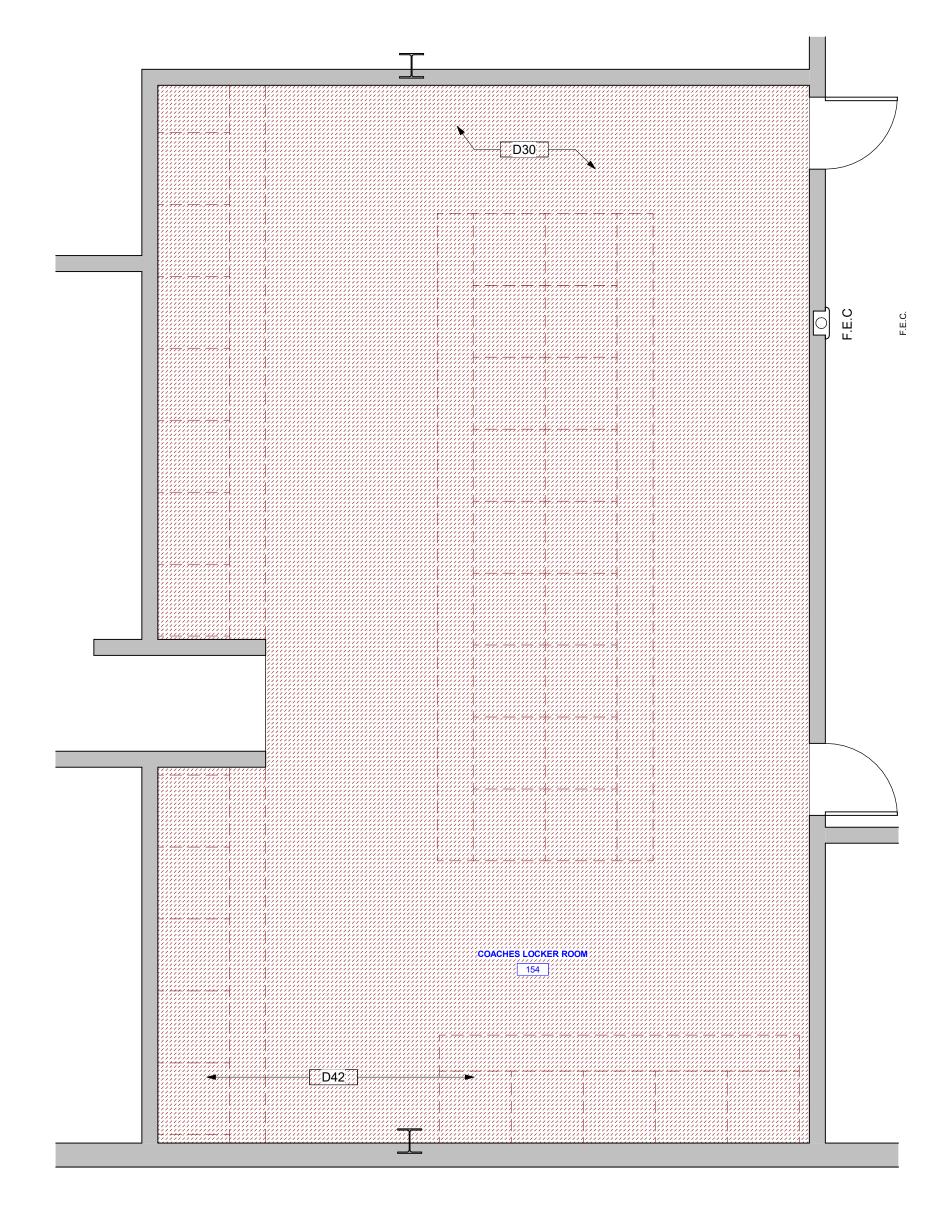

1 DEMO PLAN - COACHES' LOCKER ROOM
D1.04 1/4" = 1'-0"

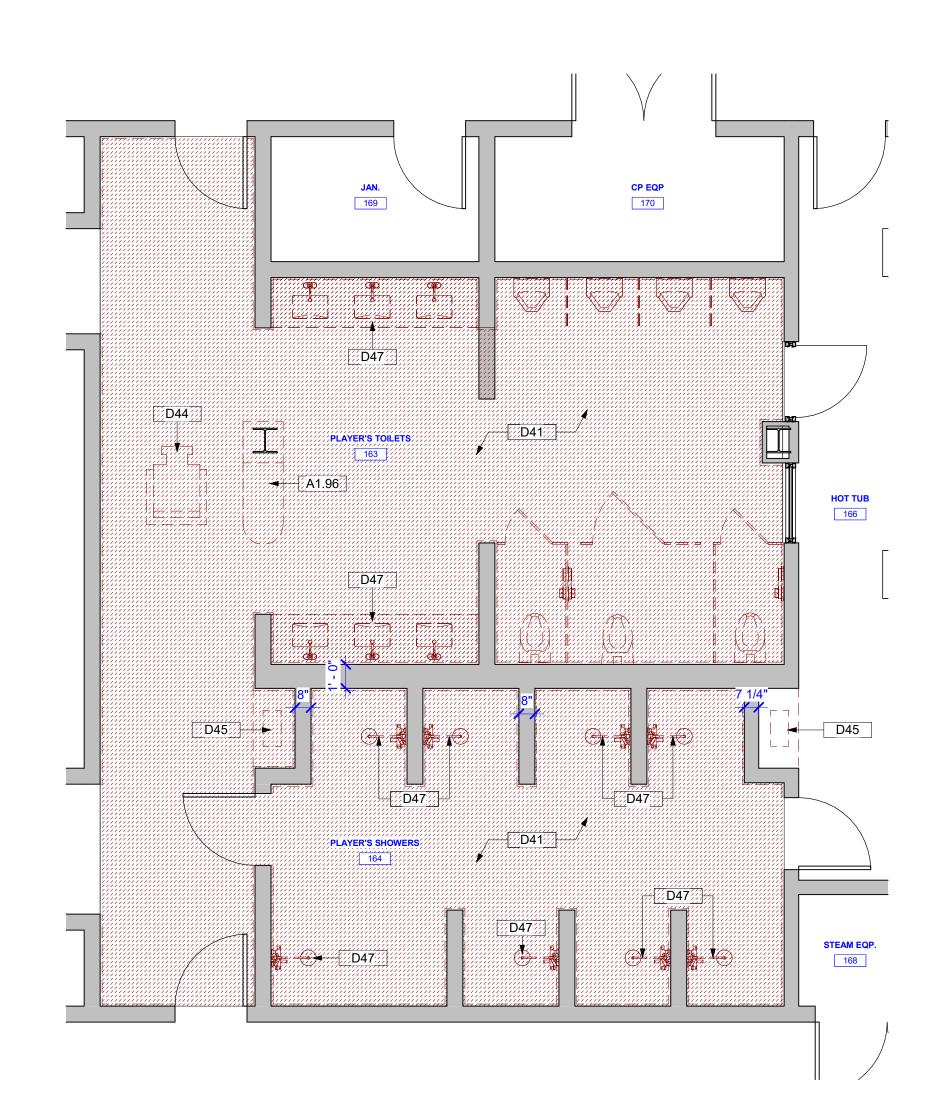

2 DEMO PLAN - PLAYERS' RESTROOM D1.04 1/4" = 1'-0"

DEMOLITION LEGEND

EXISTING WALL TO BE REMOVED



ZXXX EXISTING MASONRY WALL TO BE

EXISTING WALL TO REMAIN



REMOVED



EXISTING FINISH TO BE REMOVED



EXISTING SLAB TO BE REMOVED

DEMOLITION PLAN GENERAL NOTES

- ANY DEMOLITION IS TO BE CONDUCTED IN A MANNER AS TO NOT DAMAGE OR FURTHER DESTROY ANY INTERIOR OR EXTERIOR BUILDING MATERIALS.
- 2. ALL PLUMBING FIXTURES, PIPES, DUCTWORK, CONDUIT, ETC. (AS INDICATED BY DASHED LINES) TO BE DEMOLISHED UNLESS OTHERWISE NOTED. REFER TO MECHANICAL, ELECTRICAL, AND PLUMBING DRAWINGS FOR FURTHER DETAILS.
- 3. ALL INTERIOR PARTITIONS (AS INDICATED BY DASHED LINES) SHALL BE DEMOLISHED IN THEIR ENTIRETY, UNLESS OTHERWISE NOTED.
- 4. ALL FINISH MATERIALS FOR WALLS AND FLOORS TO BE REMOVED DOWN TO EXISTING STRUCTURE.
- REMOVE ALL APPLIANCES, MILLWORK, ETC. AS INDICATED BY DASHED LINES.
- 6. REMOVE AND SALVAGE ALL FURNITURE IN AREAS OF WORK. TURN OVER TO OWNER.
- REFER TO D1.00 FOR LOCATIONS OF FLOOR
- FINISHES TO BE DEMOLISHED.
- REMOVE AND SALVAGE ALL WALL GRAPHICS AND STANDOFF FRAMES ALONG ALL AREAS OF WORK. TURN OVER TO OWNER.

KEYNOTES - DEMOLITION

D30	REMOVE (E) CARPET
D41	REMOVE (E) FLOOR & WALL TILE
D42	REMOVE (E) LOCKERS
	SALVAGE EXISTING BARBER CHAIR. NEW LOCATION TO BE DETERMINED
D45	DEMOLISH EXISTING TOWEL DROP
D47	DEMOLISH EXISTING FIXTURES AND COUNTERTOP

PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana

woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443


Erik Wismar, AIA

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024



REVIS	SIONS			
no.	descripton	date		
DEMO PLAN				

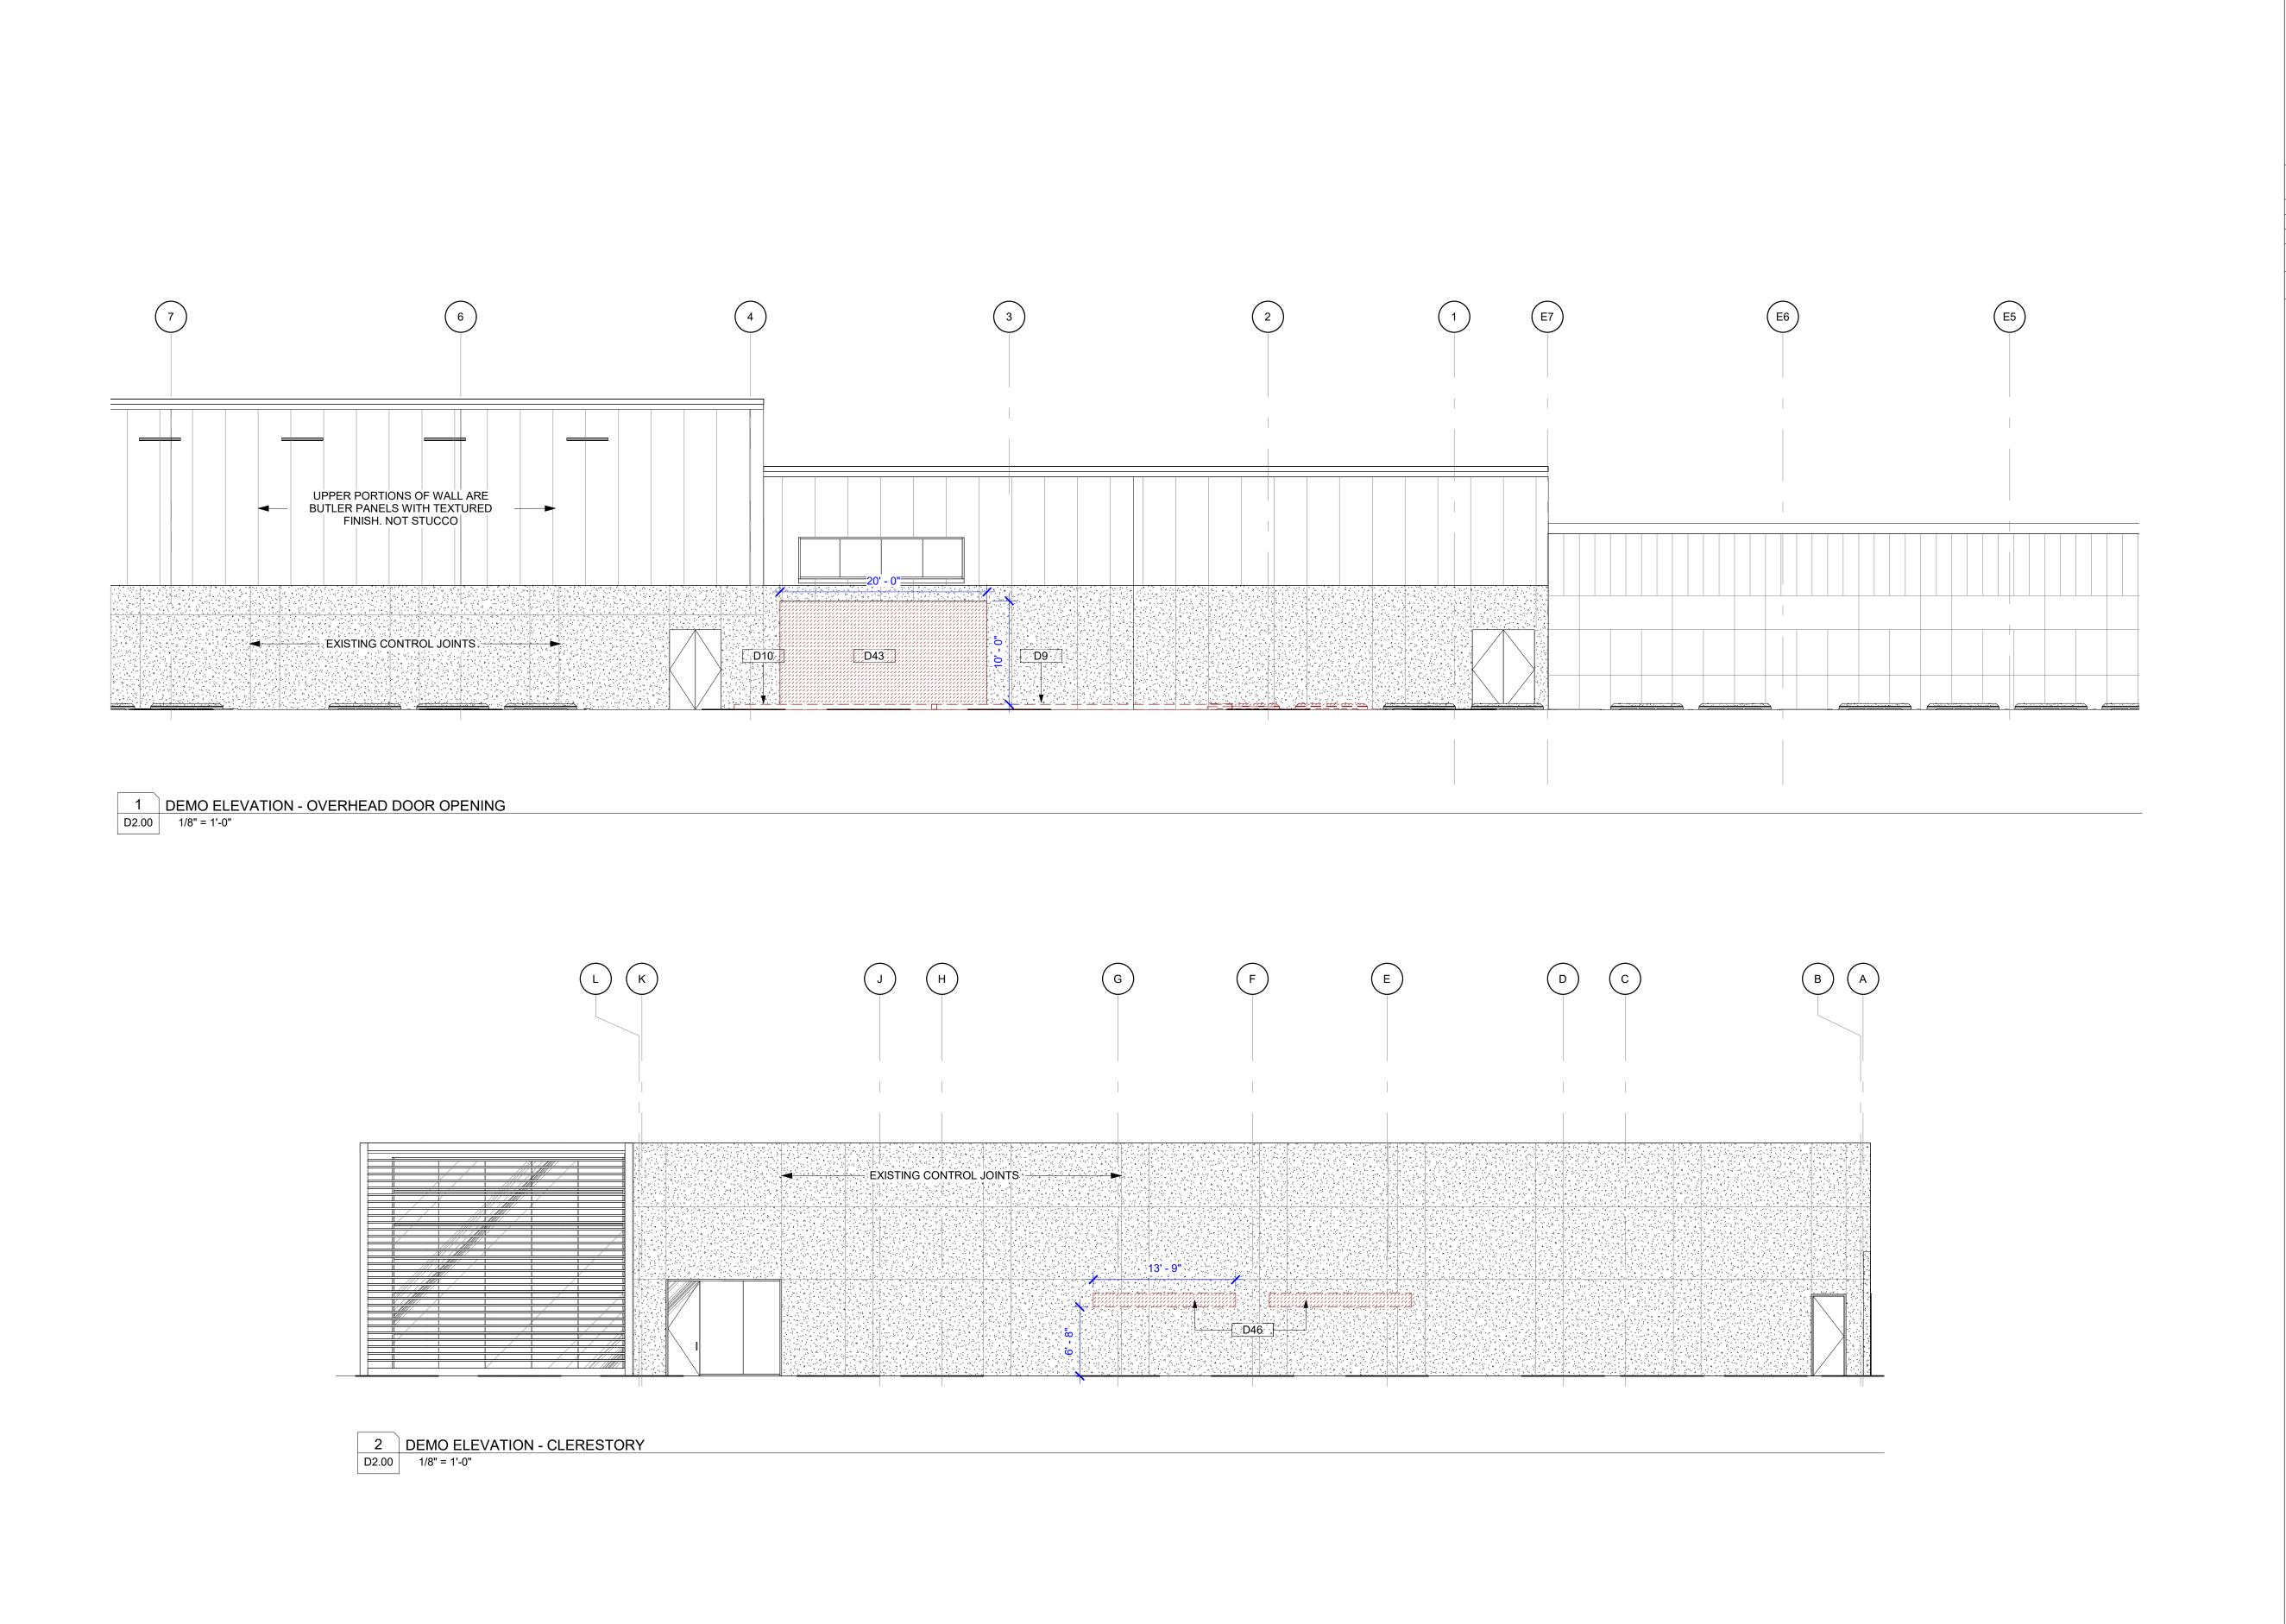

DEMOLITION LEGEND

EXISTING WALL TO BE REMOVED

EXISTING MASONRY WALL TO BE REMOVED

EXISTING WALL TO REMAIN



EXISTING FINISH TO BE REMOVED





EXISTING SLAB TO BE REMOVED

NOT IN SCOPE

KEYNOTES - DEMOLITION

DEMOLISH PORTION OF SLAB
REMOVE (E) GRAVEL & CONCRETE CURB
DEMOLISH WALL FOR O.H. SECTIONAL DOOR. RE: STRUCT.
DEMOLISH PORTION OF WALL FOR

CLERESTORY WINDOWS. RE STRUCT.

PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana


woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443


Erik Wismar, AIA

WDG PROJECT NO | AR2315



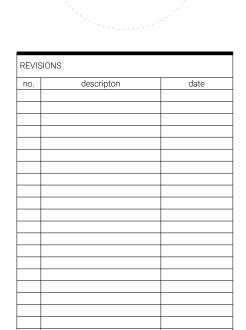


DEMO EXTERIOR ELEVATIONS

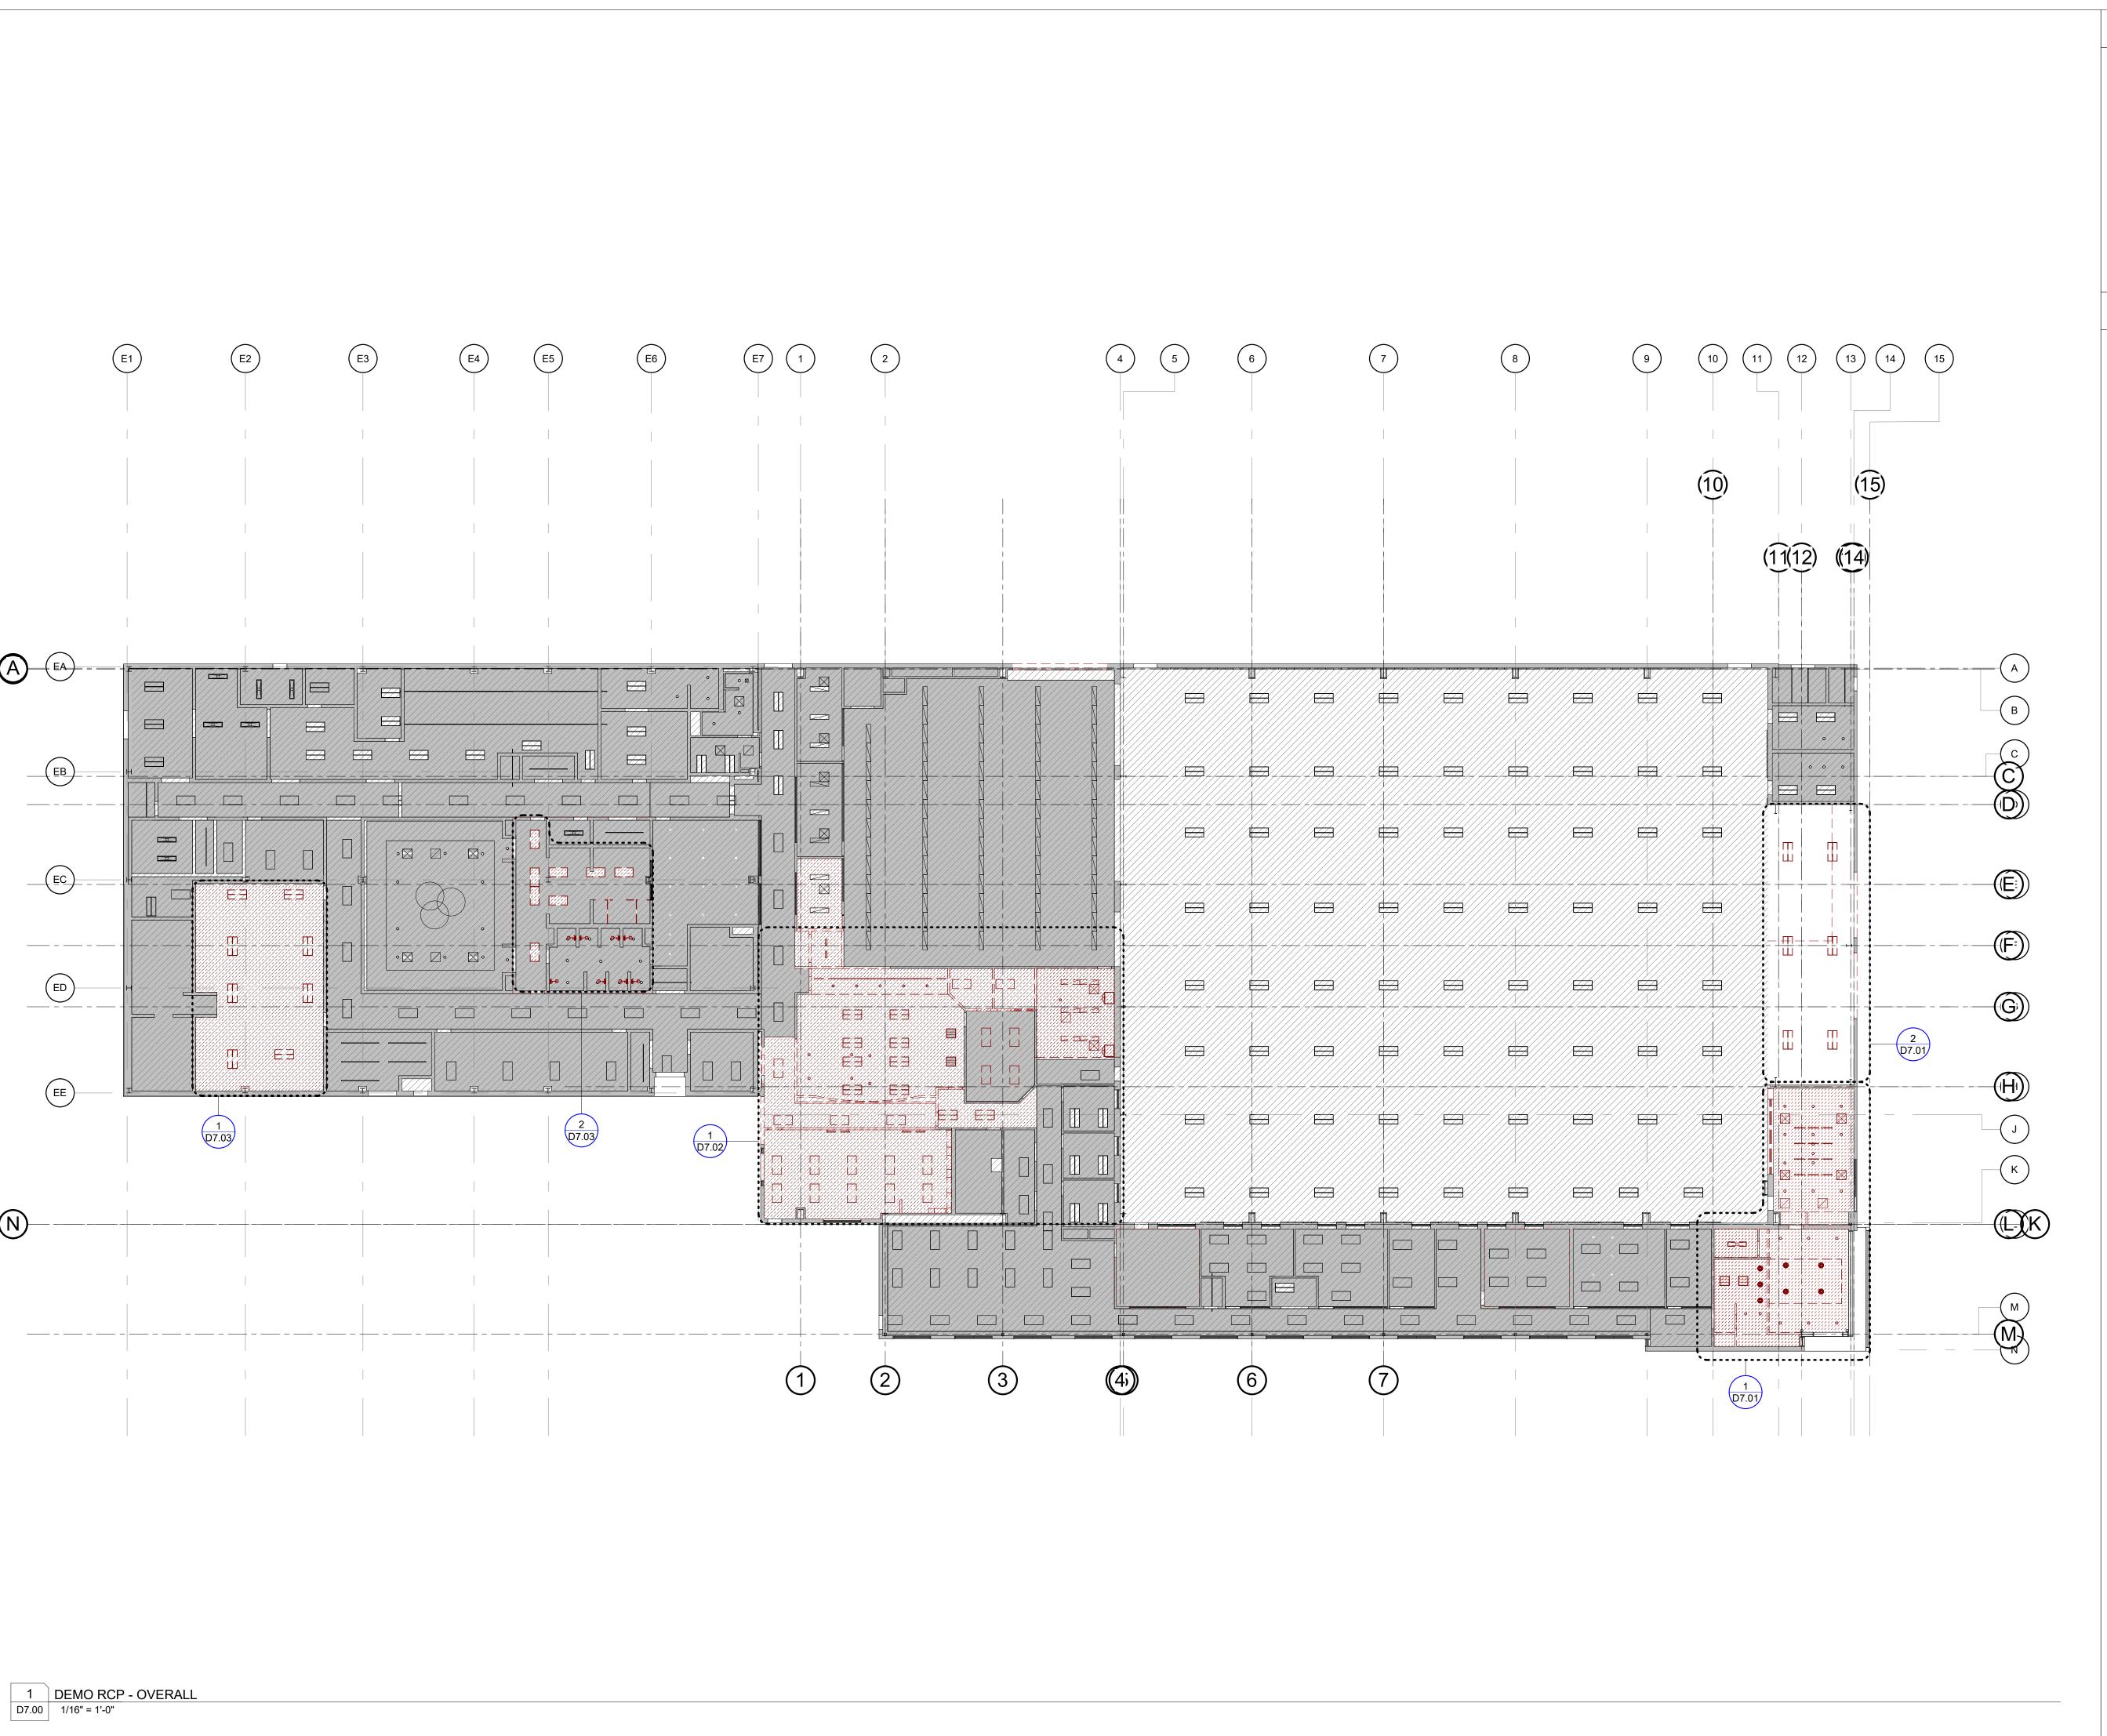

---- EXISTING WALL TO BE DEMOLISHED



EXISTING MASONRY WALL TO BE DEMOLISHED



EXISTING CEILING TO BE DEMOLISHED



woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443 Erik Wismar, AIA


RCP GENERAL DEMOLITION NOTES

- INTERIOR GYPSUM BOARD CEILINGS, SOFFITS AND ACOUSTIC CEILING TILE (ACT) CEILINGS TO BE REMOVED IN THEIR ENTIRETY, INCLUDING ALL FRAMING AND SUPPORTS WHERE INDICATED.
- DEMOLISH ALL LIGHT FIXTURES AS INDICATED BY DASHED LINES.
- PROTECT ALL ADJACENT AND NEARBY SURFACES SCHEDULED TO REMAIN.
- THE RENOVATION WORK SHALL REMAIN FULLY SPRINKLERED DURING DEMOLITION AND CONSTRUCTION. ALL SHUT DOWN REQUIRED TO RELOCATE, CAP, OR REMOVE EXISTING PIPING SHALL BE COORDINATED TO BE DONE AT A TIME AGREED TO BY THE OWNER. CONTRACTOR IS RESPONSIBLE FOR PROVIDING A FIRE WATCH AS REQUIRED BY THE STATE FIRE MARSHAL.

PELICANS CAMPUS IMPROVEMENTS

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024



10.	descripton	date
10.	descriptori	uate

OVERALL DEMO RCP



EXISTING WALL TO BE DEMOLISHED



ZXXX EXISTING MASONRY WALL TO BE DEMOLISHED



EXISTING WALL TO REMAIN



EXISTING CEILING TO BE DEMOLISHED



woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443 Erik Wismar, AIA

RCP GENERAL DEMOLITION NOTES

- 1. INTERIOR GYPSUM BOARD CEILINGS, SOFFITS AND ACOUSTIC CEILING TILE (ACT) CEILINGS TO BE REMOVED IN THEIR ENTIRETY, INCLUDING ALL FRAMING AND SUPPORTS WHERE INDICATED.
- DEMOLISH ALL LIGHT FIXTURES AS INDICATED BY DASHED LINES.
- PROTECT ALL ADJACENT AND NEARBY SURFACES SCHEDULED TO REMAIN.
- THE RENOVATION WORK SHALL REMAIN FULLY SPRINKLERED DURING DEMOLITION AND CONSTRUCTION. ALL SHUT DOWN REQUIRED TO RELOCATE, CAP, OR REMOVE EXISTING PIPING SHALL BE COORDINATED TO BE DONE AT A TIME AGREED TO BY THE OWNER. CONTRACTOR IS RESPONSIBLE FOR PROVIDING A FIRE WATCH AS REQUIRED BY THE STATE FIRE MARSHAL.

KEYNOTES - DEMOLITION

D7.01 REMOVE LIGHT FIXTURES AND ASSOCIATED MOUNTING HARDWARE D7.02 REMOVE ACT CEILING GRID AND TILES D7.03 REMOVE LIGHT FIXTURES D7.04 DEMOLISH GWB CEILING AND SOFFIT

D7.05 REROUTE SPRINKLER LINES

PELICANS CAMPUS IMPROVEMENTS

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024



DEMO RCP



EXISTING WALL TO BE DEMOLISHED



₹XXX EXISTING MASONRY WALL TO BE DEMOLISHED



EXISTING WALL TO REMAIN



EXISTING CEILING TO BE DEMOLISHED

woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA

RCP GENERAL DEMOLITION NOTES

- INTERIOR GYPSUM BOARD CEILINGS, SOFFITS AND ACOUSTIC CEILING TILE (ACT) CEILINGS TO BE REMOVED IN THEIR ENTIRETY, INCLUDING ALL FRAMING AND SUPPORTS WHERE INDICATED.
- DEMOLISH ALL LIGHT FIXTURES AS INDICATED BY DASHED LINES.
- PROTECT ALL ADJACENT AND NEARBY SURFACES SCHEDULED TO REMAIN.
- 4. THE RENOVATION WORK SHALL REMAIN FULLY SPRINKLERED DURING DEMOLITION AND CONSTRUCTION. ALL SHUT DOWN REQUIRED TO RELOCATE, CAP, OR REMOVE EXISTING PIPING SHALL BE COORDINATED TO BE DONE AT A TIME AGREED TO BY THE OWNER. CONTRACTOR IS RESPONSIBLE FOR PROVIDING A FIRE WATCH AS REQUIRED BY THE STATE FIRE MARSHAL.

KEYNOTES - DEMOLITION

D7.01 REMOVE LIGHT FIXTURES AND ASSOCIATED MOUNTING HARDWARE


D7.04 DEMOLISH GWB CEILING AND SOFFIT

PELICANS CAMPUS IMPROVEMENTS

WDG PROJECT NO | AR2315 CONSTRUCTION DOCUMENTS 04.15.2024

DEMO RCP

D7.02

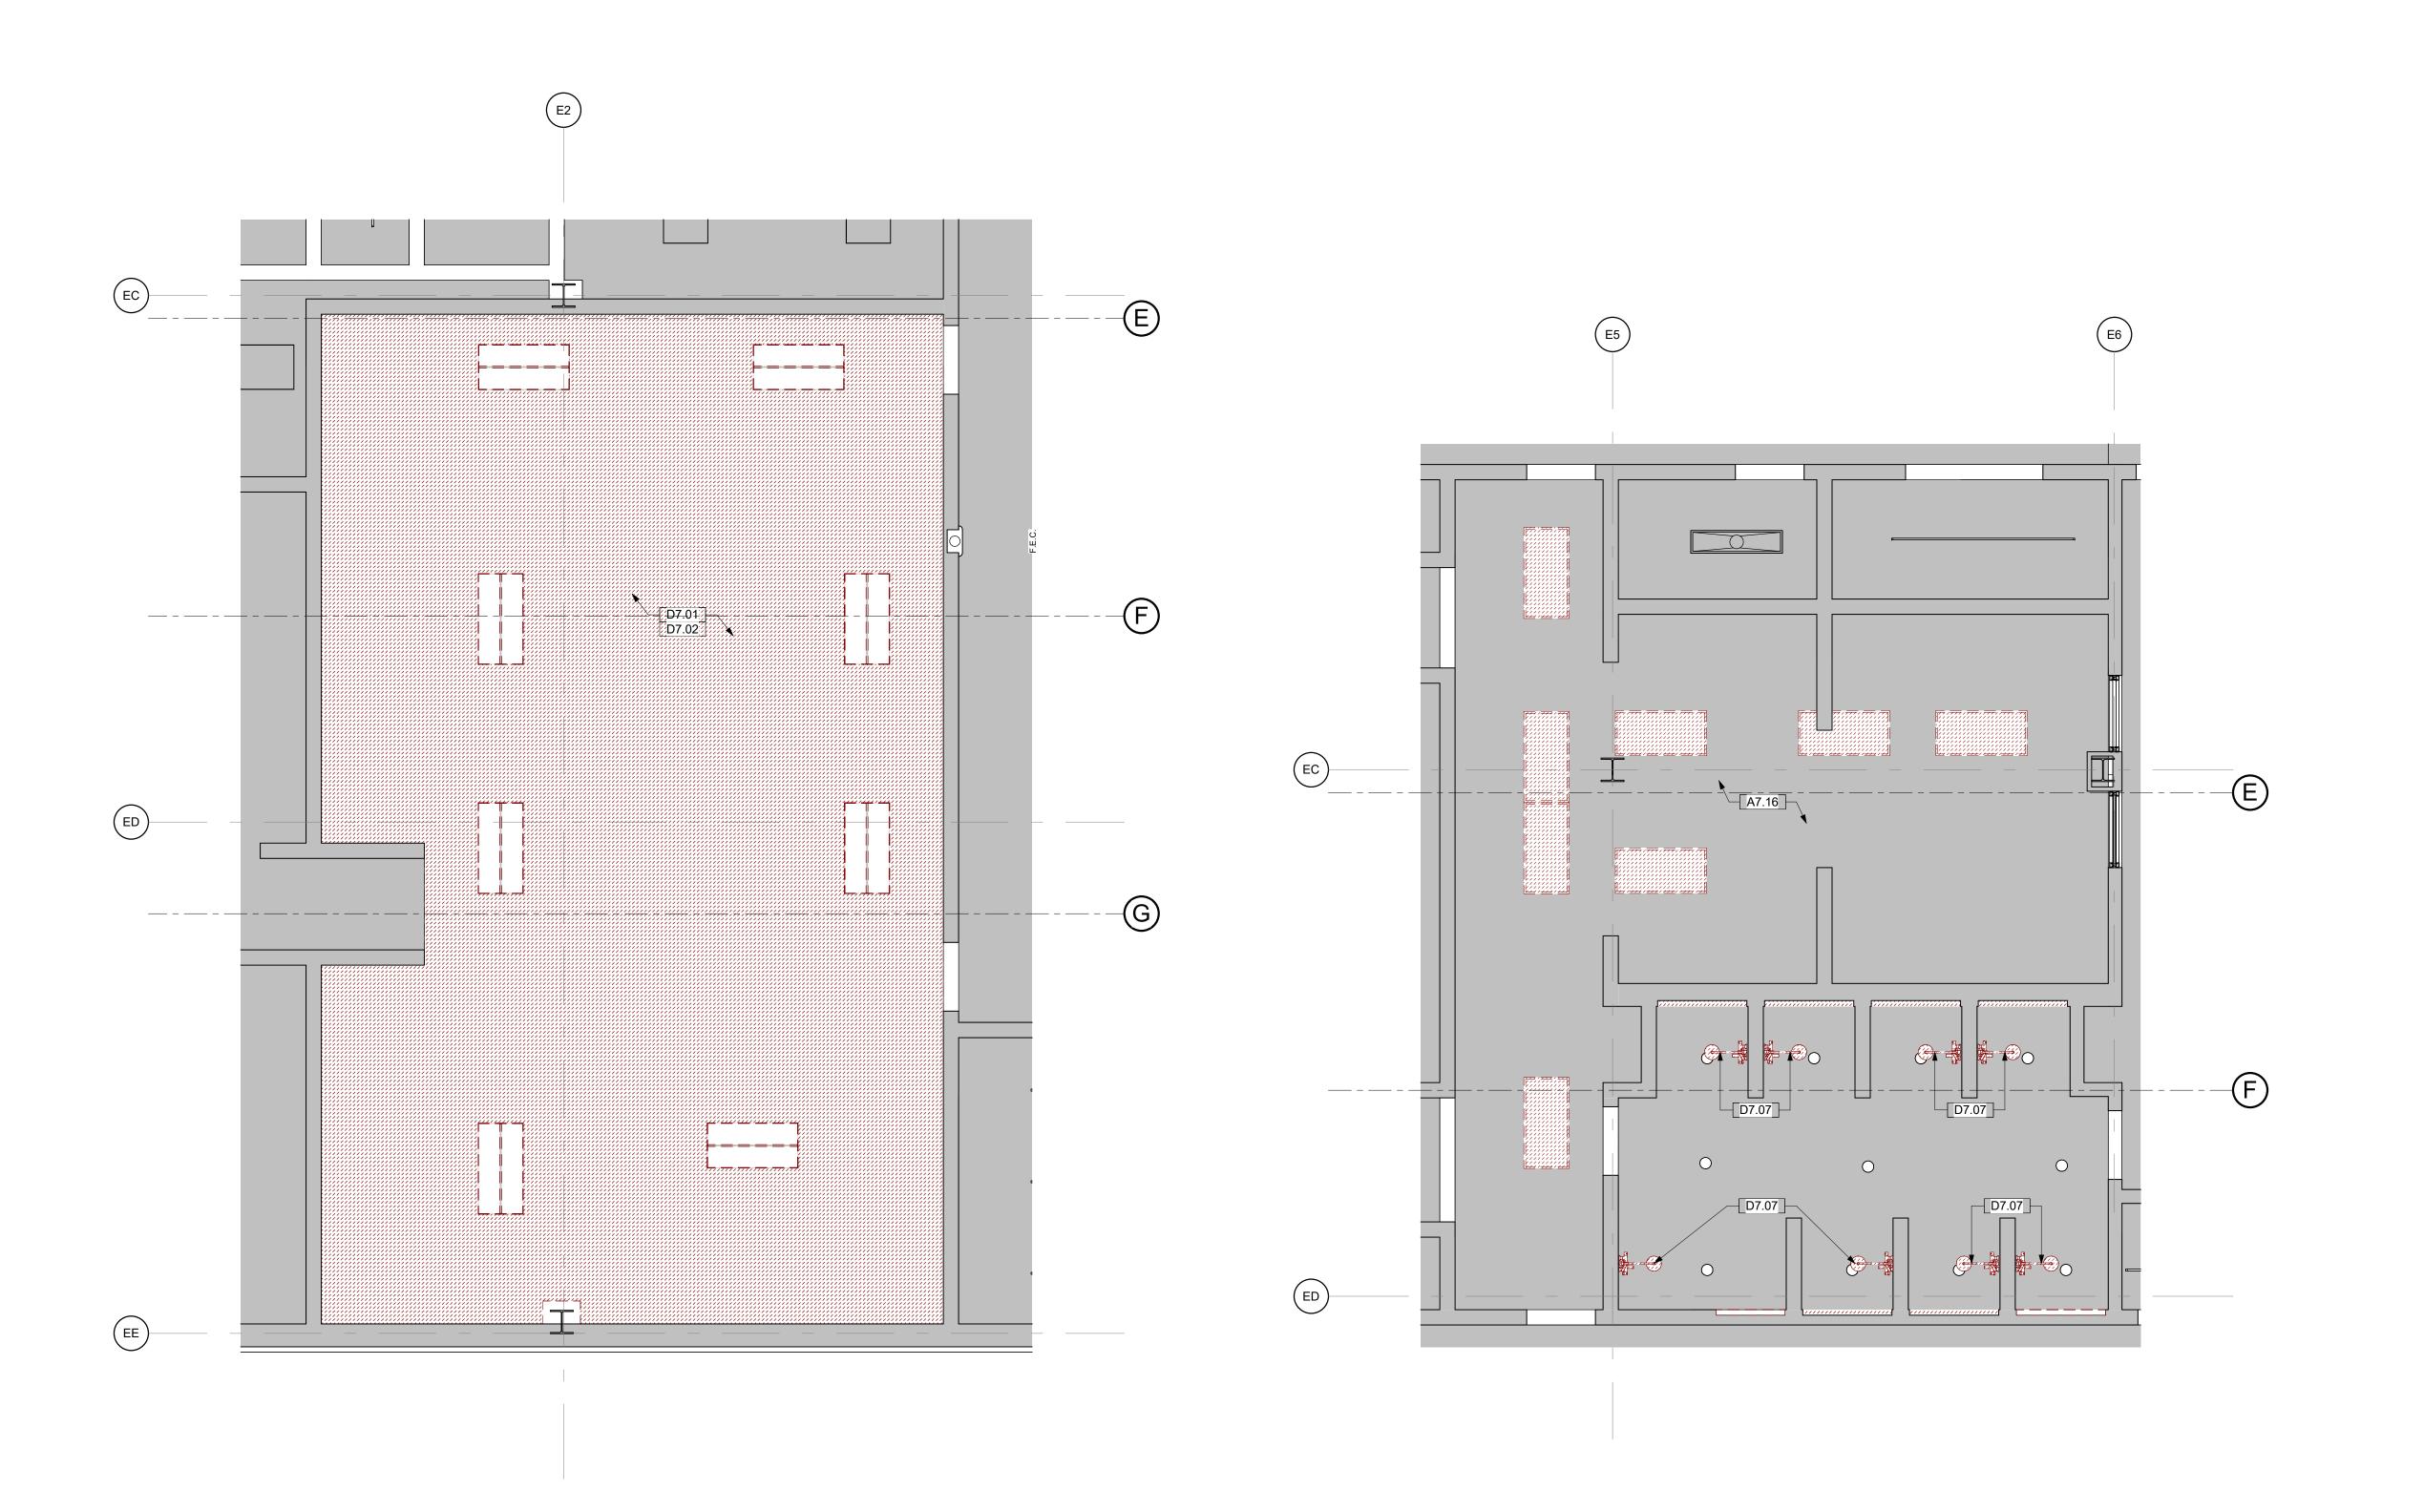


EXISTING WALL TO BE DEMOLISHED



ZXXX EXISTING MASONRY WALL TO BE



DEMOLISHED



EXISTING CEILING TO BE DEMOLISHED



Erik Wismar, AIA

RCP GENERAL DEMOLITION NOTES

- INTERIOR GYPSUM BOARD CEILINGS, SOFFITS
 AND ACOUSTIC CEILING TILE (ACT) CEILINGS TO
 BE REMOVED IN THEIR ENTIRETY, INCLUDING ALL FRAMING AND SUPPORTS WHERE INDICATED.
- DEMOLISH ALL LIGHT FIXTURES AS INDICATED BY DASHED LINES.
- PROTECT ALL ADJACENT AND NEARBY SURFACES SCHEDULED TO REMAIN.
- 4. THE RENOVATION WORK SHALL REMAIN FULLY SPRINKLERED DURING DEMOLITION AND CONSTRUCTION. ALL SHUT DOWN REQUIRED TO RELOCATE, CAP, OR REMOVE EXISTING PIPING SHALL BE COORDINATED TO BE DONE AT A TIME AGREED TO BY THE OWNER. CONTRACTOR IS RESPONSIBLE FOR PROVIDING A FIRE WATCH AS REQUIRED BY THE STATE FIRE MARSHAL.


KEYNOTES - DEMOLITION

D7.01 REMOVE LIGHT FIXTURES AND ASSOCIATED MOUNTING HARDWARE D7.02 REMOVE ACT CEILING GRID AND TILES


D7.07 REMOVE EXISTING SHOWER FIXTURE

PELICANS CAMPUS IMPROVEMENTS

WDG PROJECT NO | AR2315



DEMO RCP

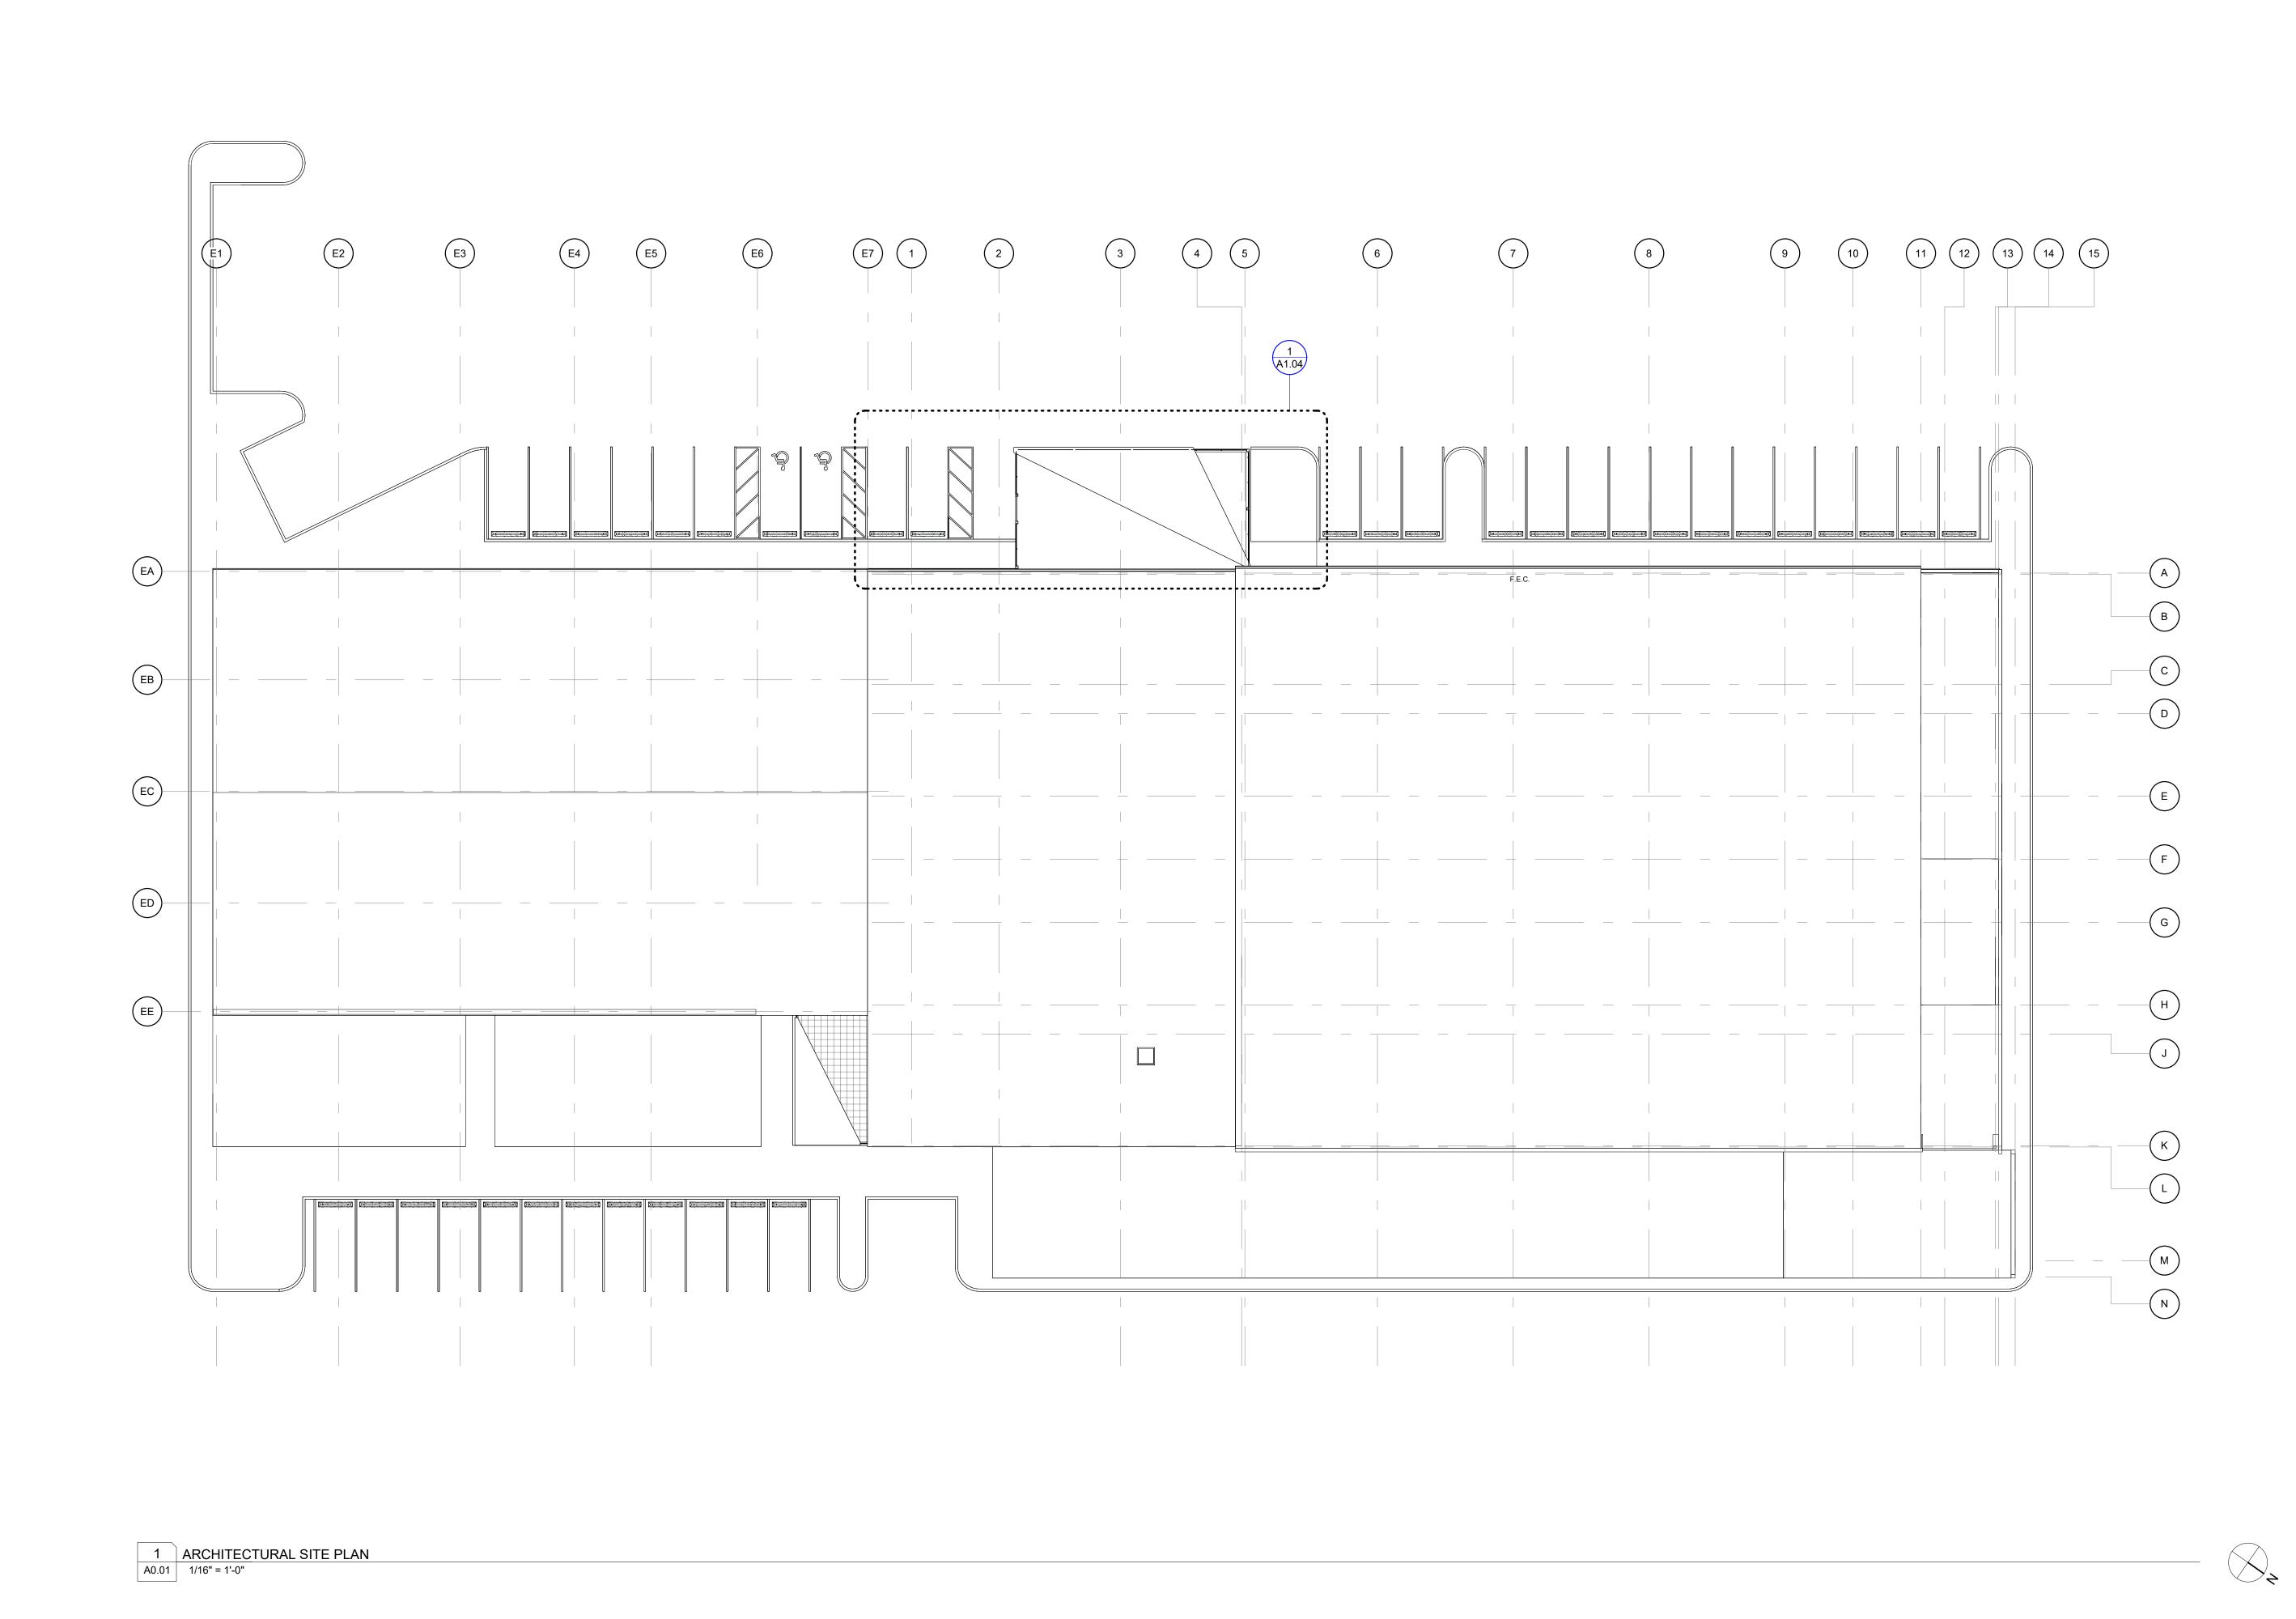

PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana

WDG PROJECT NO | AR2315


CONSTRUCTION DOCUMENTS 04.15.2024


CONSTRUCTION DOCUMENTS 04.13.2


REVISIONS


no. descripton date

ARCHITECTURAL SITE PLAN

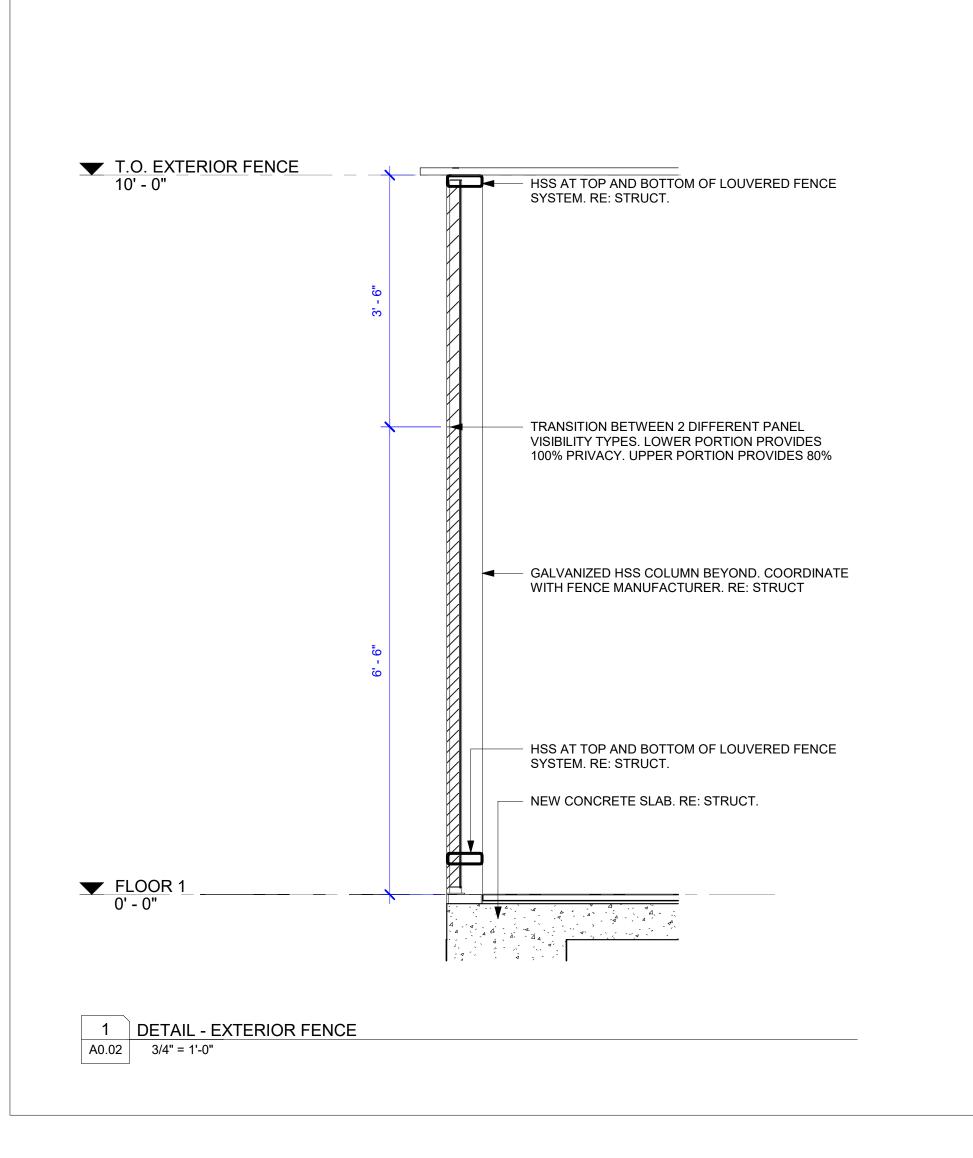

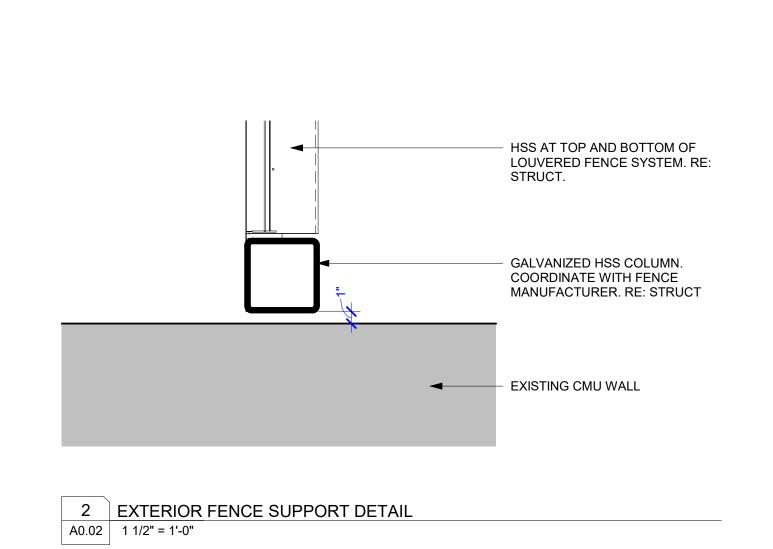

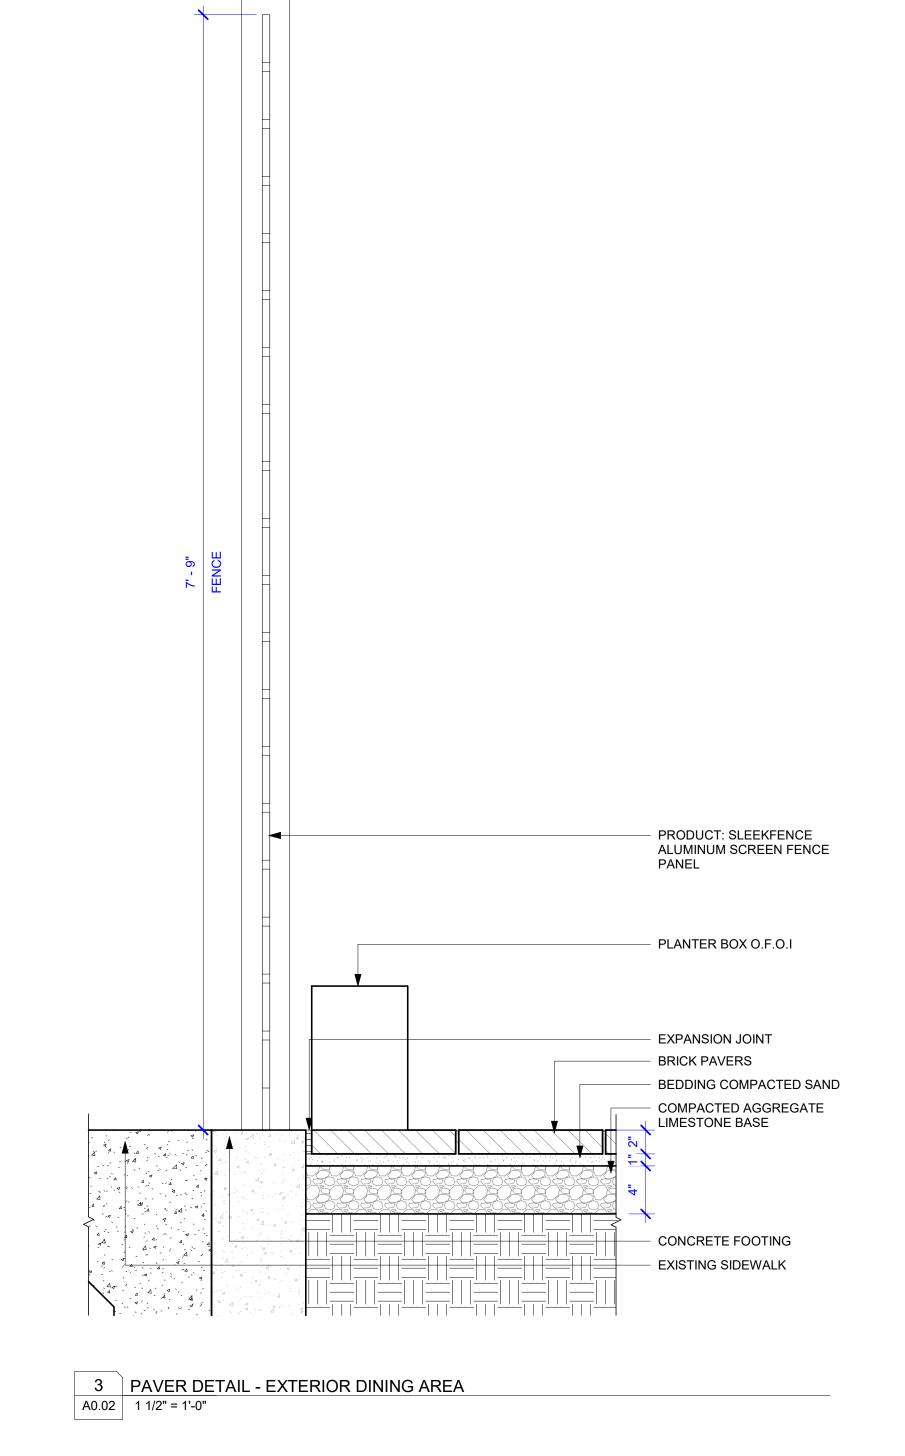

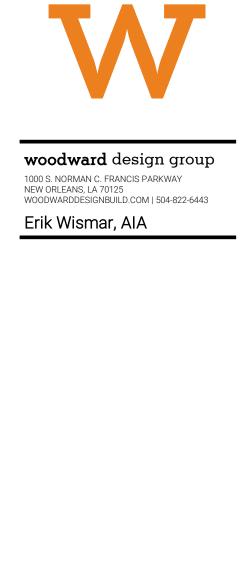

PELICANS CAMPUS IMPROVEMENTS

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024

SITE DETAILS



EXISTING WALL TO REMAIN

NEW CONSTRUCTION - MASONRY WALL

NEW CONSTRUCTION - STUD WALL

NOT IN SCOPE

GENERAL NOTES

- 1. SEE PROJECT INFO. SHEET G0.01 FOR ALL GENERAL NOTES PERTAINING TO PROJECT.
- 2. REFER TO SHEET A6.00 FOR PARTITION
- 3. REFER TO SHEET A6.20 FOR DOOR TYPES.
- REFER TO SHEET A6.30 FOR STOREFRONT
- DIMENSIONS ARE FROM FINISHED FACE OF WALL TO FINISHED FACE OF WALL.
- ALL DOORS ARE 6" CLR. FROM FINISHED FACE OF WALL U.N.O.
- 7. ALL DOUBLE DOORS ARE EQUALLY SPACED BETWEEN WALLS U.N.O.
- 8. REFER TO SHEET FS-1 FOR KITCHEN EQUIPMENT SCHEDULE

woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA

PELICANS CAMPUS IMPROVEMENTS

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024

OVERALL PLAN



EXISTING WALL TO REMAIN

NEW CONSTRUCTION - MASONRY WALL



NOT IN SCOPE

GENERAL NOTES

- SEE PROJECT INFO. SHEET G0.01 FOR ALL GENERAL NOTES PERTAINING TO PROJECT.
- 2. REFER TO SHEET A6.00 FOR PARTITION TYPES.
- 3. REFER TO SHEET A6.20 FOR DOOR TYPES.
- REFER TO SHEET A6.30 FOR STOREFRONT
- DIMENSIONS ARE FROM FINISHED FACE OF WALL TO FINISHED FACE OF WALL.
- 6. ALL DOORS ARE 6" CLR. FROM FINISHED FACE OF WALL U.N.O.
- ALL DOUBLE DOORS ARE EQUALLY SPACED BETWEEN WALLS U.N.O.
- 8. REFER TO SHEET FS-1 FOR KITCHEN EQUIPMENT SCHEDULE

PELICANS CAMPUS IMPROVEMENTS

woodward design group


1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA

WDG PROJECT NO | AR2315



FLOOR PLANS

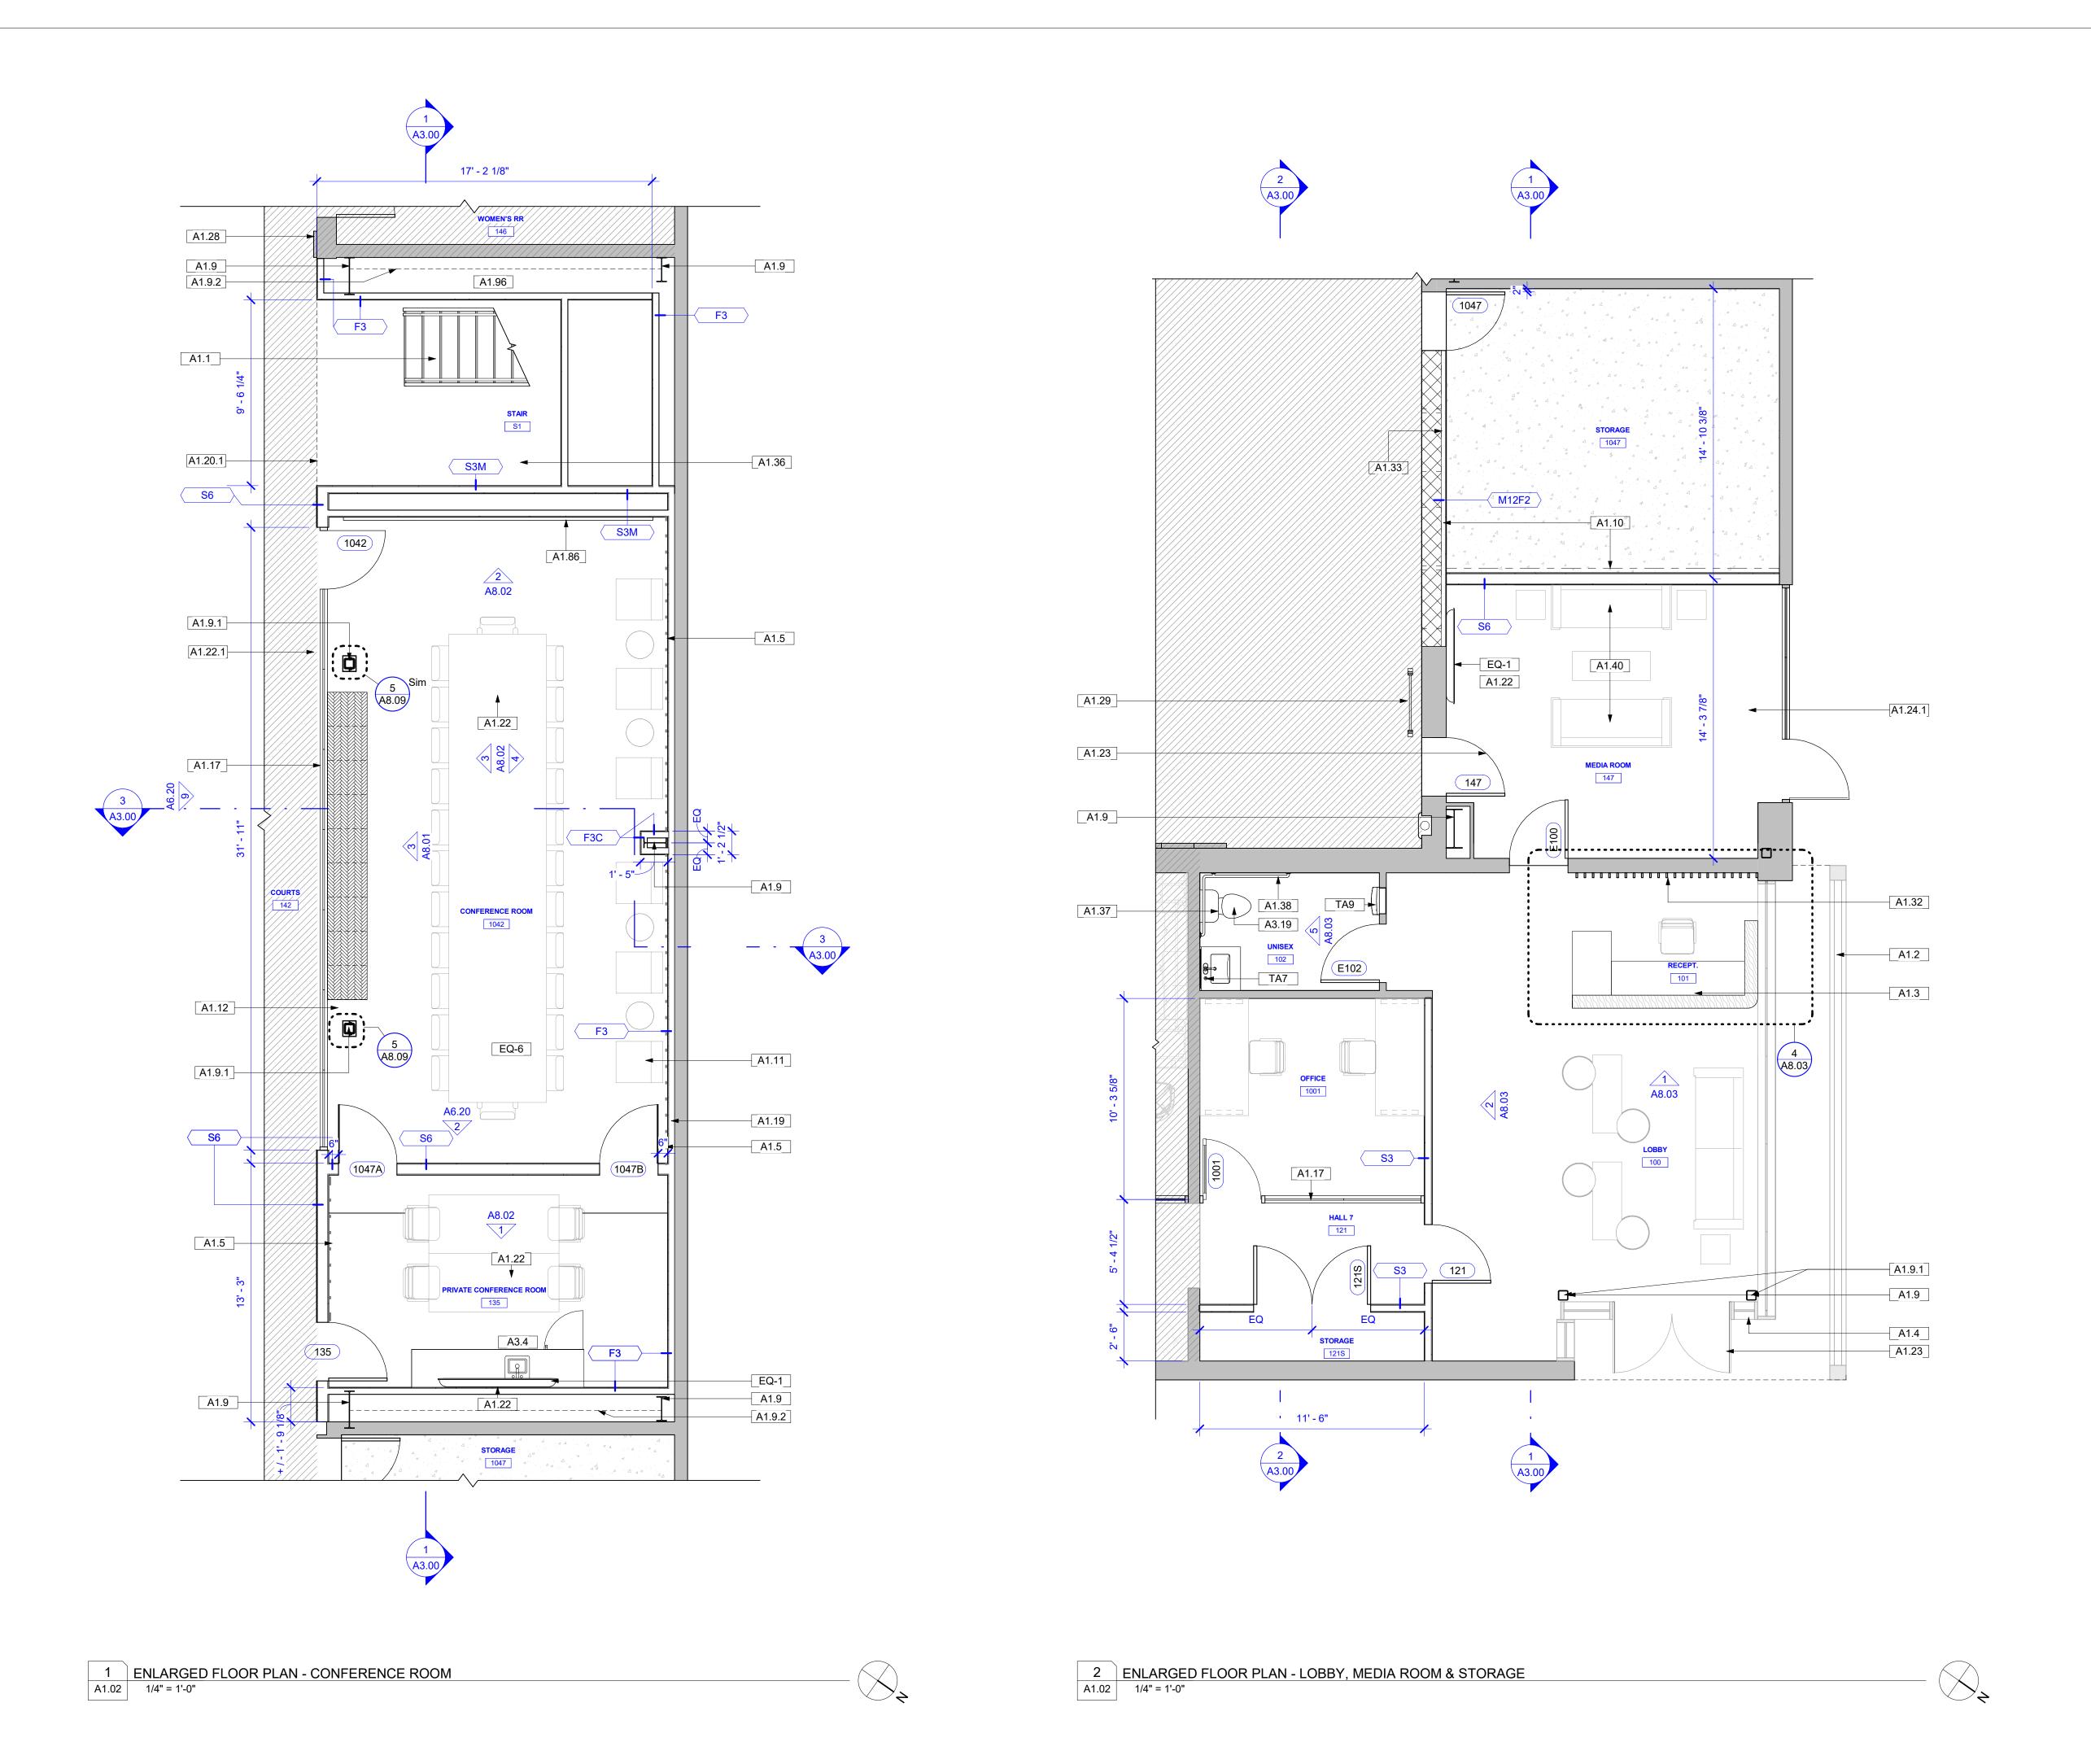

EXISTING WALL TO REMAIN

NEW CONSTRUCTION - MASONRY WALL

NEW CONSTRUCTION - STUD WALL



NOT IN SCOPE

GENERAL NOTES

- SEE PROJECT INFO. SHEET G0.01 FOR ALL GENERAL NOTES PERTAINING TO PROJECT.
- REFER TO SHEET A6.00 FOR PARTITION
- REFER TO SHEET A6.20 FOR DOOR TYPES.
- REFER TO SHEET A6.30 FOR STOREFRONT
- TYPES.
- DIMENSIONS ARE FROM FINISHED FACE OF WALL TO FINISHED FACE OF WALL.
- ALL DOORS ARE 6" CLR. FROM FINISHED FACE OF WALL U.N.O.
- ALL DOUBLE DOORS ARE EQUALLY SPACED
- BETWEEN WALLS U.N.O. REFER TO SHEET FS-1 FOR KITCHEN
- EQUIPMENT SCHEDULE

KEYN	NOTES	6 - AR	CHIT	ECT	JR/

- NEW PREFABRICATED STAIR; CONCRETE FILLED METAL STAIR PAN W/ RUBBER TREADS AND PAINTED STEEL HANDRAILS AND GUARDRAILS
- (E) SUN SHADE W/ HORIZONTAL LOUVERS TO
- NEW RECEPTION DESK W/ MULTI-HEIGHT TRANSACTION SURFACE; B.O.D. BY WMG
- (E) EXTERIOR CURTAIN WALL & DOUBLE DOORS TO GRAY DOTTED LINE INDICATES WALL LOCATIONS
- TO RECEIVE WRITABLE FILM. SEE SPEC 08 8700 A1.9 (E) STRUCTURAL COLUMN TO REMAIN
- A1.9.1 NEW STEEL COLUMN, COORDINATE LOCATION W/ (E) PILE CAP; RE STRUCTURAL; CLAD WITH METAL
- A1.9.2 (E) STRUCTURAL FRAMING TO REMAIN A1.10 PROVIDE IN-WALL BLOCKING FOR EQUIPMENT BY
- A1.11 | FLEXIBLE CONFERENCE SEATING; MOVABLE
- CHAIRS; INFORMAL SEATING O.F.O.I.; LOCATION ON FLOOR PLAN SHOWS SEATING IN EXPANDED
- FORMAL MEETING SETTING A1.12 CUSTOM BANQUETTE BY WMG; PLAM BASE W/ 2"
- UPHOLSTERED SEAT
- NEW INTERIOR STOREFRONT, BUTT GLAZED; APPLY SEMI-OPAQUE FILM ON CONFERENCE ROOM
- SIDE GLASS A1.19 NEW GWB FUR OUT OVER EXISTING CMU FINISH;
- GWB TO BE PAINTED A1.20.1 DASHED LINE INDICATES EXTENTS OF EXISTING
- WOOD FLOORING AT COURTS A1.22 PROVIDE POWER & DATA CONNECTIONS FOR
- **EQUIPMENT**
- A1.22.1 EXISTING FLOOR OUTLET A1.23 EXISTING DOOR TO REMAIN
- A1.24.1 CARPET FLOORING TO REMAIN A1.28 (E) PADDED WALL PANEL TO REMAIN
- A1.29 (E) ROOF ACCESS LADDER TO REMAIN A1.32 WOOD BATTEN FEATURE WALL
- A1.33 RECESSED BASKETBALL SHELVES TO REMAIN; MODIFY AS NECESSARY TO COORDINATE WITH
- NEW DOOR OPENING A1.36 NEW PLUMBING CONNECTION ROUTED BELOW
- STAIR LANDING; RE: PLUMB A1.37 REPLACE PLUMBING FIXTURES AT (E) LOCATIONS
- A1.38 REINSTALL (E) GRAB BARS ONCE TILE WORK IS
- COMPLETE ` A1.40 RELOCATE EXISTING LOBBY LOUNGE FURNITURE
- A1.86 VIDEO WALL SCREEN

- A1.96 TRENCH AND INFILL (E) CONC. SLAB FOR COMPRESSED AIR LINES AND ELEC/DATA CONDUIT THAT SERVES THE FITNESS EQUIPMENT
- A3.4 15" SINGLE COMPARTMENT SINK A3.19 FLOOR-MOUNTED TOILET

KEYNOTES - EQUIPMENT

EQ-1 85" DISPLAY MONITOR, WALL-MOUNTED, O.F.O.I. EQ-6 CONFERENCE ROOM TABLE & CHAIRS, O.F.O.I.

KEYNOTES - TOILET ACCESSORIES

SOAP DISPENSER PAPER TOWEL DISPENSER, BOBRICK MODEL PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana

woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443


Erik Wismar, AIA

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024



no.	descripton	date
110.	descriptori	uate
	·	
_		_

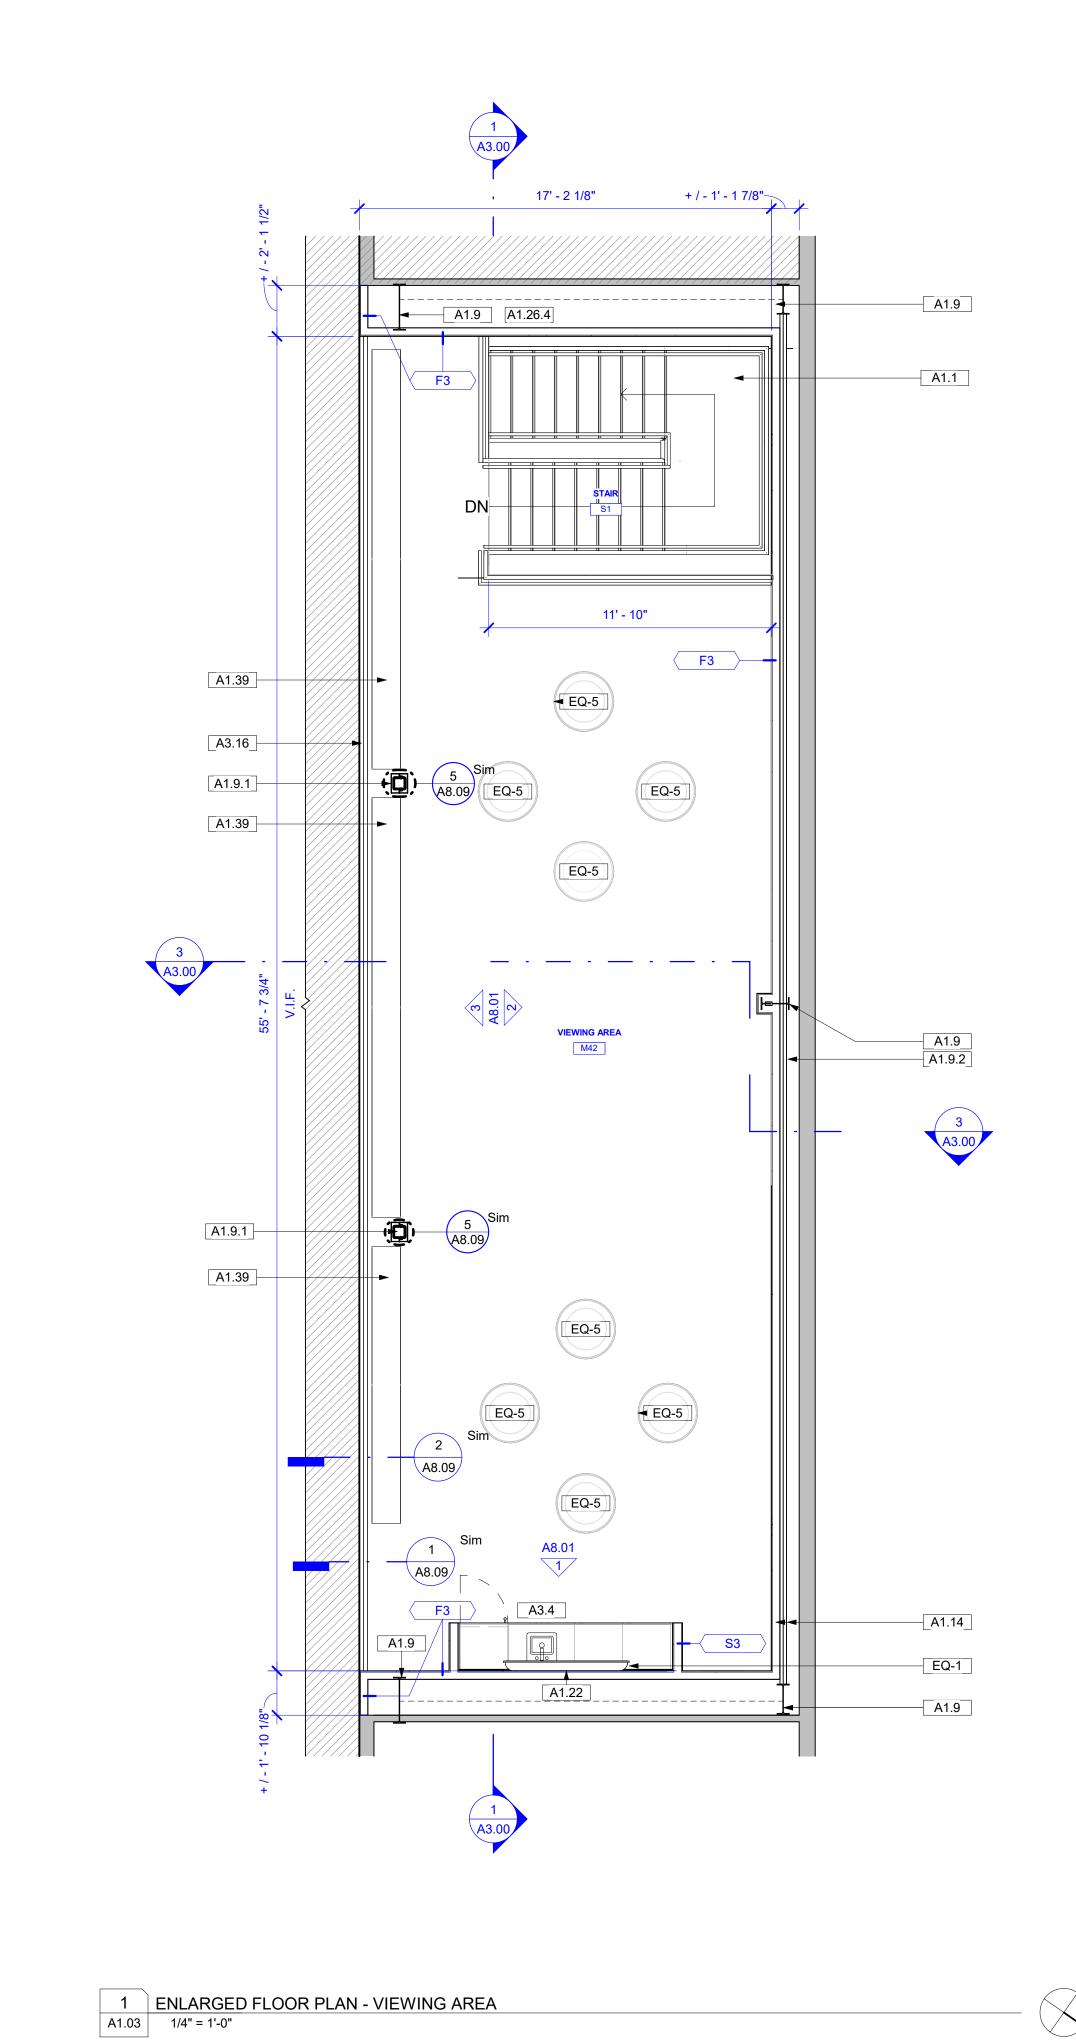

EXISTING WALL TO REMAIN

NEW CONSTRUCTION - MASONRY WALL

NEW CONSTRUCTION - STUD WALL



GENERAL NOTES

- SEE PROJECT INFO. SHEET G0.01 FOR ALL GENERAL NOTES PERTAINING TO PROJECT.
- REFER TO SHEET A6.00 FOR PARTITION
- REFER TO SHEET A6.20 FOR DOOR TYPES.
- REFER TO SHEET A6.30 FOR STOREFRONT
- DIMENSIONS ARE FROM FINISHED FACE OF WALL TO FINISHED FACE OF WALL.
- ALL DOORS ARE 6" CLR. FROM FINISHED FACE OF WALL U.N.O.
- ALL DOUBLE DOORS ARE EQUALLY SPACED BETWEEN WALLS U.N.O.
- REFER TO SHEET FS-1 FOR KITCHEN EQUIPMENT SCHEDULE

KEYNOTES - ARCHITECTURAL

A1.1	NEW PREFABRICATED STAIR; CONCRETE FILLED METAL STAIR PAN W/ RUBBER TREADS AND PAINTED STEEL HANDRAILS AND GUARDRAILS
A1.9	(E) STRUCTURAL COLUMN TO REMAIN
A1.9.1	NEW STEEL COLUMN, COORDINATE LOCATION W/ (E) PILE CAP; RE STRUCTURAL; CLAD WITH METAL PANEL
A1.9.2	(E) STRUCTURAL FRAMING TO REMAIN
A1.14	GWB FUR OUT CONCEALS EXISTING BEAM AT FLOOR LEVEL
A1.22	PROVIDE POWER & DATA CONNECTIONS FOR EQUIPMENT

A1.26.4 MECHANICAL CHASE RE: MECH

- A1.39 CUSTOM BUILT DRINK LEDGE; BOLTED TO FLOOR
 A3.4 15" SINGLE COMPARTMENT SINK
- A3.16 GLASS GUARDRAIL; RE: A8.53

KEYNOTES - EQUIPMENT

85" DISPLAY MONITOR, WALL-MOUNTED, O.F.O.I. HIGH TOP TABLES, O.F.O.I.

PELICANS CAMPUS IMPROVEMENTS

woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443


Erik Wismar, AIA

WDG PROJECT NO | AR2315



REVIS	SIONS	
no.	descripton	date
	•	

FLOOR PLANS

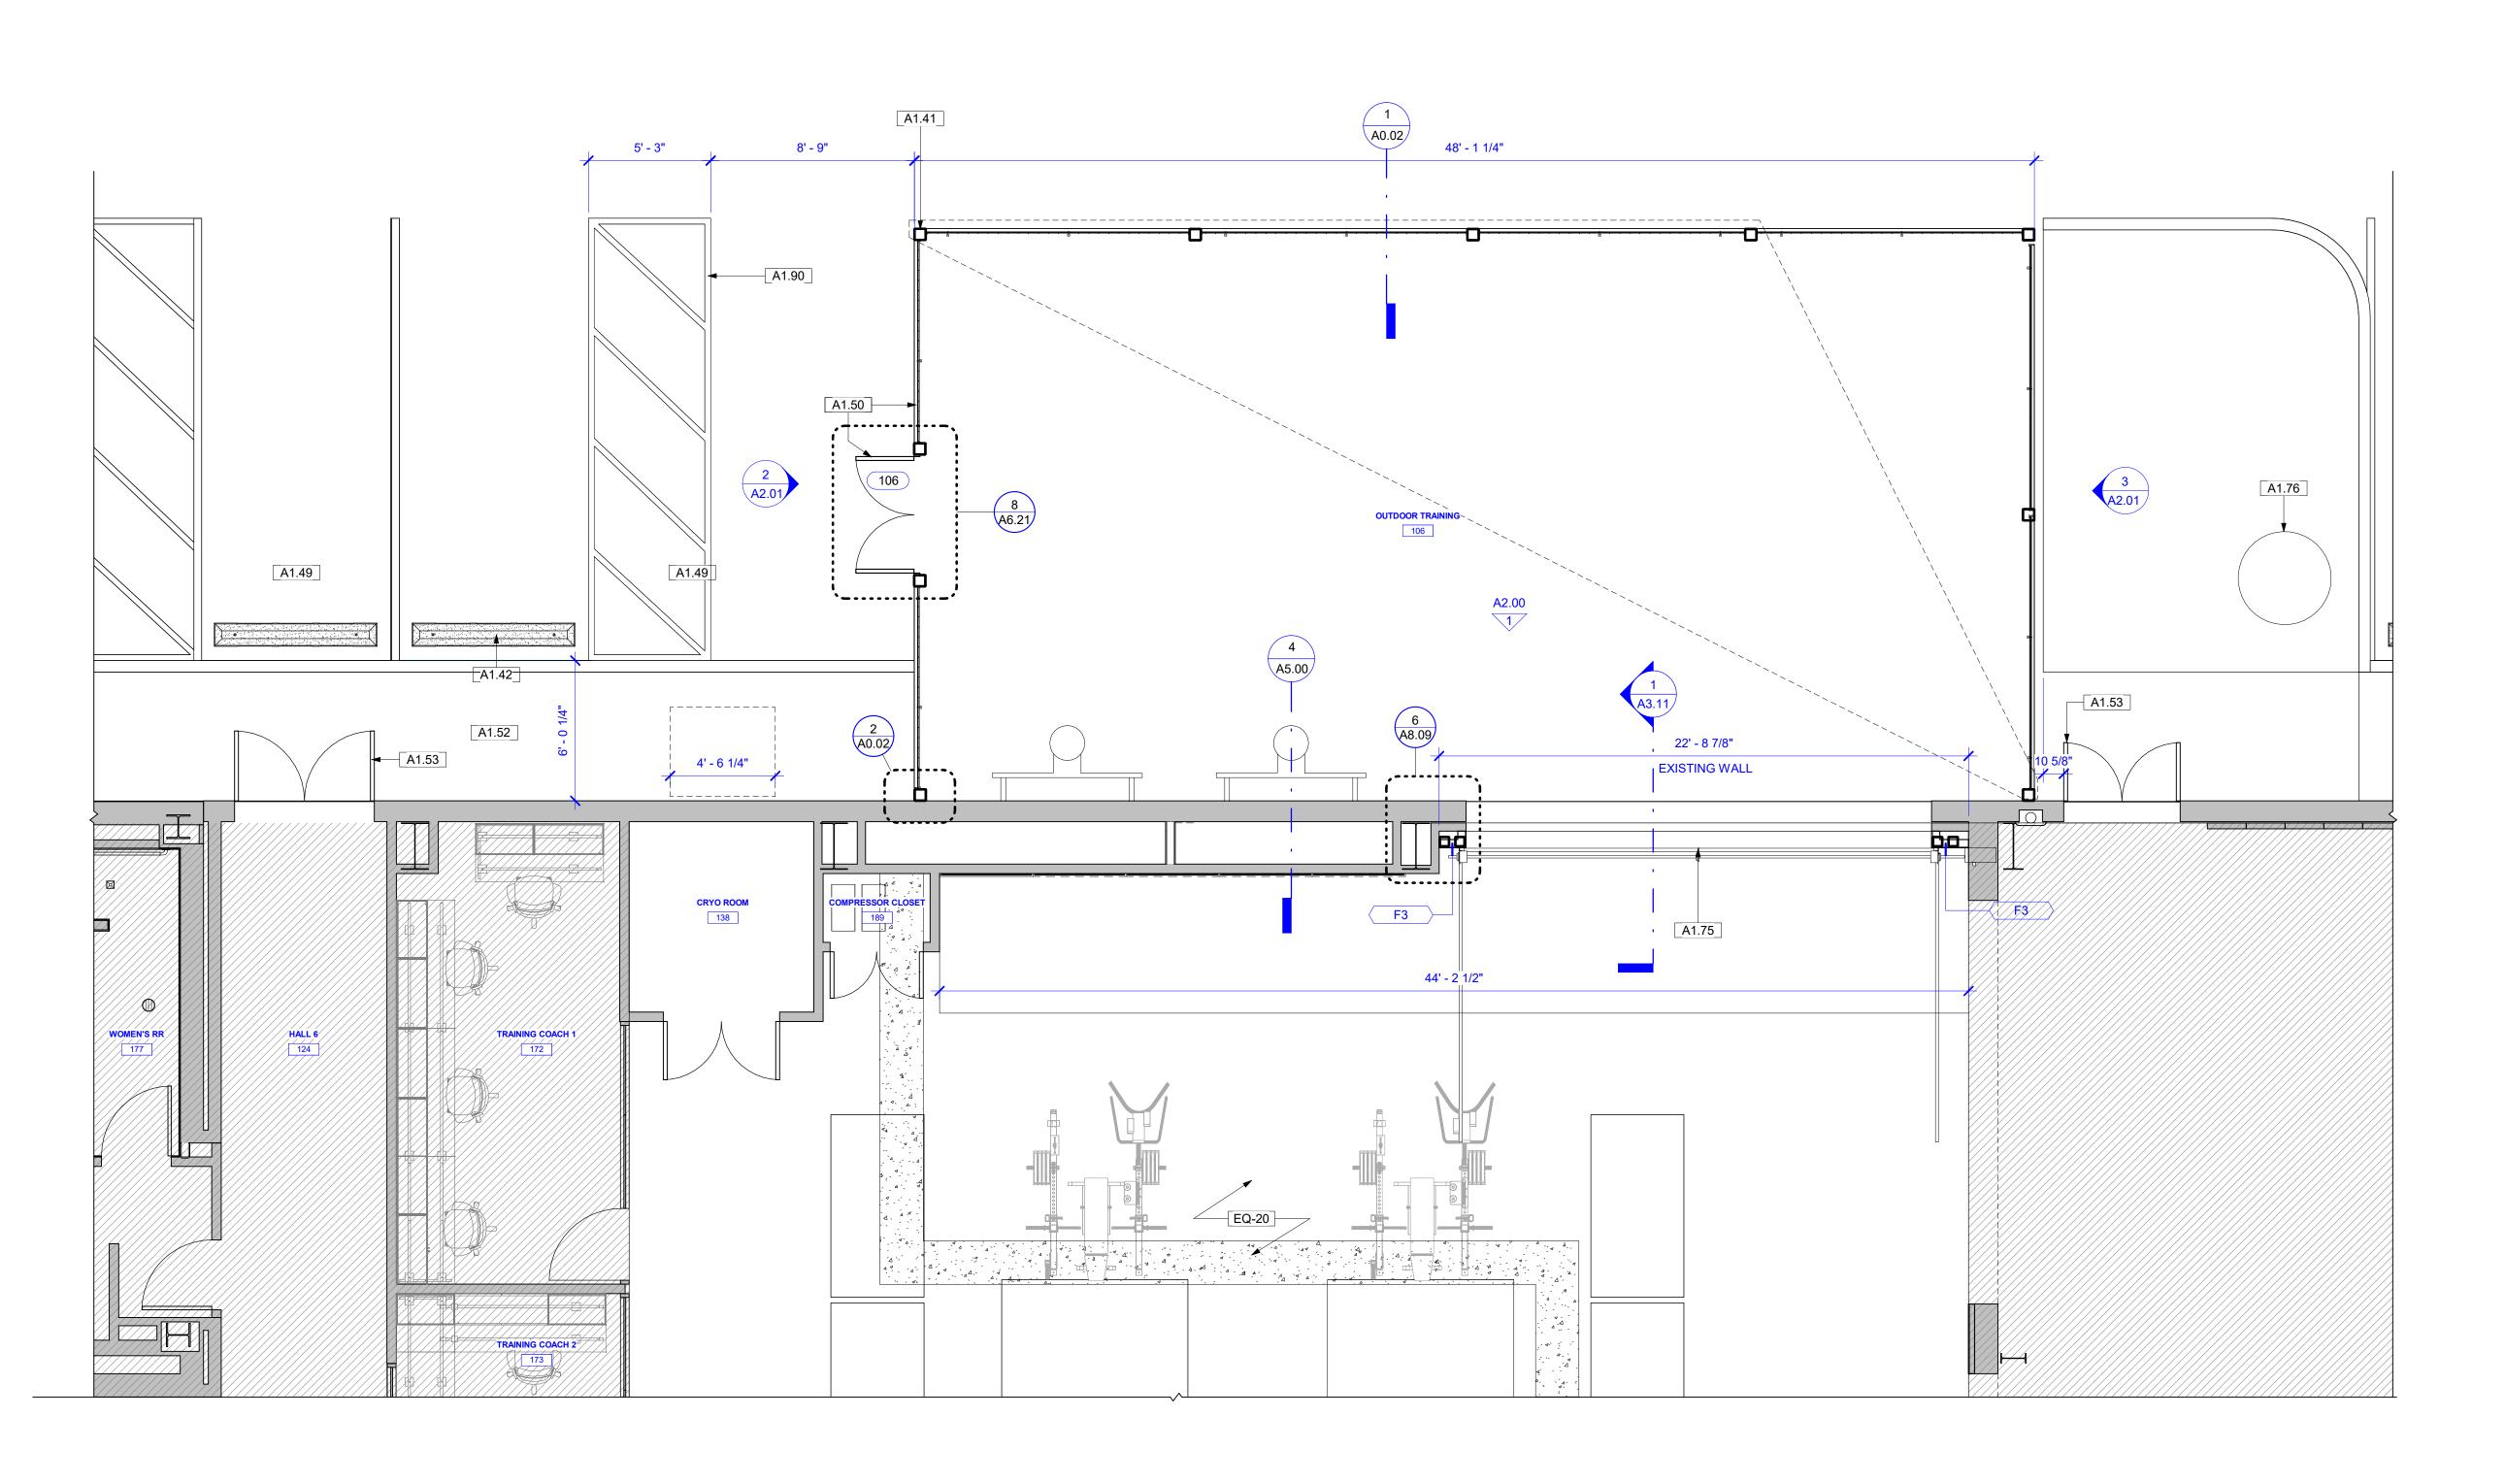

1 ENLARGED FLOOR PLAN - OUTDOOR TRAINING
A1.04 1/4" = 1'-0"

FLOOR PLAN LEGEND

EXISTING WALL TO REMAIN



NEW CONSTRUCTION - MASONRY WALL





GENERAL NOTES

- SEE PROJECT INFO. SHEET G0.01 FOR ALL GENERAL NOTES PERTAINING TO PROJECT.
- REFER TO SHEET A6.00 FOR PARTITION TYPES.
- REFER TO SHEET A6.20 FOR DOOR TYPES.
- REFER TO SHEET A6.30 FOR STOREFRONT TYPES.
- DIMENSIONS ARE FROM FINISHED FACE OF WALL TO FINISHED FACE OF WALL.
- ALL DOORS ARE 6" CLR. FROM FINISHED FACE OF WALL U.N.O.
- ALL DOUBLE DOORS ARE EQUALLY SPACED BETWEEN WALLS U.N.O.
- REFER TO SHEET FS-1 FOR KITCHEN EXEMMENTES E PARCHITECTURAL

A1.41	STRUCTURAL SUPPORT FOR FABRIC SUNSHADE, EMBEDDED IN POURED IN PLAC CONCRETE WALL
A1.42	(E) CONCRETE CURB
A1.49	(E) PARKING SPACES TO REMAIN
A1.50	NEW STEEL GATE, PTD; PROVIDE CARD READER ACCESS DEVICE
A1.52	(E) SIDEWALK TO REMAIN
A1.53	(E) DOOR TO REMAIN
A1.75	O.H. SECTIONAL DOOR RECESSED IN POCKET TO CLEAR EXIST. STRUCTURE
A1.76	(E) MANHOLE COVER
A1.90	NEW STRIPING TO MATCH EXIST.

KEYNOTES - EQUIPMENT

(E) WEIGHT ROOM EQUIPMENT TO BE RELOCATED; SEE A1.08

PELICANS CAMPUS IMPROVEMENTS


woodward design group


1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA

WDG PROJECT NO | AR2315



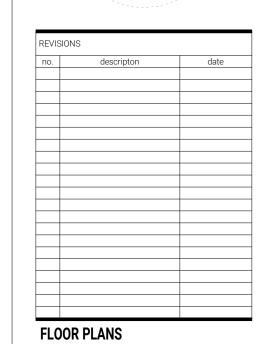

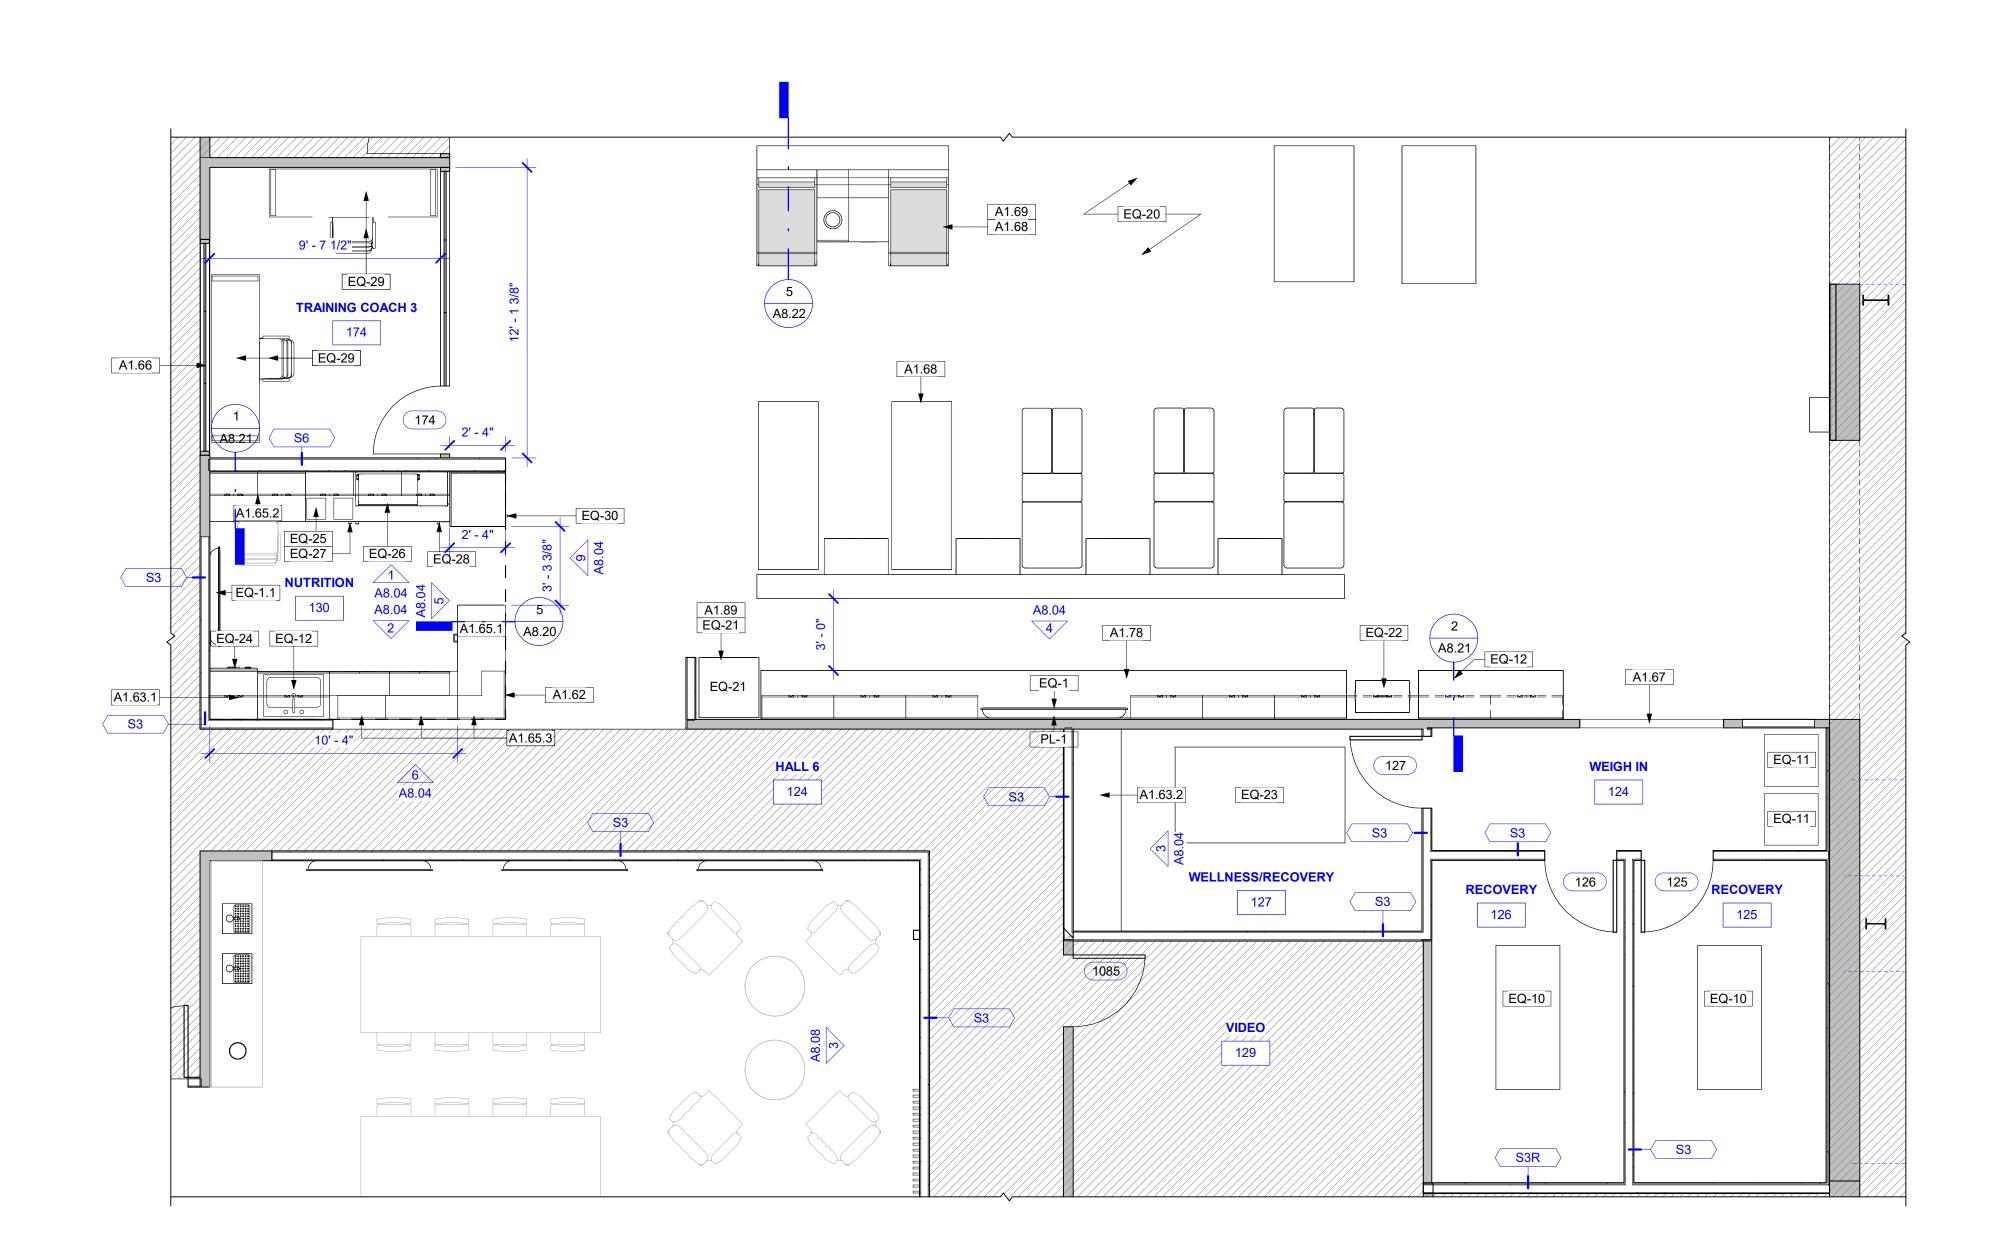

1 ENLARGED FLOOR PLAN - NUTRITION & RECOVERY/WELLNESS ROOMS A1.05 1/4" = 1'-0"



FLOOR PLAN LEGEND

EXISTING WALL TO REMAIN



NEW CONSTRUCTION - MASONRY WALL





NOT IN SCOPE

GENERAL NOTES

- SEE PROJECT INFO. SHEET G0.01 FOR ALL GENERAL NOTES PERTAINING TO PROJECT.
- REFER TO SHEET A6.00 FOR PARTITION
- REFER TO SHEET A6.20 FOR DOOR TYPES.
- REFER TO SHEET A6.30 FOR STOREFRONT
- DIMENSIONS ARE FROM FINISHED FACE OF WALL TO FINISHED FACE OF WALL.
- ALL DOORS ARE 6" CLR. FROM FINISHED FACE OF WALL U.N.O.
- ALL DOUBLE DOORS ARE EQUALLY SPACED BETWEEN WALLS U.N.O.
- REFER TO SHEET FS-1 FOR KITCHEN EQUIPMENT SCHEDULE

KEYNOTES - ARCHITECTURAL

A1.62	DASHED LINE INDICATES EXTENTS OF EXISTING 10' CEILING ABOVE
A1.63.1	UPPER CABINETS
A1.63.2	SOLID SURFACE COUNTERTOP ON PLAM LOWER CABINETS
A1.65.1	NUTRITION SERVICE; SOLID SURFACE COUNTERTOP ABOVE PULL OUT TRASH.
A1.65.2	NUTRITION PREP; UPPER CABINETS & SOLID SURFACE COUNTERTOP ON PLAM LOWER CABINETS
A1.65.3	UNDER CABINET SHELVING DISPLAY
A1.66	(E) INTERIOR STOREFRONT TO REMAIN
A1.67	NEW CASED OPENING
A1.68	TAPING STATIONS AND TREATMENT TABLES SALVAGED AND RELOCATED
A1.69	TAPING STATION SEATS AND MILLWORK TO BE EXTENDED 6"
A1.78	CASEWORK SALVAGED AND RELOCATED
A1.89	NEW ICE MAKER C.P.C.I

KEYNOTES - EQUIPMENT

EQ-1	85" DISPLAY MONITOR, WALL-MOUNTED, O.F.O.I.
EQ-1.1	50" DISPLAY MONITOR, WALL-MOUNTED, O.F.O.I.
EQ-10	MASSAGE TABLE, O.F.O.I.
EQ-11	(E) SCALES IN NEW LOCATION
EQ-12	STAINLESS STEEL UNDERMOUNT SINK W/ GARBAGE DISPOSAL
EQ-20	(E) WEIGHT ROOM EQUIPMENT TO BE RELOCATED; SEE A1.08
EQ-21	NEW ICE MAKER
EQ-22	(E) HYDROCULATOR IN NEW LOCATION
EQ-23	(E) THERALIGHT360
EQ-24	(E) DISHWASHER IN NEW LOCATION
EQ-25	(E) BLENDERS IN NEW LOCATION
EQ-26	NEW COLD WELL
EQ-27	NEW UNDER-COUNTER FREEZER
EQ-28	NEW UNDER COUNTER REFRIGERATOR
EQ-29	DESKS AND OFFICE CHAIRS O.F.O.I
EQ-30	2'-0" X 2'-0" REFRIGERATED GRAB AND GO UNIT


PELICANS CAMPUS IMPROVEMENTS


woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443


Erik Wismar, AIA

WDG PROJECT NO | AR2315





FLOOR PLANS

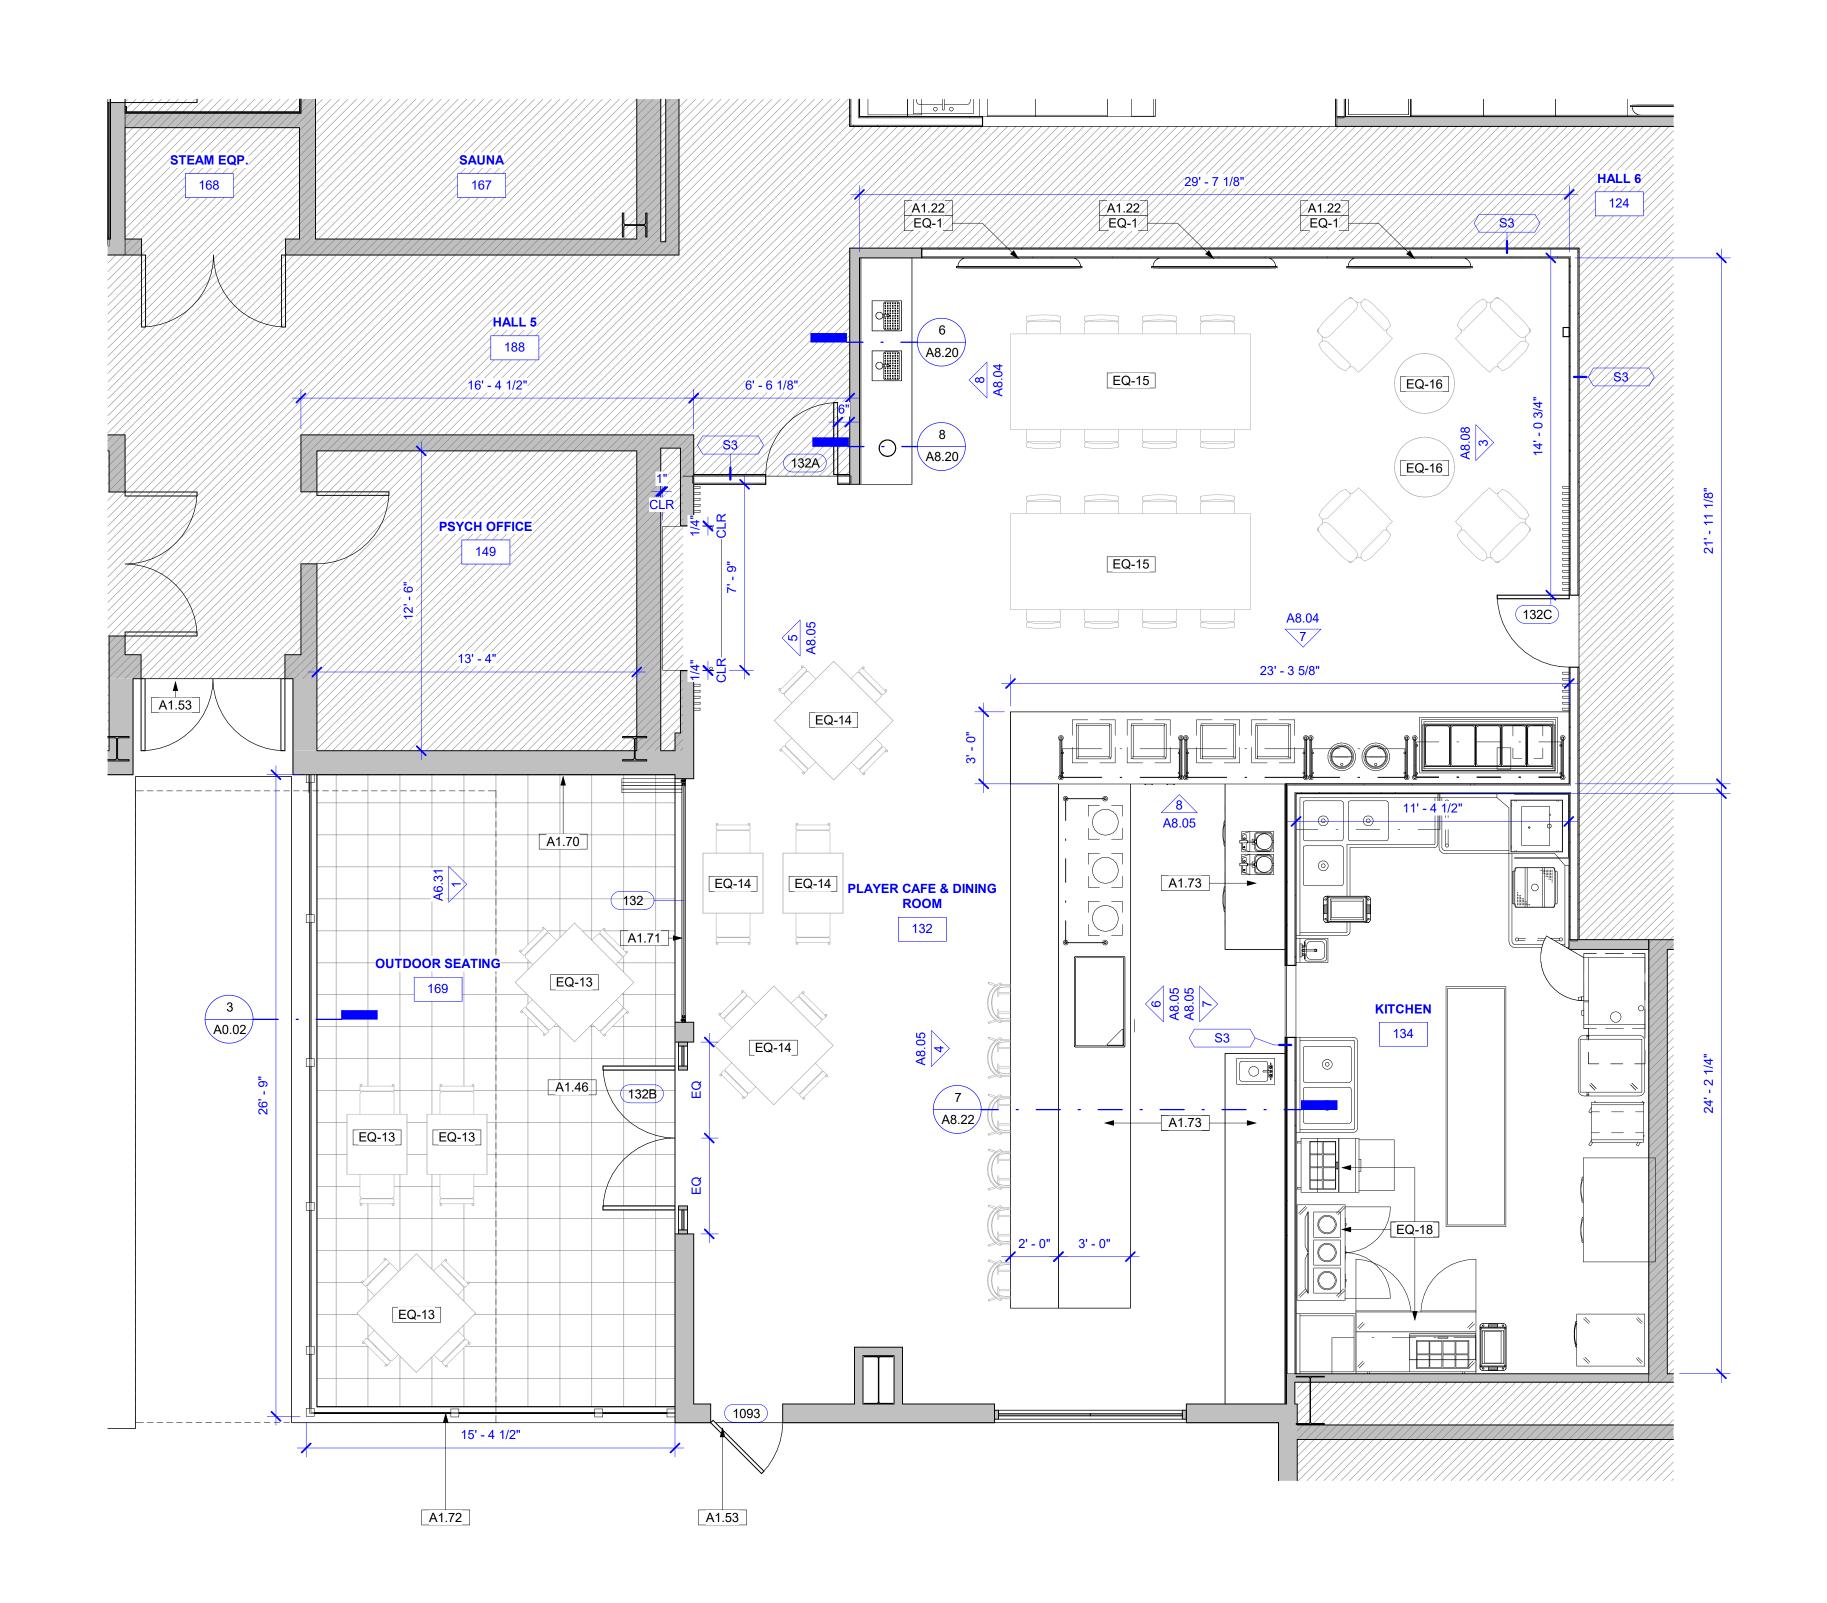

1 ENLARGED FLOOR PLAN - PLAYERS' CAFE & DINING AREA
A1.06 1/4" = 1'-0"




FLOOR PLAN LEGEND

EXISTING WALL TO REMAIN



NEW CONSTRUCTION - MASONRY WALL





GENERAL NOTES

- SEE PROJECT INFO. SHEET G0.01 FOR ALL GENERAL NOTES PERTAINING TO PROJECT.
- REFER TO SHEET A6.00 FOR PARTITION
- REFER TO SHEET A6.20 FOR DOOR TYPES.
- REFER TO SHEET A6.30 FOR STOREFRONT TYPES.
- DIMENSIONS ARE FROM FINISHED FACE OF WALL TO FINISHED FACE OF WALL.
- ALL DOORS ARE 6" CLR. FROM FINISHED FACE OF WALL U.N.O.
- ALL DOUBLE DOORS ARE EQUALLY SPACED BETWEEN WALLS U.N.O.
- REFER TO SHEET FS-1 FOR KITCHEN EQUIPMENT SCHEDULE

KEYNOTES - ARCHITECTURAL

PROVIDE POWER & DATA CONNECTIONS FOR EQUIPMENT
CONCRETE PAVERS
(E) DOOR TO REMAIN
NEW PAINTED WALL MURAL; CUSTOM DESIGN TBD
FOLDING PARTITION; B.O.D. SL45 BY NANAWALL
PLANTER SCREEN WALL: 4'H CONCRETE BASE W/ PLANTED MTL FENCING TO 10'H
NEW SERVING LINE; SOLID SURFACE COUNTERTOP ON PLAM BASE

KEYNOTES - EQUIPMENT

EQ-1	85" DISPLAY MONITOR, WALL-MOUNTED, O.F.O.I.
EQ-13	OUTDOOR FURNITURE, O.F.O.I.
EQ-14	NEW CAFE SEATING, O.F.O.I.
EQ-15	COUNTER HEIGHT TABLE & SEATING, O.F.O.I.
EQ-16	NEW LOUNGE SEATING; O.F.O.I.
EQ-18	(E) KITCHEN EQUIPMENT IN NEW LOCATION

PELICANS CAMPUS IMPROVEMENTS


woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443


Erik Wismar, AIA

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024




no	dopprinton	dot
no.	descripton	dat

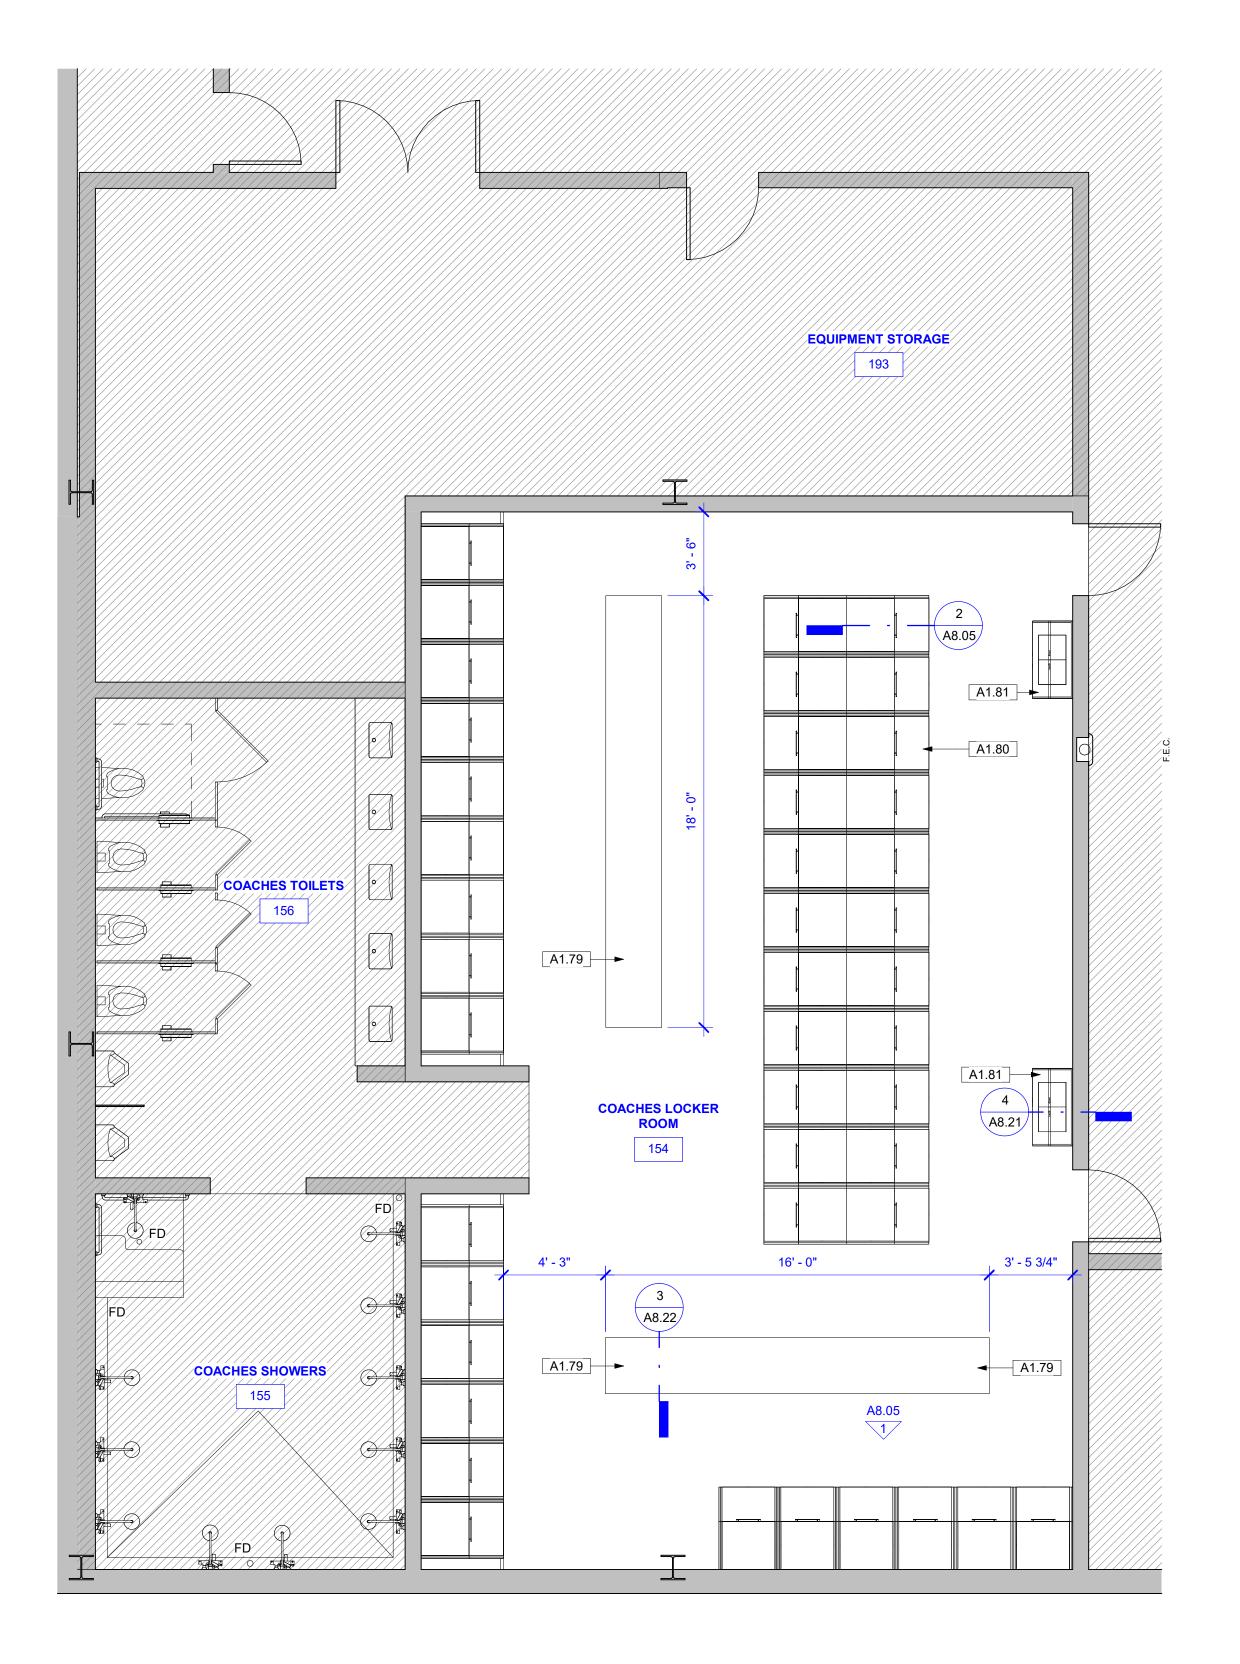

1 ENLARGED FLOOR PLAN - COACHES' LOCKER ROOM
A1.07 1/4" = 1'-0"



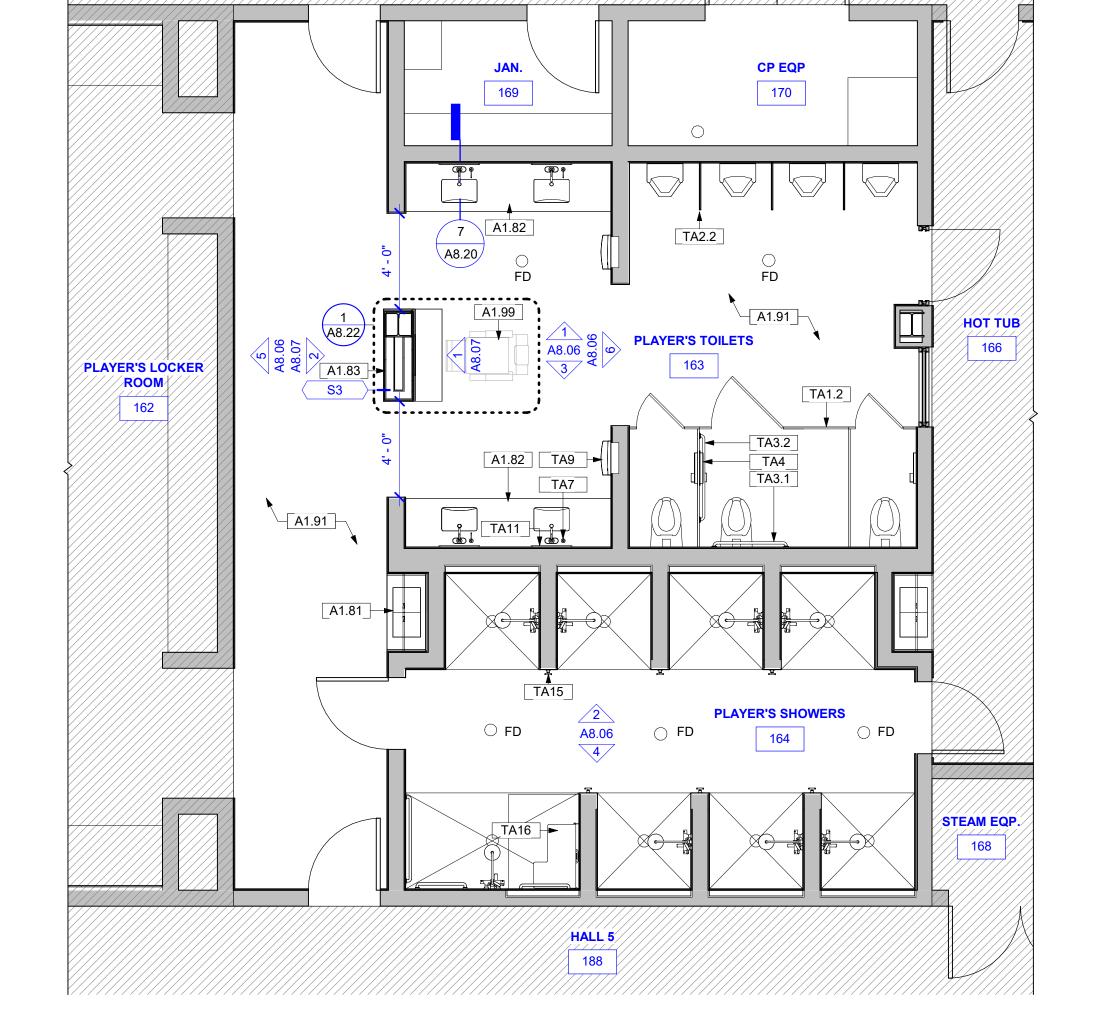

HALL 2 186

2 ENLARGED FLOOR PLAN - PLAYERS TOILETS
A1.07 1/4" = 1'-0"

FLOOR PLAN LEGEND

EX

EXISTING WALL TO REMAIN



NEW CONSTRUCTION - MASONRY WALL



NEW CONSTRUCTION - STUD WALL



NOT IN SCOPE

GENERAL NOTES

- SEE PROJECT INFO. SHEET G0.01 FOR ALL GENERAL NOTES PERTAINING TO PROJECT.
- REFER TO SHEET A6.00 FOR PARTITION
- REFER TO SHEET A6.20 FOR DOOR TYPES.
- 4. REFER TO SHEET A6.30 FOR STOREFRONT TYPES.
- DIMENSIONS ARE FROM FINISHED FACE OF WALL TO FINISHED FACE OF WALL.
- 6 ALL DOORS ARE 6" OLD EROM FINISHED FA
- 6. ALL DOORS ARE 6" CLR. FROM FINISHED FACE OF WALL U.N.O.
- . ALL DOUBLE DOORS ARE EQUALLY SPACED BETWEEN WALLS U.N.O.
- REFER TO SHEET FS-1 FOR KITCHEN EQUIPMENT SCHEDULE

KEYNOTES - ARCHITECTURAL

A1.79	CUSHIONED BENCH
A1.80	COACHES LOCKERS WITH CUSTOM MILLWORK (PL-3). SEE 1/A8.05
A1.81	TOWEL DROP W/ CASEWORK
A1.82	NEW SS COUNTER TOP (SS-4) MATCHING HEIGHT OF EXISTING COUNTER
A1.83	NEW CASEWORK
A1.91	NEW CERAMIC TILE FLOOR; RE: STRUCTUI
A1.99	(E) BARBER CHAIR RELOCATED

KEYNOTES - EQUIPMENT

KEYNOTES - TOILET ACCESSORIES

TA1.2	PHENOLIC TOILET PARTITION
TA2.2	PHENOLIC URINAL SCREEN
TA3.1	36" STAINLESS STEEL GRAB BAR, PROVIDE BLOCKING IN WALL
TA3.2	42" STAINLESS STEEL GRAB BAR, PROVIDE BLOCKING IN WALL
TA4	TOILET PAPER DISPENSER, BOBRICK MODEL #B221
TA7	SOAP DISPENSER
TA9	PAPER TOWEL DISPENSER, BOBRICK MODEL B4262
TA11	BACKLIT LED MIRROR
TA15	DOUBLE ROBE HOOK
TA16	FOLDING SHOWER SEAT

PELICANS CAMPUS IMPROVEMENTS

woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443


Erik Wismar, AIA

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04 15 2



no.	descripton	date
110.	accompton	date
	-	

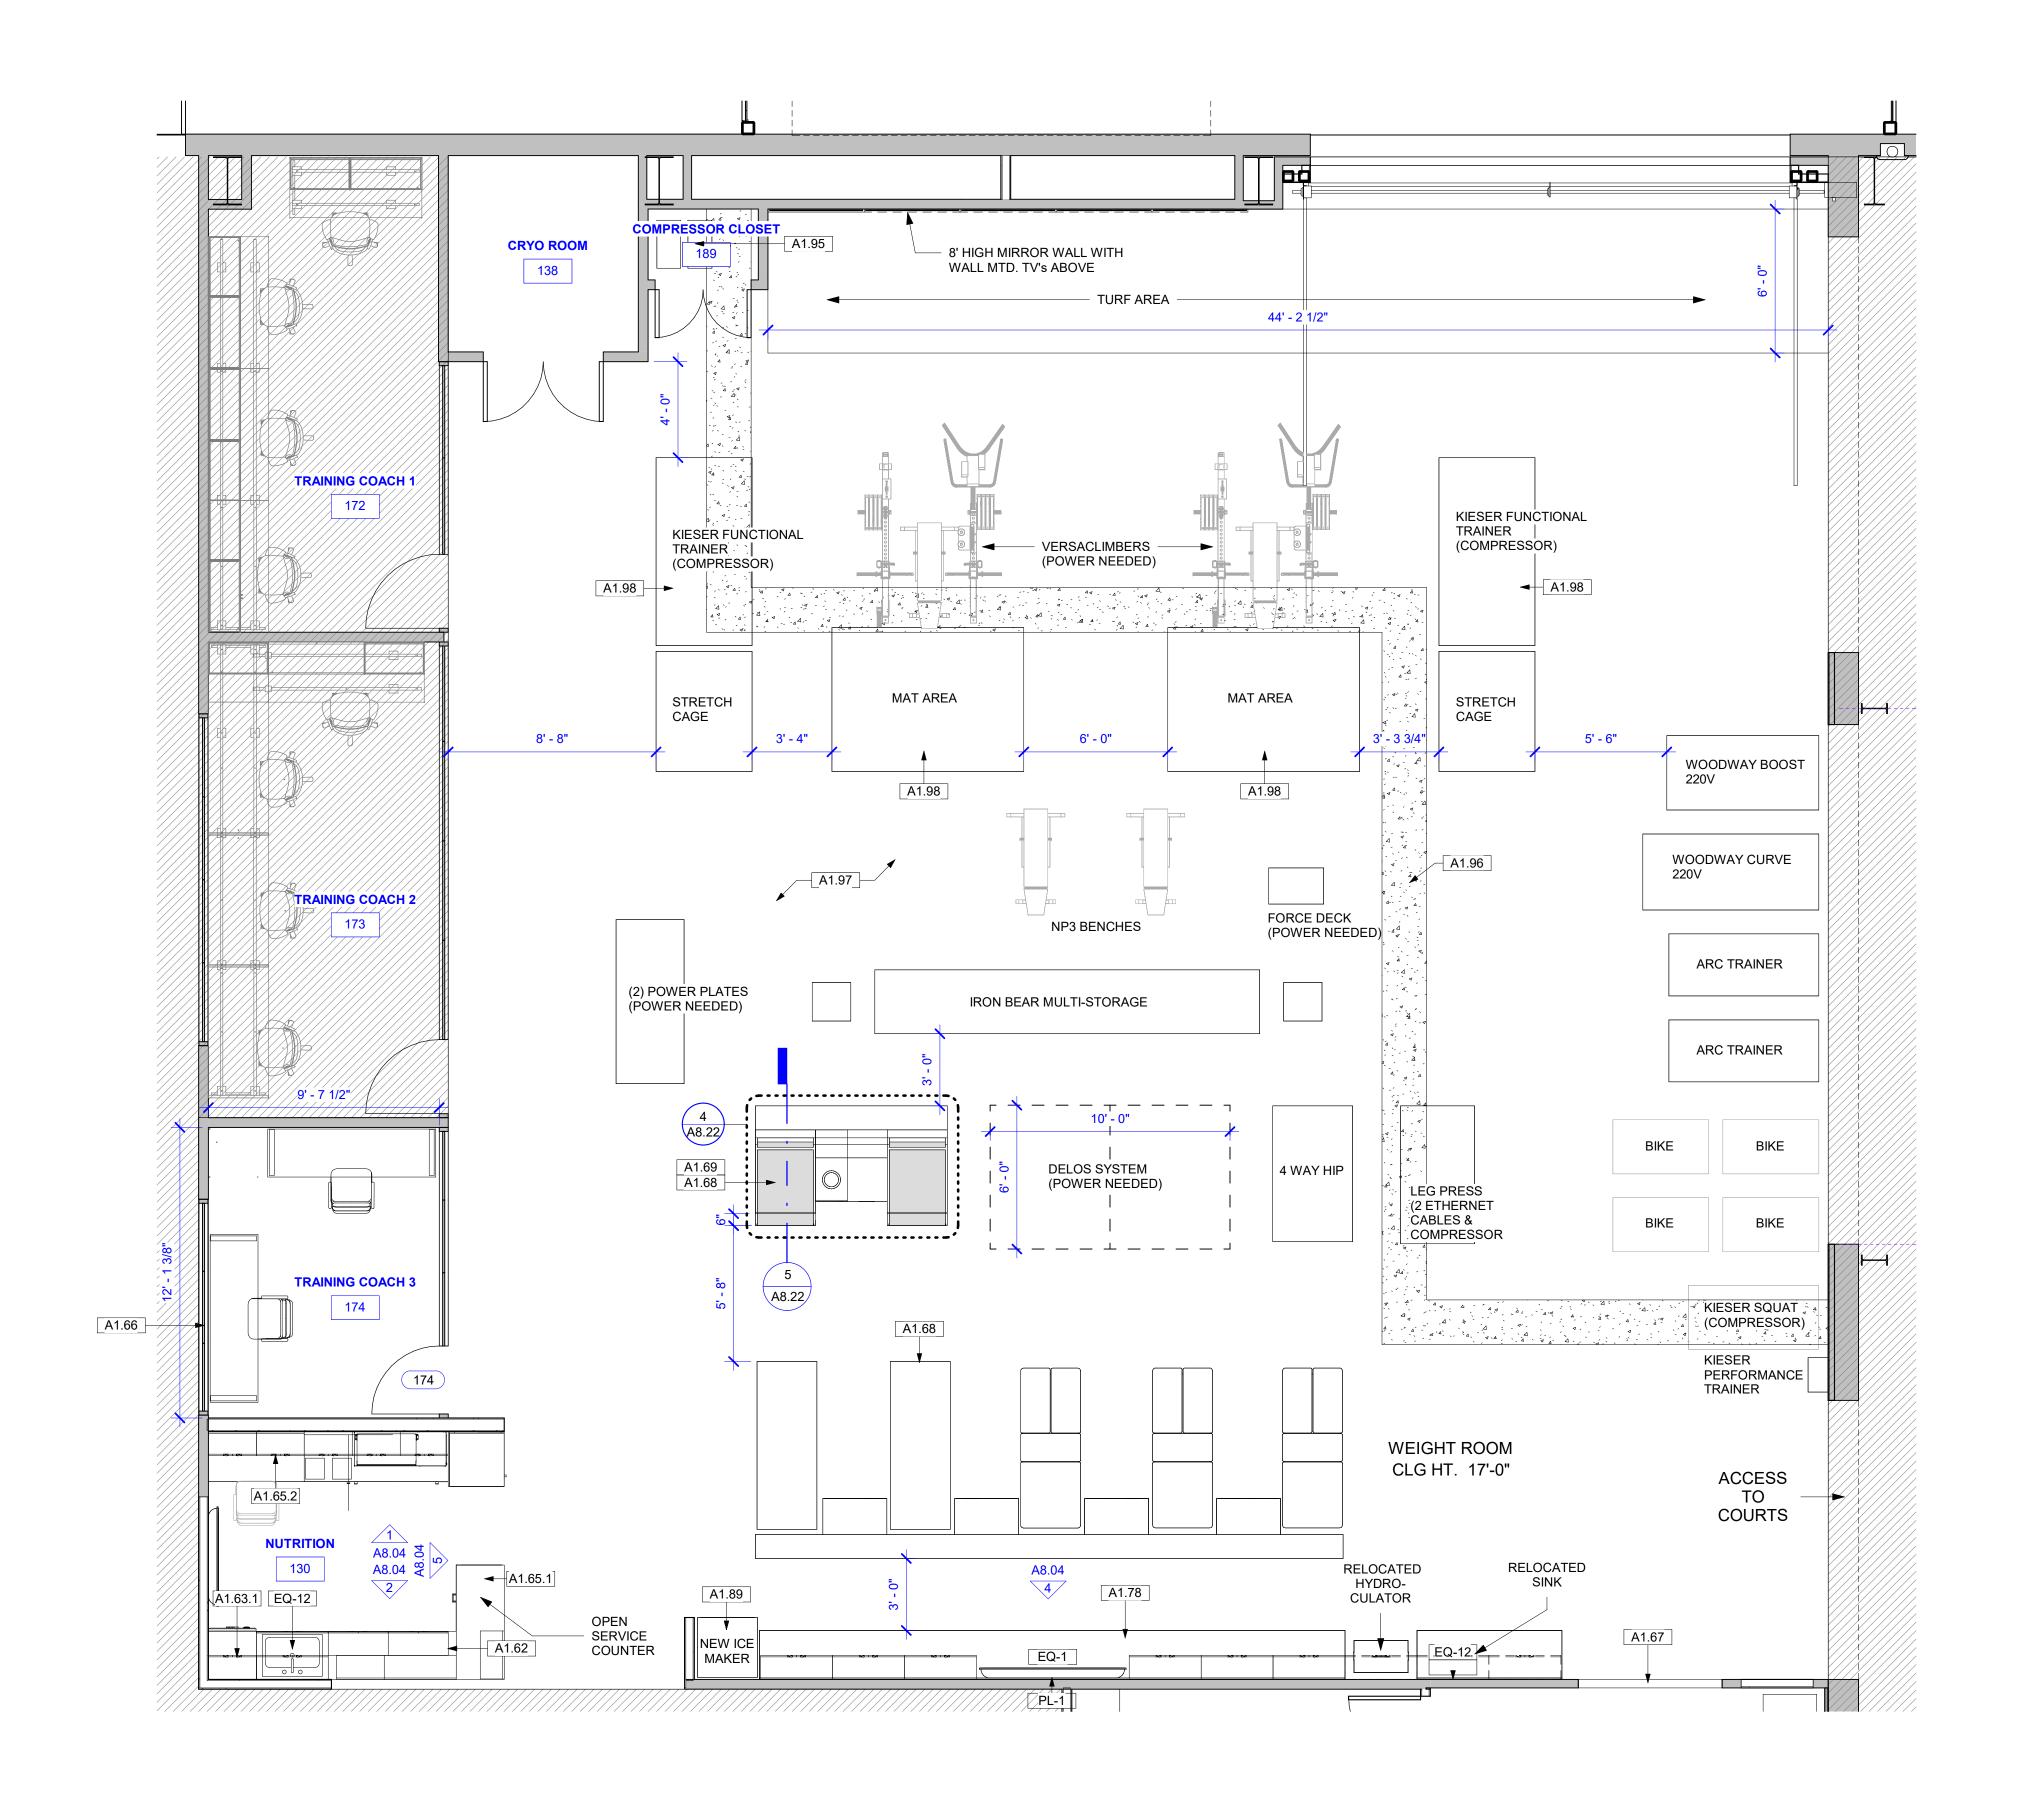


1 ENLARGED FLOOR PLAN - WEIGHT ROOM

FLOOR PLAN LEGEND

EXISTING WALL TO REMAIN

NEW CONSTRUCTION - MASONRY WALL

NEW CONSTRUCTION - STUD WALL



GENERAL NOTES

- 1. SEE PROJECT INFO. SHEET G0.01 FOR ALL GENERAL NOTES PERTAINING TO PROJECT.
- 2. REFER TO SHEET A6.00 FOR PARTITION
- 3. REFER TO SHEET A6.20 FOR DOOR TYPES.
- REFER TO SHEET A6.30 FOR STOREFRONT
- 5. DIMENSIONS ARE FROM FINISHED FACE OF WALL TO FINISHED FACE OF WALL.
- 6. ALL DOORS ARE 6" CLR. FROM FINISHED FACE OF WALL U.N.O.
- ALL DOUBLE DOORS ARE EQUALLY SPACED BETWEEN WALLS U.N.O.
- 8. REFER TO SHEET FS-1 FOR KITCHEN EQUIPMENT SCHEDULE

KEYNOTES - ARCHITECTURAL

A1.62	DASHED LINE INDICATES EXTENTS OF EXISTING 10' CEILING ABOVE
A1.63.1	UPPER CABINETS
A1.65.1	NUTRITION SERVICE; SOLID SURFACE COUNTERTOP ABOVE PULL OUT TRASH.
A1.65.2	NUTRITION PREP; UPPER CABINETS & SOLID SURFACE COUNTERTOP ON PLAM LOWER CABINETS
A1.66	(E) INTERIOR STOREFRONT TO REMAIN
A1.67	NEW CASED OPENING
A1.68	TAPING STATIONS AND TREATMENT TABLES SALVAGED AND RELOCATED
A1.69	TAPING STATION SEATS AND MILLWORK TO BE EXTENDED 6"
A1.78	CASEWORK SALVAGED AND RELOCATED
A1.89	NEW ICE MAKER C.P.C.I
A1.95	(E) COMPRESSORS TO BE RELOCATED. RE: MECH
A1.96	TRENCH AND INFILL (E) CONC. SLAB FOR COMPRESSED AIR LINES AND ELEC/DATA CONDUIT THAT SERVES THE FITNESS EQUIPMENT
A1.97	NEW PERFORMANCE ULTRATILE RUBBER FLOORING
A1.98	CUSTOM PELICANS LOGO TO BE APPLIED TO PERFORMANCE ULTRATILE RUBBER FLOORING
	FLOORING

PELICANS CAMPUS IMPROVEMENTS


woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA


WDG PROJECT NO | AR2315



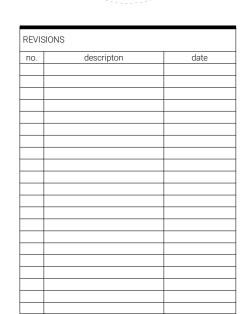

WEIGHT ROOM EQUIPMENT PLAN


A1.08

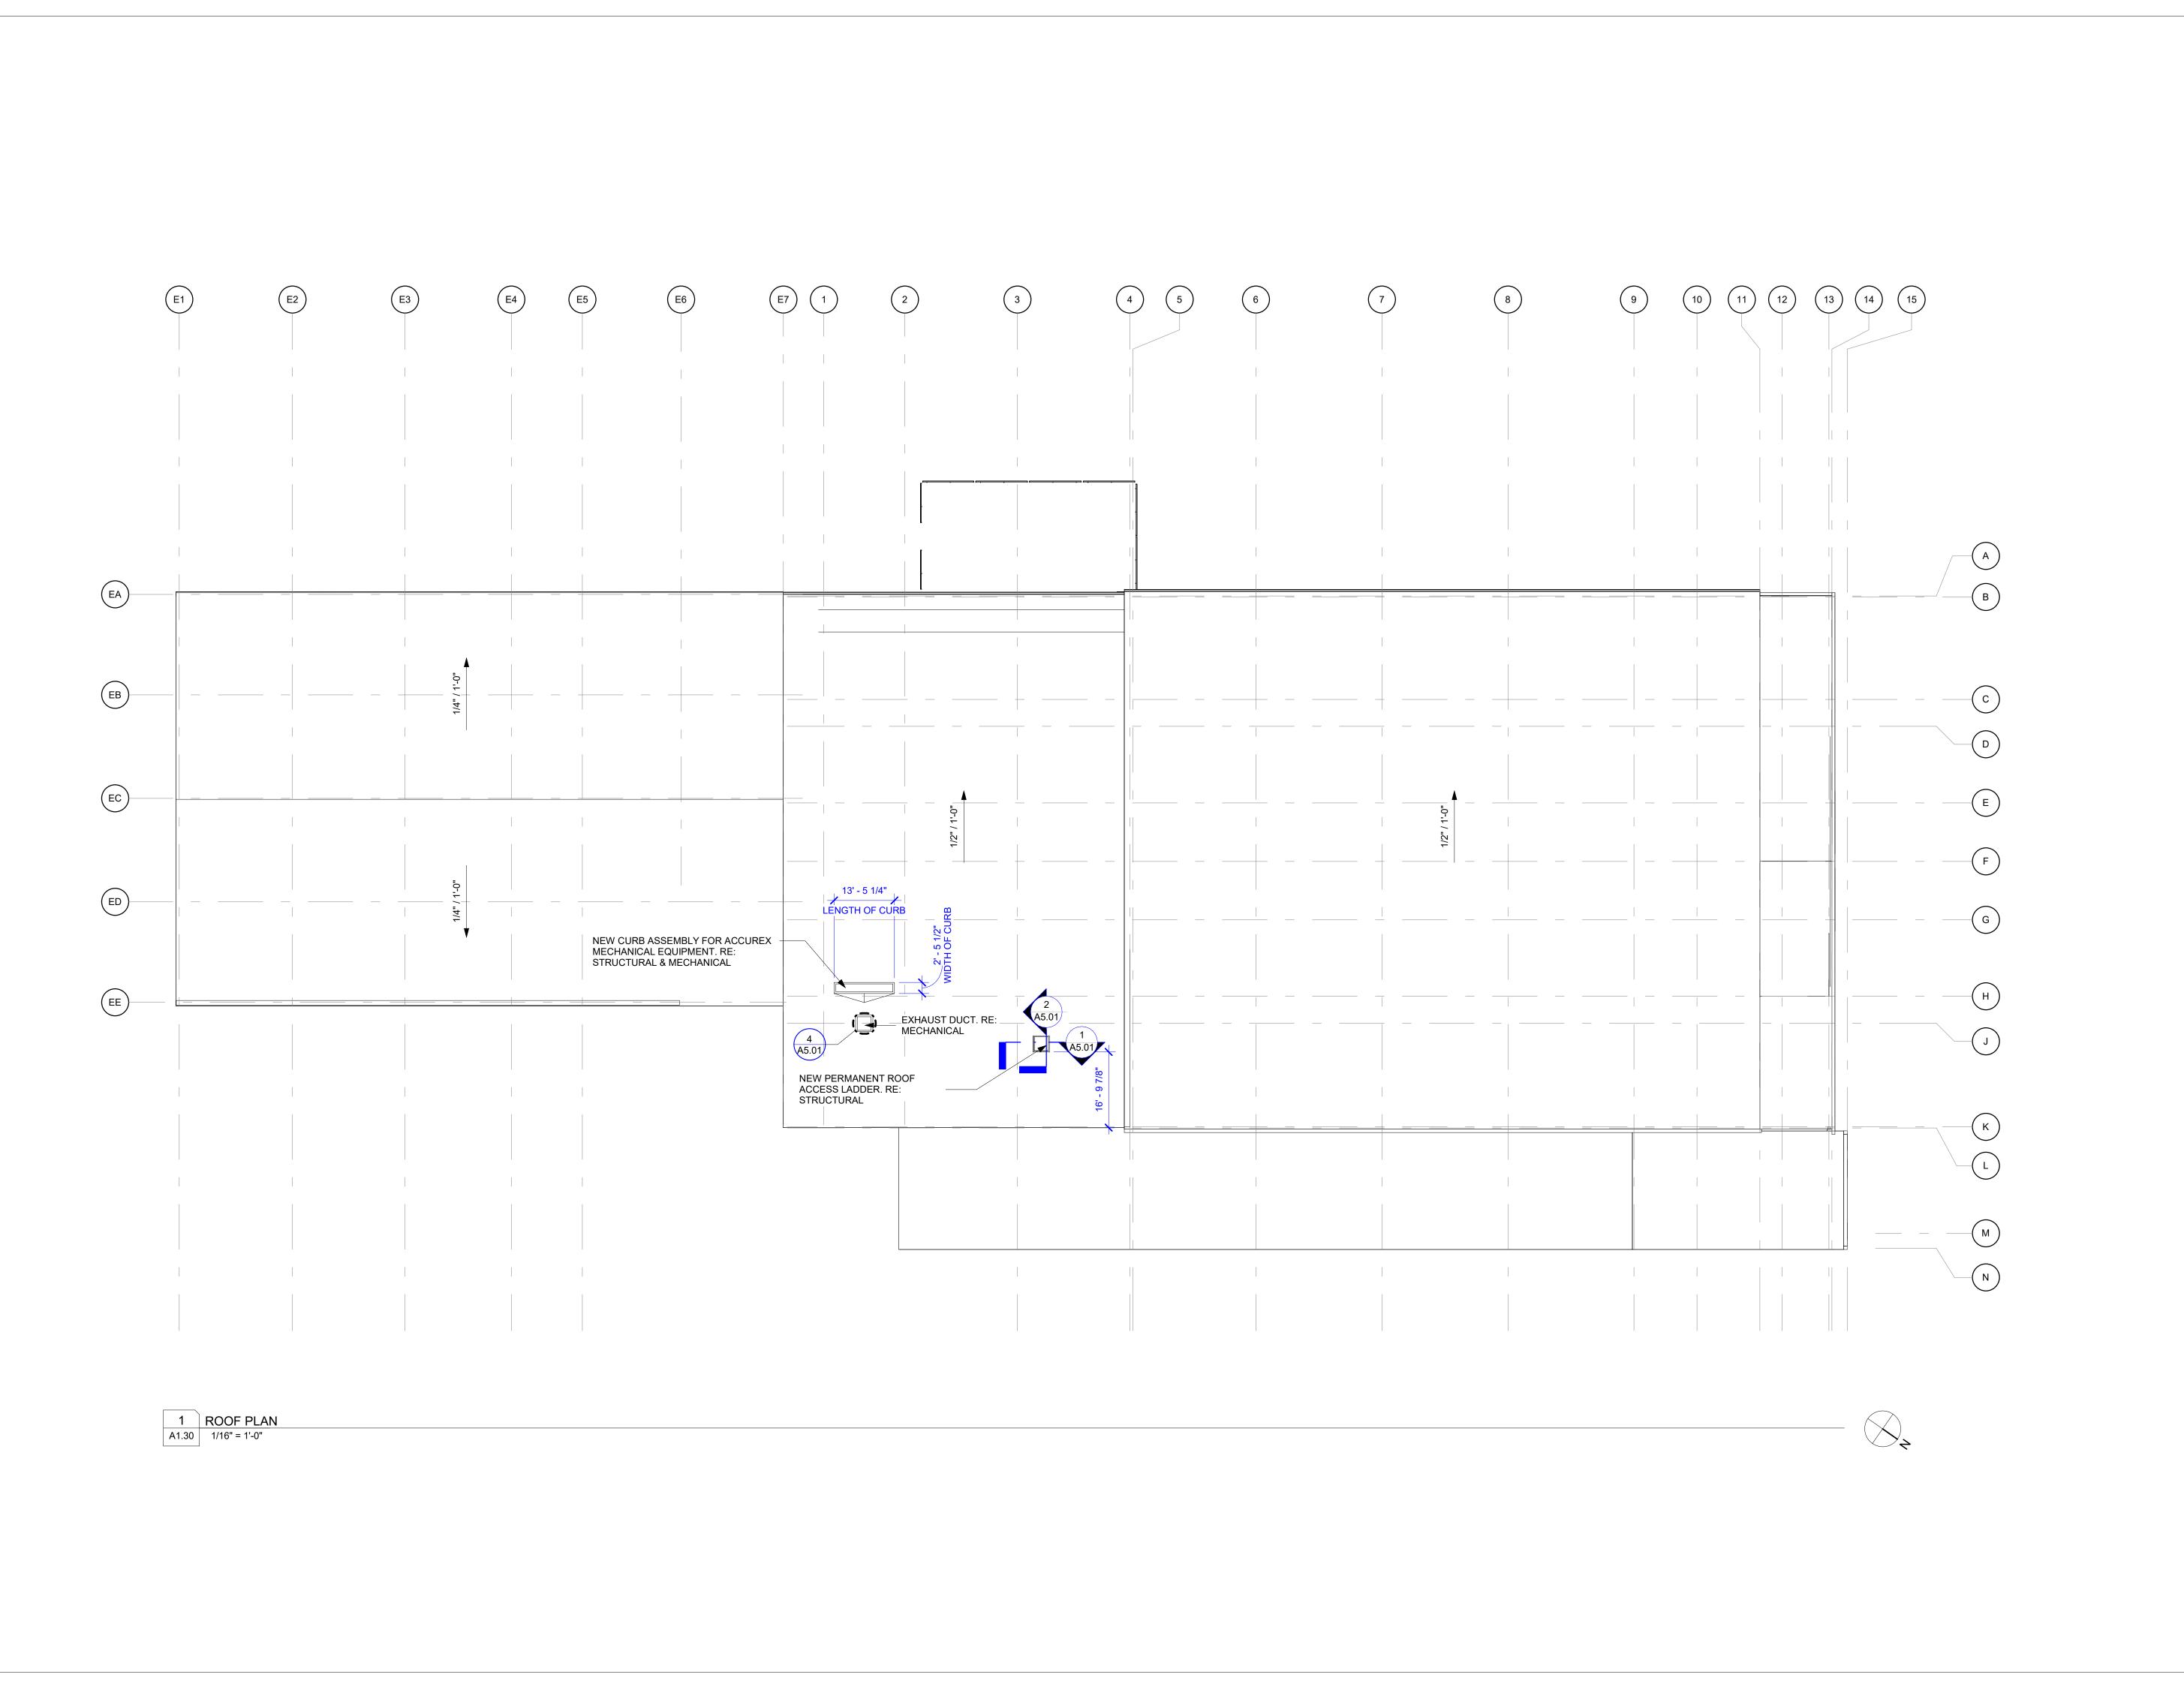


PELICANS CAMPUS IMPROVEMENTS
Metairie, Louisiana


WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024



ROOF PLAN

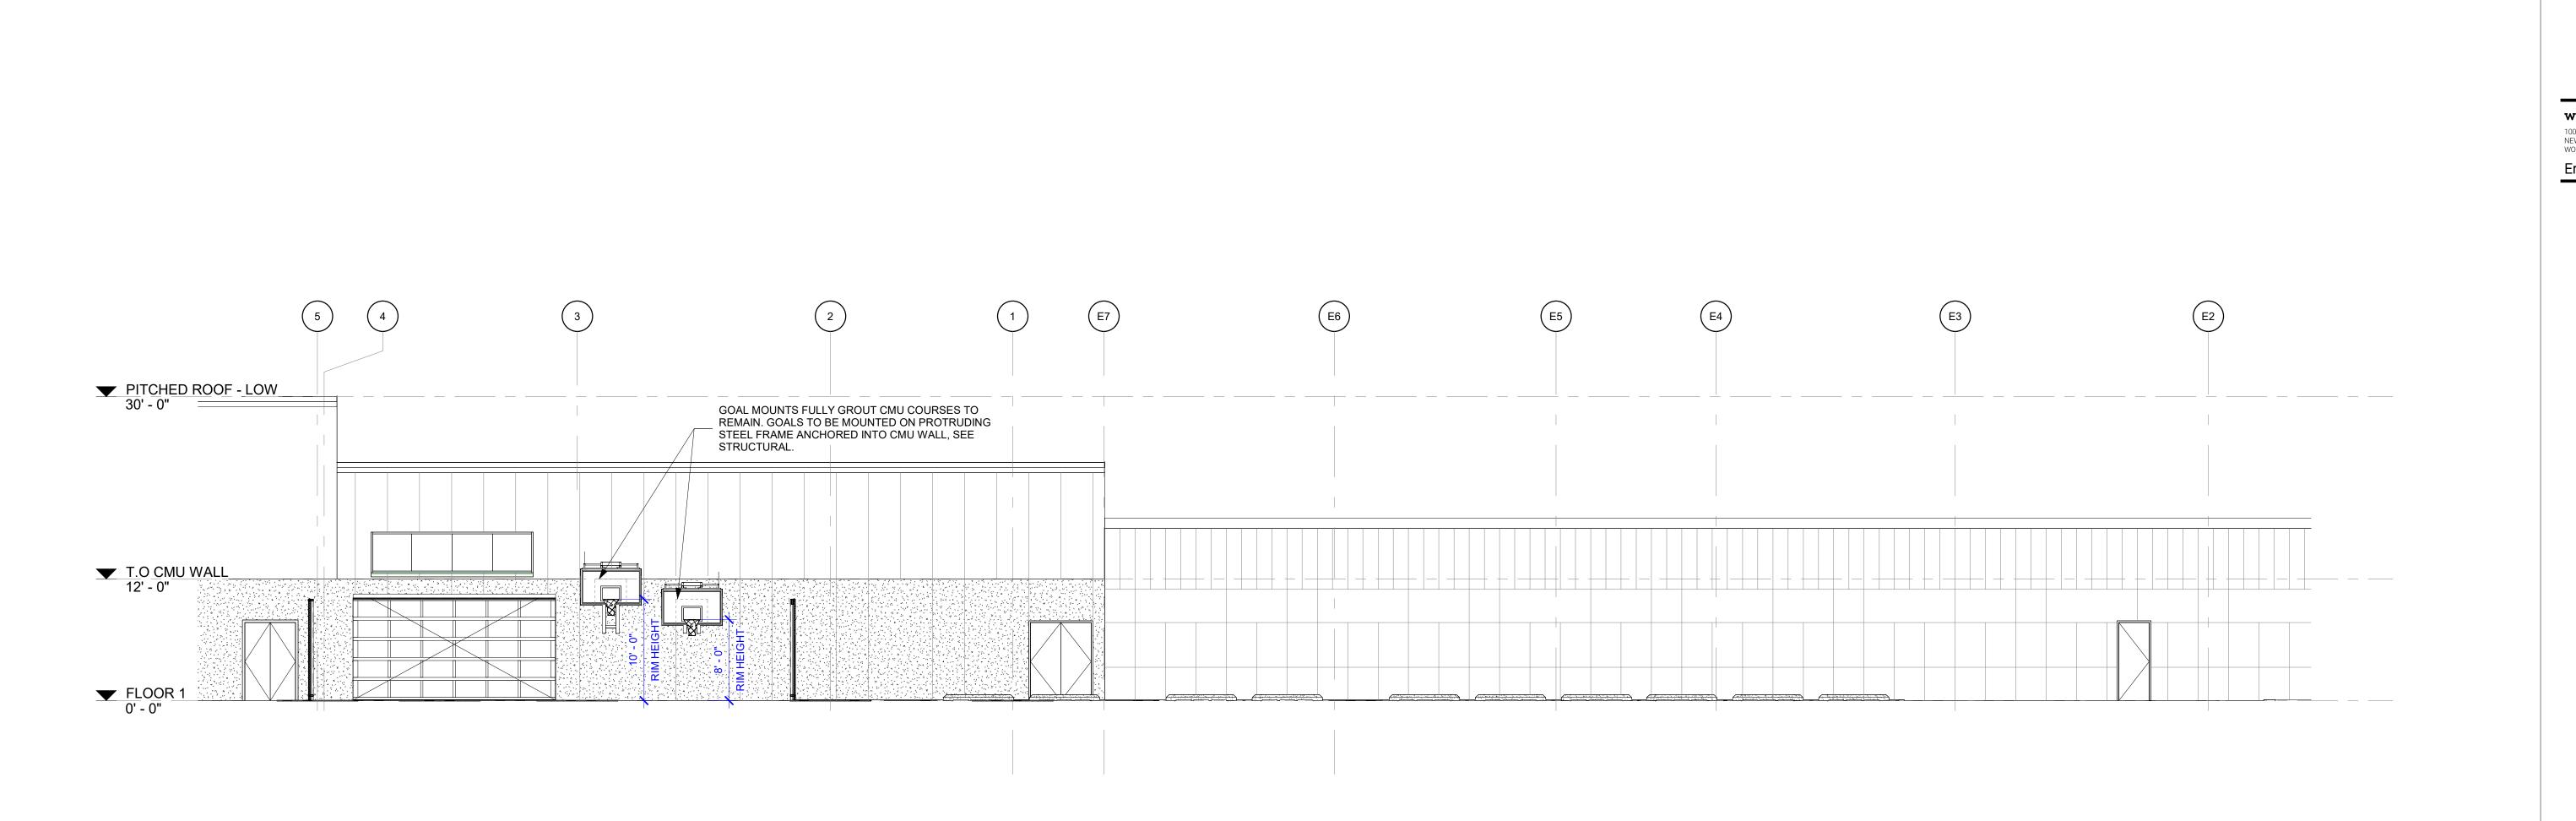

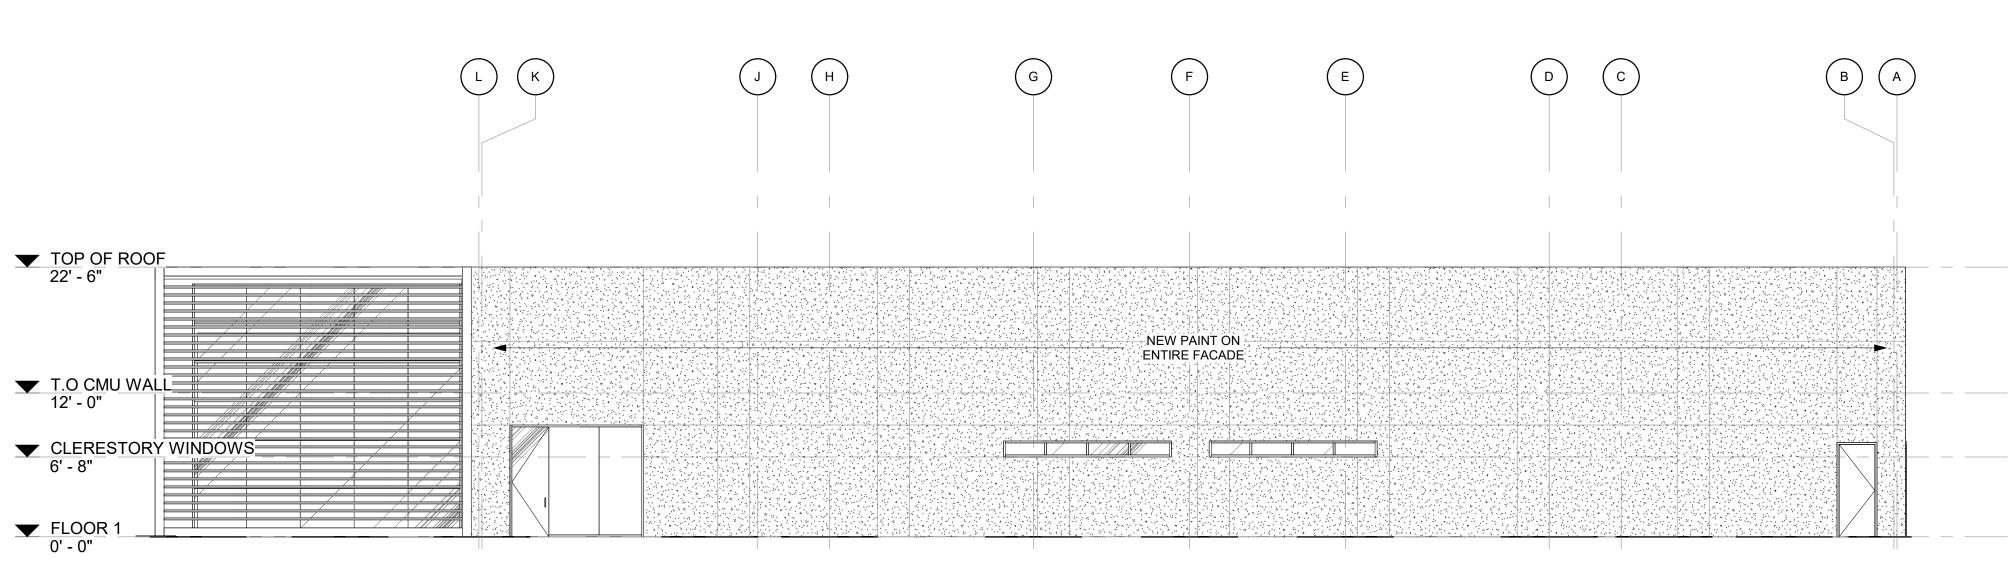

1 SOUTH ELEVATION - OUTDOOR TRAINING AREA
A2.00 1/8" = 1'-0"

2 WEST ELEVATION A2.00 1/8" = 1'-0"




woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443 Erik Wismar, AIA

PELICANS CAMPUS IMPROVEMENTS
Metairie, Louisiana

WDG PROJECT NO | AR2315


CONSTRUCTION DOCUMENTS 04.15.2024

EXTERIOR ELEVATIONS

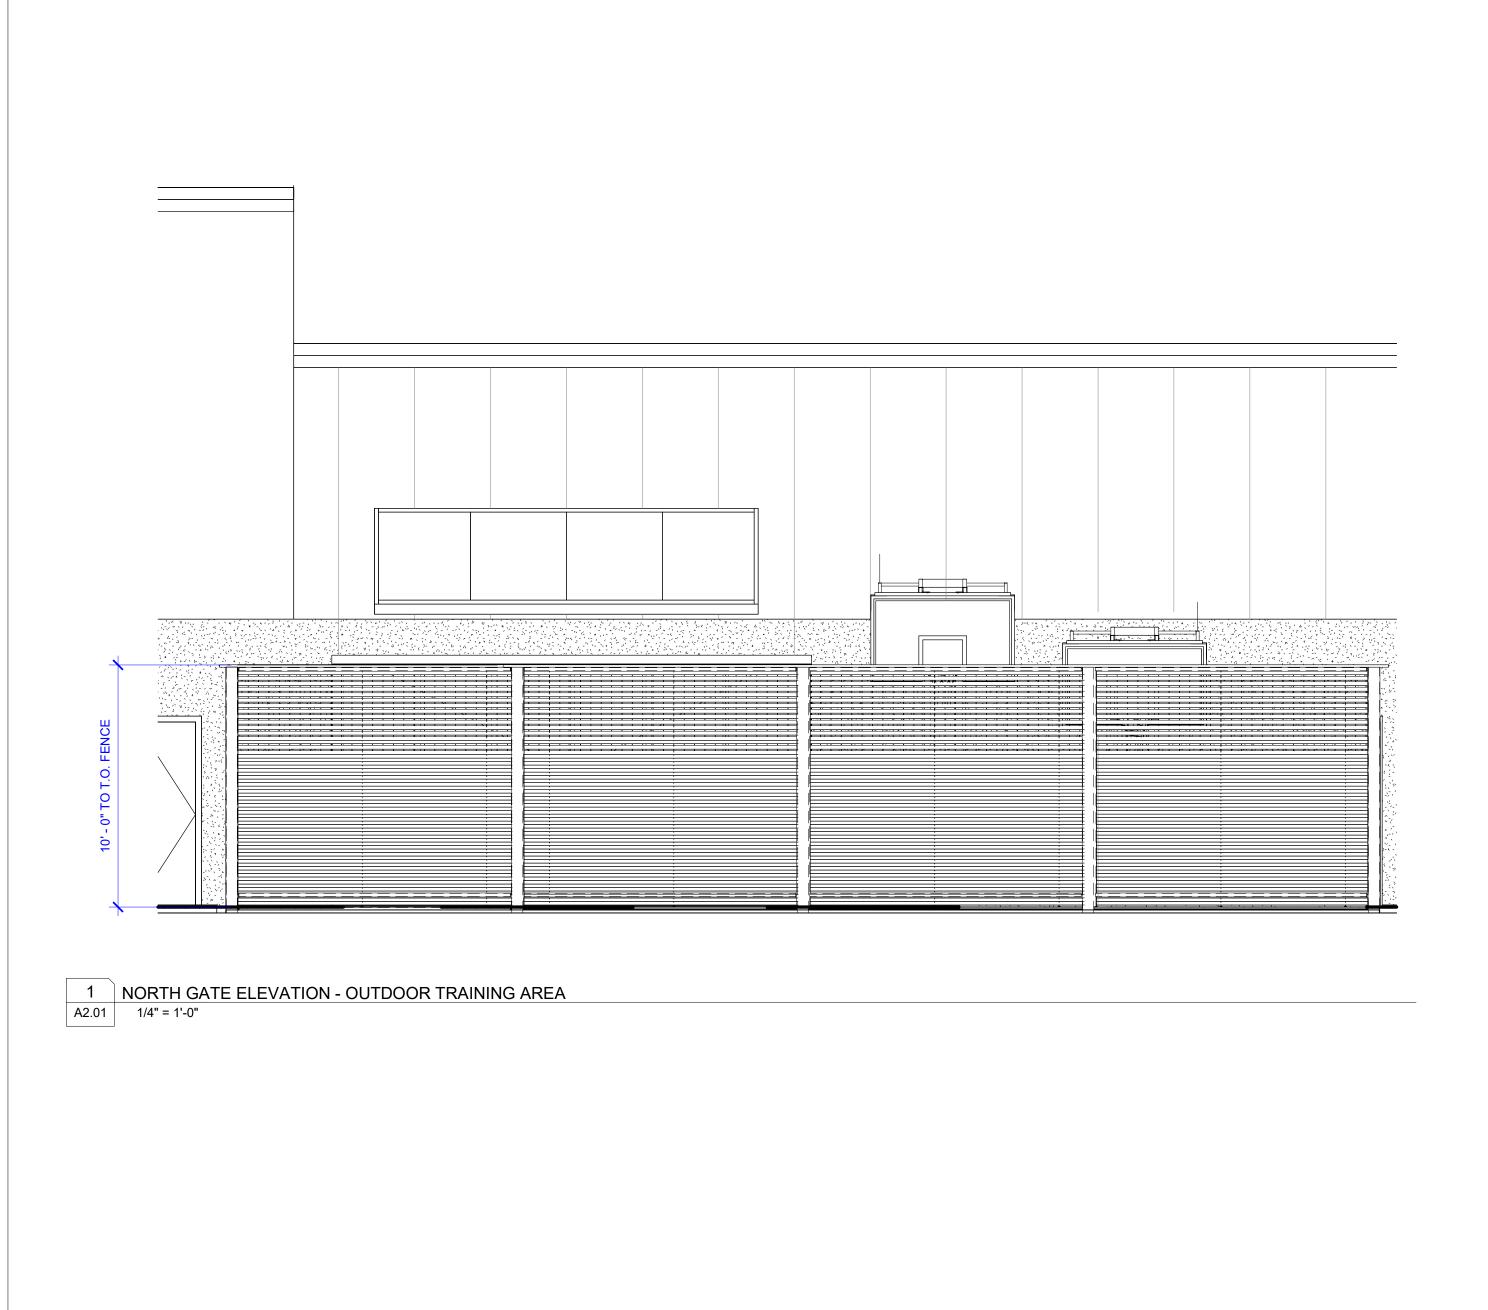



2 WEST GATE ELEVATION - OUTDOOR TRAINING AREA
A2.01 1/4" = 1'-0"

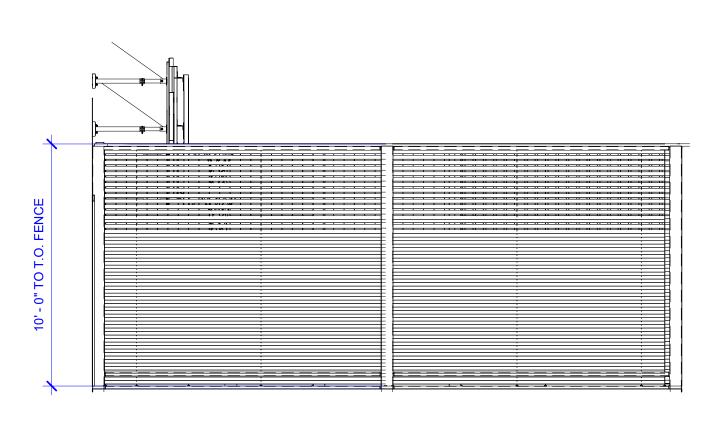

3 EAST GATE ELEVATION - OUTDOOR TRAINING AREA
A2.01 1/4" = 1'-0"

PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana

woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443


Erik Wismar, AIA


WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024



REVISIO	INS	
no.	descripton	dat

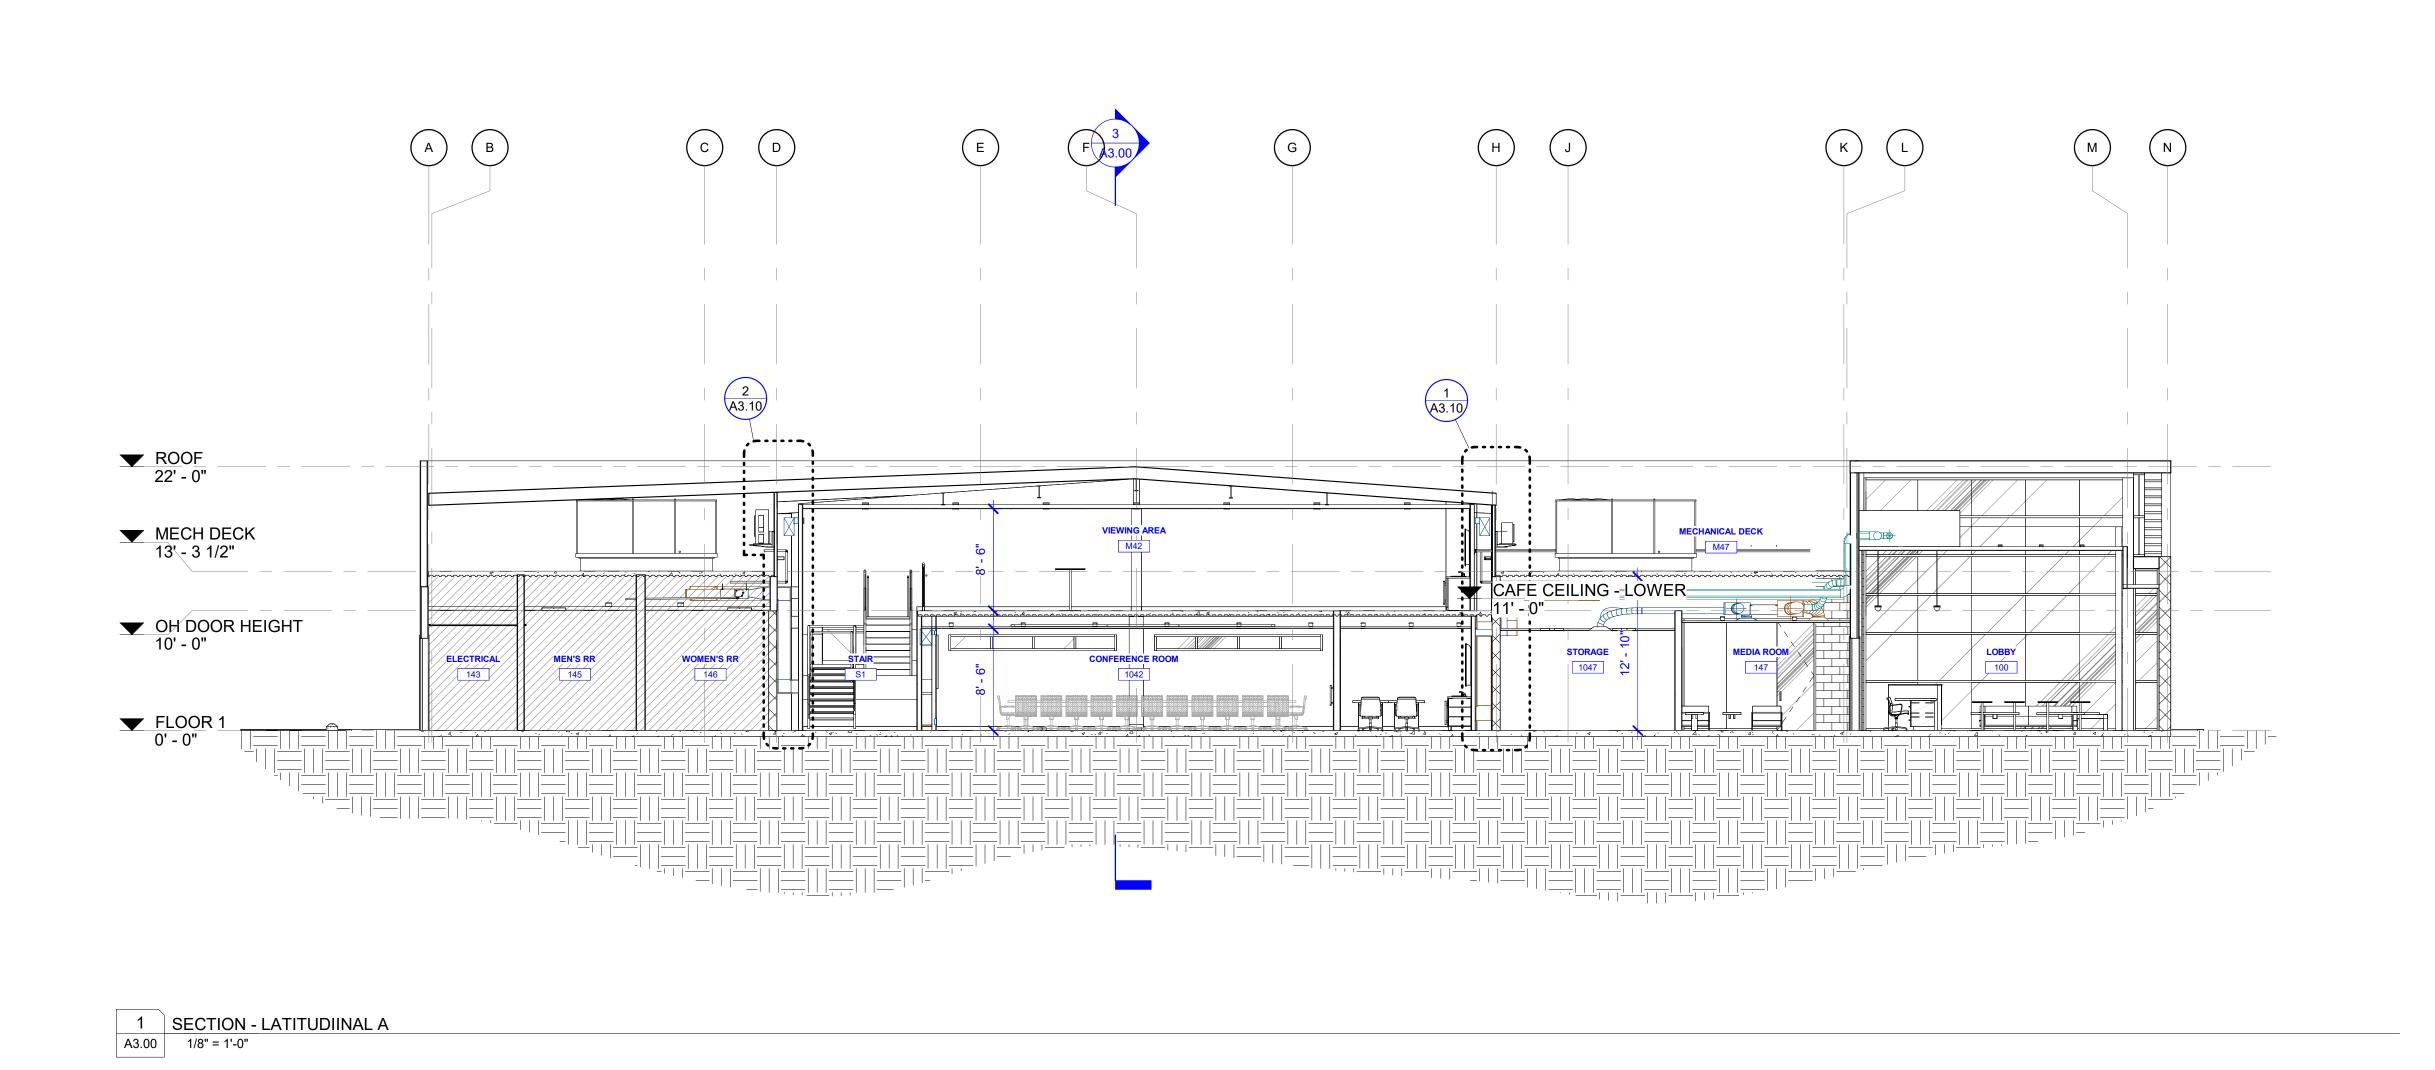

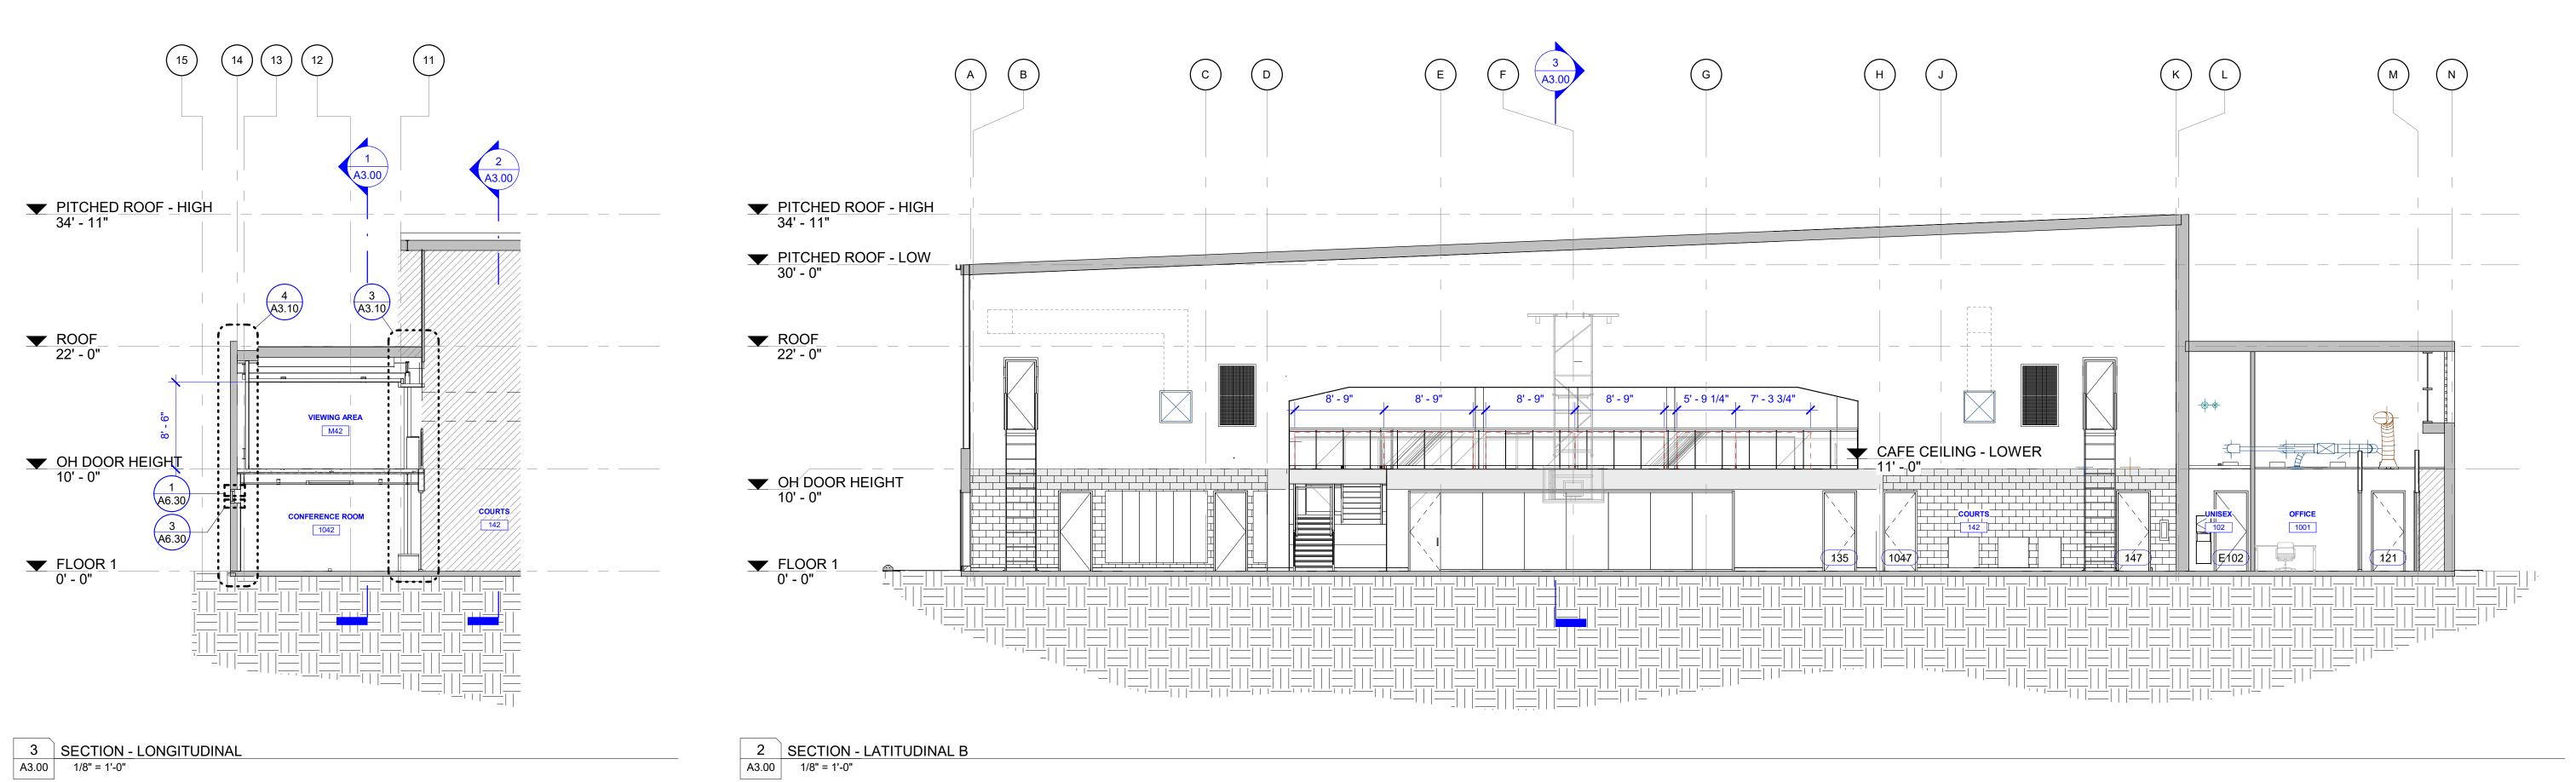



PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024

REVISIONS

BUILDING SECTIONS



woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA

Metairie, Louisiana

PELICANS CAMPUS IMPROVEMENTS


WDG PROJECT NO | AR2315


CONSTRUCTION DOCUMENTS 04.15.2024

REVISIONS

no. descripton date

BUILDING SECTIONS

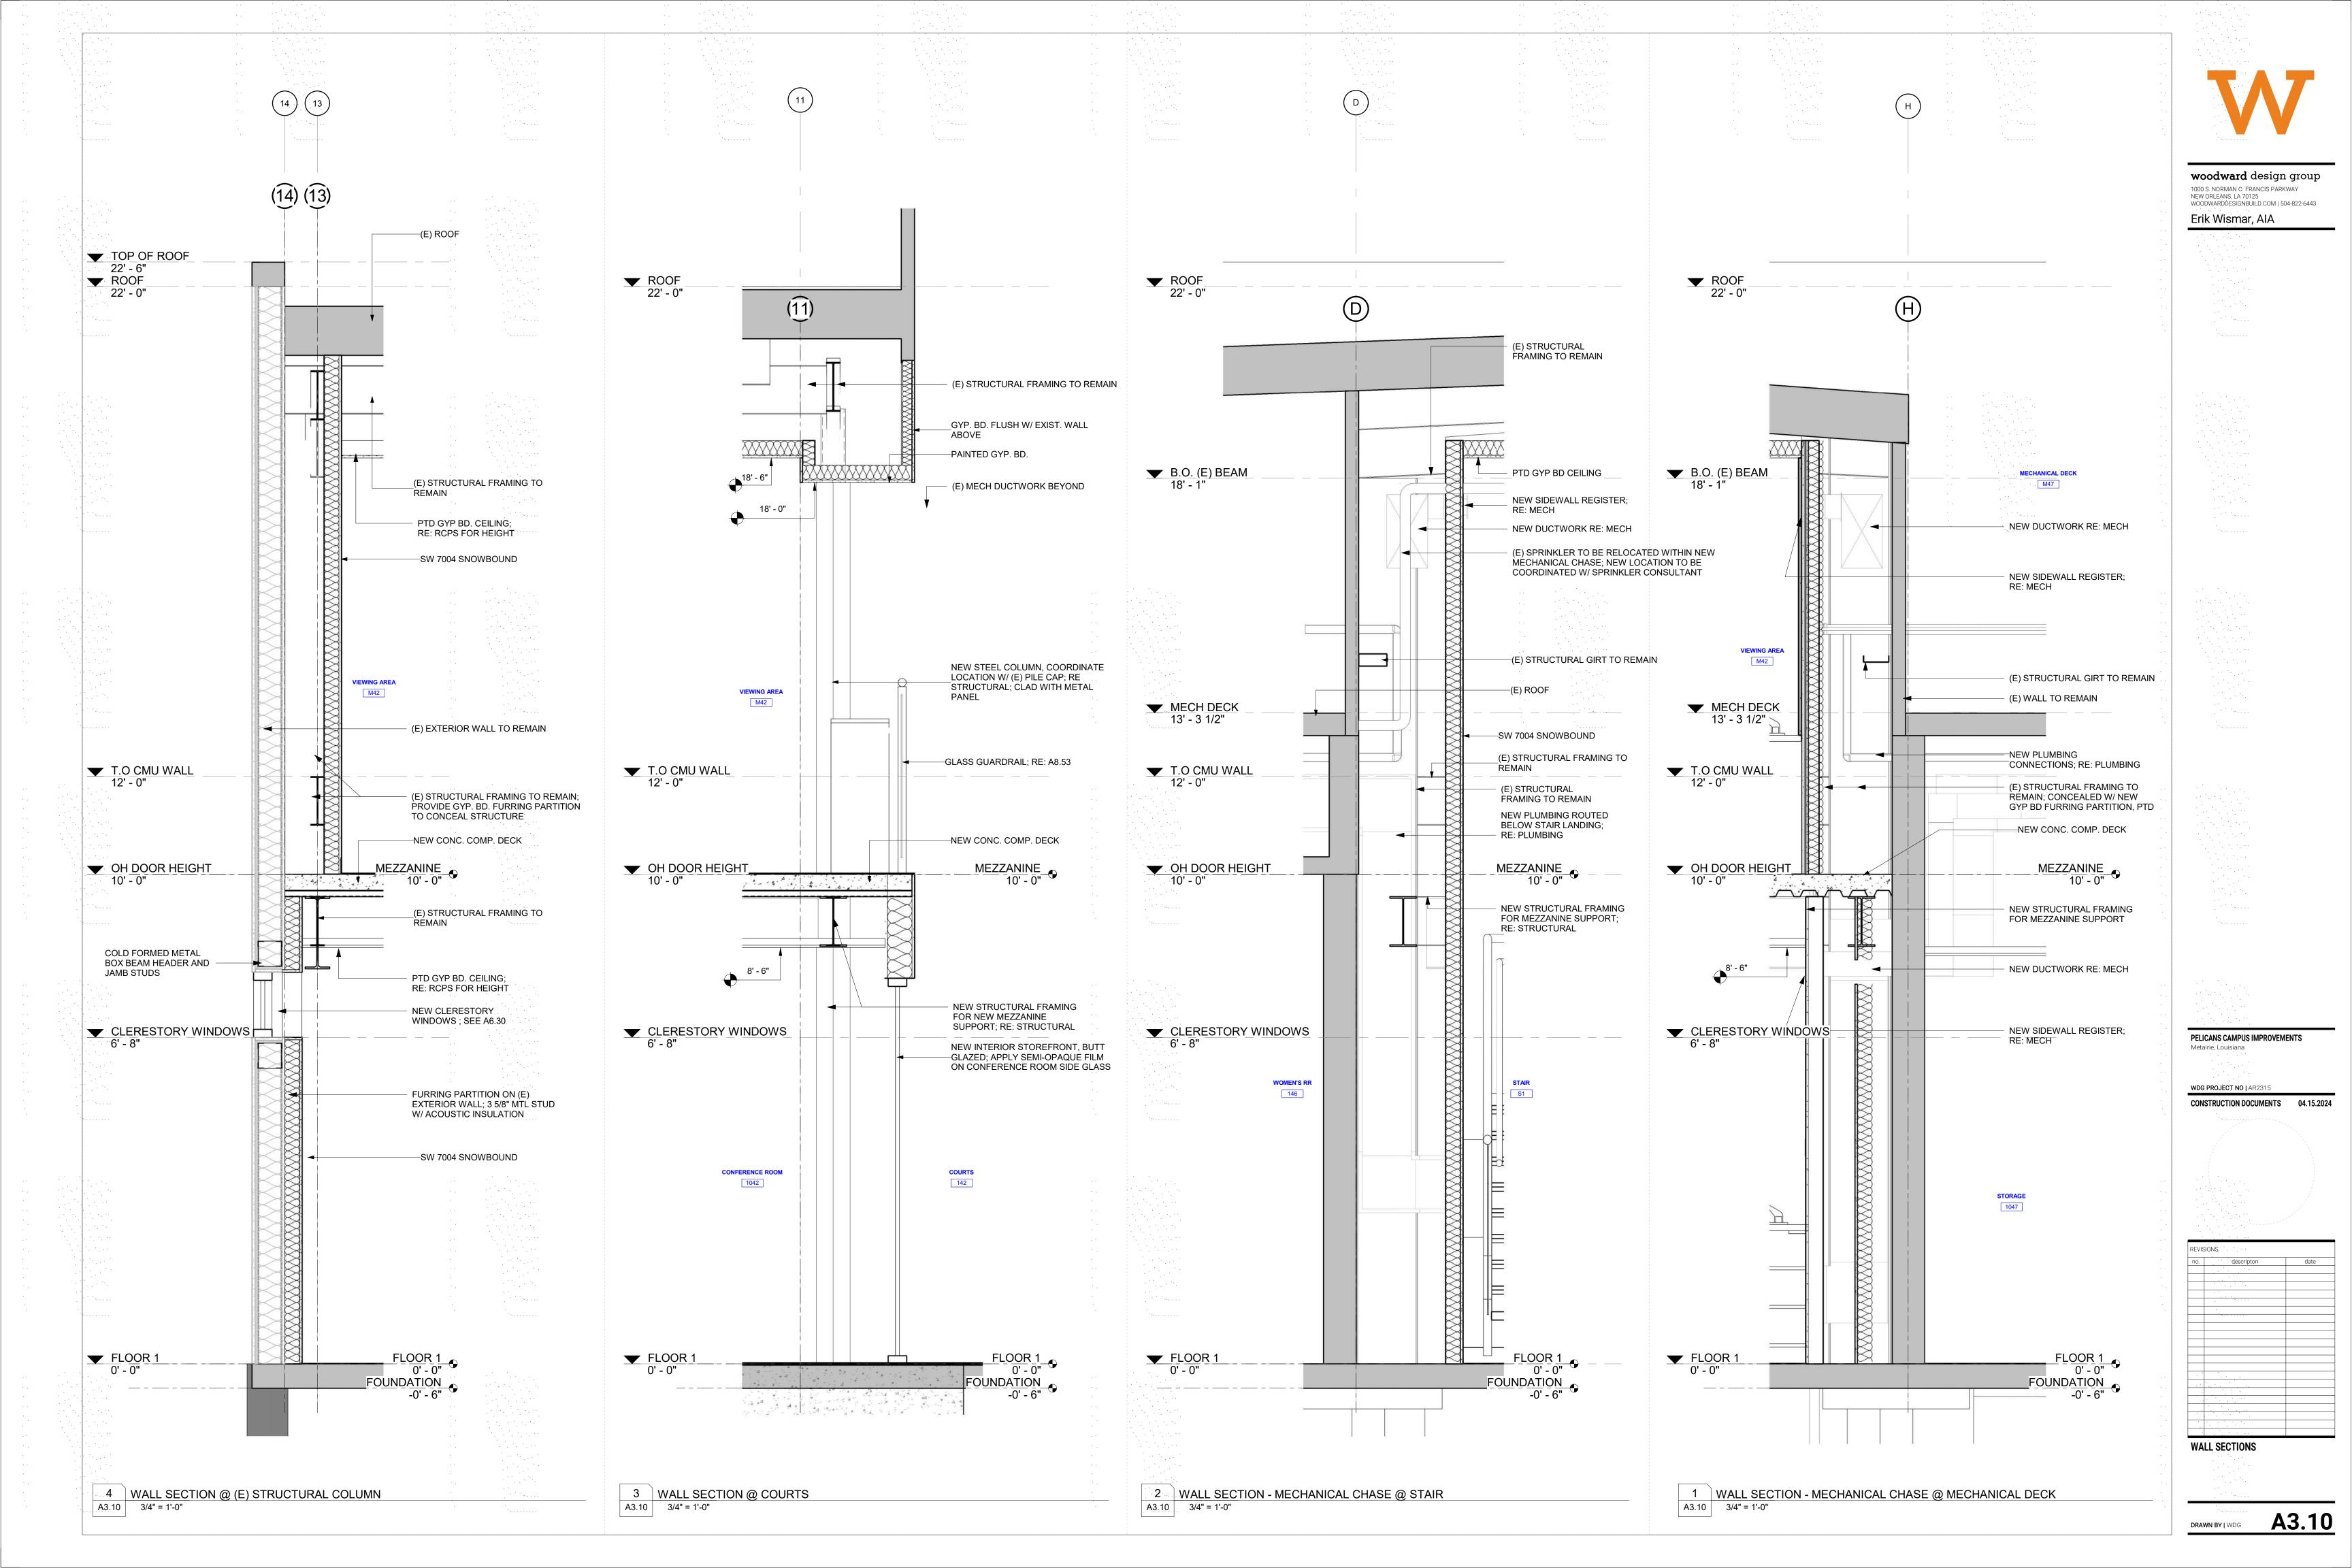

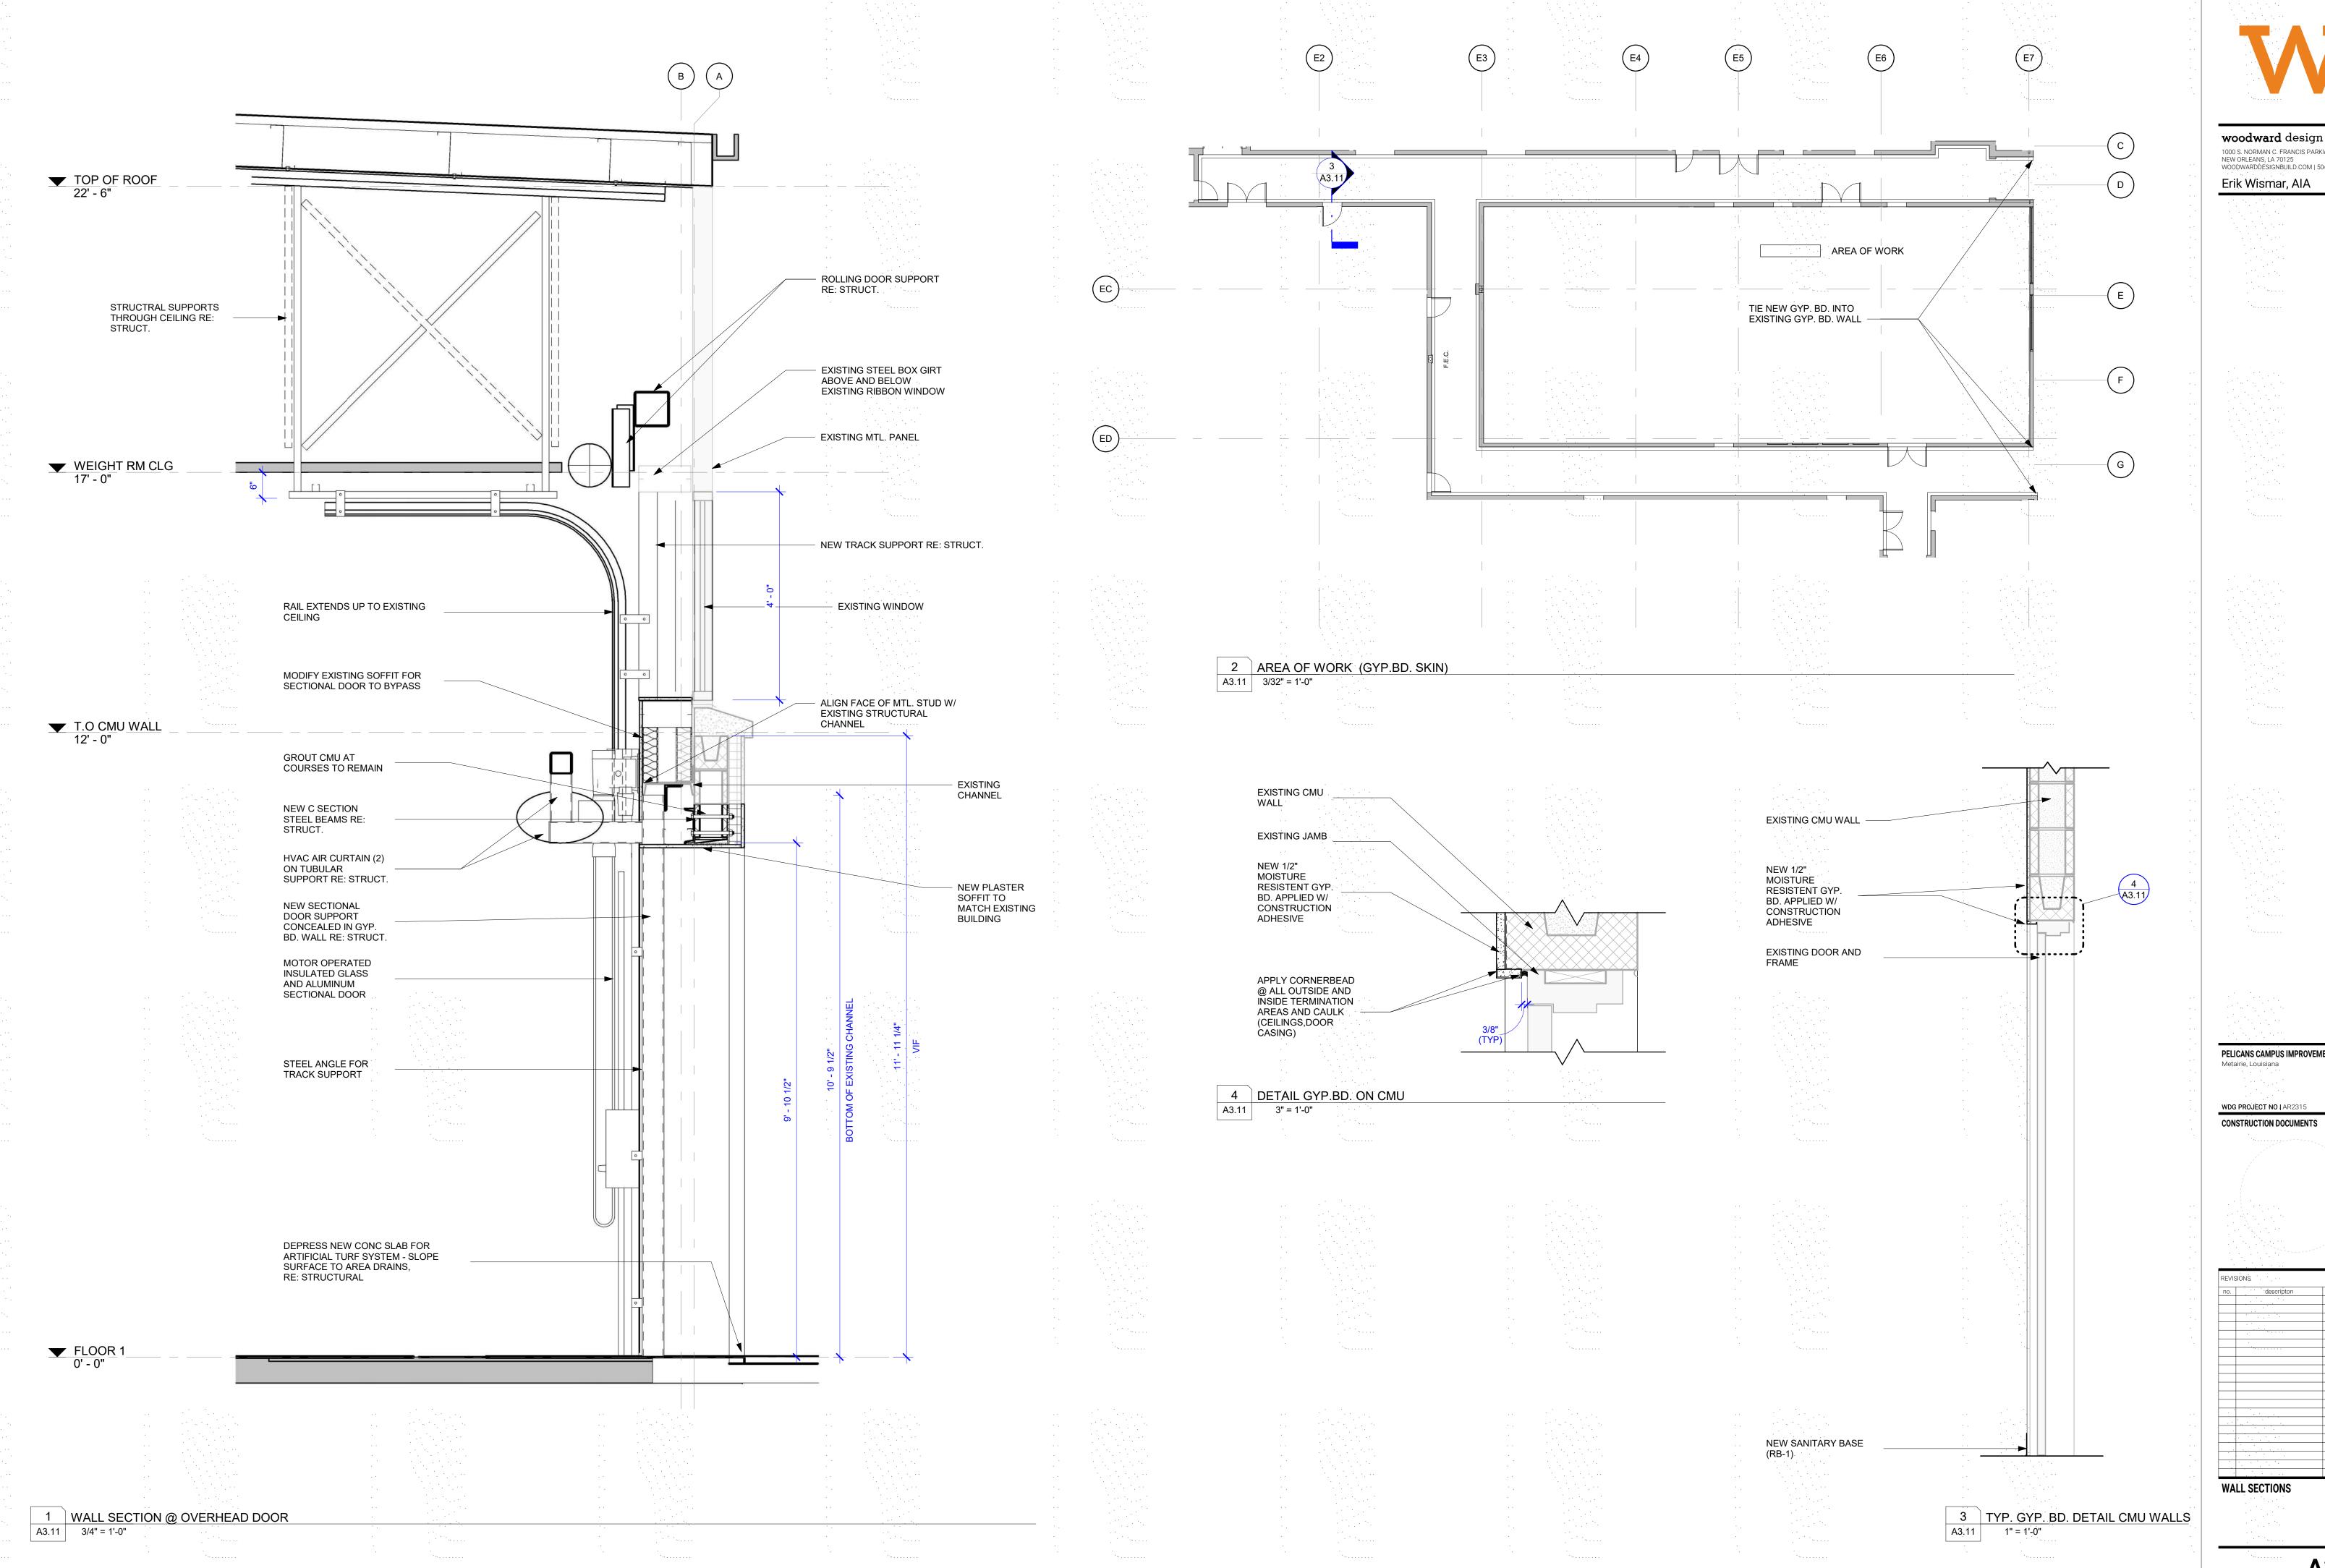




PELICANS CAMPUS IMPROVEMENTS

CONSTRUCTION DOCUMENTS 04.15.2024

A3.11 DRAWN BY | WDG

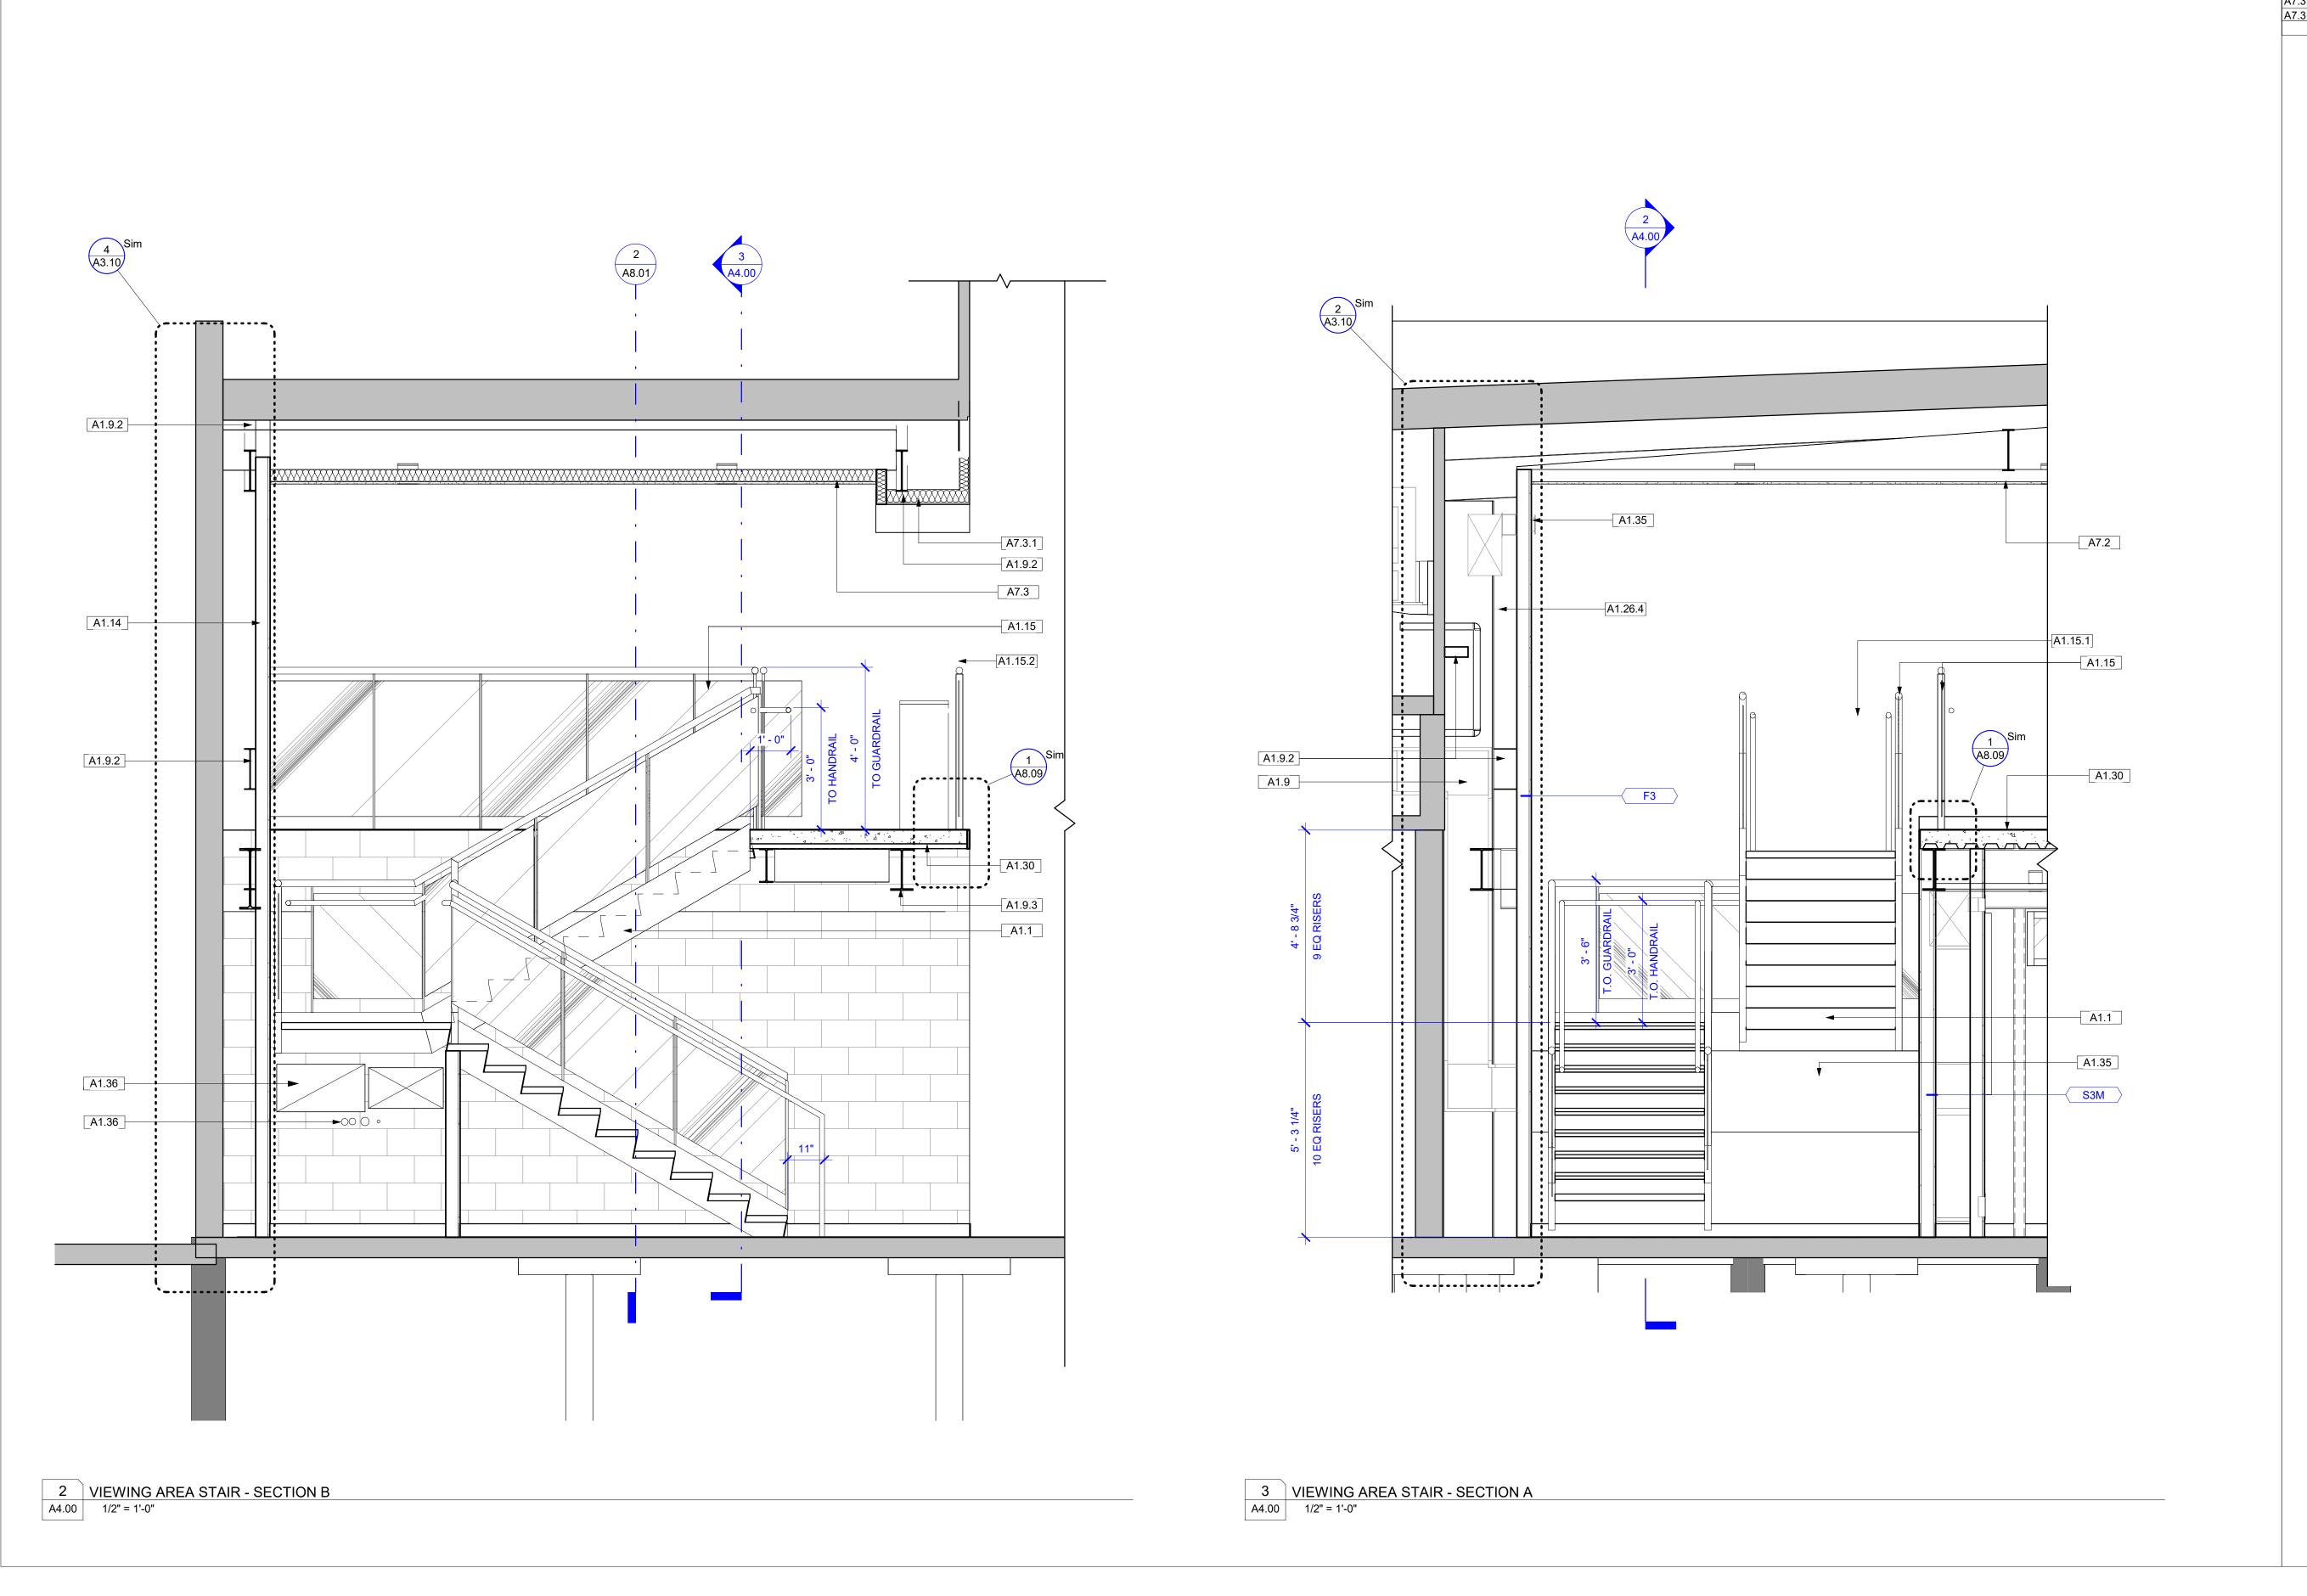

KEYNOTES - ARCHITECTURAL

A1.1 NEW PREFABRICATED STAIR; CONCRETE FILLED METAL STAIR PAN W/ RUBBER TREADS AND PAINTED STEEL HANDRAILS AND GUARDRAILS A1.9 (E) STRUCTURAL COLUMN TO REMAIN

A1.9.2 (E) STRUCTURAL FRAMING TO REMAIN A1.9.3 NEW STEEL BEAM, RE: STRUCT

A1.14 GWB FUR OUT CONCEALS EXISTING BEAM AT FLOOR LEVEL

A1.15 42" H STEEL GUARDRAIL W/ GLASS PANELS A1.15.1 36" H STEEL HANDRAIL

A1.15.2 48" H STEEL GUARDRAIL W/ GLASS PANELS A1.26.4 MECHANICAL CHASE RE: MECH

A1.30 NEW COMPOSITE METAL FLOOR DECK; RE: STRUCT A1.35 SIDEWALL REGISTER; RE: MECH A1.36 NEW PLUMBING CONNECTION ROUTED BELOW STAIR LANDING; RE: PLUMB

A7.3 GWB FINISHED CEILING, PTD; RE: FINISH SCHEDULE

A7.2 COORDINATE W/ STRUCTURE TO ACHIEVE HIGHEST POSSIBLE FINISHED CEILING A7.3.1 GWB BULKHEAD & SOFFIT, PTD; RE: FINISH SCHEDULE


PELICANS CAMPUS IMPROVEMENTS

woodward design group


1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA

WDG PROJECT NO | AR2315 CONSTRUCTION DOCUMENTS 04.15.2024

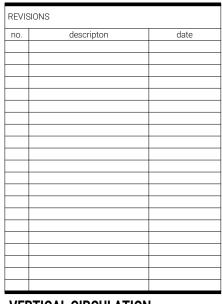

VERTICAL CIRCULATION

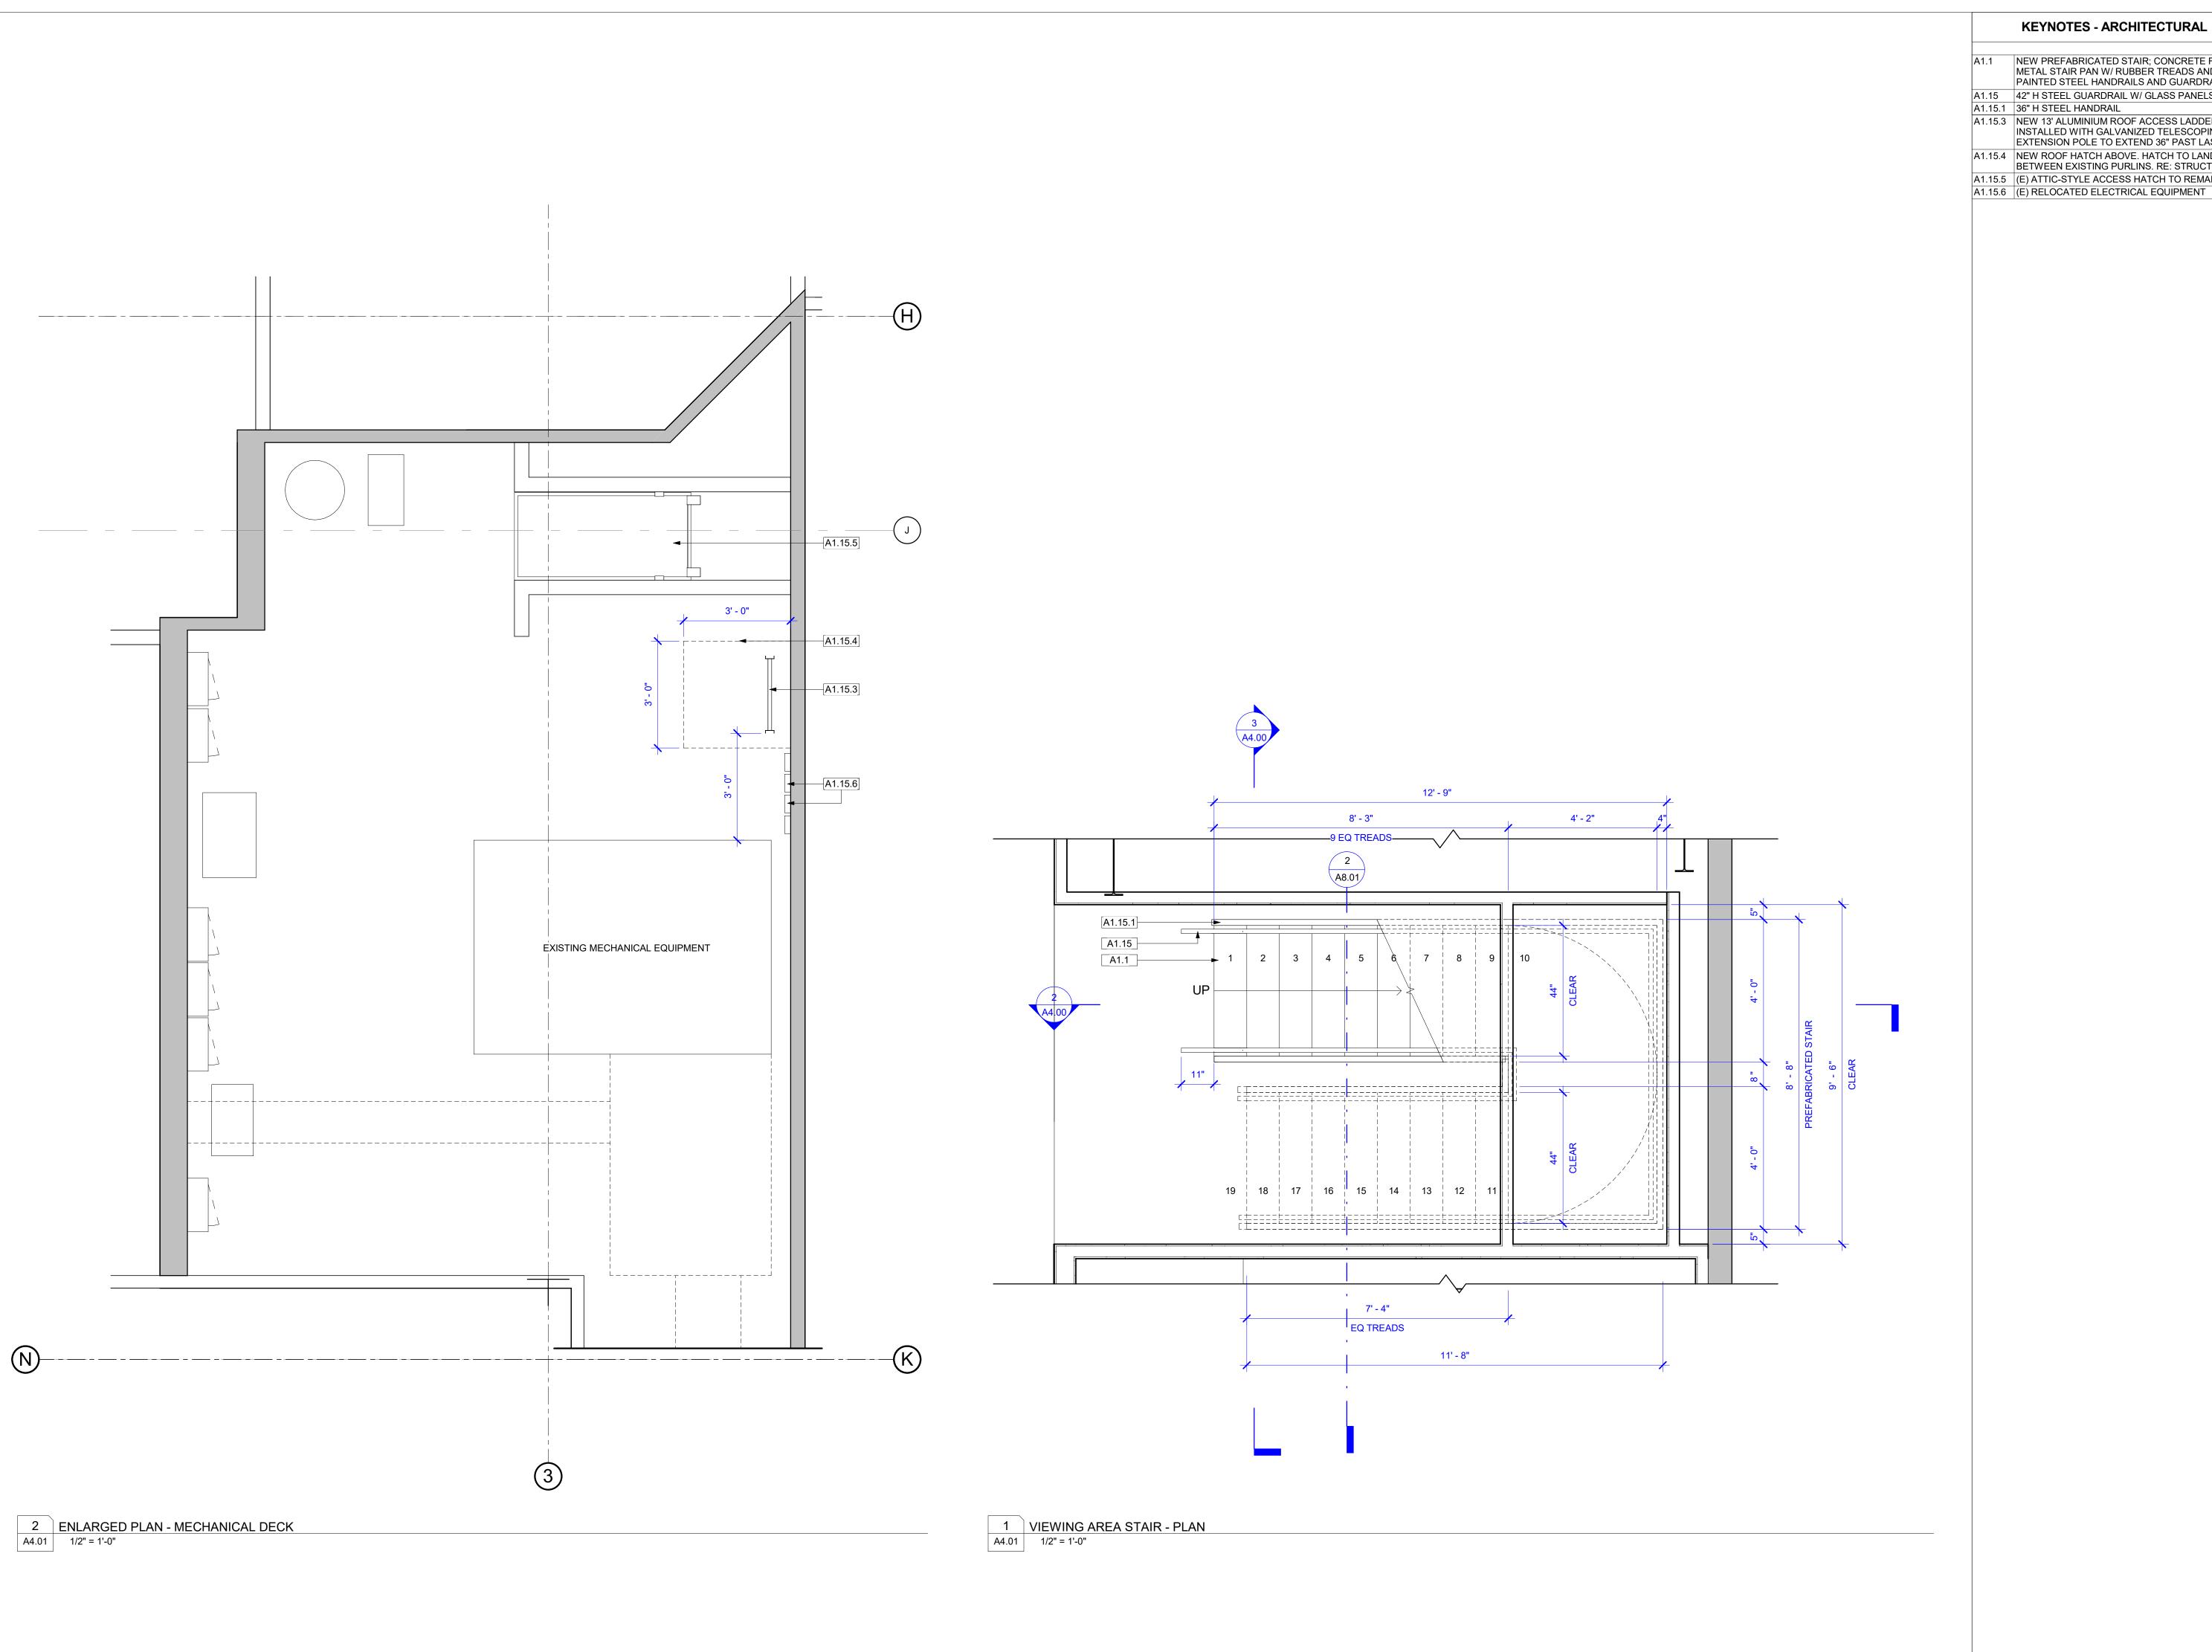

KEYNOTES - ARCHITECTURAL

NEW PREFABRICATED STAIR; CONCRETE FILLED METAL STAIR PAN W/ RUBBER TREADS AND PAINTED STEEL HANDRAILS AND GUARDRAILS

A1.15 42" H STEEL GUARDRAIL W/ GLASS PANELS A1.15.1 36" H STEEL HANDRAIL

A1.15.3 NEW 13' ALUMINIUM ROOF ACCESS LADDER.
INSTALLED WITH GALVANIZED TELESCOPING
EXTENSION POLE TO EXTEND 36" PAST LAST RUNG

A1.15.4 NEW ROOF HATCH ABOVE. HATCH TO LAND IN BETWEEN EXISTING PURLINS. RE: STRUCT. A1.15.5 (E) ATTIC-STYLE ACCESS HATCH TO REMAIN


woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443 Erik Wismar, AIA

PELICANS CAMPUS IMPROVEMENTS

WDG PROJECT NO | AR2315 CONSTRUCTION DOCUMENTS 04.15.2024



no.	descripton	date
110.	иезырын	uate
		+

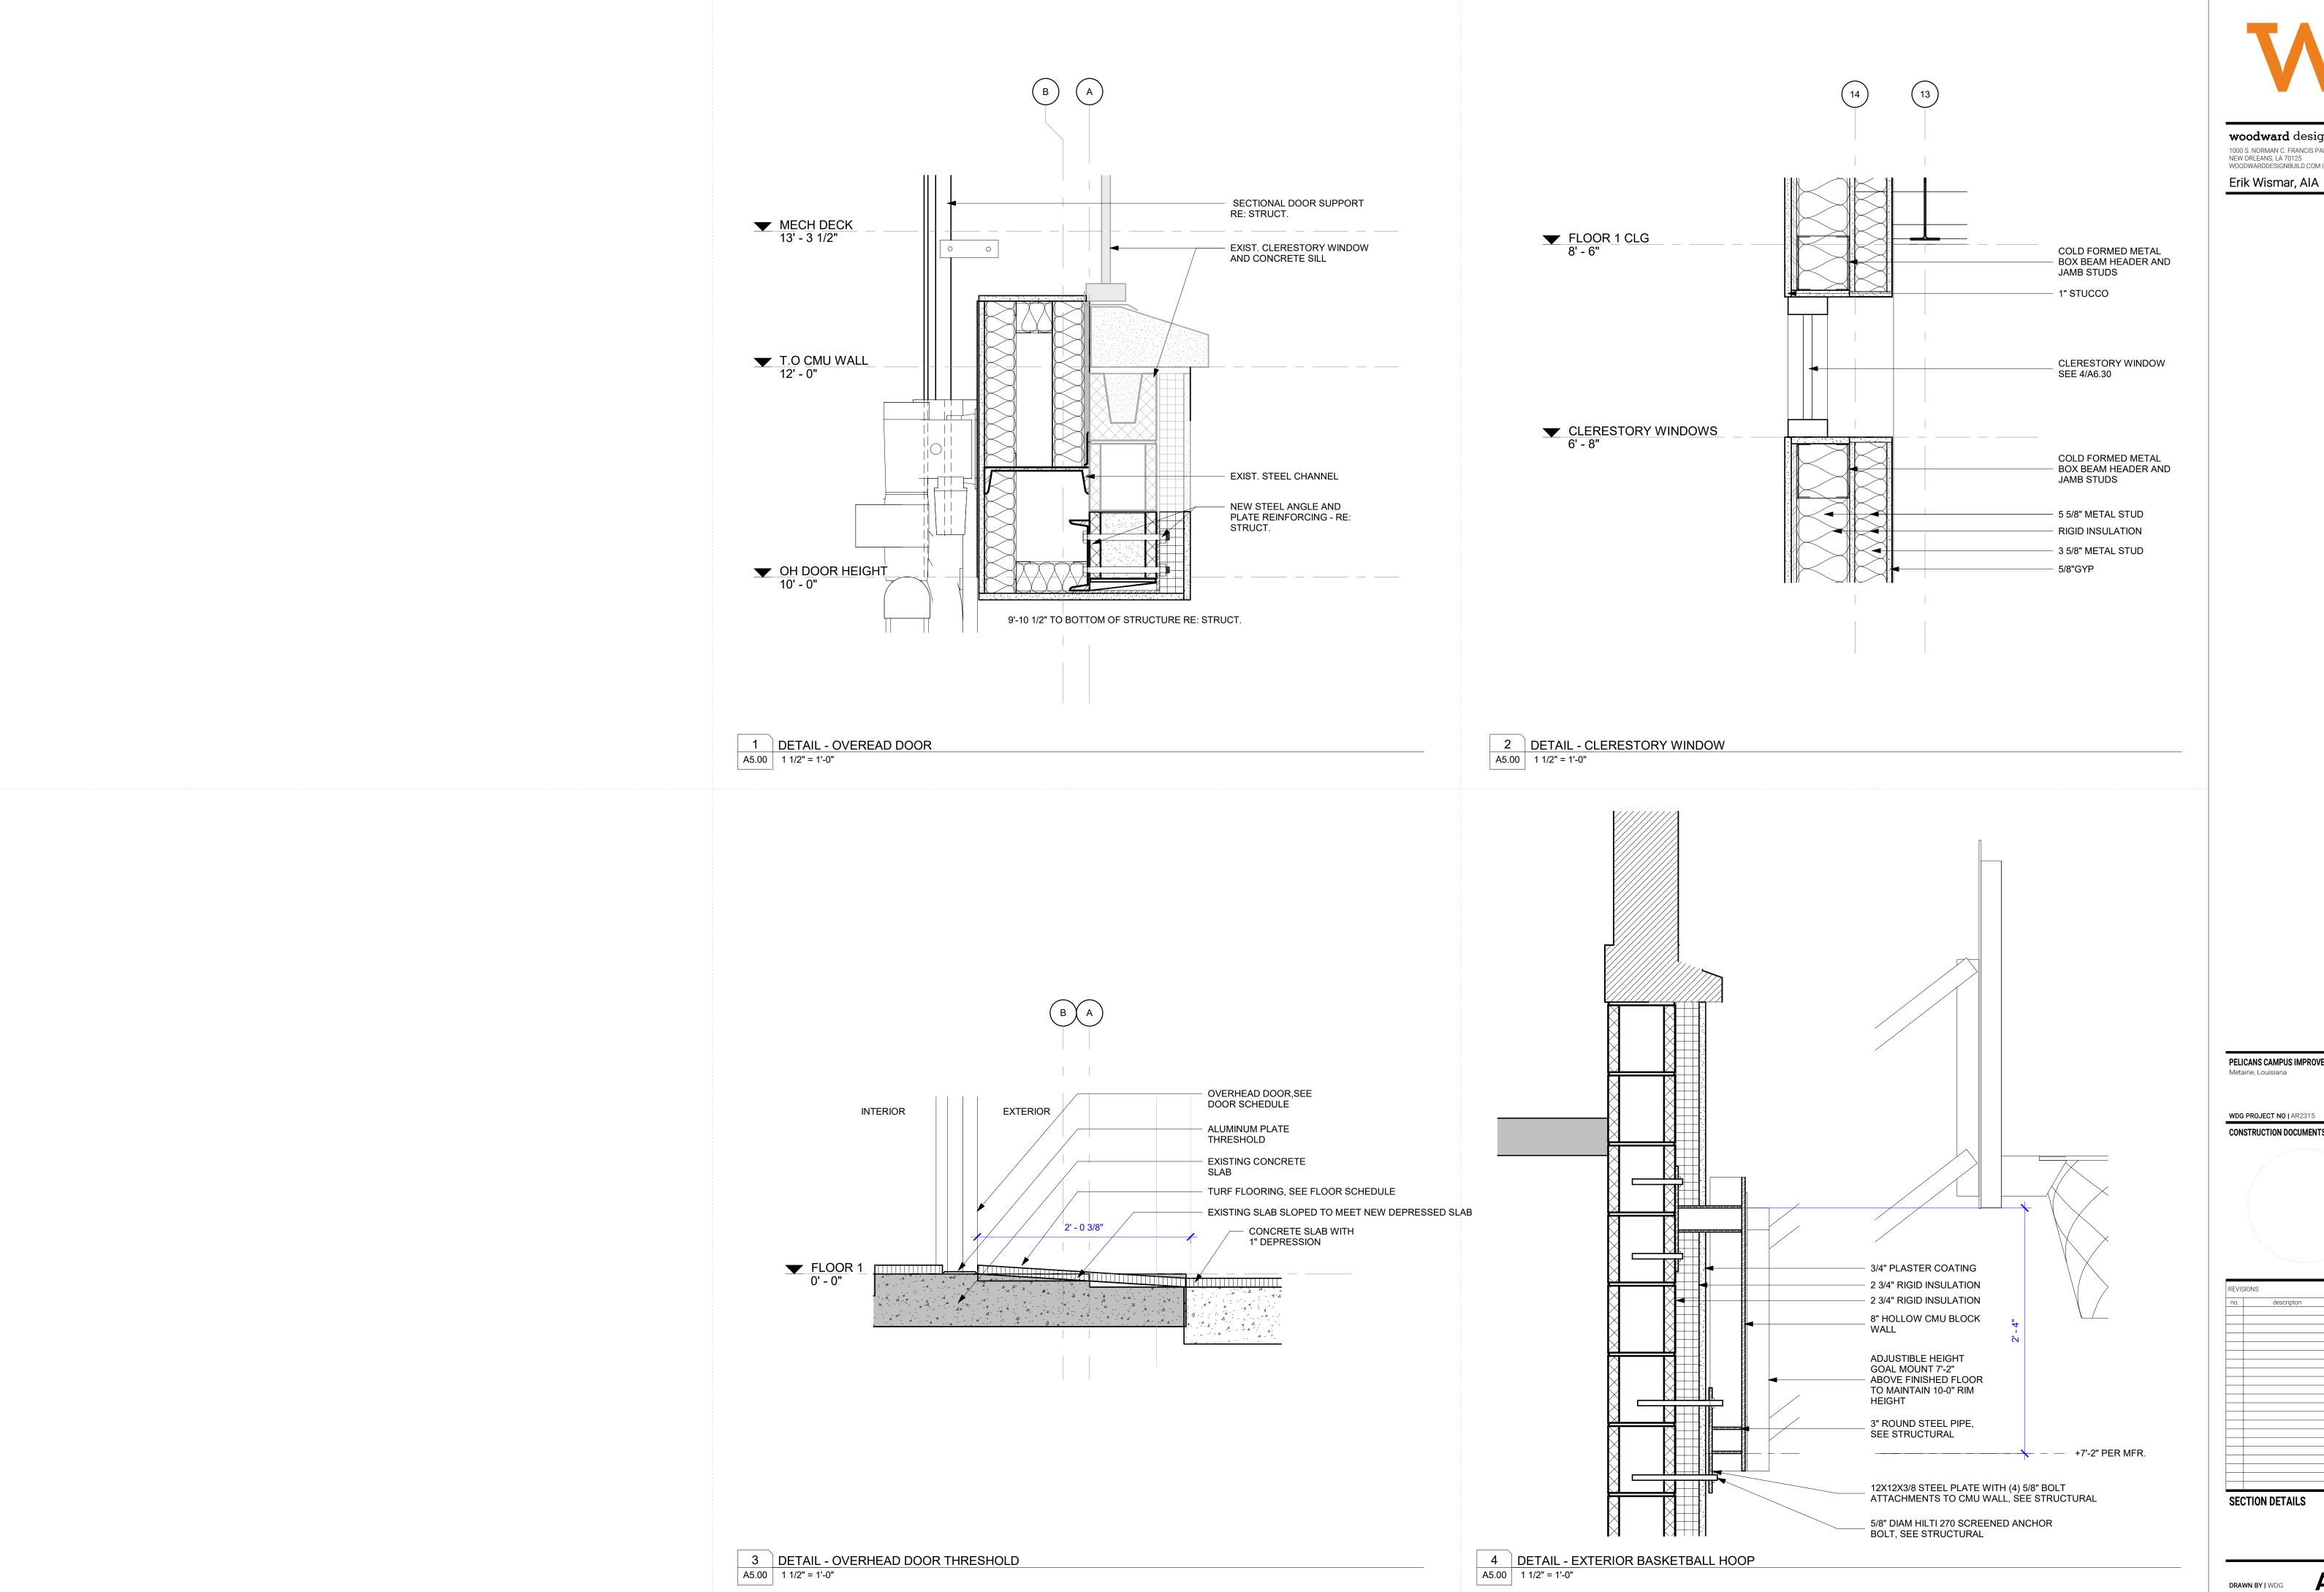




PELICANS CAMPUS IMPROVEMENTS


WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024



SECTION DETAILS

A5.00

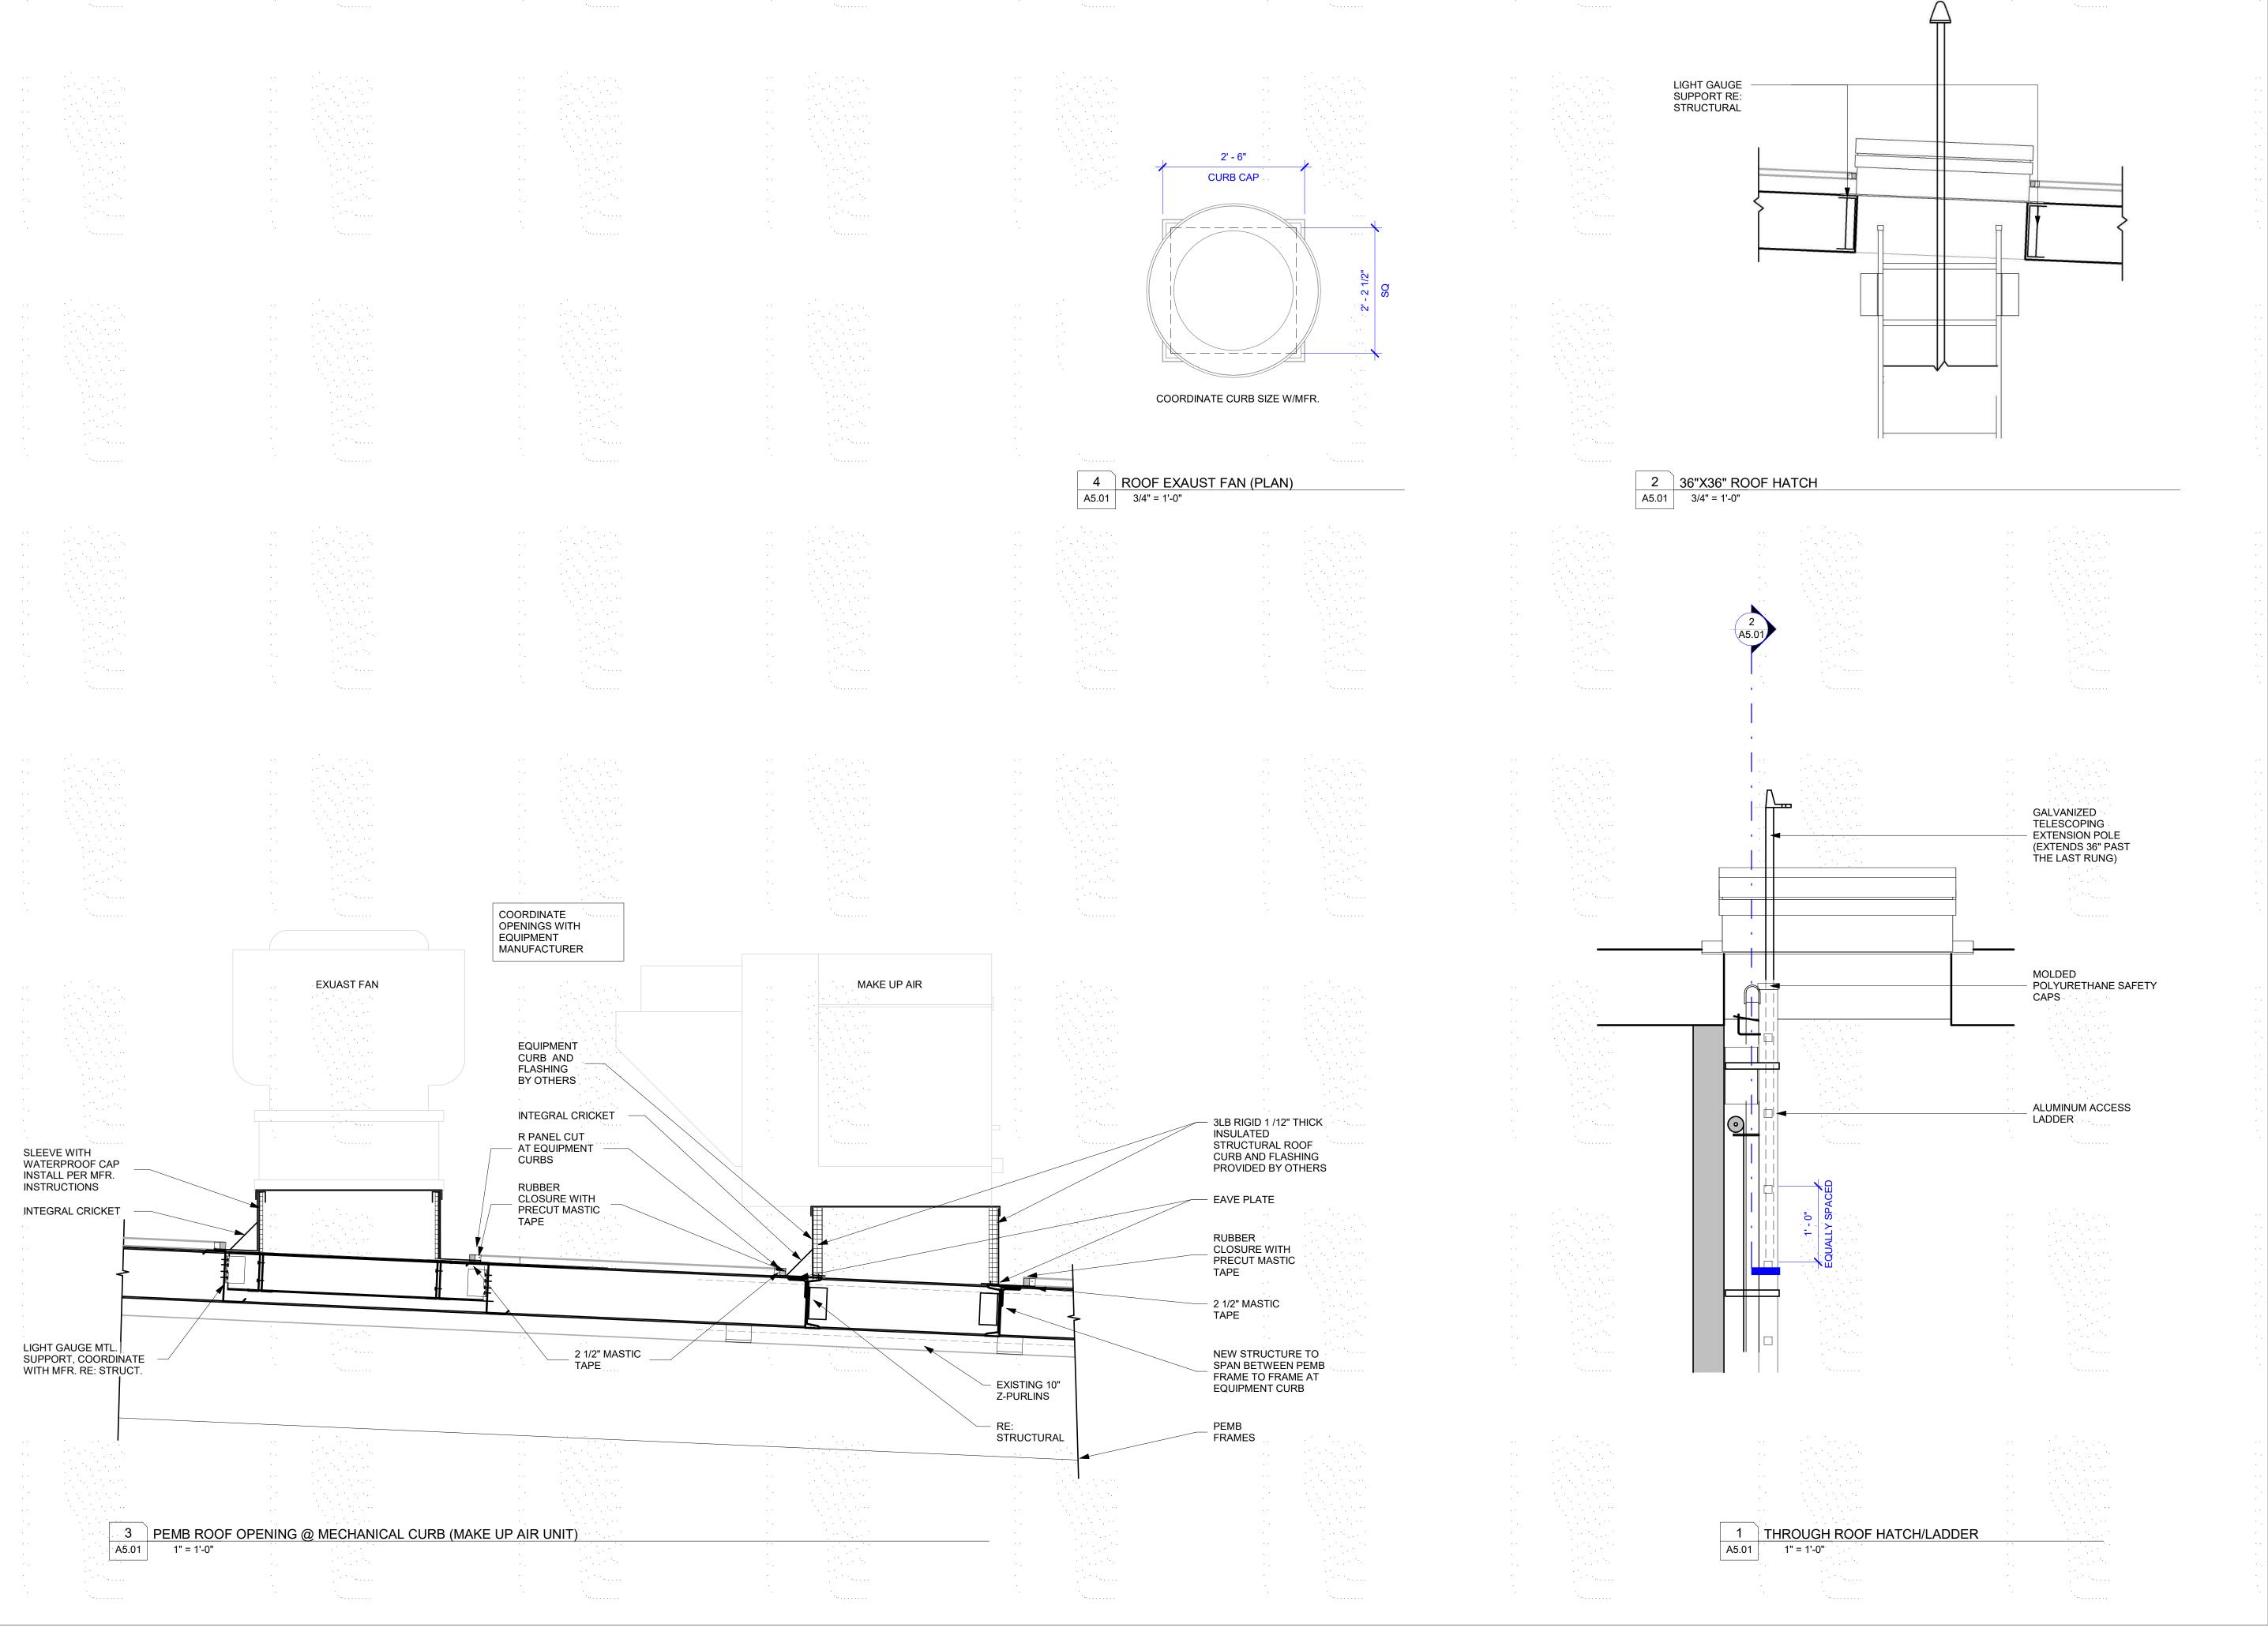

PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana


WDG PROJECT NO LAR2315


CONSTRUCTION DOCUMENTS 04.15.2024

REVISIONS

no. descripton date

SECTION DETAILS

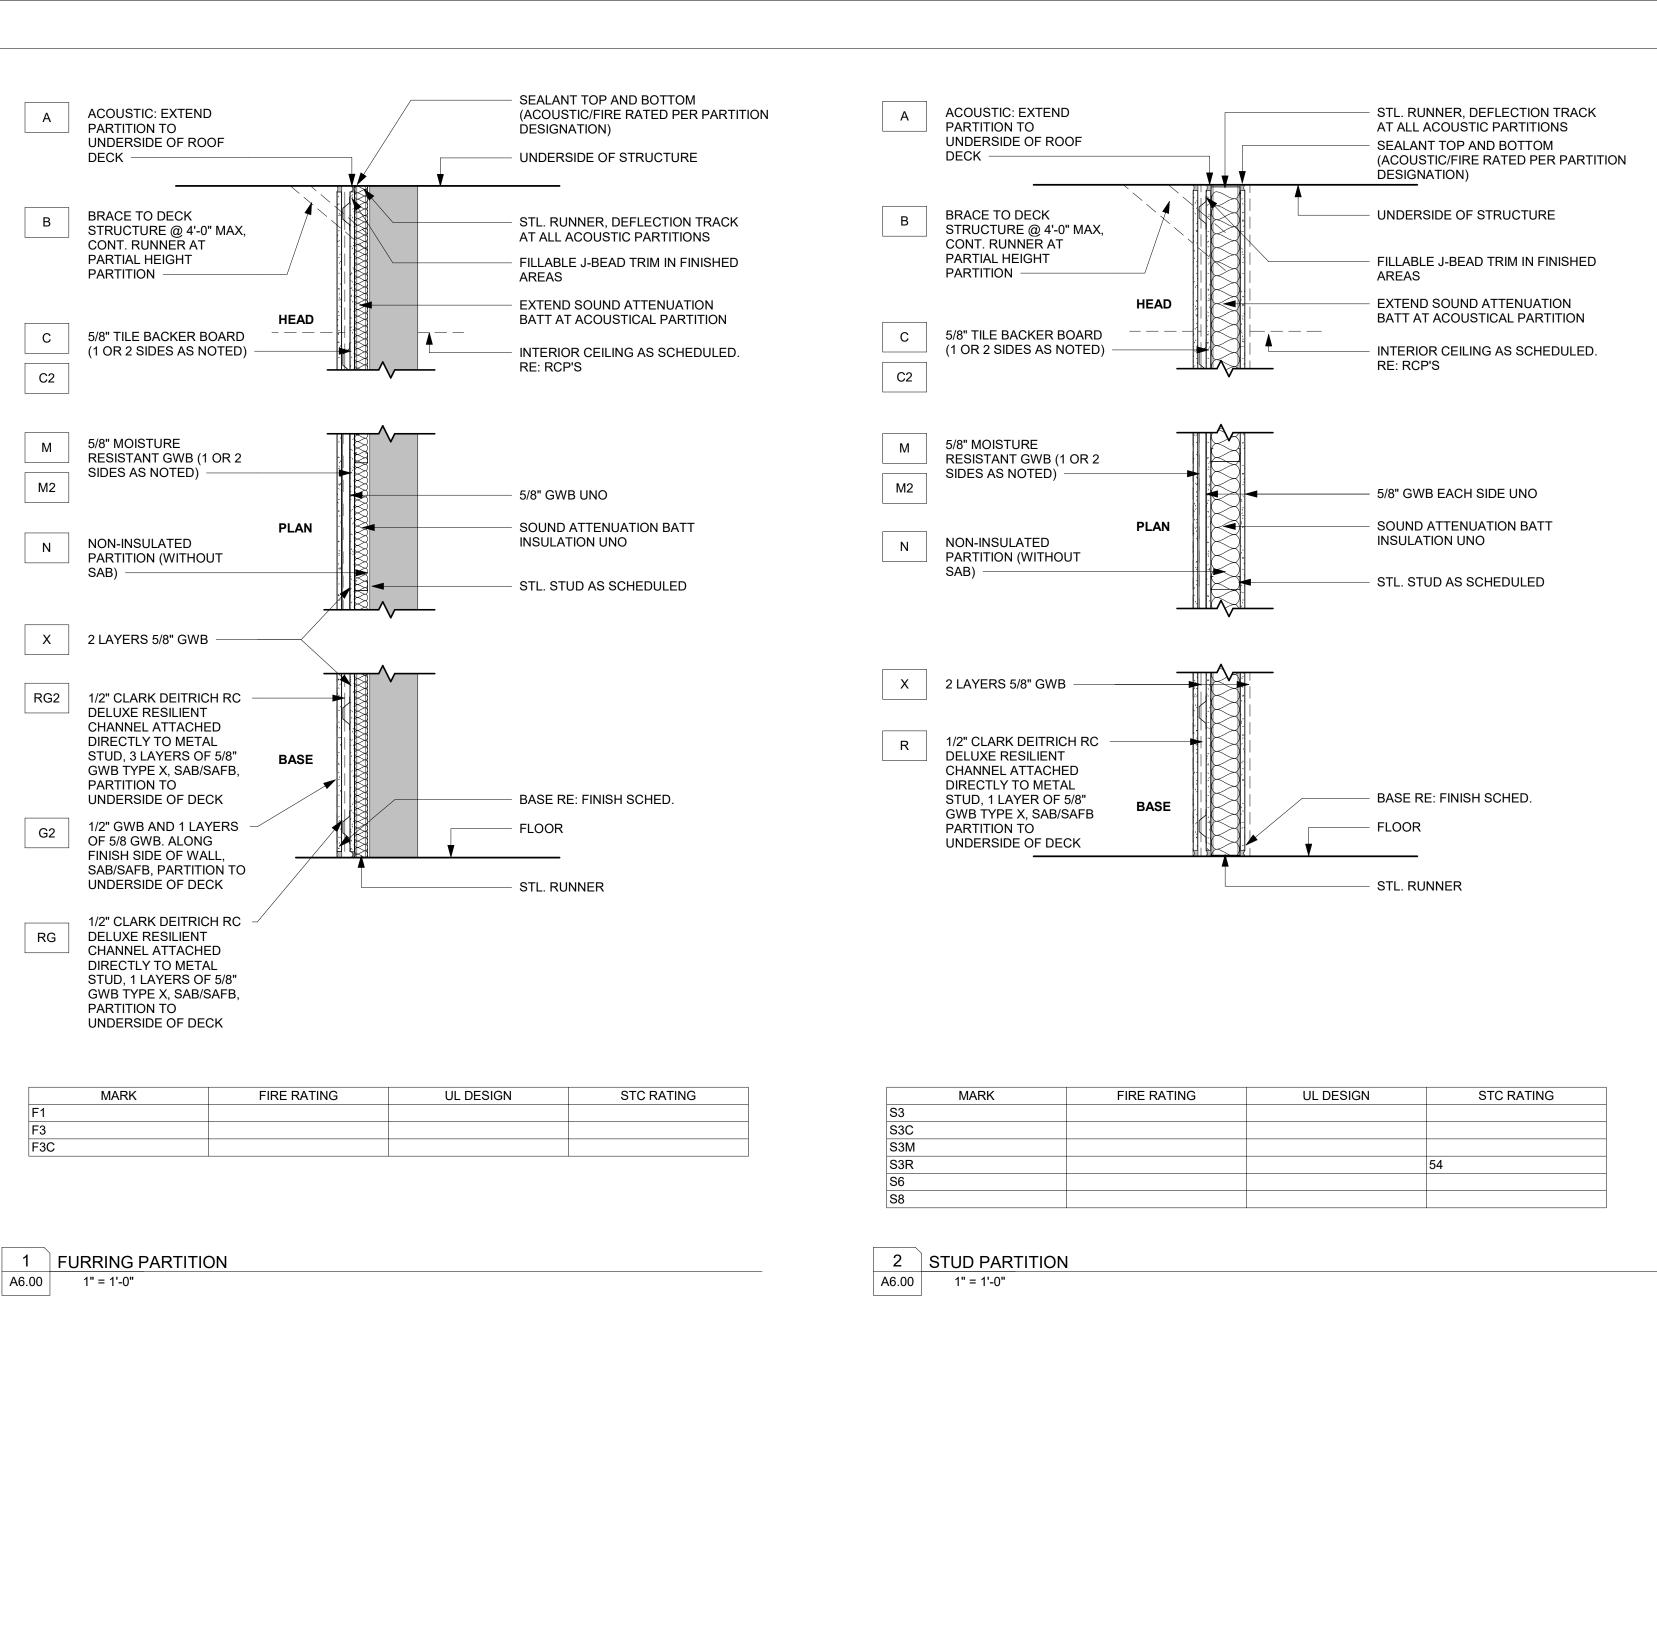

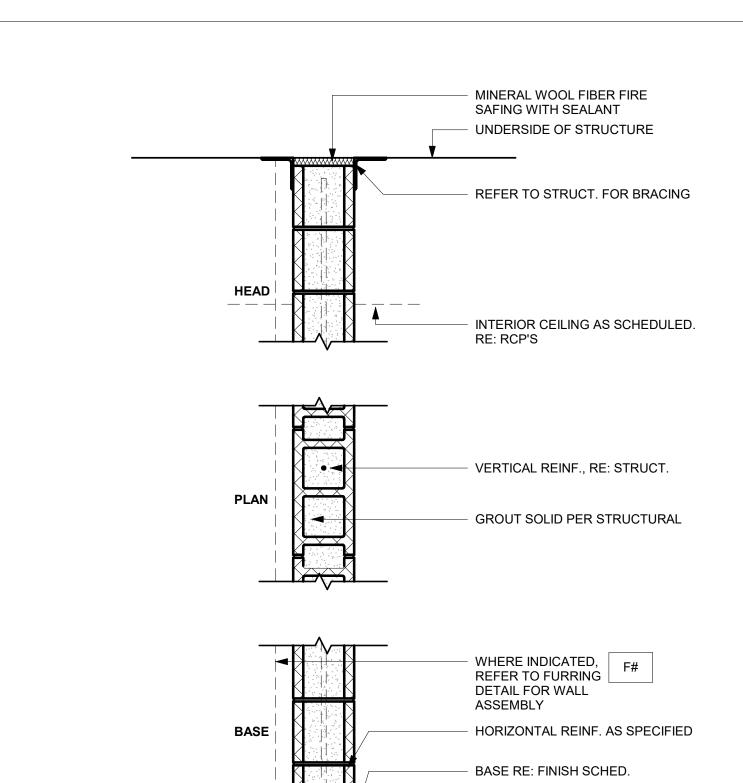

FIRE RATING


UL DESIGN

ING]	
	-	M8
]	M12
		M12F2
	1	
	_	
	₹	

3 CMU PARTITION

MARK

PARTITION SYMBOL TYPES:



UNLESS "A" MODIFIER INDICATED, EXTEND STUDS TO UNDERSIDE OF STRUCTURE AND GWB 6" ABOVE CEILING STRUCTURE, RE: WALL SECTIONS FOR SPECIAL CONDITIONS.

UNLESS OTHERWISE NOTED STUDS SHALL BE SPACED AT 24" O.C. AND 16" O.C. FOR WALLS RECEIVING TILE. RE: SPECS FOR DEFELCTION REQUIREMENTS.

ALL METAL STUD WALLS TO HAVE INSULATION UNLESS OTHERWISE NOTED.

ALL CORRIDOR AND STAIR PARITIONS SHALL HAVE ABUSE RESISTANCE GYP. (CORRIDOR SIDE ONLY) AT 48" HIGH UNLESS OTHERWISE NOTED.

BASIC MATERIAL:

FURRING METAL STUD S#S STAGGERED STUD SH SHAFT WALL CH CHASE, METAL STUD MASONRY, CMU CONCRETE

NOMINAL SIZE: 7/8" FURRING CHANNEL 1 5/8" METAL STUD 2 1/2" METAL STUD, 2 1/2" SHAFTWALL 3 5/8" METAL STUD 4" CONCRETE, MASONRY, STUD OR SHAFTWALL 6" CONCRETE, MASONRY, STUD OR SHAFTWALL 8" CONCRETE MASONRY OR STUD 12" CONCRETE MASONRY OR STUD

DESCRIPTION CODE:

ACOUSTIC: SAB/SAFB, PARTION TO UNDERSIDE OF DECK BRACE TO UNDERSIDE OF STRUCTURE

TILE BACKER BOARD: 1 LAYER TILE BACKER BOARD: 1 LAYER EACH SIDE

EXISTING EXTERIOR WALL FURRING MOISTURE AND MOLD RESISTANT BOARD: 1 LAYER

MOISTURE AND MOLD RESISTANT BOARD: 1 LAYERS EACH SIDE NON-INSULATED PARTITION

ACOUSTIC WALL WITH RESILIENT CHANNEL, SAB/SAFB, PARTITION TO UNDERSIDE OF DECK 2 LAYERS OF GWB

RG2 1/2" CLARK DEITRICH RC DELUXE RESILIENT CHANNEL, 3 LAYERS OF 5/8" GWB TYPE X, SAB/SAFB, PARTITION TO UNDERSIDE OF

1/2" CLARK DEITRICH RC DELUXE RESILIENT CHANNEL, 1 LAYER OF 5/8" GWB TYPE X, SAB/SAFB, PARTITION TO UNDERSIDE OF

1/2" GWB AND 5/8 GWB. ALONG FINISH SIDE OF WALL, SAB/SAFB, PARTITION TO UNDERSIDE OF DECK

FIRE RATING CODE: SEE TABLE FOR UL NUMBER - TYPICAL

2 HOUR 3 HOUR

4 HOUR .S SMOKE RATED

STC RATING: SEE TABLE FOR STC RATING DESCRIPTION

STC RATING

woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443 Erik Wismar, AIA


PELICANS CAMPUS IMPROVEMENTS

WDG PROJECT NO | AR2315



no.	descripton	date
110.	descriptori	date
		-

PARTITION TYPES

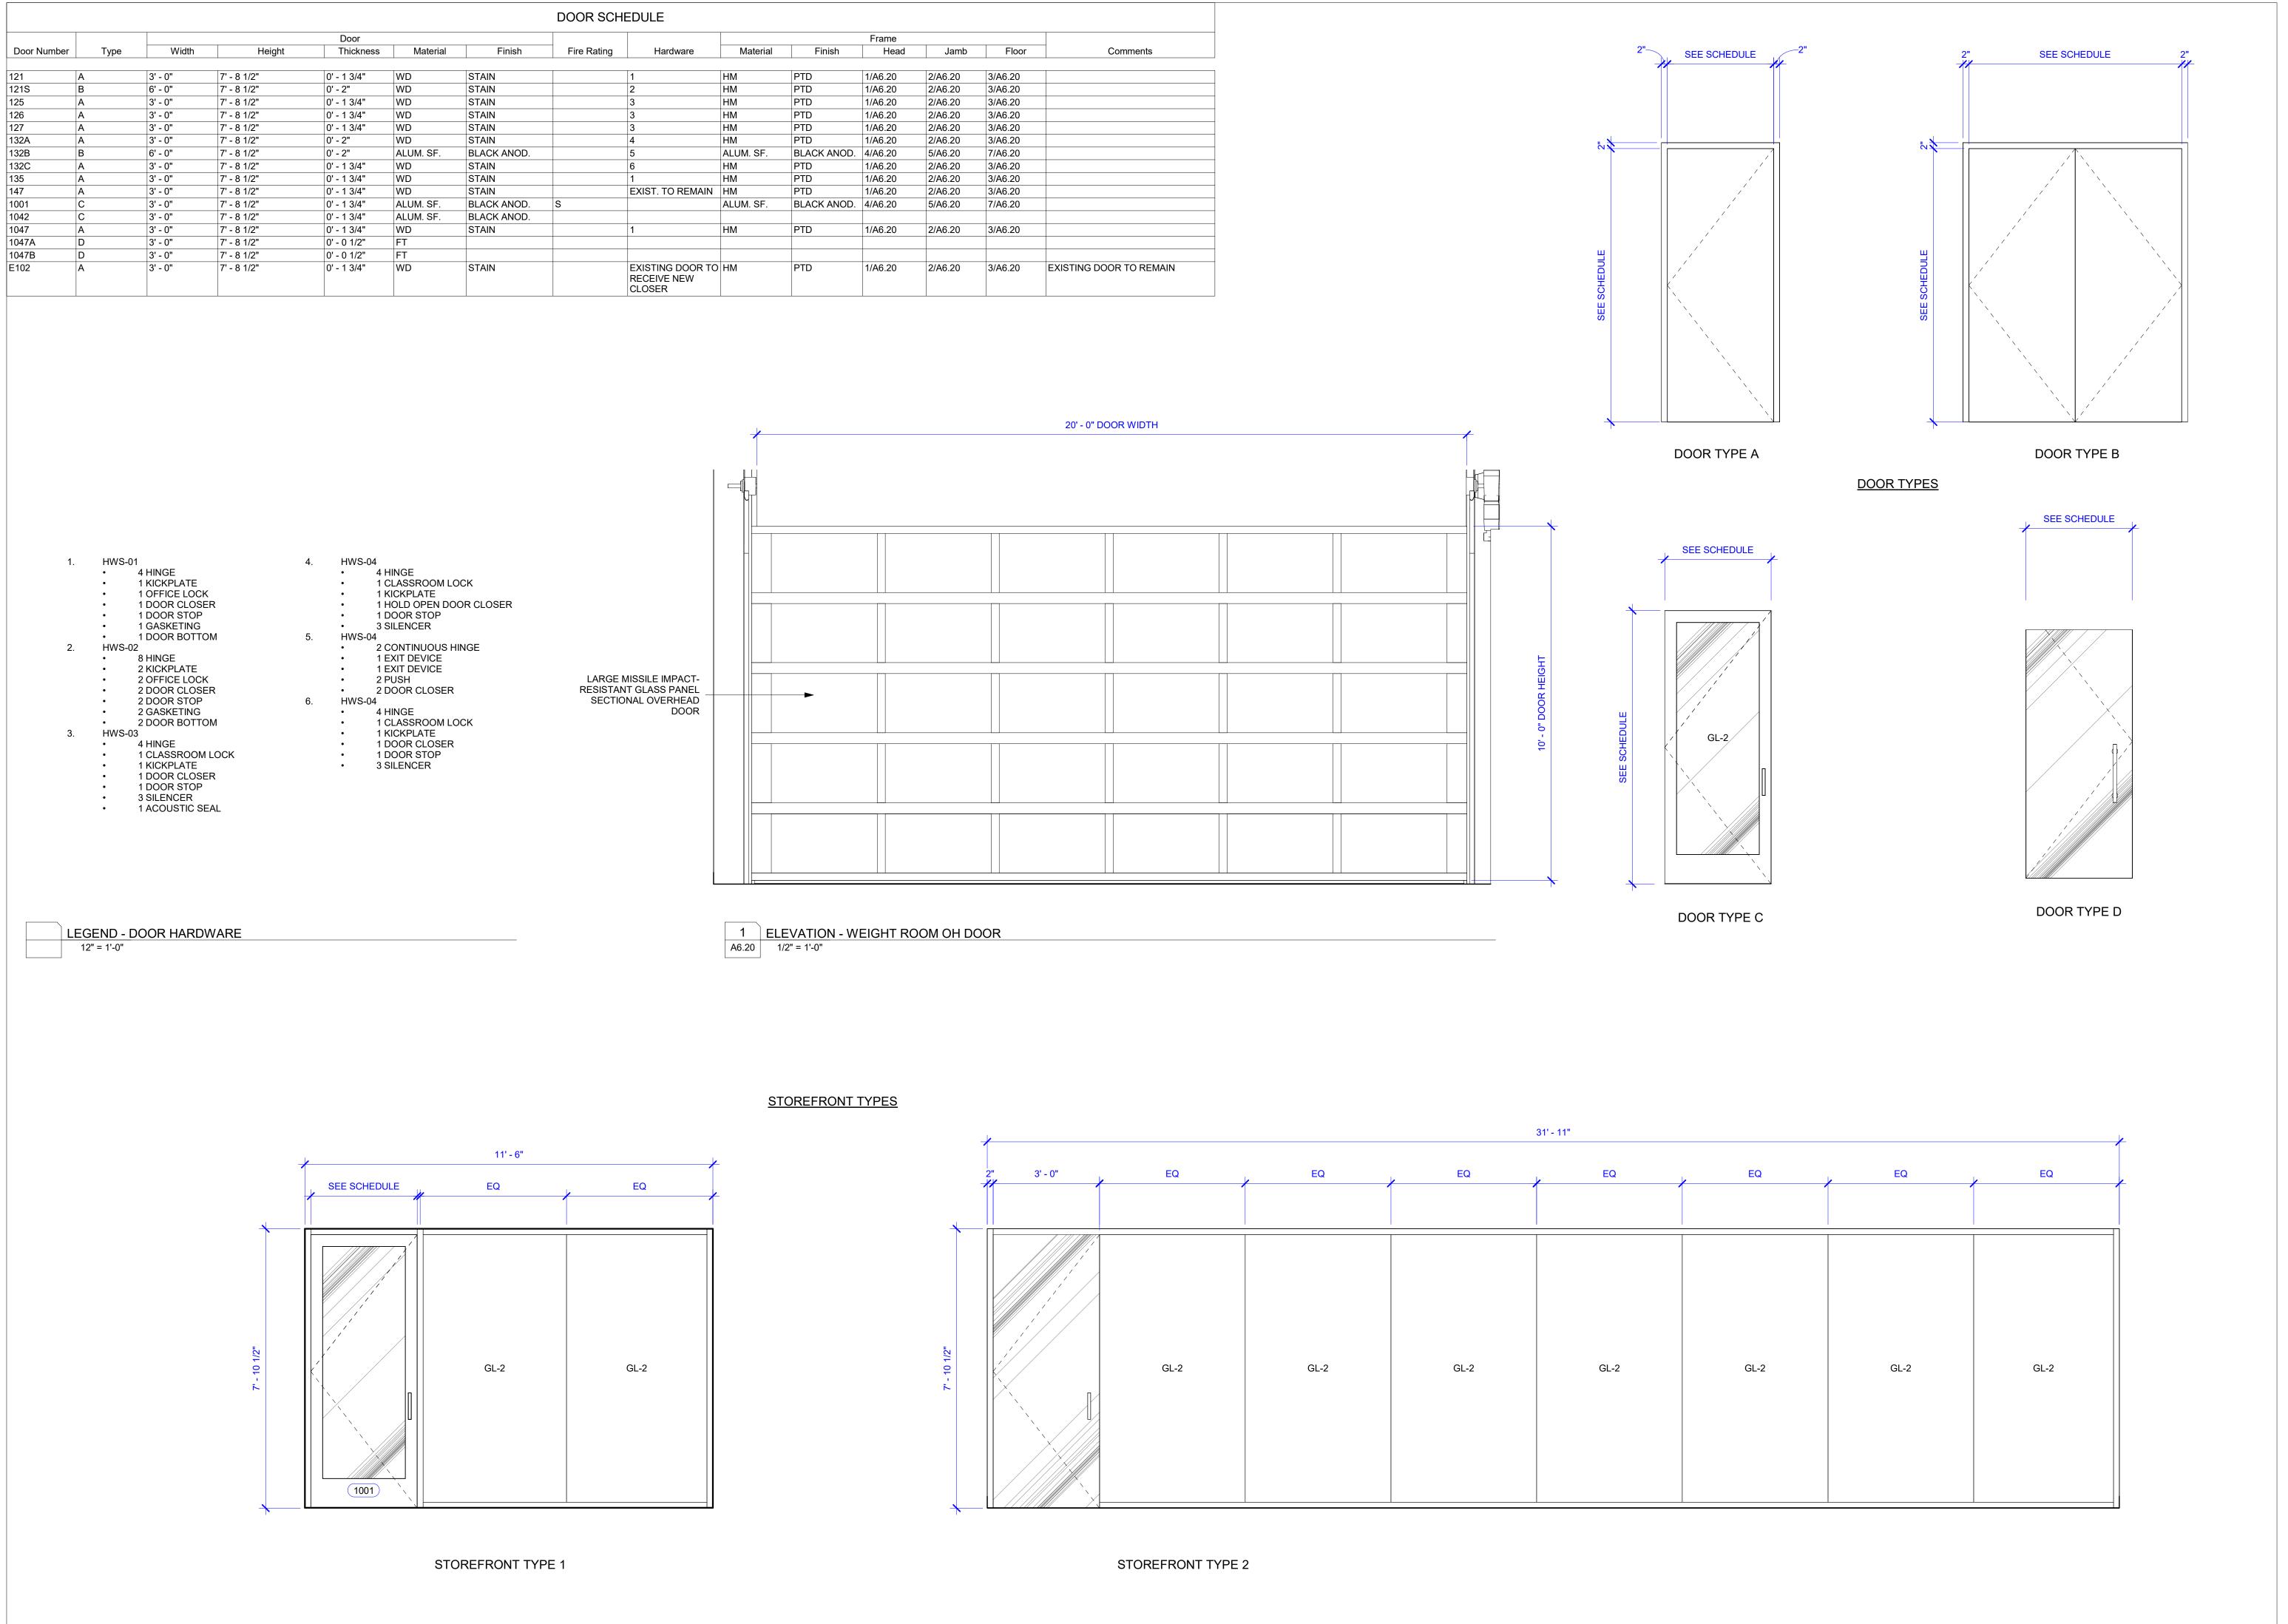


PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana


WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024


DOOR SCHEDULE

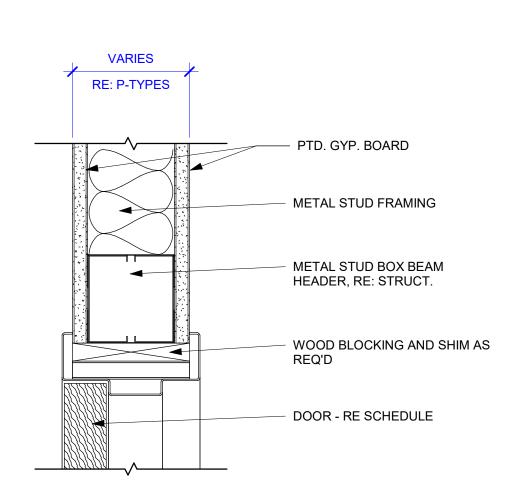




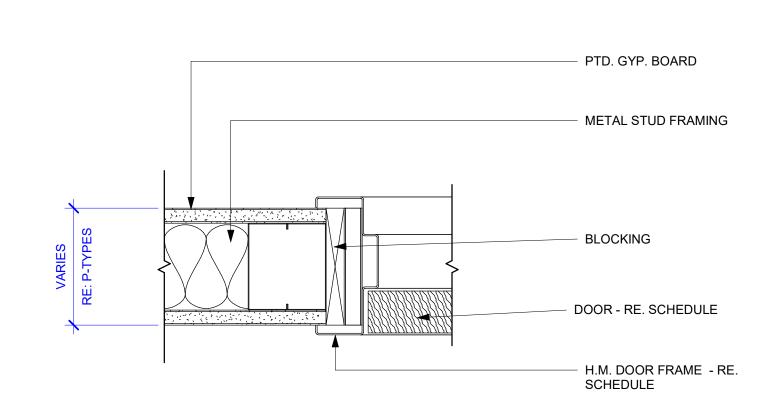


2 TYPICAL INTERIOR DOOR JAMB DETAIL
A6.21 3" = 1'-0"

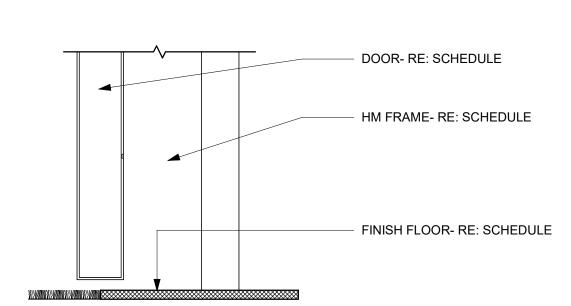


3 TYPICAL INTERIOR DOOR SILL DETAIL
A6.21 3" = 1'-0"

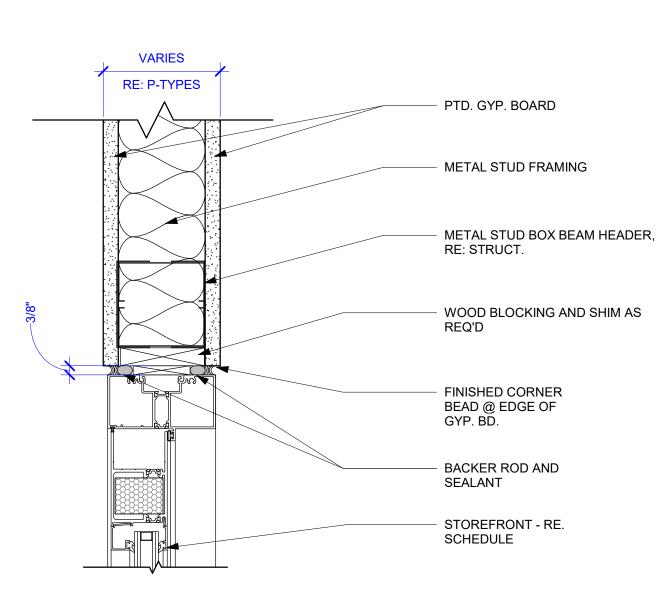


4 TYPICAL INTERIOR STOREFRONT HEAD A6.21 3" = 1'-0"

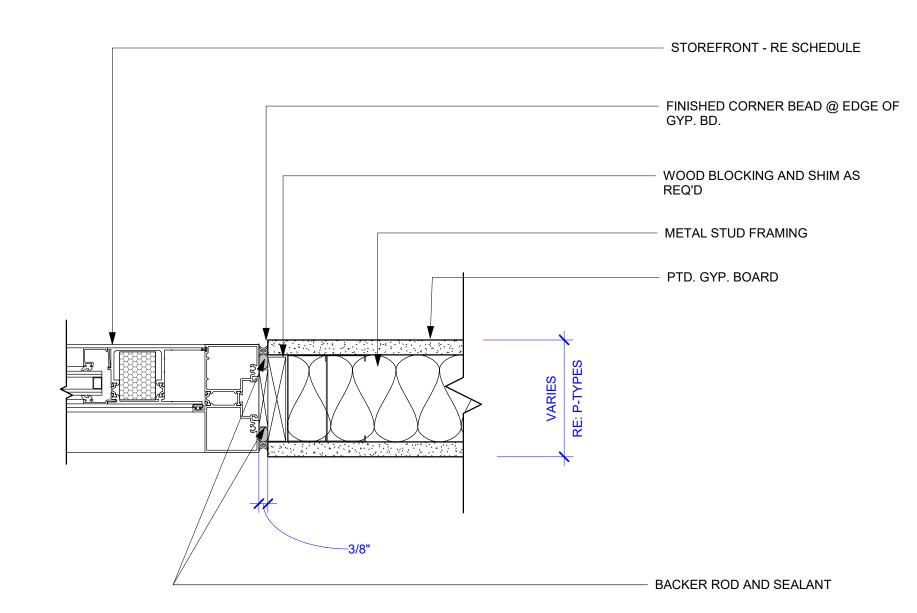


5 TYPICAL INTERIOR STOREFRONT JAMB DETAIL
A6.21 3" = 1'-0"

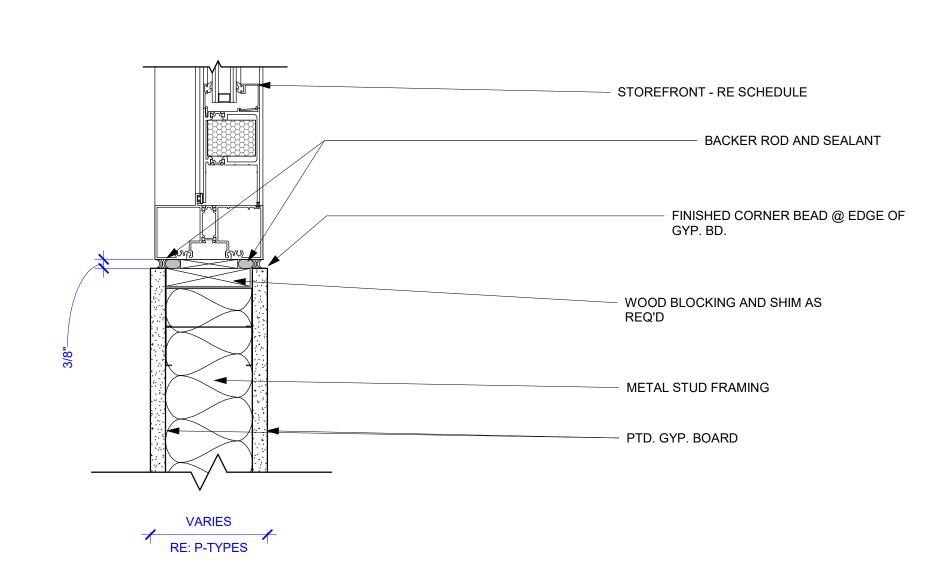

6 TYPICAL INTERIOR STOREFRONT WALL SILL
A6.21 3" = 1'-0"

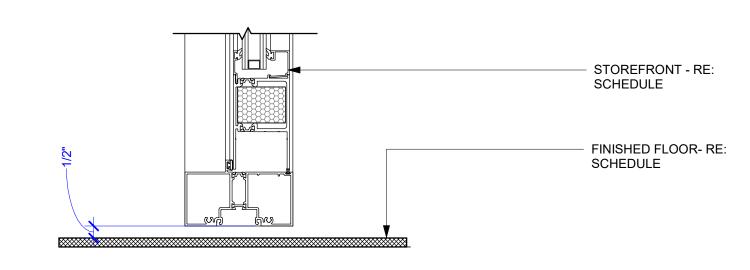

7 TYPICAL INTERIOR STOREFRONT SILL A6.21 3" = 1'-0"

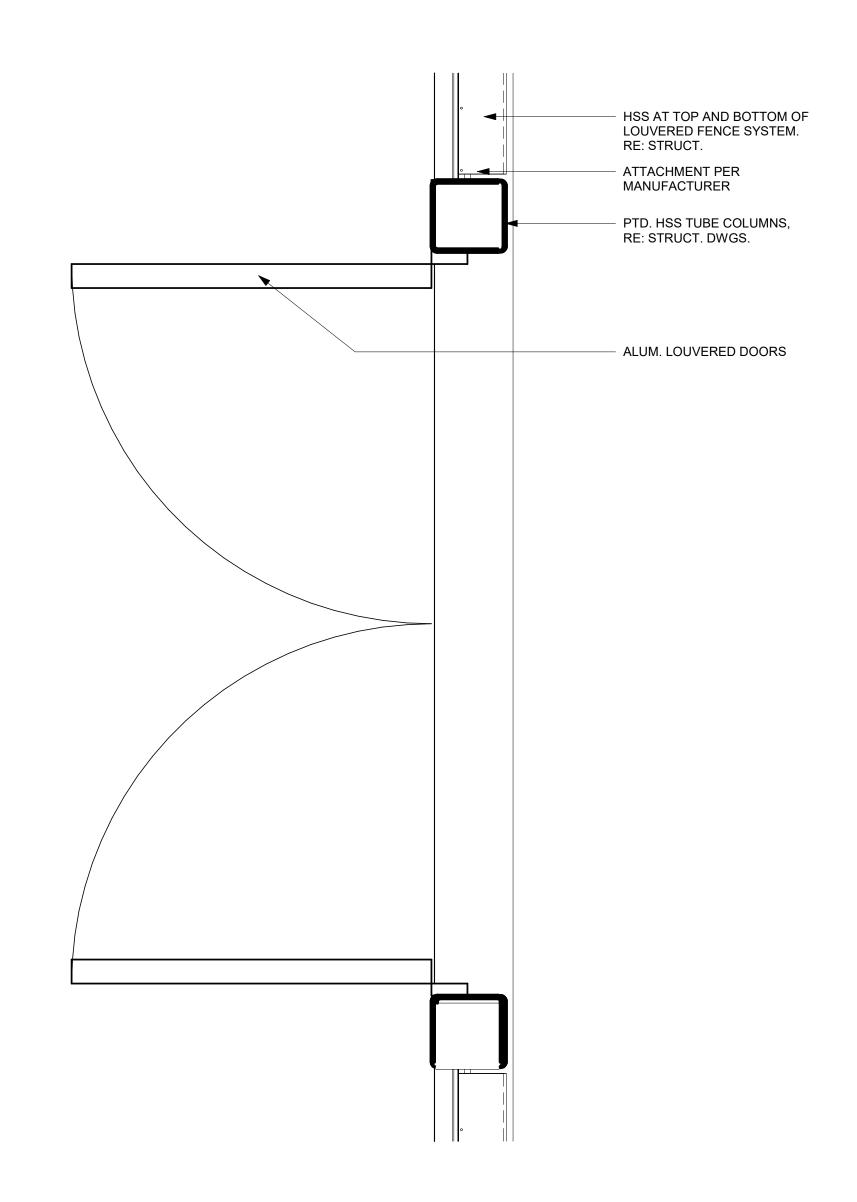

8 EXTERIOR FENCE GATE DETAIL
A6.21 1 1/2" = 1'-0"

PELICANS CAMPUS IMPROVEMENTS

woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443


Erik Wismar, AIA

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024



DOOR DETAILS

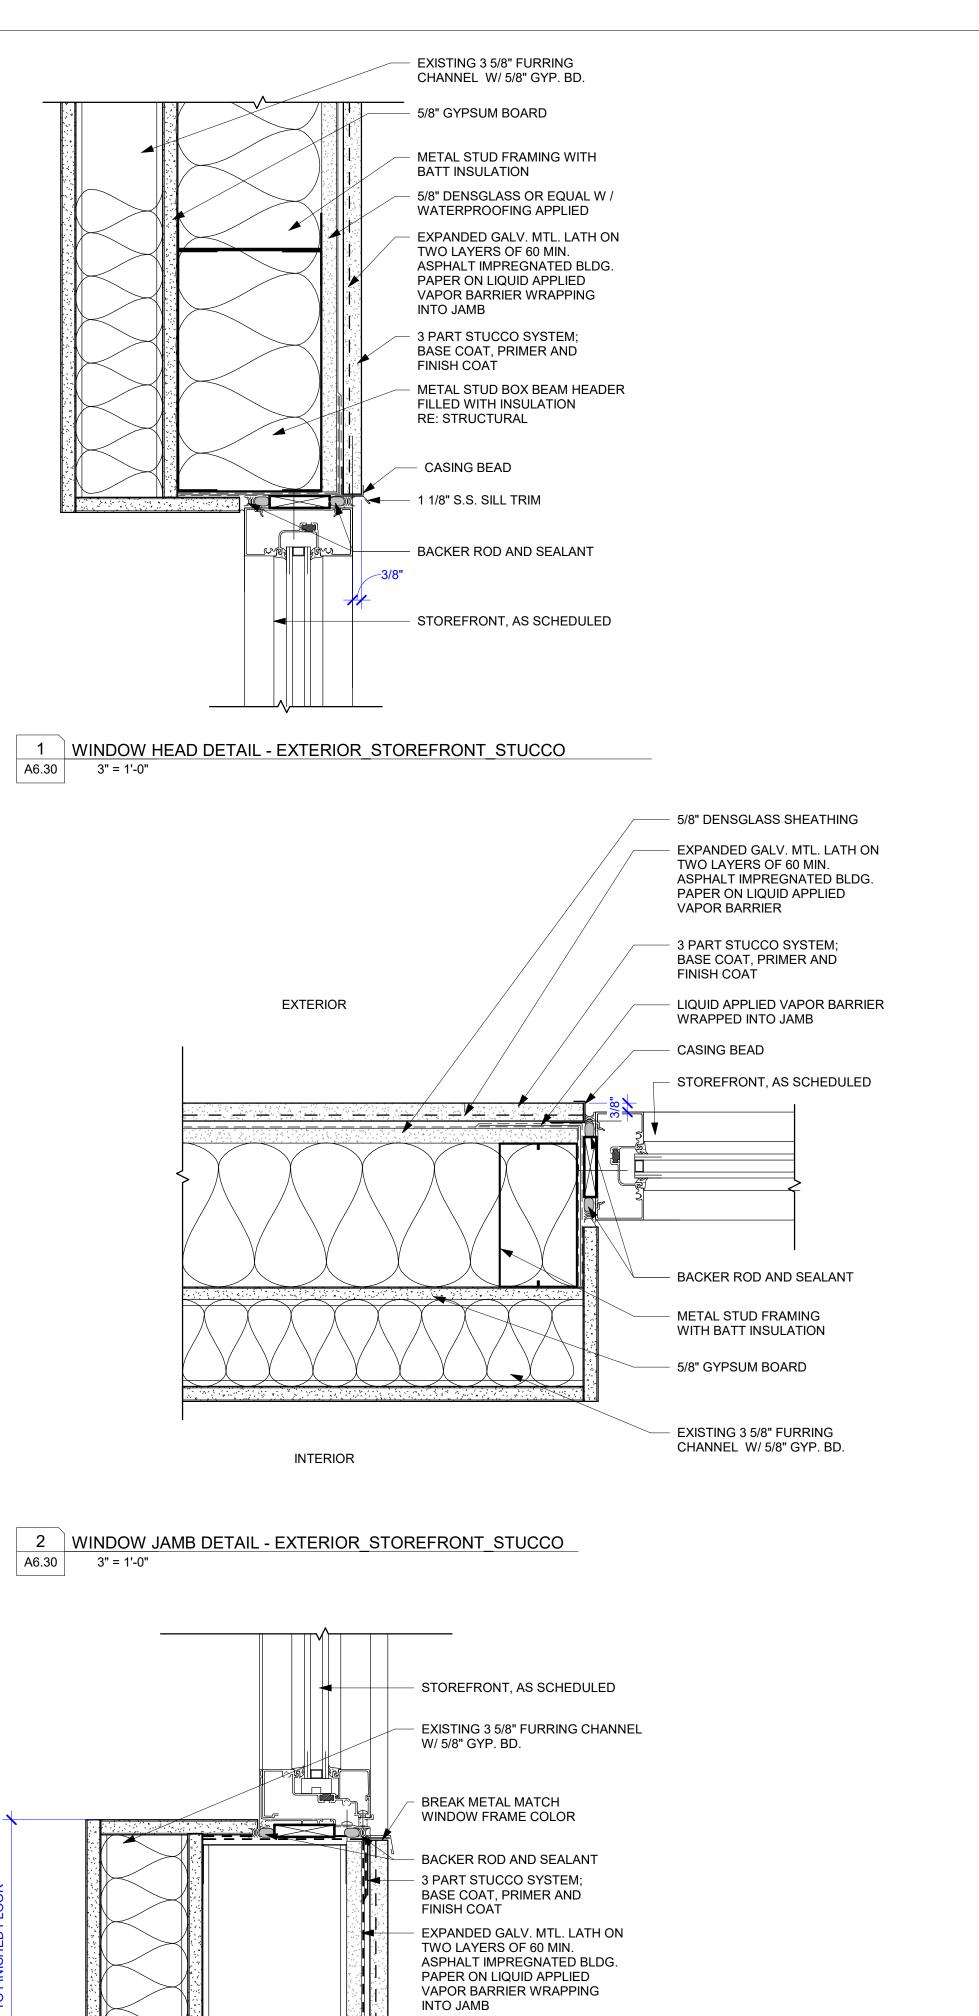

- 5/8" DENSGLASS OR EQUAL W / WATERPROOFING APPLIED


- METAL STUD FRAMING WITH

BATT INSULATION

5/8" GYPSUM BOARD

3 WINDOW SILL DETAIL - EXTERIOR_STOREFRONT_STUCCO

A6.30 3" = 1'-0"

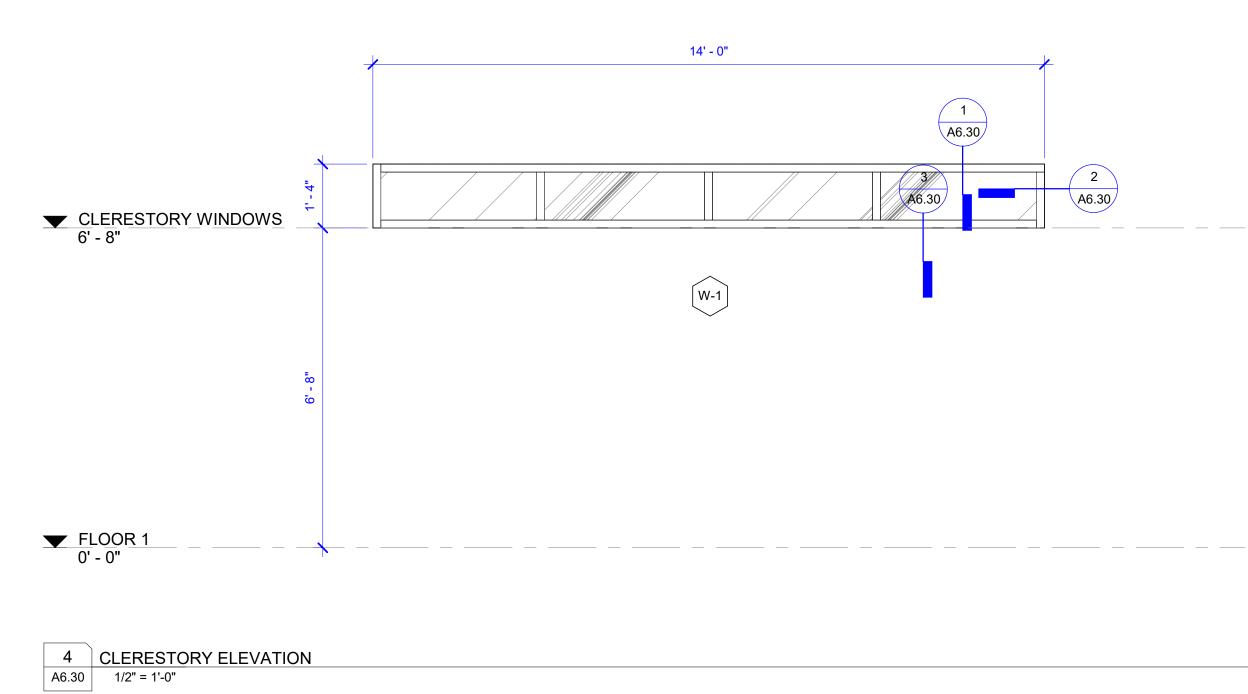




woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443 Erik Wismar, AIA

Metairie, Louisiana


PELICANS CAMPUS IMPROVEMENTS

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024



WINDOW SCHEDULE

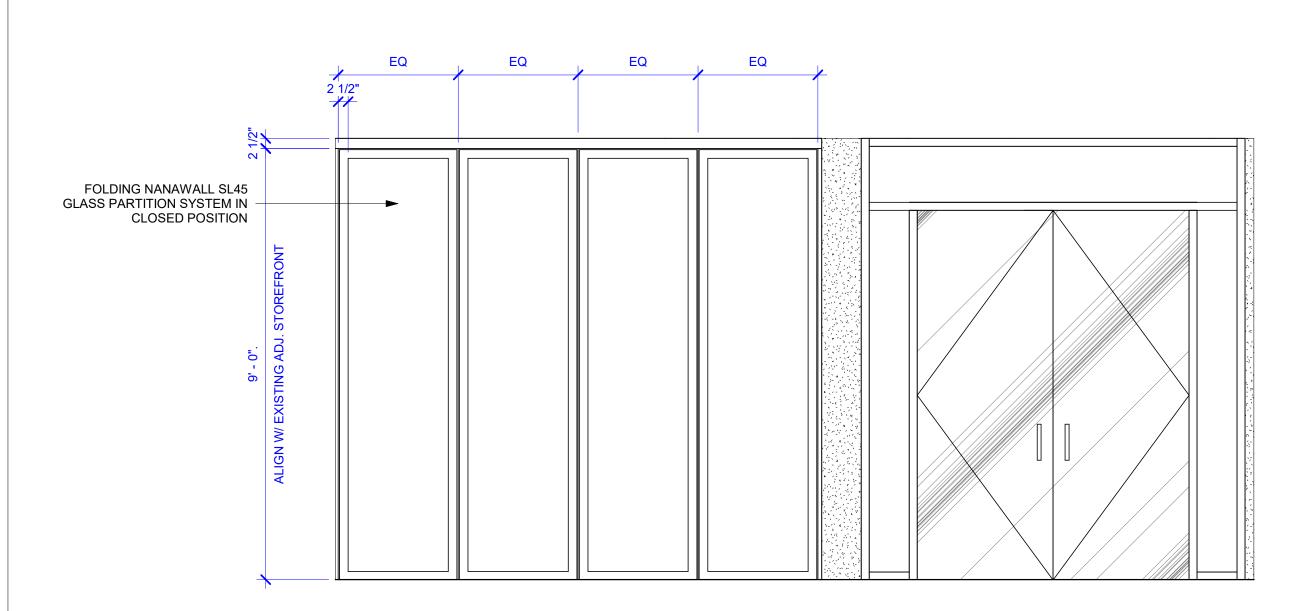


1 FOLDABLE WINDOW ELEVATION
A6.31 1/2" = 1'-0"

woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443 Erik Wismar, AIA

PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024



no.	descripton	dat
	docompton	

ROOM FINISH SCHEDULE										
			Ceiling					Wall Finishes		
Room Number	Name	Finish	Height	Floor Finish	Base Finish	North	South	East	West	Comments
	LOBBY	GYP-1	15' - 0"	TL-1	RB-1	PT-1	PT-3	PT-1	PT-1	
	LOBBY RECEPT.	GYP-1	18' - 0"	TL-1	RB-1	PT-1	PT-1	PT-1	PT-1	
	UNISEX	GYP-1	9' - 0"	TL-2	TL-4	EXISTING	EXISTING	EXISTING	EXISTING	
	HALL 7	ACT-1	10' - 0"	CPT-2	RB-1	PT-1	PT-1	PT-1	PT-1	
	STORAGE	ACT-1	10' - 0"	CPT-2	RB-1	PT-1	PT-1	PT-1	PT-1	
	WEIGH IN	GYP-1	10' - 0"	CPT-3	RB-1	PT-1	PT-1	PT-1	PT-1	
	RECOVERY	ACT-1	10' - 0"	CPT-2	RB-1	PT-2	PT-2	PT-2	PT-2	
	RECOVERY	ACT-1	10' - 0"	CPT-2	RB-1	PT-1	PT-1	PT-1	PT-1	
	WELLNESS/RECOVERY	ACT-1/GYP-1	10' - 0"	CPT-2	RB-1	PT-1	PT-1	PT-1	PT-1	
	NUTRITION	ACT-1/GYP-1	9' - 0"		RB-1	PT-1	PT-1	PT-1	PT-1	
	PLAYER CAFE & DINING ROOM	WV-1/GYP-1	14' - 0"	TL-1	RB-1	PT-1	PT-1	PT-1	PT-1/WV-1	
	KITCHEN	ACT-1	10' - 0"	TBD	RB-1	PT-1	PT-1	PT-1	PT-1	
	MEDIA ROOM	ACT-1	9' - 0"	CPT-1	RB-1	PT-1	PT-1	PT-1	PT-1	
	COACHES LOCKER ROOM	ACT-1	10' - 0"	CPT-2	RB-1	PT-1	PT-1	PT-1	PT-1	
	PLAYER'S TOILETS	ACT-1	10' - 0"	ST-1		TL-3	TL-3	TL-3	TL-3	
	PLAYER'S SHOWERS	GYP-1	10' - 0"	ST-1		TL-3	TL-3	TL-3	TL-3	
	OFFICE	ACT-1	10' - 0"	CPT-1	RB-1	PT-1	PT-1	PT-1	PT-1	
	CONFERENCE ROOM	ACT-1	8' - 6"	CPT-2/LVT-1	RB-1	PT-4	PT-1	PT-1	CD-1	
	STORAGE	ACT-1	9' - 0"	CPT-1	RB-1	PT-1	PT-1	PT-1	PT-1	
	VIEWING AREA	GYP-1	8' - 6"	LVT-1	RB-1	PT-1	PT-1	PT-1	CD-1 CD-1	
	STAIR	GYP-1				PT-1	PT-1	PT-1	CD-1	

- REFER TO FINISH FLOOR PLAN FOR DESIGN LAYOUT.
 REFER TO REFLECTED CEILING PLAN FOR CLG HEIGHTS.

ROOM FINISH LEGEND					
KEY NAME	DESCRIPTION	MANUFACTURER	MODEL, NAME & COLOR	SIZE & SPEC	
ACT-1	ACOUSTICAL TILE CEILING	ULTIMA	1941, ULTIMA HIGH NRC, WHITE	24"X24" SQUARE LAY-IN	
CPT-1	CARPET TILE	TARKETT, TANDUS CENTIVA	BALANCE 11339, LITHOGRAPHY 30804	18"x36" VERTICAL ASHLAR	
CPT-2	CARPET TILE	TARKETT, TANDUS CENTIVA	OFFSET 11338, INK FILM 30807	18"x36" VERTICAL ASHLAR	
CPT-3	CARPET TILE	TARKETT, TANDUS CENTIVA	OFFSET 11338, DIE CUT 30806	18"x36" VERTICAL ASHLAR	
CD-1	CUSTOM DECAL	TBD	CUSTOM WALL DECAL: MATCH PELICANS LOGO IN PELICANS NAVY		
DM-1	DECORATIVE METAL	WILSONART	MEDIUM BRONZE ALUMINUM 6262-00-419, SATIN BRUSHED		
DW 1	DESCRIPTIVE WILLIAM	WESSIAN	MEDION BRONZE ACOMINON 0202 00 110, GATIN BROOTIED		
FB-1	FABRIC	STINSON	TILT 64 NAVY	54" ROLLS; VINYL WITH POLYESTER BACKING	
GF-1	GLASS FINISH	ЗМ	WH-111-G WHITEBOARD	60" ROLLS	
GF-2	GLASS FINISH	SMARTFILM	SMART FILM WITH SMART CLING SELF ADHESIVE		
LVT-1	LUXURY VINYL TILE	KARNDEAN DESIGN FLOORING	VGW85T FRENCH OAK	48"x7" PLANKS	
PT-1	PAINT	SHERWIN WILLIAMS	SW 7004 SNOWBOUND		
PT-2	PAINT	SHERWIN WILLIAMS	SW 7004 SNOWBOOND SW 7016 MINDFUL GRAY		
PT-3	PAINT	SHERWIN WILLIAMS	SW 7010 MINDI GE GIVAT		
PT-4	PAINT	SHERWIN WILLIAMS	TBD, MATCH TO PELICANS RED		
PT-5	PAINT	SHERWIN WILLIAMS	TBD, MATCH TO PELICANS NAVY		
DL 4	PLASTIC LAMINATE	WILCONADT	LIMBER MAPLE 10734-60	MATTE FINISH, STANDARD LAMINATE	
PL-1 PL-2	PLASTIC LAMINATE PLASTIC LAMINATE	WILSONART WILSONART	ASIAN NIGHT 7949K-18	LINEARITY FINISH, STANDARD LAMINATE LINEARITY FINISH, PREMIUM LAMINATE	
PL-3	PLASTIC LAMINATE PLASTIC LAMINATE	FORMICA	WALNUT RIFTWOOD 9823	MATTE FINISH, STANDARD LAMINATE	
	DODOSI ANI TIL S	la at the			
TL-1	PORCELAIN TILE	DALTILE DALTILE	RAVEL, PLATINUM RA12	32"X32", UNPOLISHED	
TL-2	PORCELAIN TILE PORCELAIN TILE	TILE BAR	METAL FUSION, STAINLESS STEEL P450 HOLLAND, HEWLETT METAL SILVER	8"X24" BRICK PATTERN, LIGHTLY POLISHED 24"X24" MATTE	
TL-3			·		
TI 5	PORCELAIN TILE PORCELAIN TILE	PLATFORM SURFACES TILE BAR	VALLA, NAVY, NAVY VERSILIA, CALACATTA ORO	2"X10" 3"X12"	
TL-5 TL-6	PORCELAIN TILE PORCELAIN TILE	INAX	YUKAGE DTL-2/YGE-3	1.5"X9" NAVY BLUE	
TL-7	PORCELAIN TILE PORCELAIN TILE	TILE BAR	CARRARA HERRINGBONE MOSAIC	1/2"X4" POLISHED MARBLE	
TL-8	PORCELAIN TILE	DALTILE	LINEAR IN DESERT GRAY	4"X12" VERTICAL INSTALLATION	
RF-1	RESILIENT FLOORING	MONDO	18MM RAMFLEX HYBRID	G707 GREY	
RF-2	RESILIENT FLOORING RESILIENT FLOORING	TRIUMPH SPORTS FLOORING, KJ1 MARINO	24"X24"	G707 GREY	
RB-1	RUBBER BASE	JOHNSONITE	20 CHARCOAL WG	4" COVE BASE	
SCS-1	SEALED CONCRETE SLAB		· · · · · · · · · · · · · · · · · · ·		
SS-1 SS-2	SOLID SURFACE	WILSONART	HAIDA Q4008	QUARTZ	
	SOLID SURFACE	WILSONART	HALDI Q4032	QUARTZ	
SS-3	SOLID SURFACE	CAMBRIA	QUEEN ANNE - LUXURY SERIES	MATTE FINISH, QUARTZ	
SS-4	SOLID SURFACE	GEOLUXE	ALIVERI	20 MM, POLISHED	
ST-1	STONE TILE	AKDO	MB2776-1224H0	12"X24" GRIGIO VERISILIA GOLD	
WV-1	WOOD VENEER	ARMSTRONG	669fO1W1, PLAIN SLICE WHITE OAK	24"X96", WOODWORKS LINEAR VENEERED PANELS	

ALL NEW HM DOOR FRAMES TO BE PT-3.


PELICANS CAMPUS IMPROVEMENTS
Metairie, Louisiana


WDG PROJECT NO | AR2315


CONSTRUCTION DOCUMENTS 04.15.2024

FINISH SCHEDULE



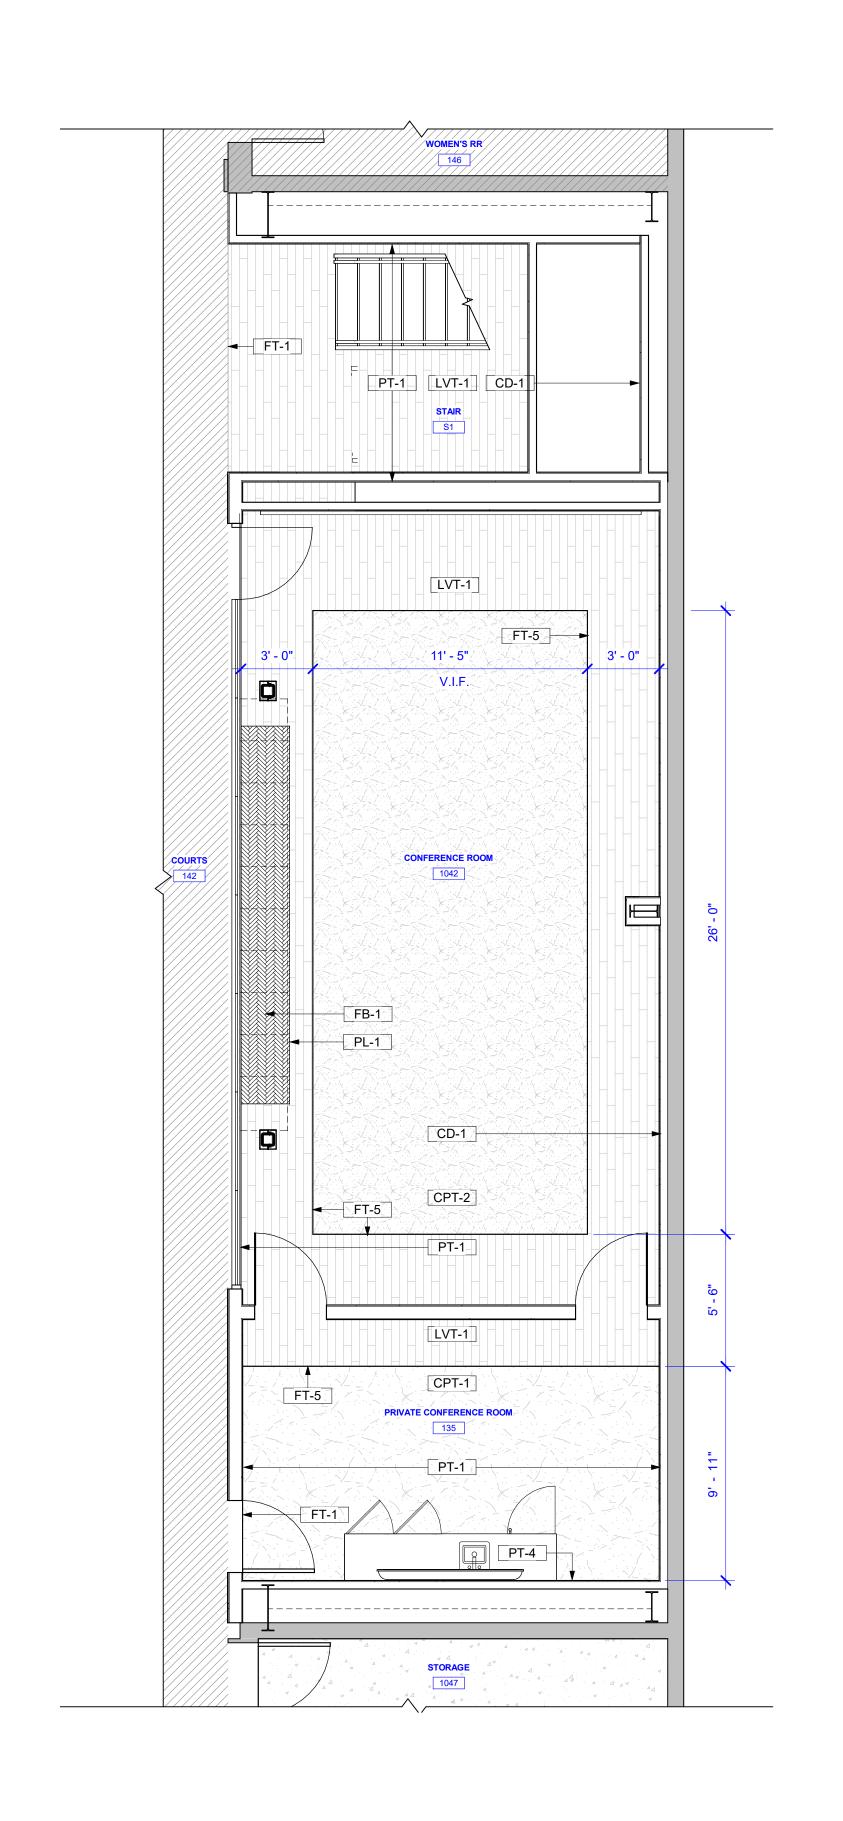

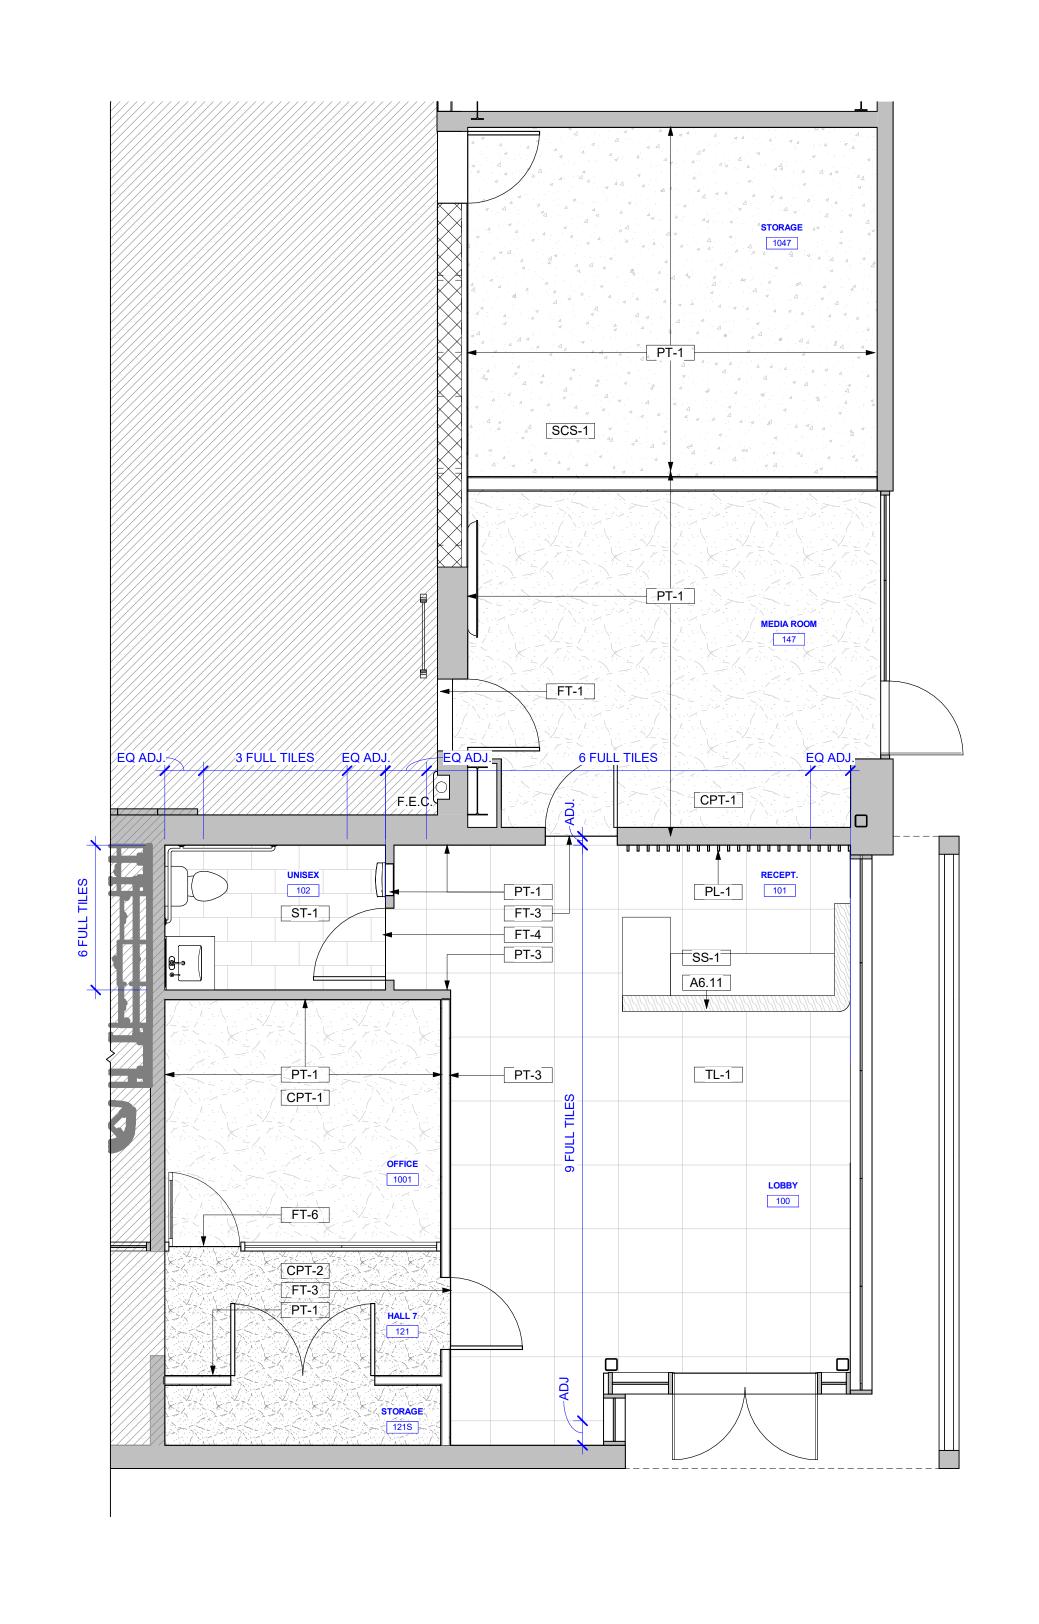

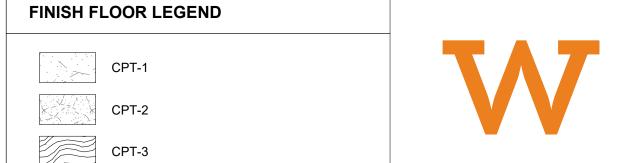

FLOORING TRANSITION LEGEND


(E) WOOD TO CPT; TRANSITION STRIP: SCHLUTER RENO-U (E) WOOD TO LVT; TRANSITION STRIP: TARKETT CTA-XX-HL FT-3: TL TO CPT; TARKETT EDGE SEAM SEALER FT-4: TRANSITION STRIP: TARKETT CTA-XX-HL LVT TO CPT; TARKETT EDGE SEAM SEALER CPT TO CPT; TARKETT POWER BOND


* ALL TRANSITION ELEMENTS SHALL BE ADA COMPLIANT

PELICANS CAMPUS IMPROVEMENTS


WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024



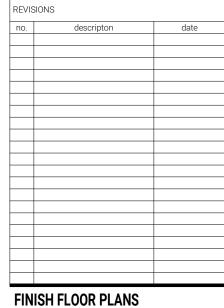





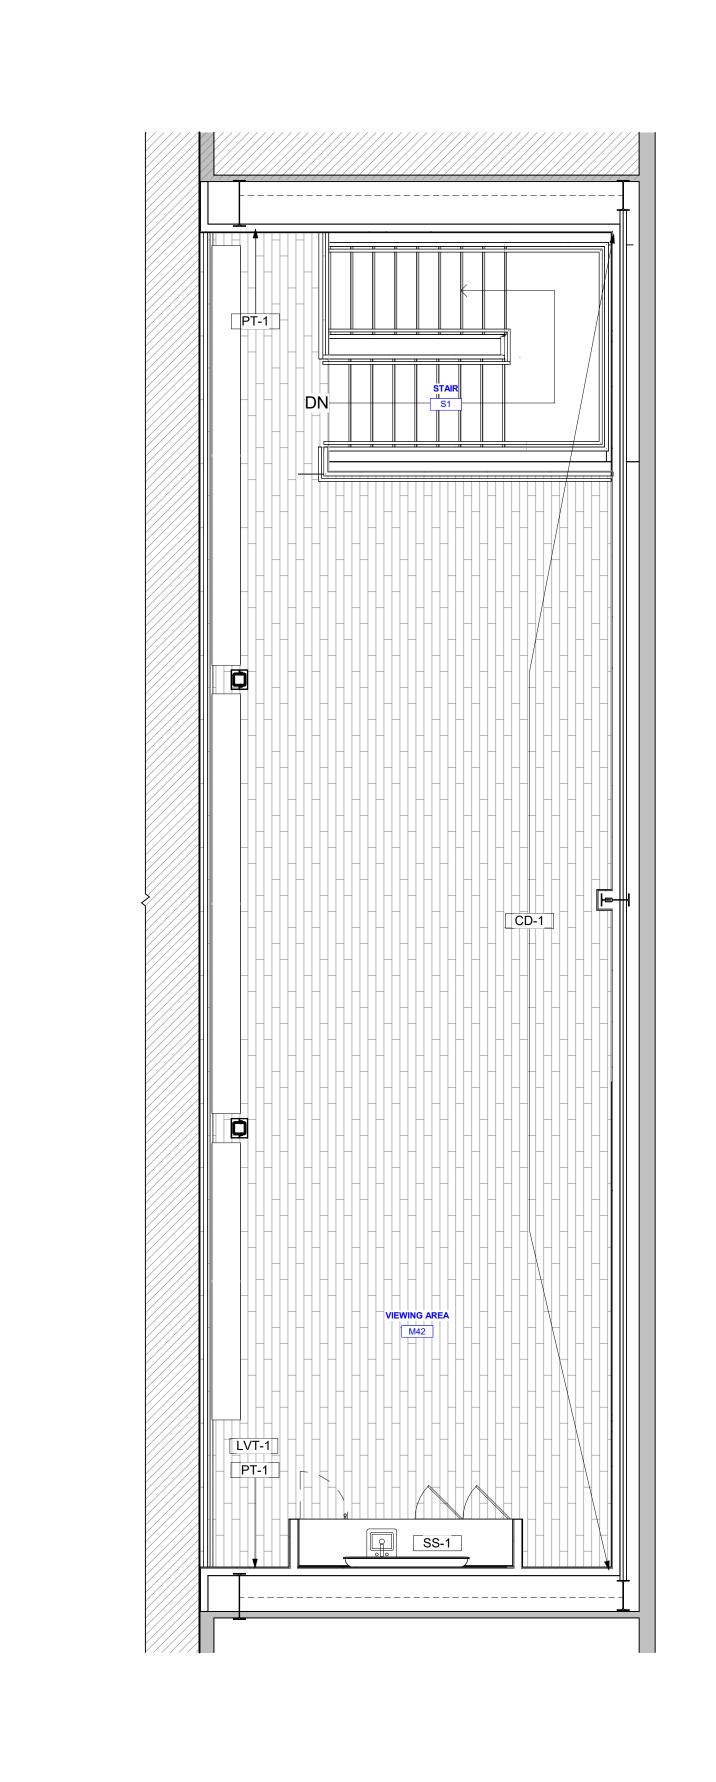




















FLOORING TRANSITION LEGEND

(E) WOOD TO CPT; TRANSITION STRIP: SCHLUTER RENO-U

(E) WOOD TO LVT; TRANSITION STRIP: TARKETT CTA-XX-HL

TL TO CPT; TARKETT EDGE SEAM SEALER FT-3:

TL-1 TO TL-2; TRANSITION STRIP: TARKETT CTA-XX-HL FT-4:

LVT TO CPT; TARKETT EDGE SEAM SEALER

CPT TO CPT; TARKETT POWER BOND FT-6:

* ALL TRANSITION ELEMENTS SHALL BE ADA COMPLIANT

PELICANS CAMPUS IMPROVEMENTS

woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA







	4	-1-4-
no.	descripton	date
		+
		+
_		+

FINISH FLOOR PLANS

DRAWN BY | WDG A6.53

1 ENLARGED FINISH FLOOR PLAN- LOBBY & VIEWING- FLOOR 2
A6.53 1/4" = 1'-0"

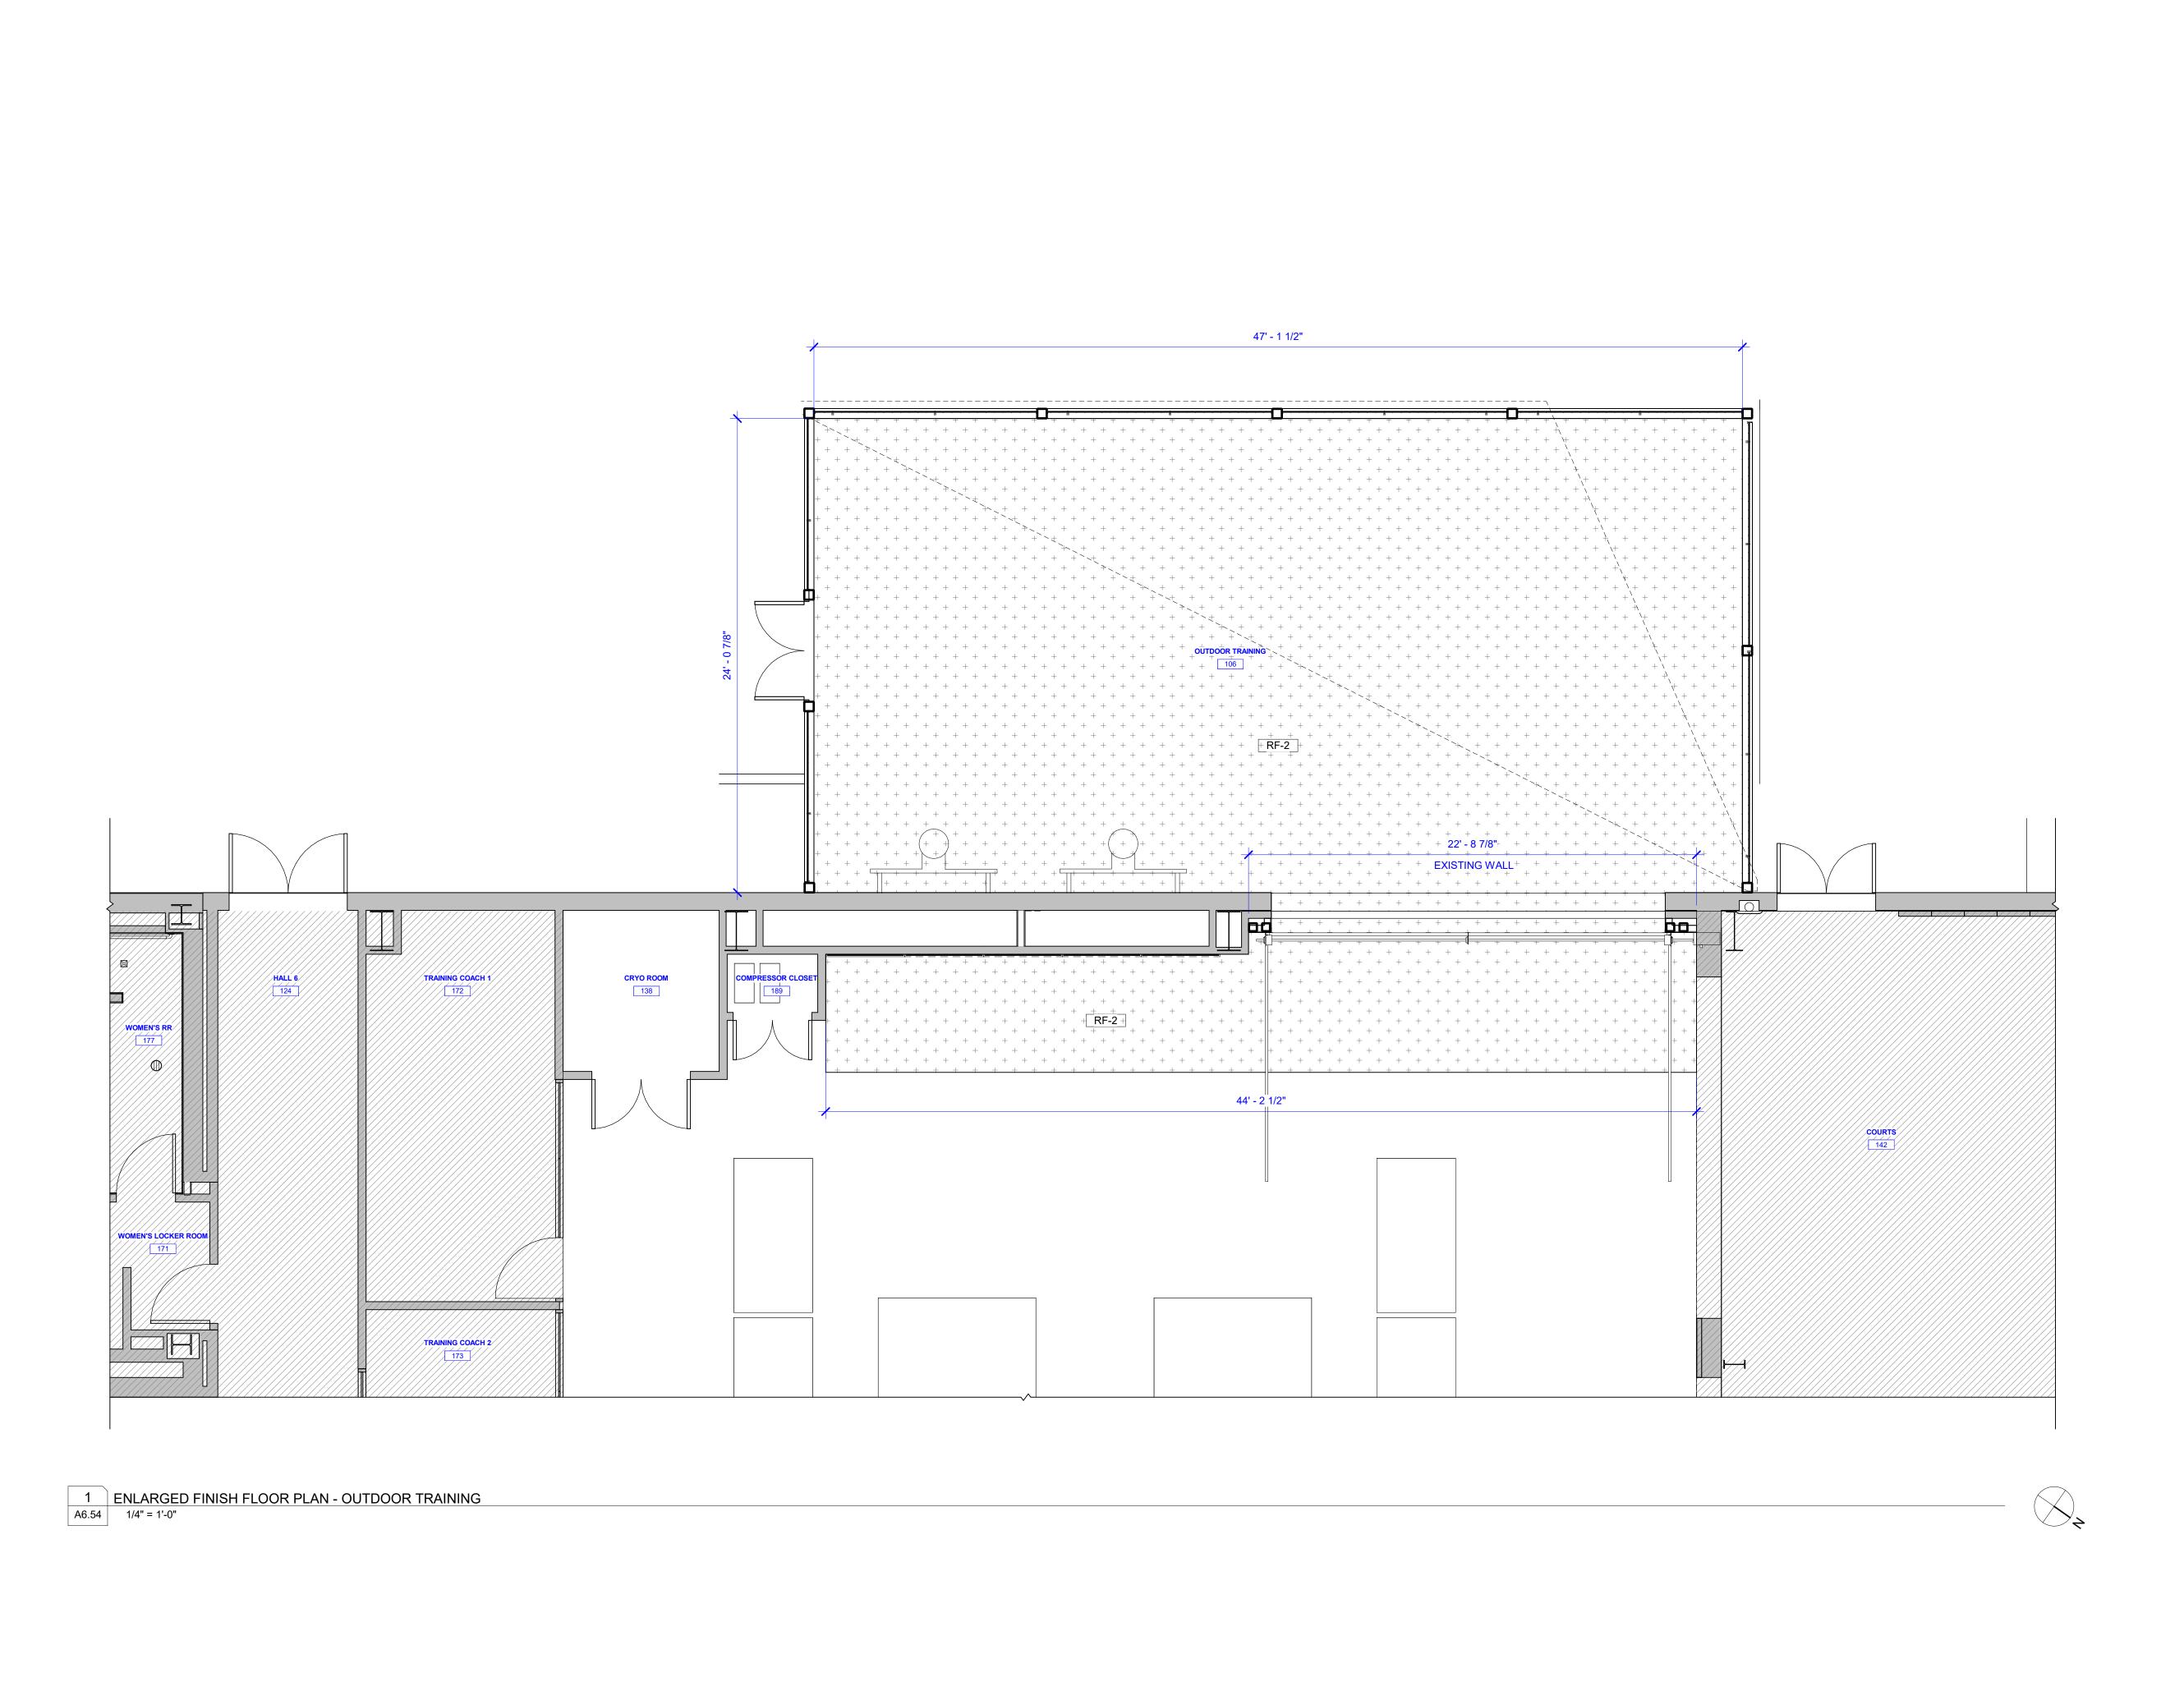

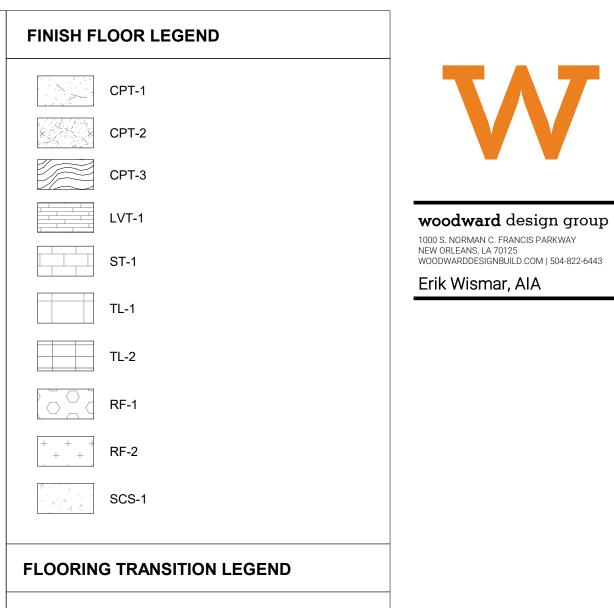

(E) WOOD TO CPT; TRANSITION STRIP: SCHLUTER RENO-U (E) WOOD TO LVT; TRANSITION STRIP: TARKETT CTA-XX-HL FT-3:

TARKETT EDGE SEAM SEALER FT-4: TRANSITION STRIP: TARKETT CTA-XX-HL

LVT TO CPT; TARKETT EDGE SEAM SEALER

CPT TO CPT; FT-6: TARKETT POWER BOND


* ALL TRANSITION ELEMENTS SHALL BE ADA COMPLIANT

PELICANS CAMPUS IMPROVEMENTS

WDG PROJECT NO | AR2315


CONSTRUCTION DOCUMENTS 04.15.2024

REVIS	SIONS			
no.	descripton	date		
		I		
FIN	FINISH FLOOR PLANS			

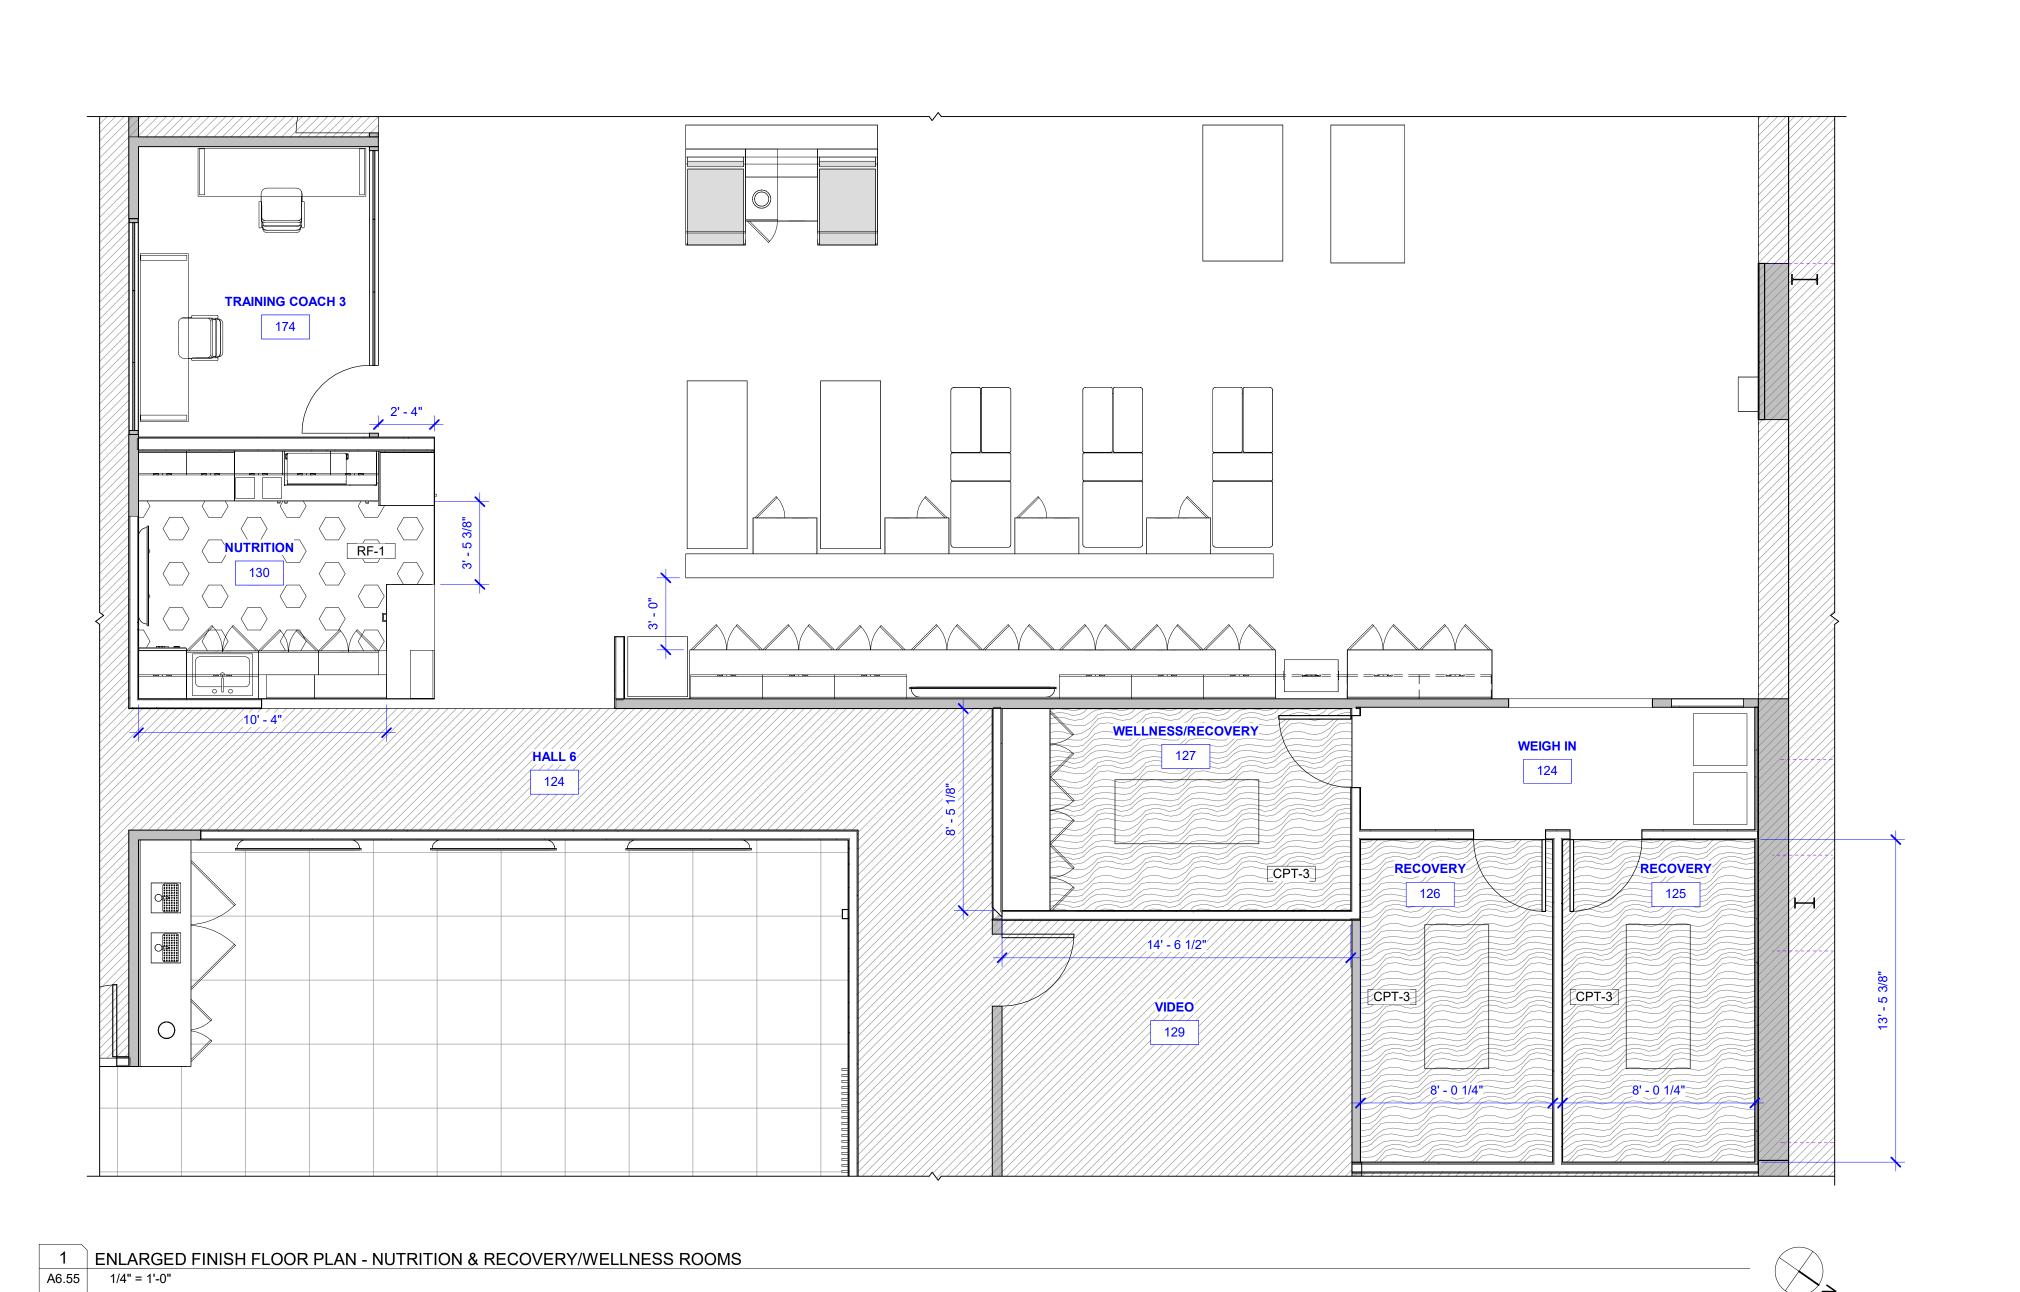

FINISH FLOOR LEGEND
















FLOORING TRANSITION LEGEND

(E) WOOD TO CPT; TRANSITION STRIP: SCHLUTER RENO-U

(E) WOOD TO LVT; TRANSITION STRIP: TARKETT CTA-XX-HL

TL TO CPT; TARKETT EDGE SEAM SEALER FT-3:

TL-1 TO TL-2; TRANSITION STRIP: TARKETT CTA-XX-HL FT-4:

LVT TO CPT; TARKETT EDGE SEAM SEALER

FT-6: CPT TO CPT; TARKETT POWER BOND

* ALL TRANSITION ELEMENTS SHALL BE ADA COMPLIANT

PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana


woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443


Erik Wismar, AIA

WDG PROJECT NO | AR2315


CONSTRUCTION DOCUMENTS 04.15.2024

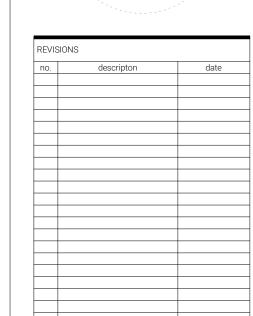

FINISH FLOOR PLANS

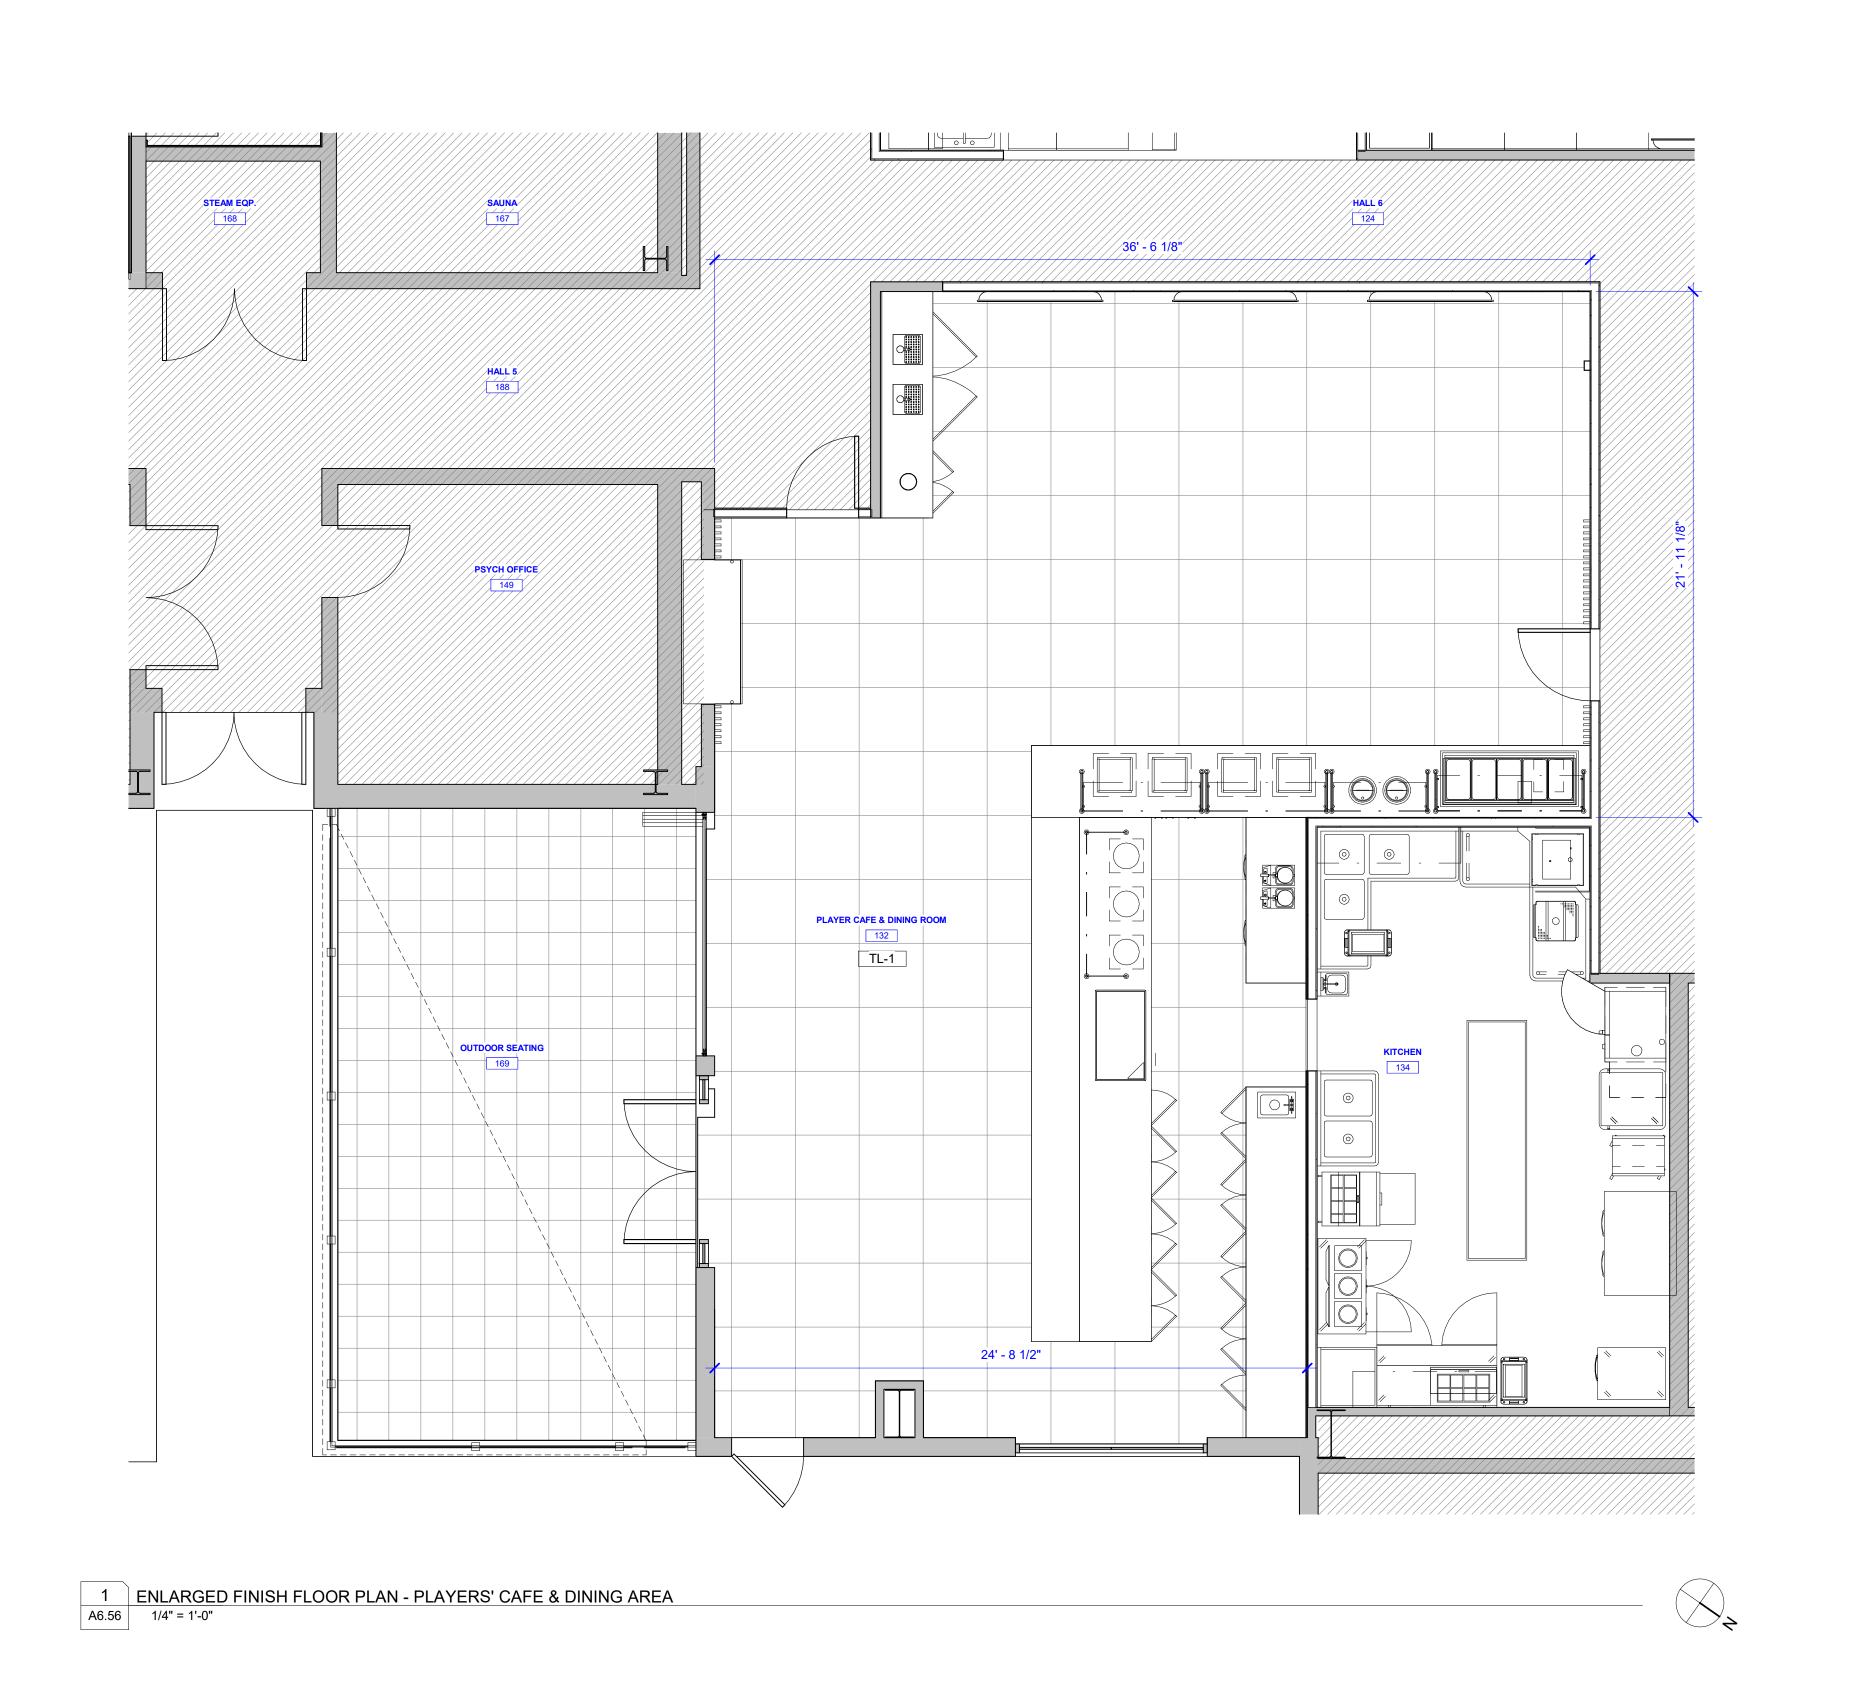


FINISH FLOOR LEGEND











FLOORING TRANSITION LEGEND

(E) WOOD TO CPT; TRANSITION STRIP: SCHLUTER RENO-U

(E) WOOD TO LVT; TRANSITION STRIP: TARKETT CTA-XX-HL

TL TO CPT; TARKETT EDGE SEAM SEALER FT-3:

TL-1 TO TL-2; TRANSITION STRIP: TARKETT CTA-XX-HL FT-4:

LVT TO CPT; TARKETT EDGE SEAM SEALER

CPT TO CPT; TARKETT POWER BOND FT-6:

* ALL TRANSITION ELEMENTS SHALL BE ADA COMPLIANT


PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana


woodward design group


1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443


Erik Wismar, AIA

WDG PROJECT NO | AR2315



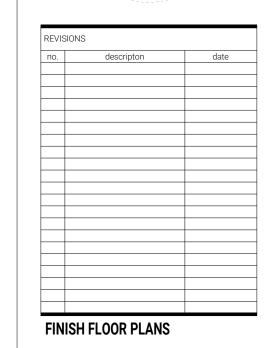

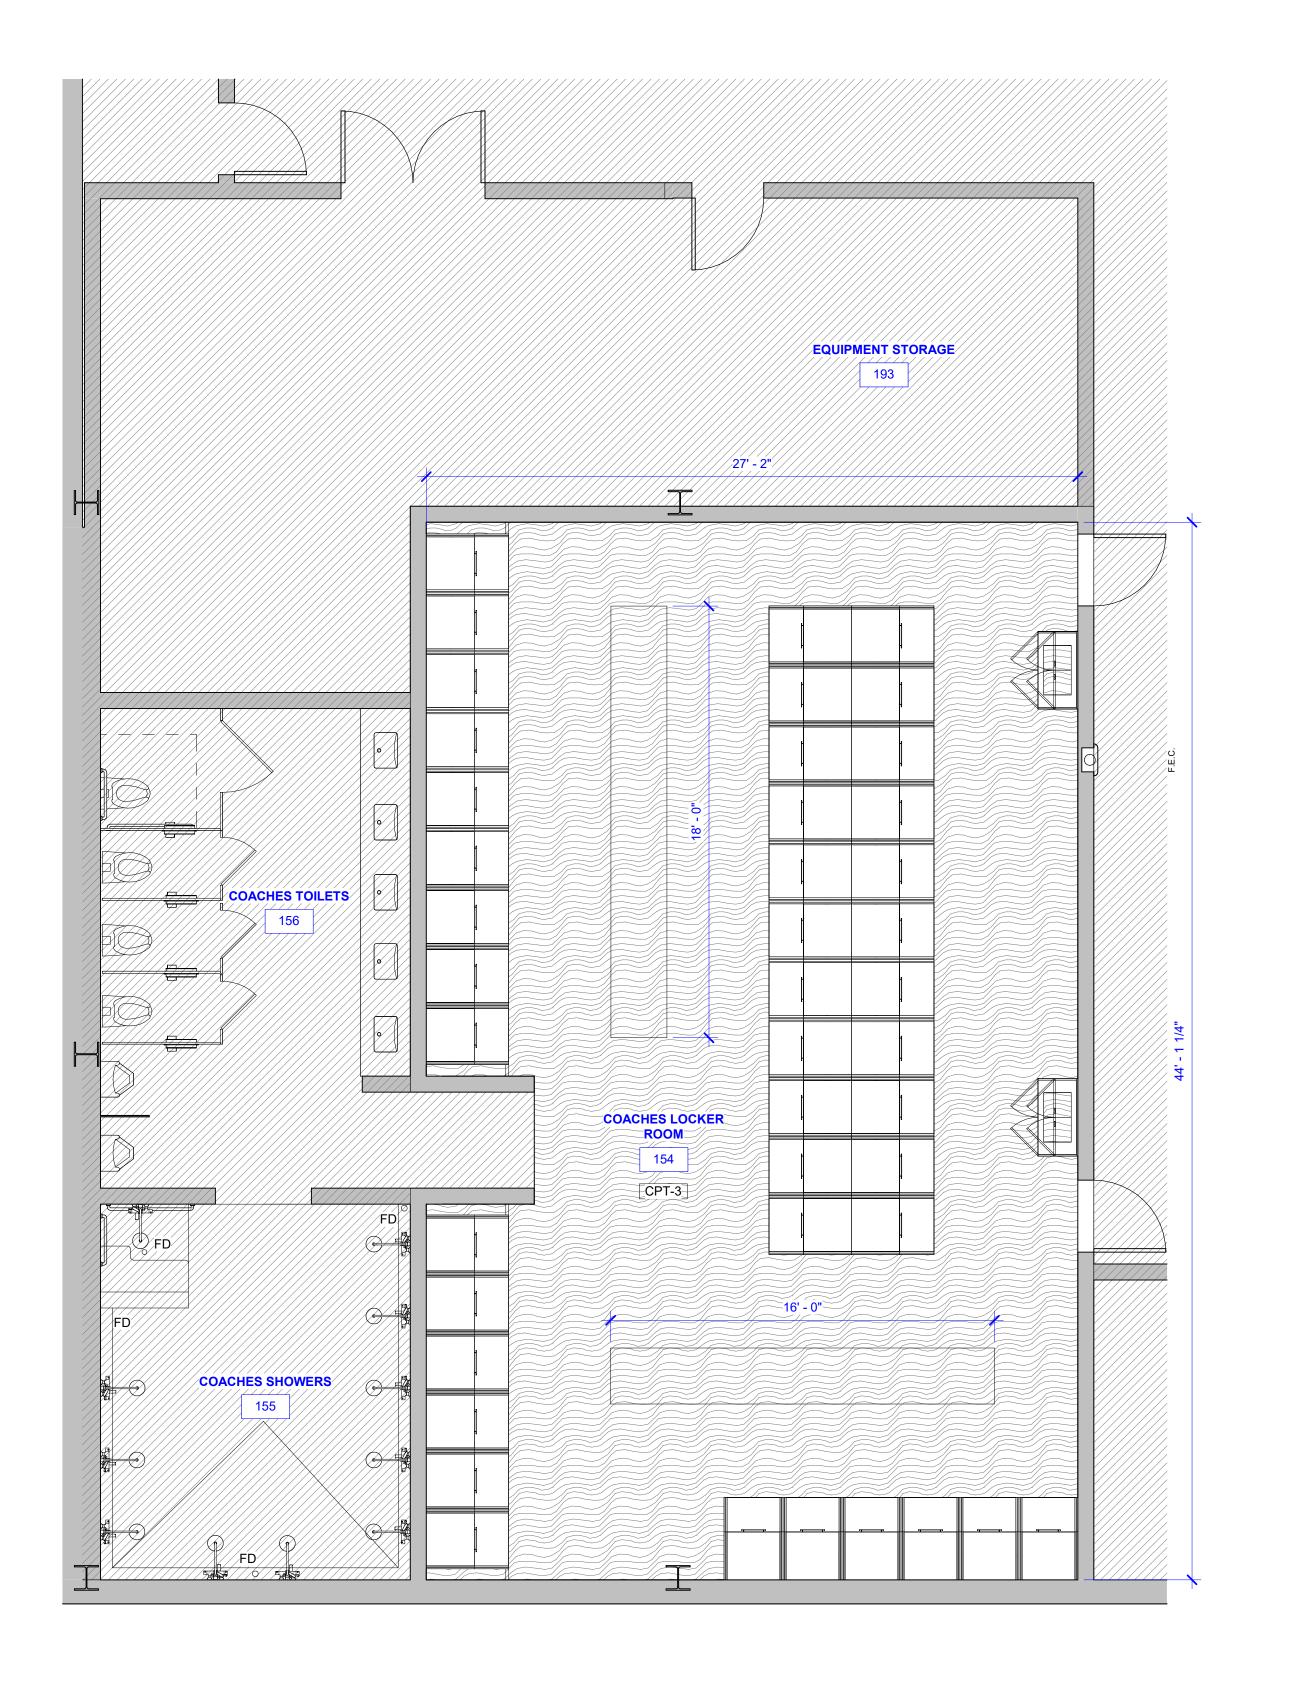

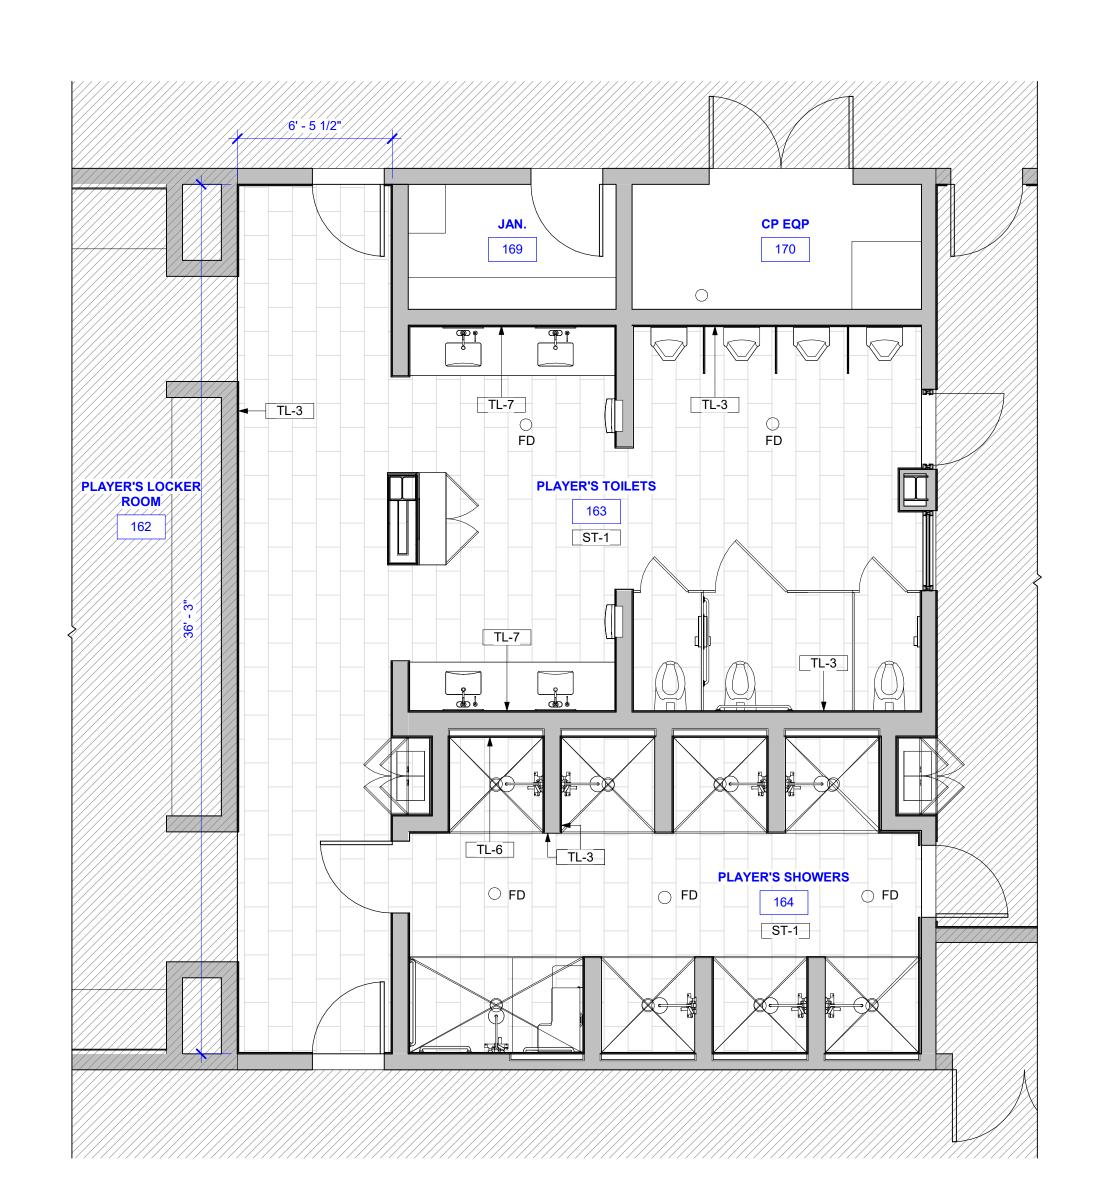

1 ENLARGED FINISH FLOOR PLAN - COACHES' LOCKER ROOM
A6.57 1/4" = 1'-0"



2 ENLARGED FINISH FLOOR PLAN - PLAYERS TOILETS
A6.57 1/4" = 1'-0"




FINISH FLOOR LEGEND woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443 Erik Wismar, AIA

FLOORING TRANSITION LEGEND


(E) WOOD TO CPT; TRANSITION STRIP: SCHLUTER RENO-U (E) WOOD TO LVT; TRANSITION STRIP: TARKETT CTA-XX-HL TL TO CPT; TARKETT EDGE SEAM SEALER FT-3: TL-1 TO TL-2; TRANSITION STRIP: TARKETT CTA-XX-HL FT-4: LVT TO CPT; TARKETT EDGE SEAM SEALER FT-6: CPT TO CPT; TARKETT POWER BOND * ALL TRANSITION ELEMENTS SHALL BE ADA COMPLIANT

PELICANS CAMPUS IMPROVEMENTS

WDG PROJECT NO | AR2315



10.	descripton	date
10.	descriptori	uate
		_

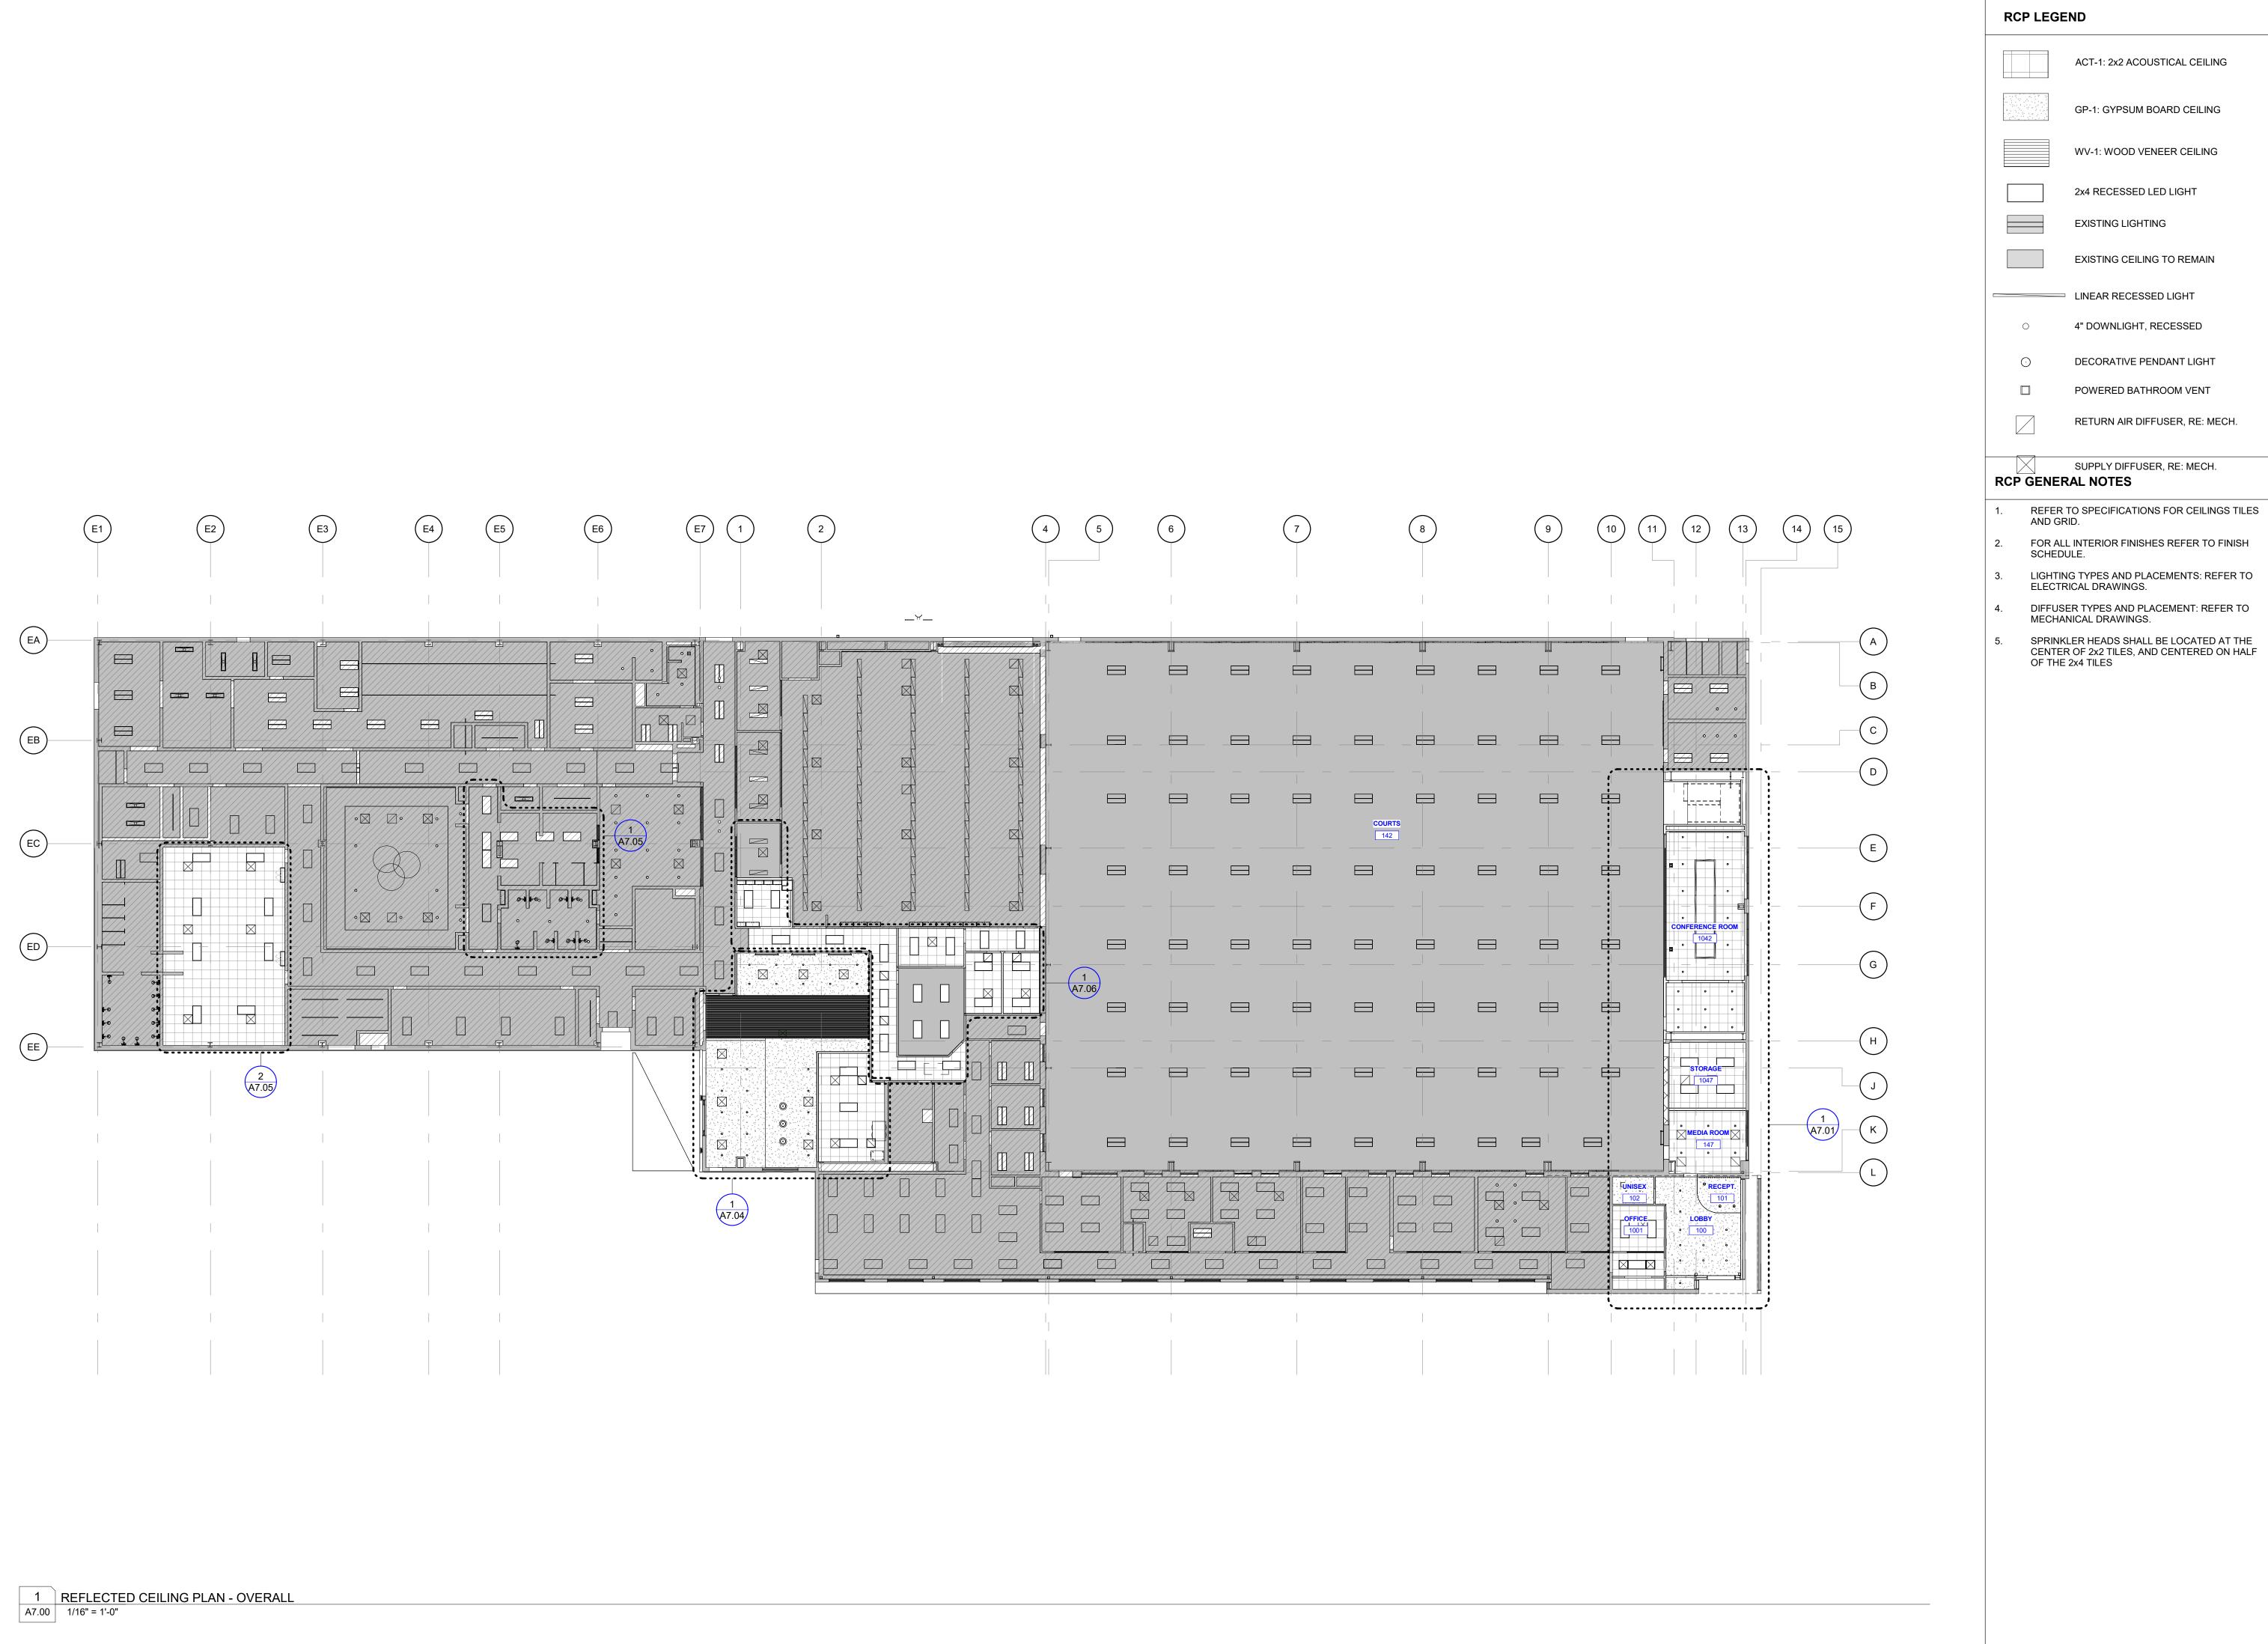



PELICANS CAMPUS IMPROVEMENTS

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024

REFLECTED CEILING KEY PLAN

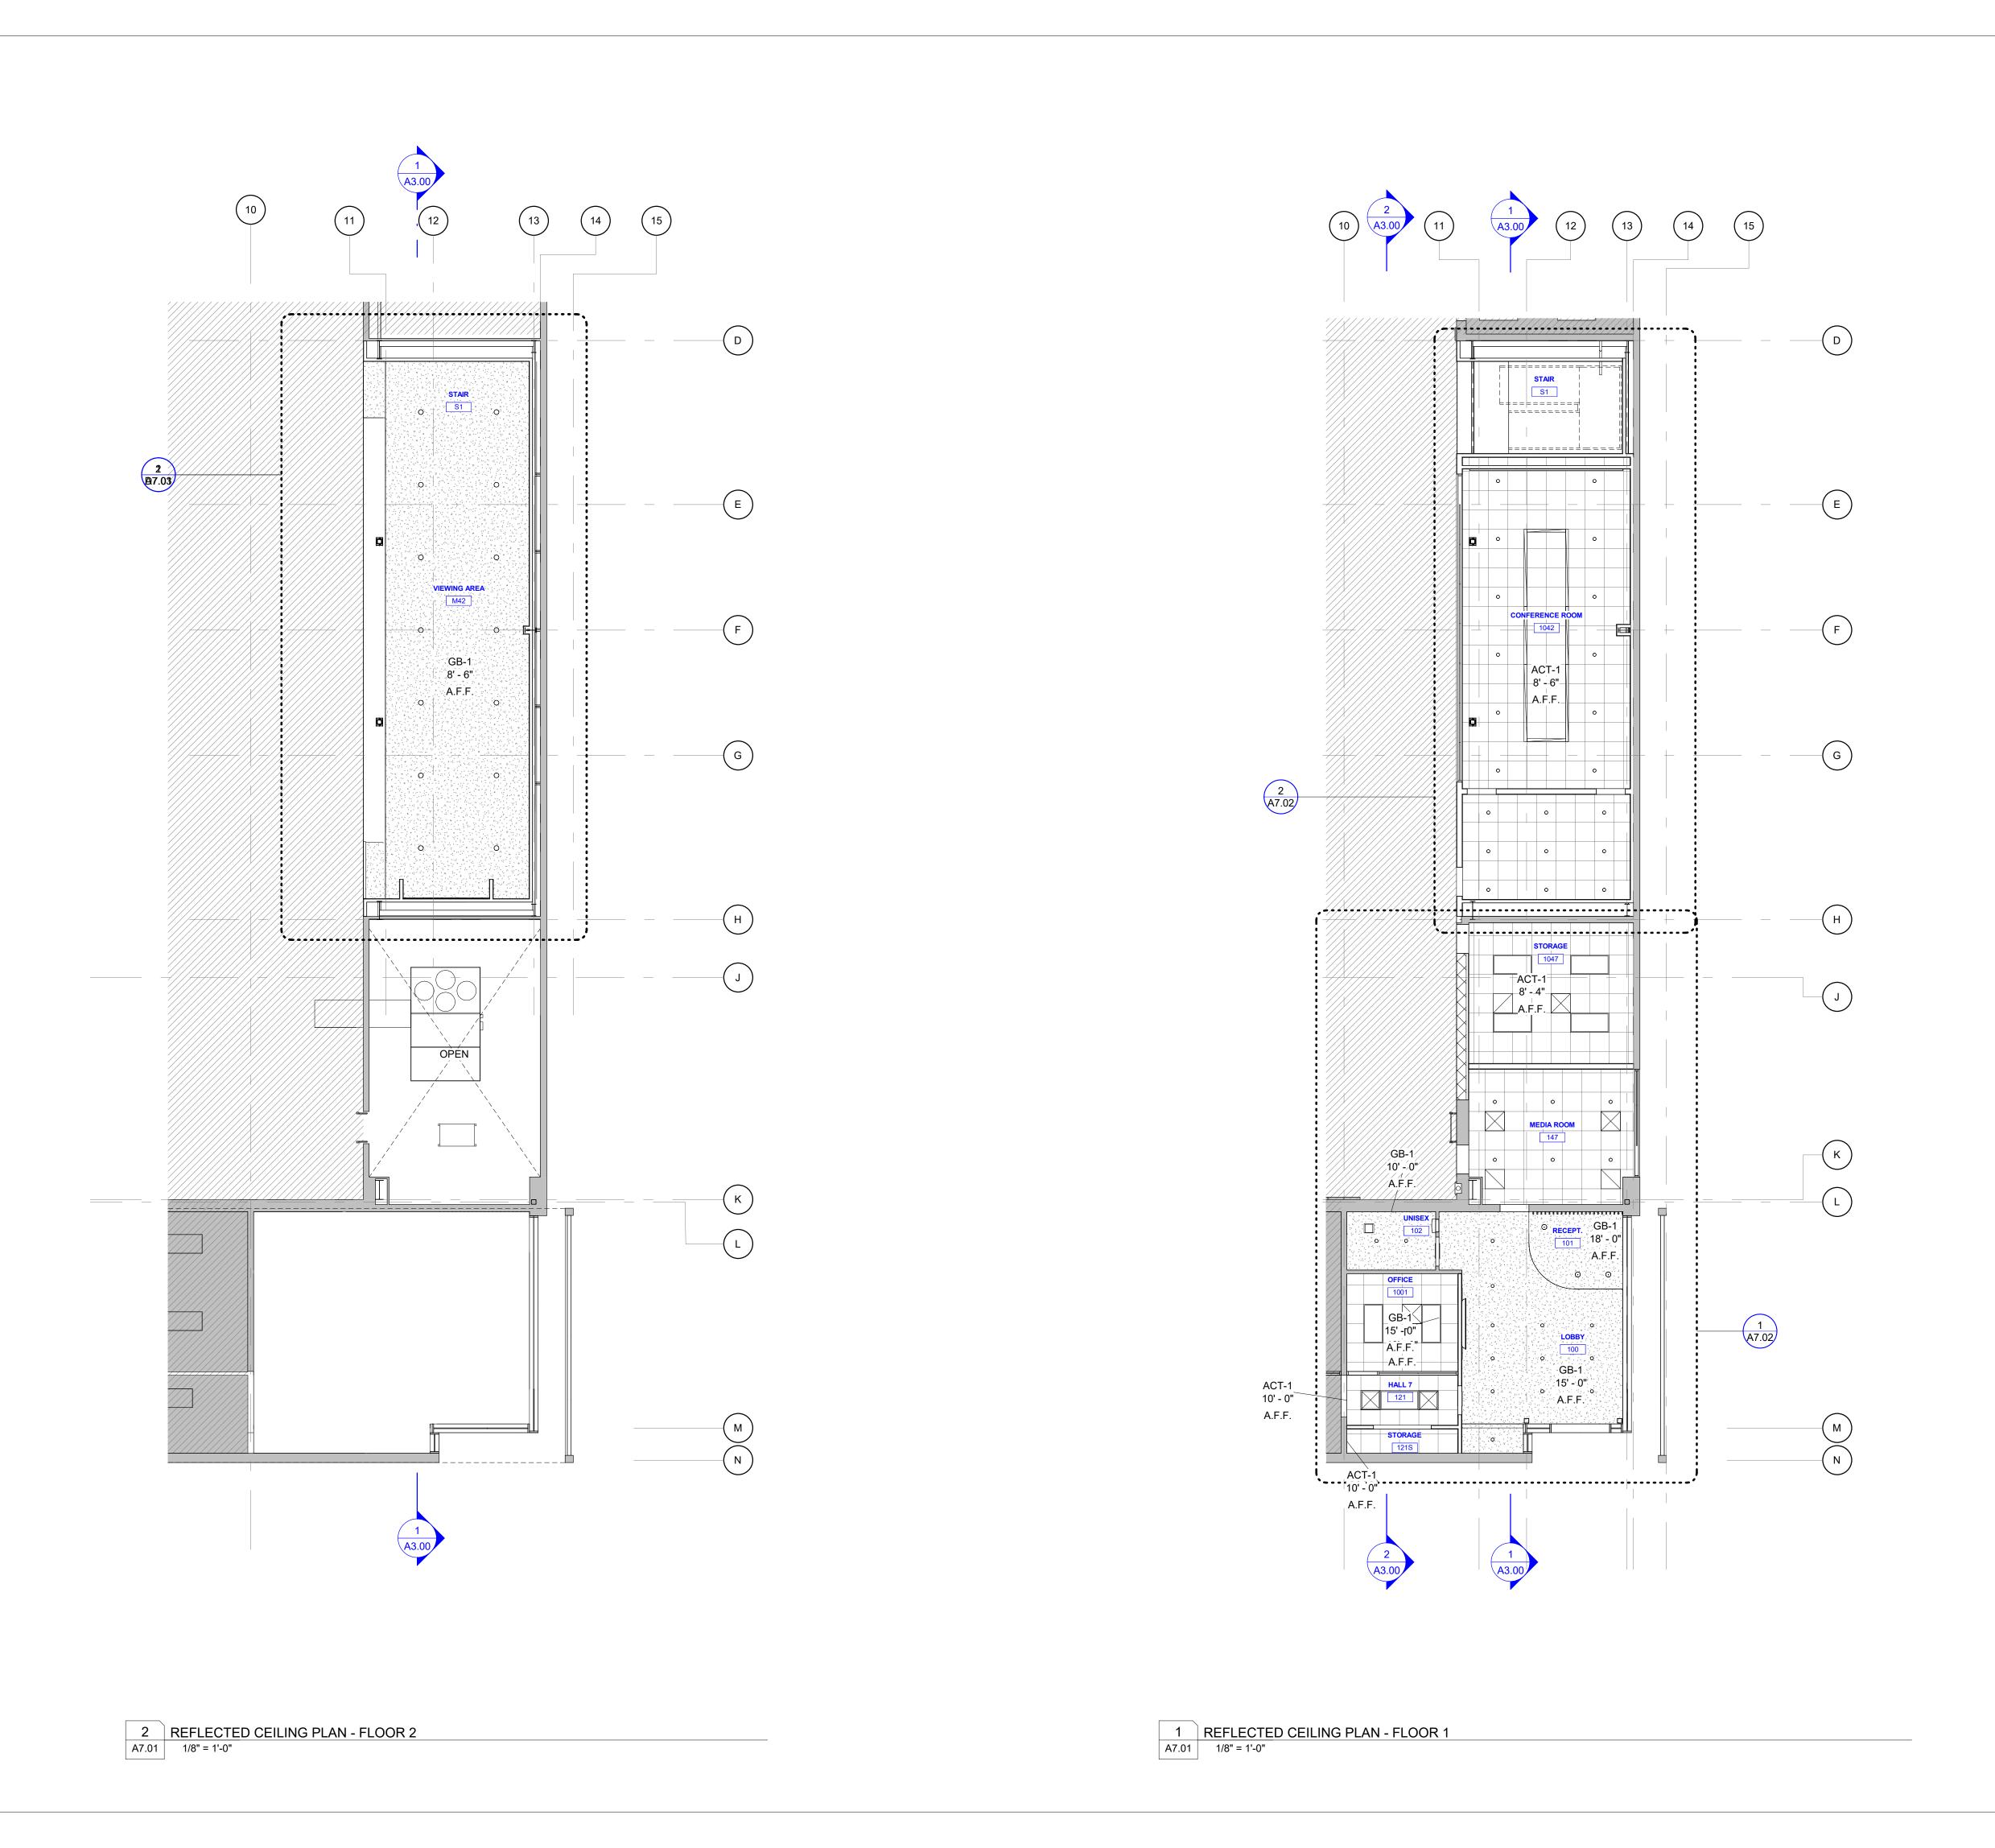

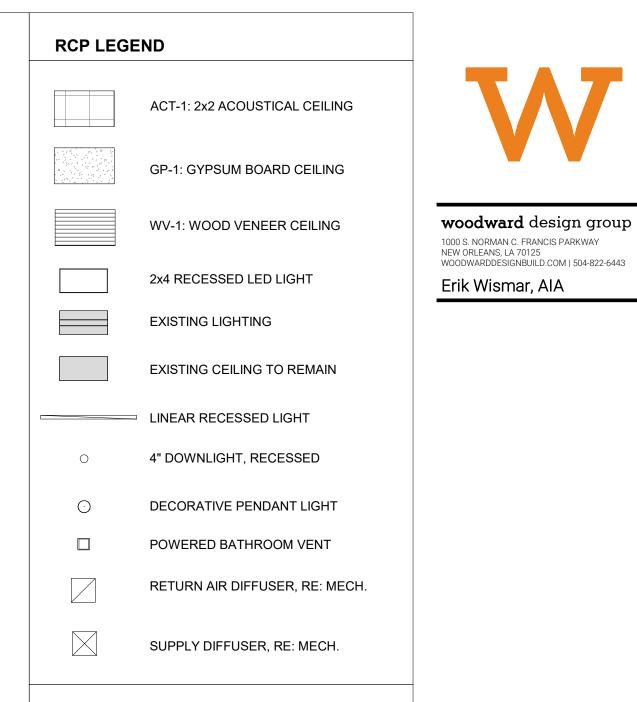

RCP GENERAL NOTES

SCHEDULE.

REFER TO SPECIFICATIONS FOR CEILINGS TILES AND GRID.

2. FOR ALL INTERIOR FINISHES REFER TO FINISH

3. LIGHTING TYPES AND PLACEMENTS: REFER TO

4. DIFFUSER TYPES AND PLACEMENT: REFER TO MECHANICAL DRAWINGS.

SPRINKLER HEADS SHALL BE LOCATED AT THE CENTER OF 2x2 TILES, AND CENTERED ON HALF OF THE 2x4 TILES


ELECTRICAL DRAWINGS.

WDG PROJECT NO | AR2315

PELICANS CAMPUS IMPROVEMENTS

CONSTRUCTION DOCUMENTS 04.15.2024

REVIS	SIONS			
no.	descripton	date		
ENLARGED REFLECTED CEILING				

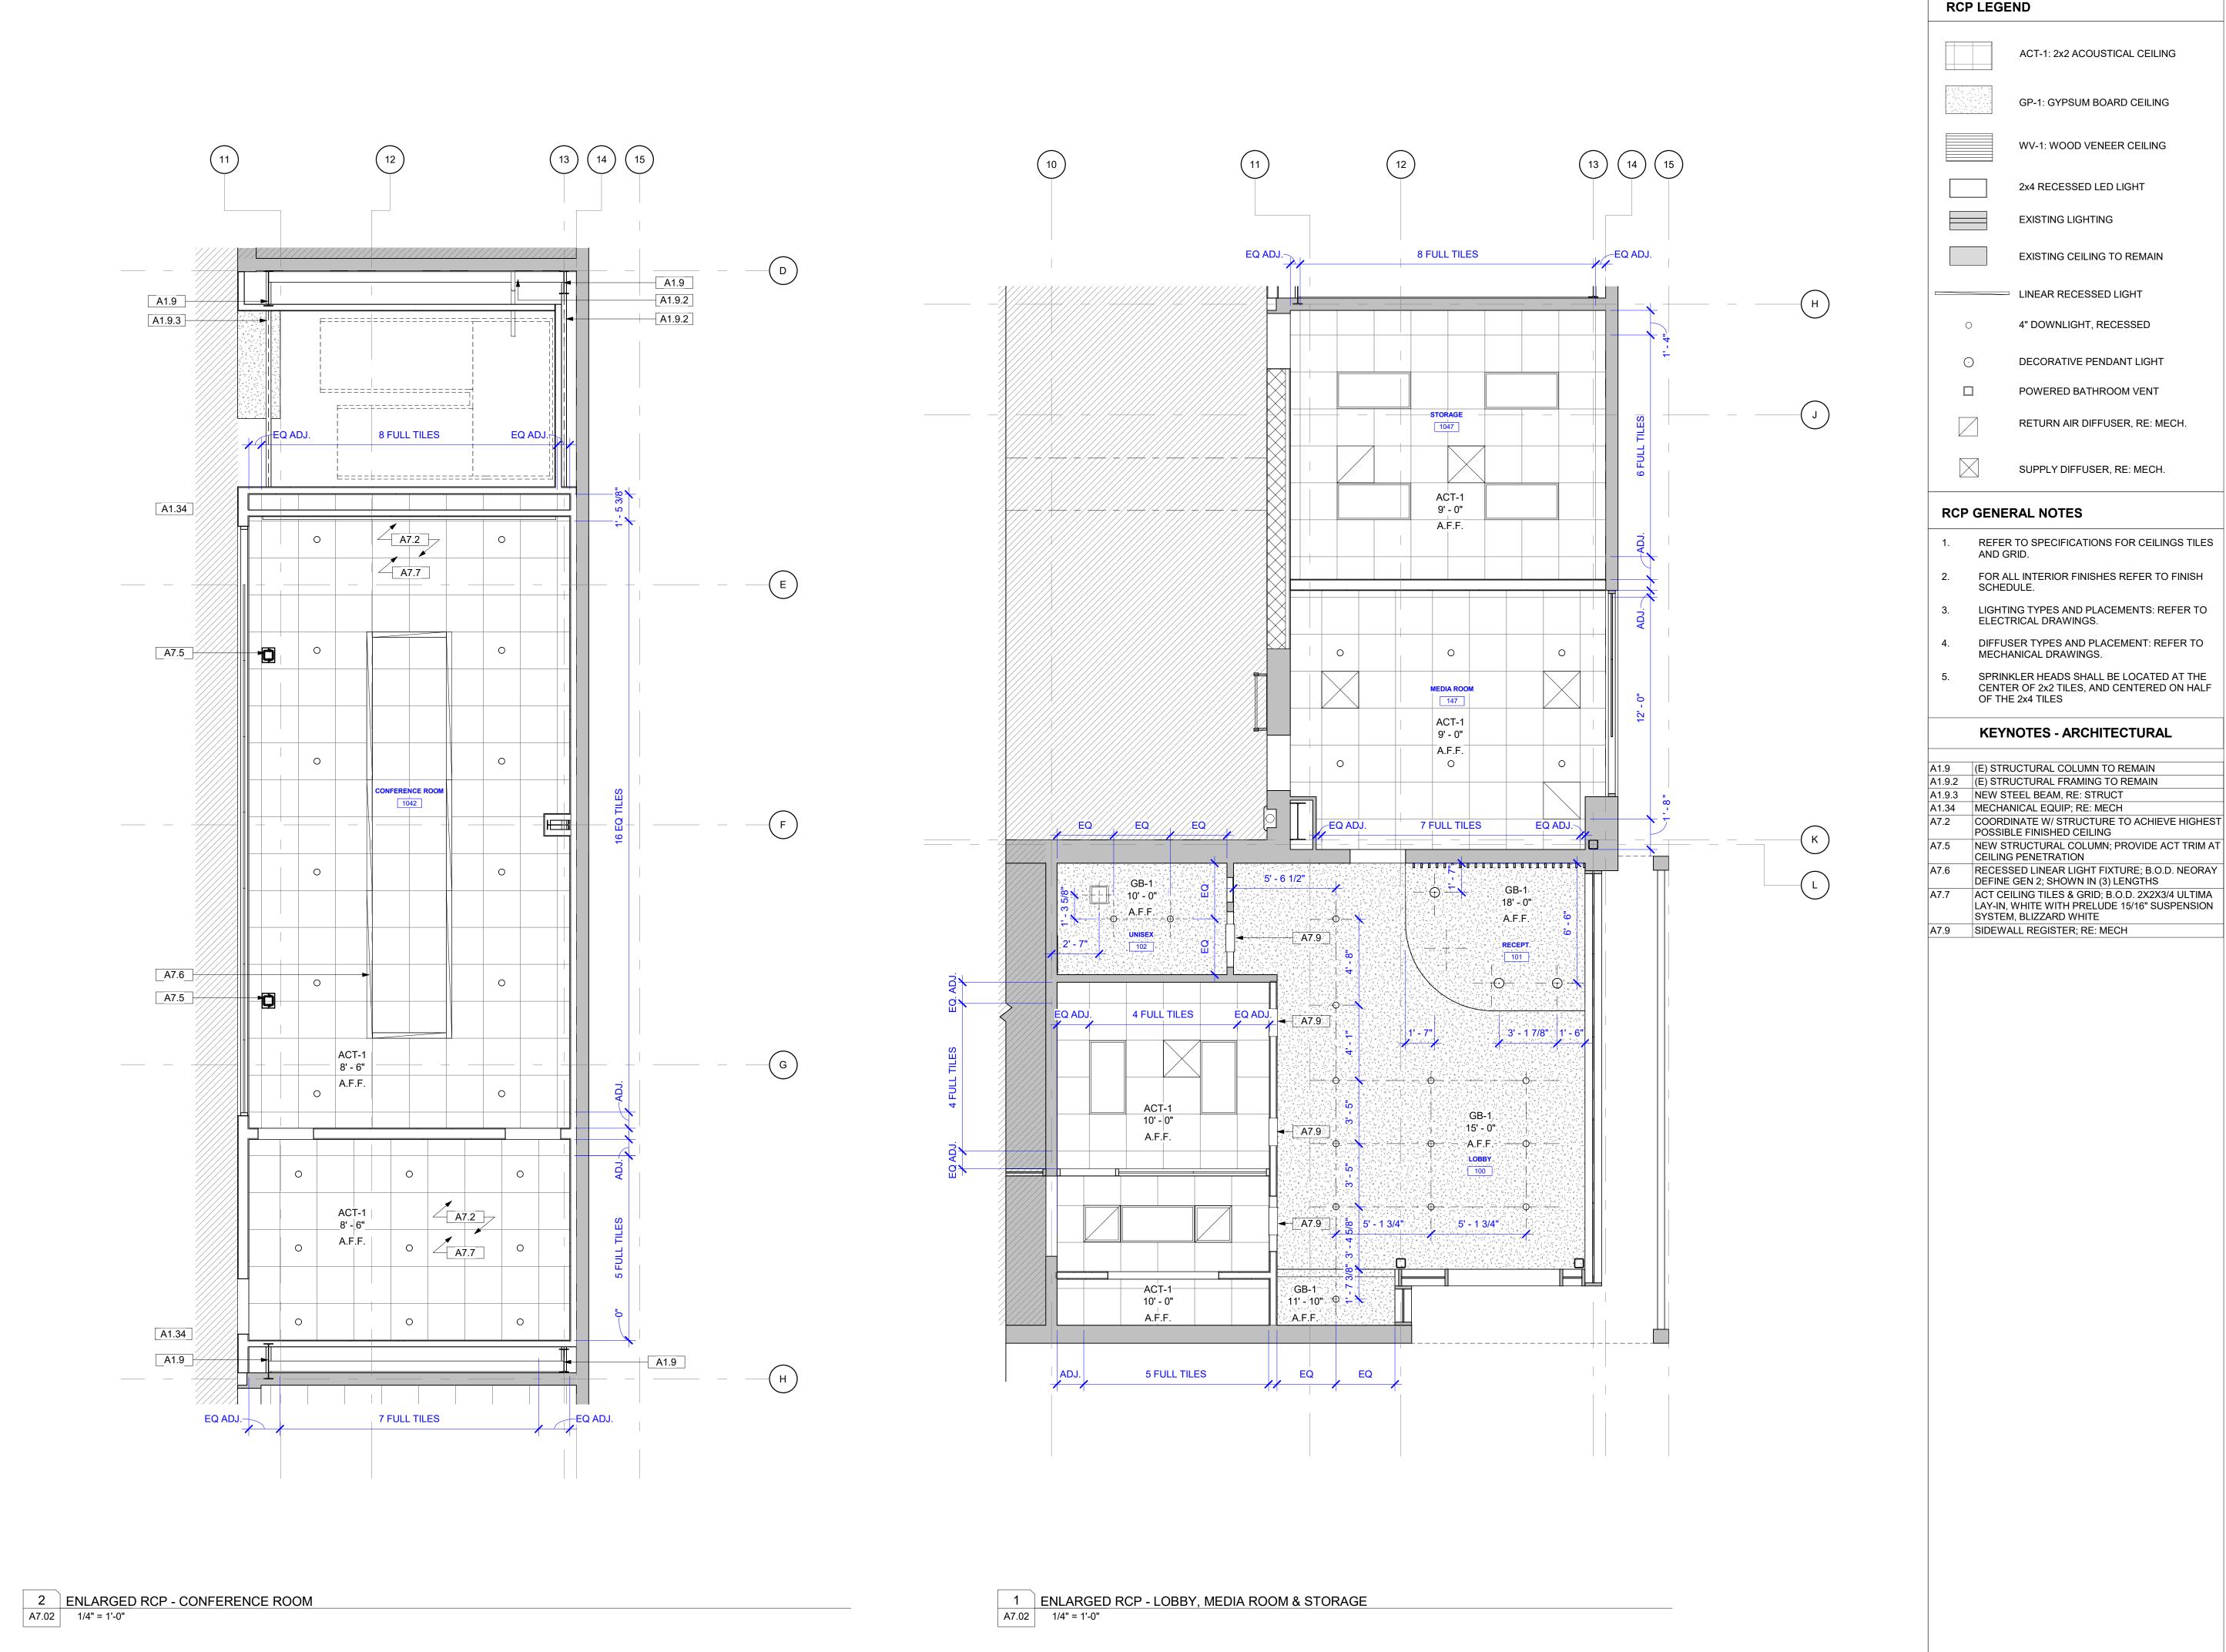

ACT-1: 2x2 ACOUSTICAL CEILING woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443 Erik Wismar, AIA

A7.5 NEW STRUCTURAL COLUMN; PROVIDE ACT TRIM AT CEILING PENETRATION

A7.6 RECESSED LINEAR LIGHT FIXTURE; B.O.D. NEORAY DEFINE GEN 2; SHOWN IN (3) LENGTHS ACT CEILING TILES & GRID; B.O.D. 2X2X3/4 ULTIMA LAY-IN, WHITE WITH PRELUDE 15/16" SUSPENSION SYSTEM, BLIZZARD WHITE

GP-1: GYPSUM BOARD CEILING

WV-1: WOOD VENEER CEILING

2x4 RECESSED LED LIGHT

EXISTING CEILING TO REMAIN

4" DOWNLIGHT, RECESSED

DECORATIVE PENDANT LIGHT

POWERED BATHROOM VENT

SUPPLY DIFFUSER, RE: MECH.

RETURN AIR DIFFUSER, RE: MECH.


EXISTING LIGHTING

A7.9 SIDEWALL REGISTER; RE: MECH


PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana


WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024



REVISION	IS	
no.	descripton	date

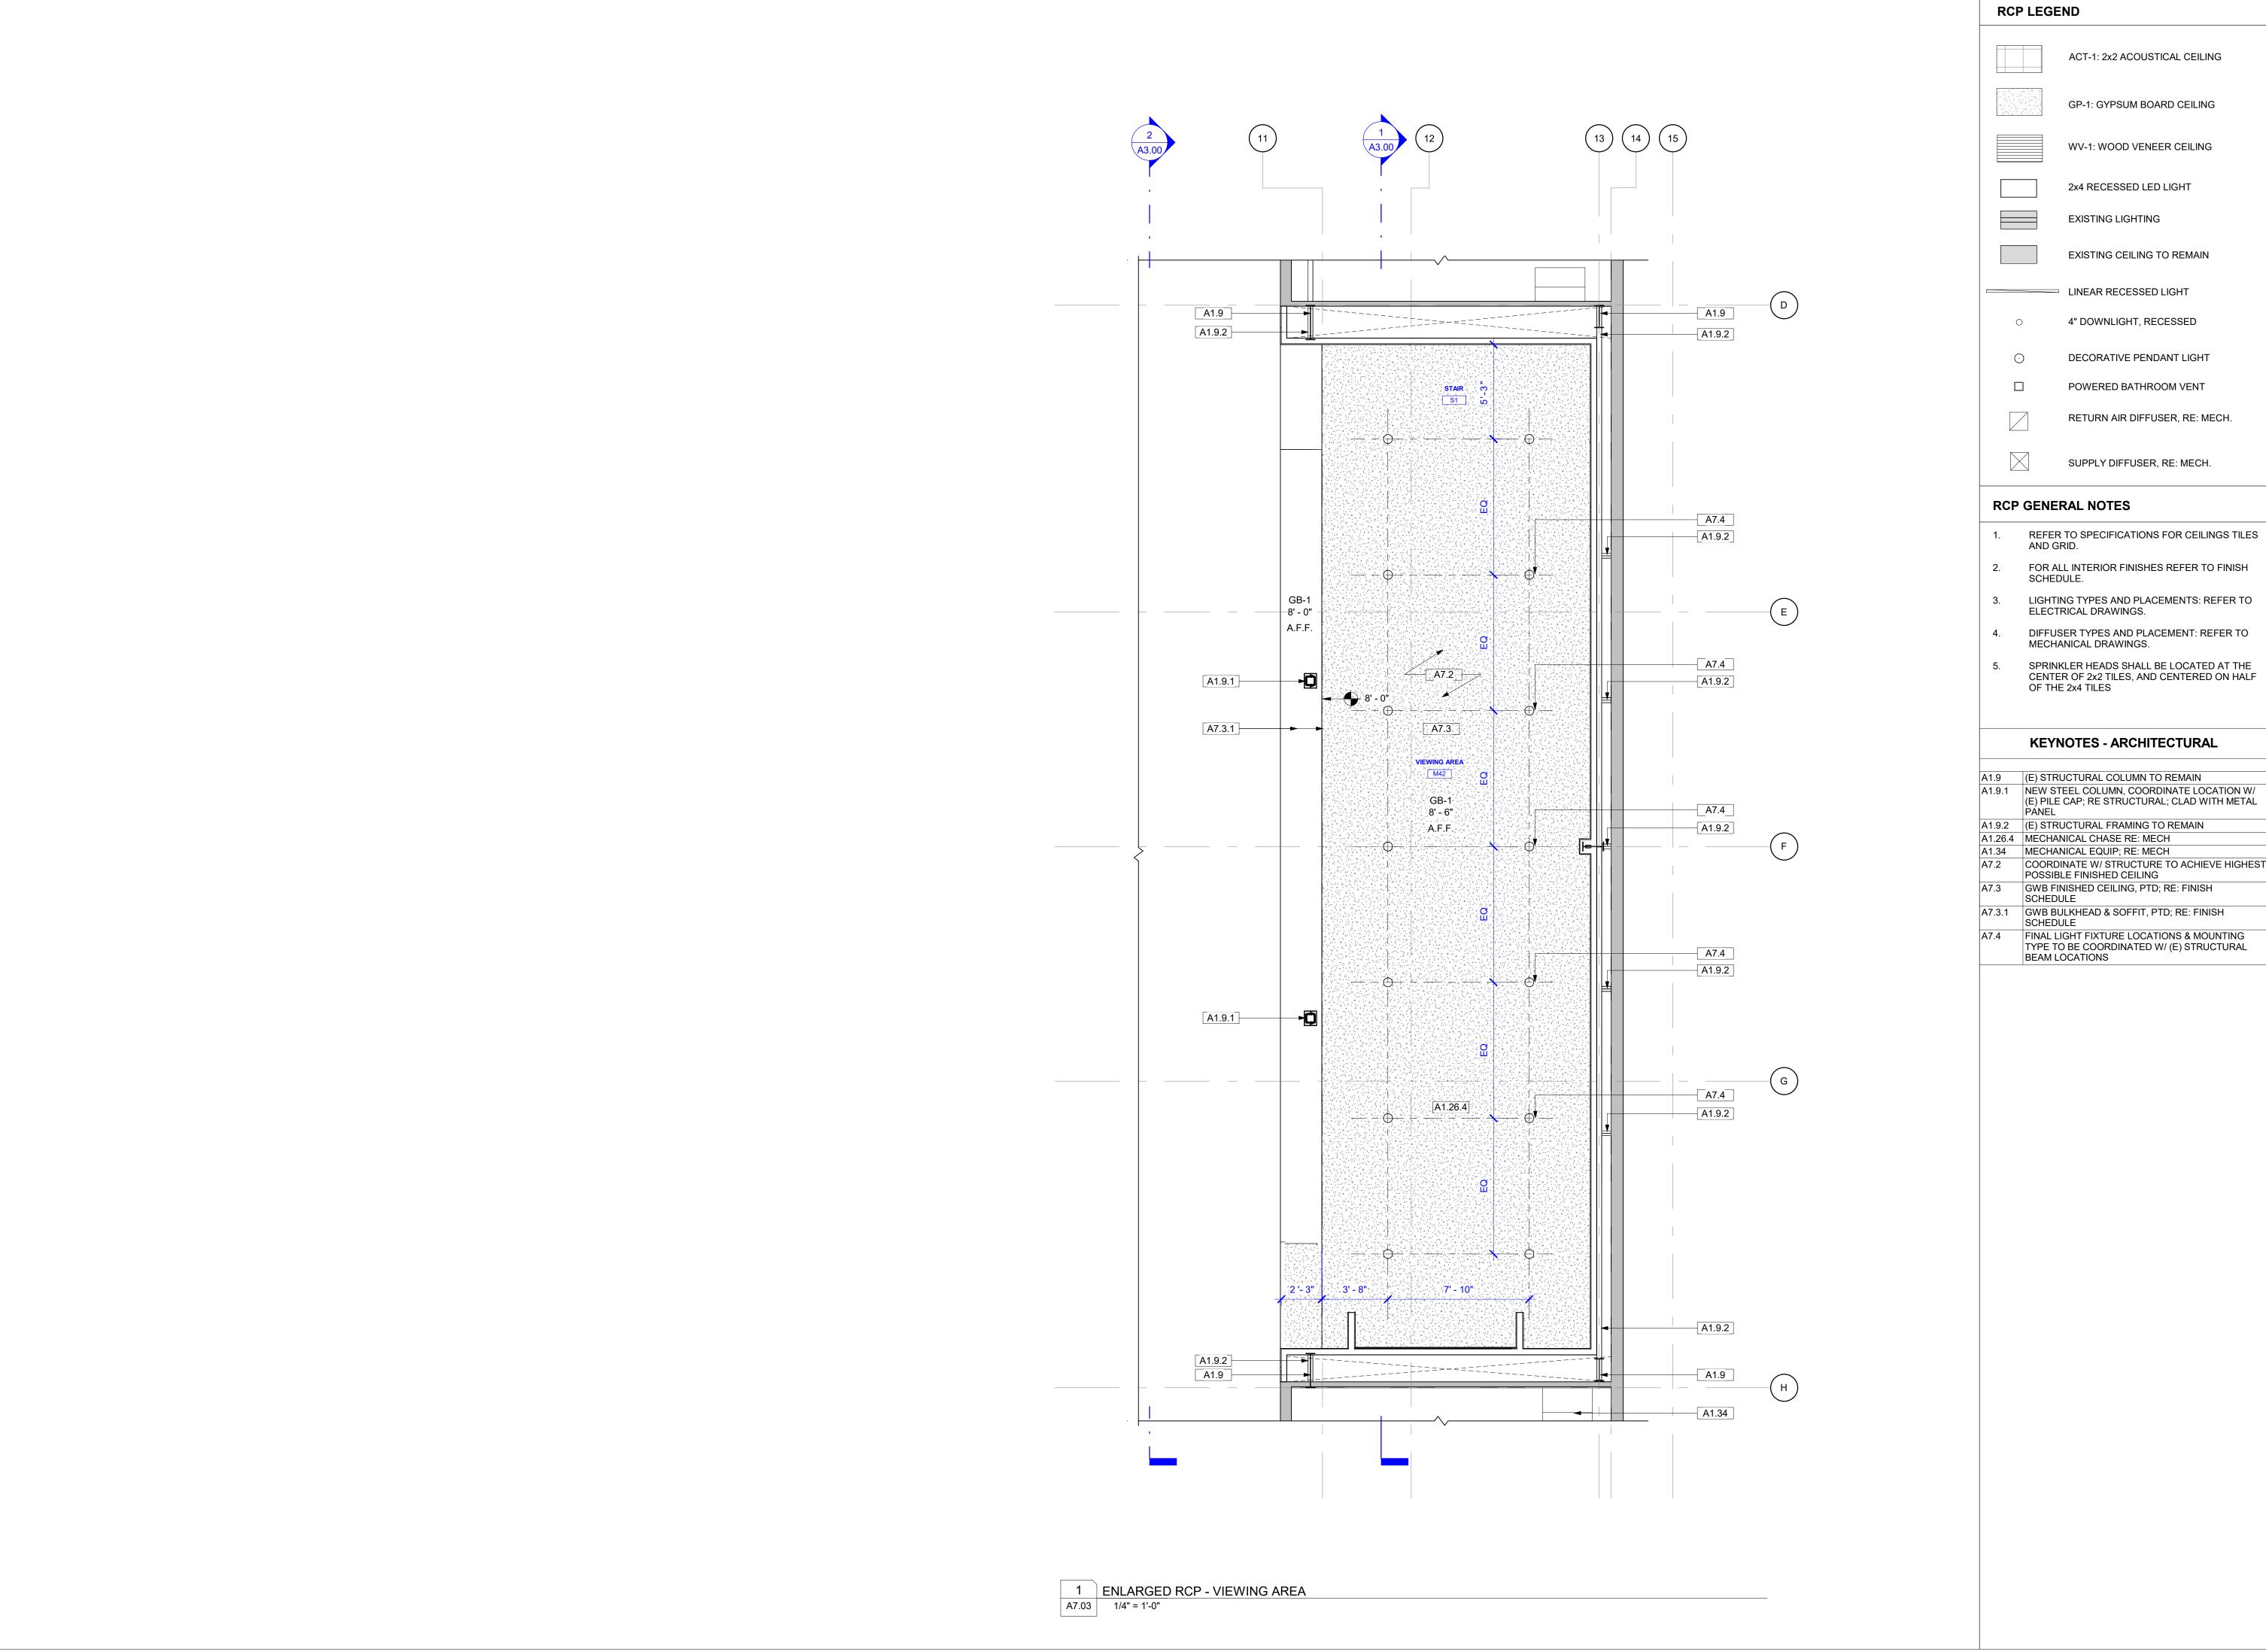

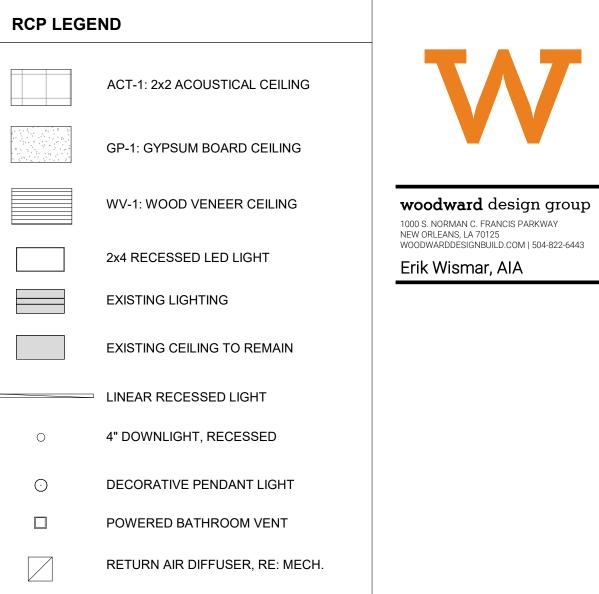

RCP GENERAL NOTES

- AND GRID. 2. FOR ALL INTERIOR FINISHES REFER TO FINISH
- LIGHTING TYPES AND PLACEMENTS: REFER TO ELECTRICAL DRAWINGS.
- 4. DIFFUSER TYPES AND PLACEMENT: REFER TO
- MECHANICAL DRAWINGS.
- 5. SPRINKLER HEADS SHALL BE LOCATED AT THE CENTER OF 2x2 TILES, AND CENTERED ON HALF OF THE 2x4 TILES

KEYNOTES - ARCHITECTURAL


A1.9	(E) STRUCTURAL COLUMN TO REMAIN
A1.9.1	NEW STEEL COLUMN, COORDINATE LOCATION W/ (E) PILE CAP; RE STRUCTURAL; CLAD WITH METAL PANEL
A1.9.2	(E) STRUCTURAL FRAMING TO REMAIN
A1.26.4	MECHANICAL CHASE RE: MECH
A1.34	MECHANICAL EQUIP; RE: MECH
A7.2	COORDINATE W/ STRUCTURE TO ACHIEVE HIGHES POSSIBLE FINISHED CEILING
A7.3	GWB FINISHED CEILING, PTD; RE: FINISH SCHEDULE
A7.3.1	GWB BULKHEAD & SOFFIT, PTD; RE: FINISH SCHEDULE

PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana

WDG PROJECT NO | AR2315



REVIS	SIONS	
no.	descripton	date
	ARGED REFLECTED	CEILING

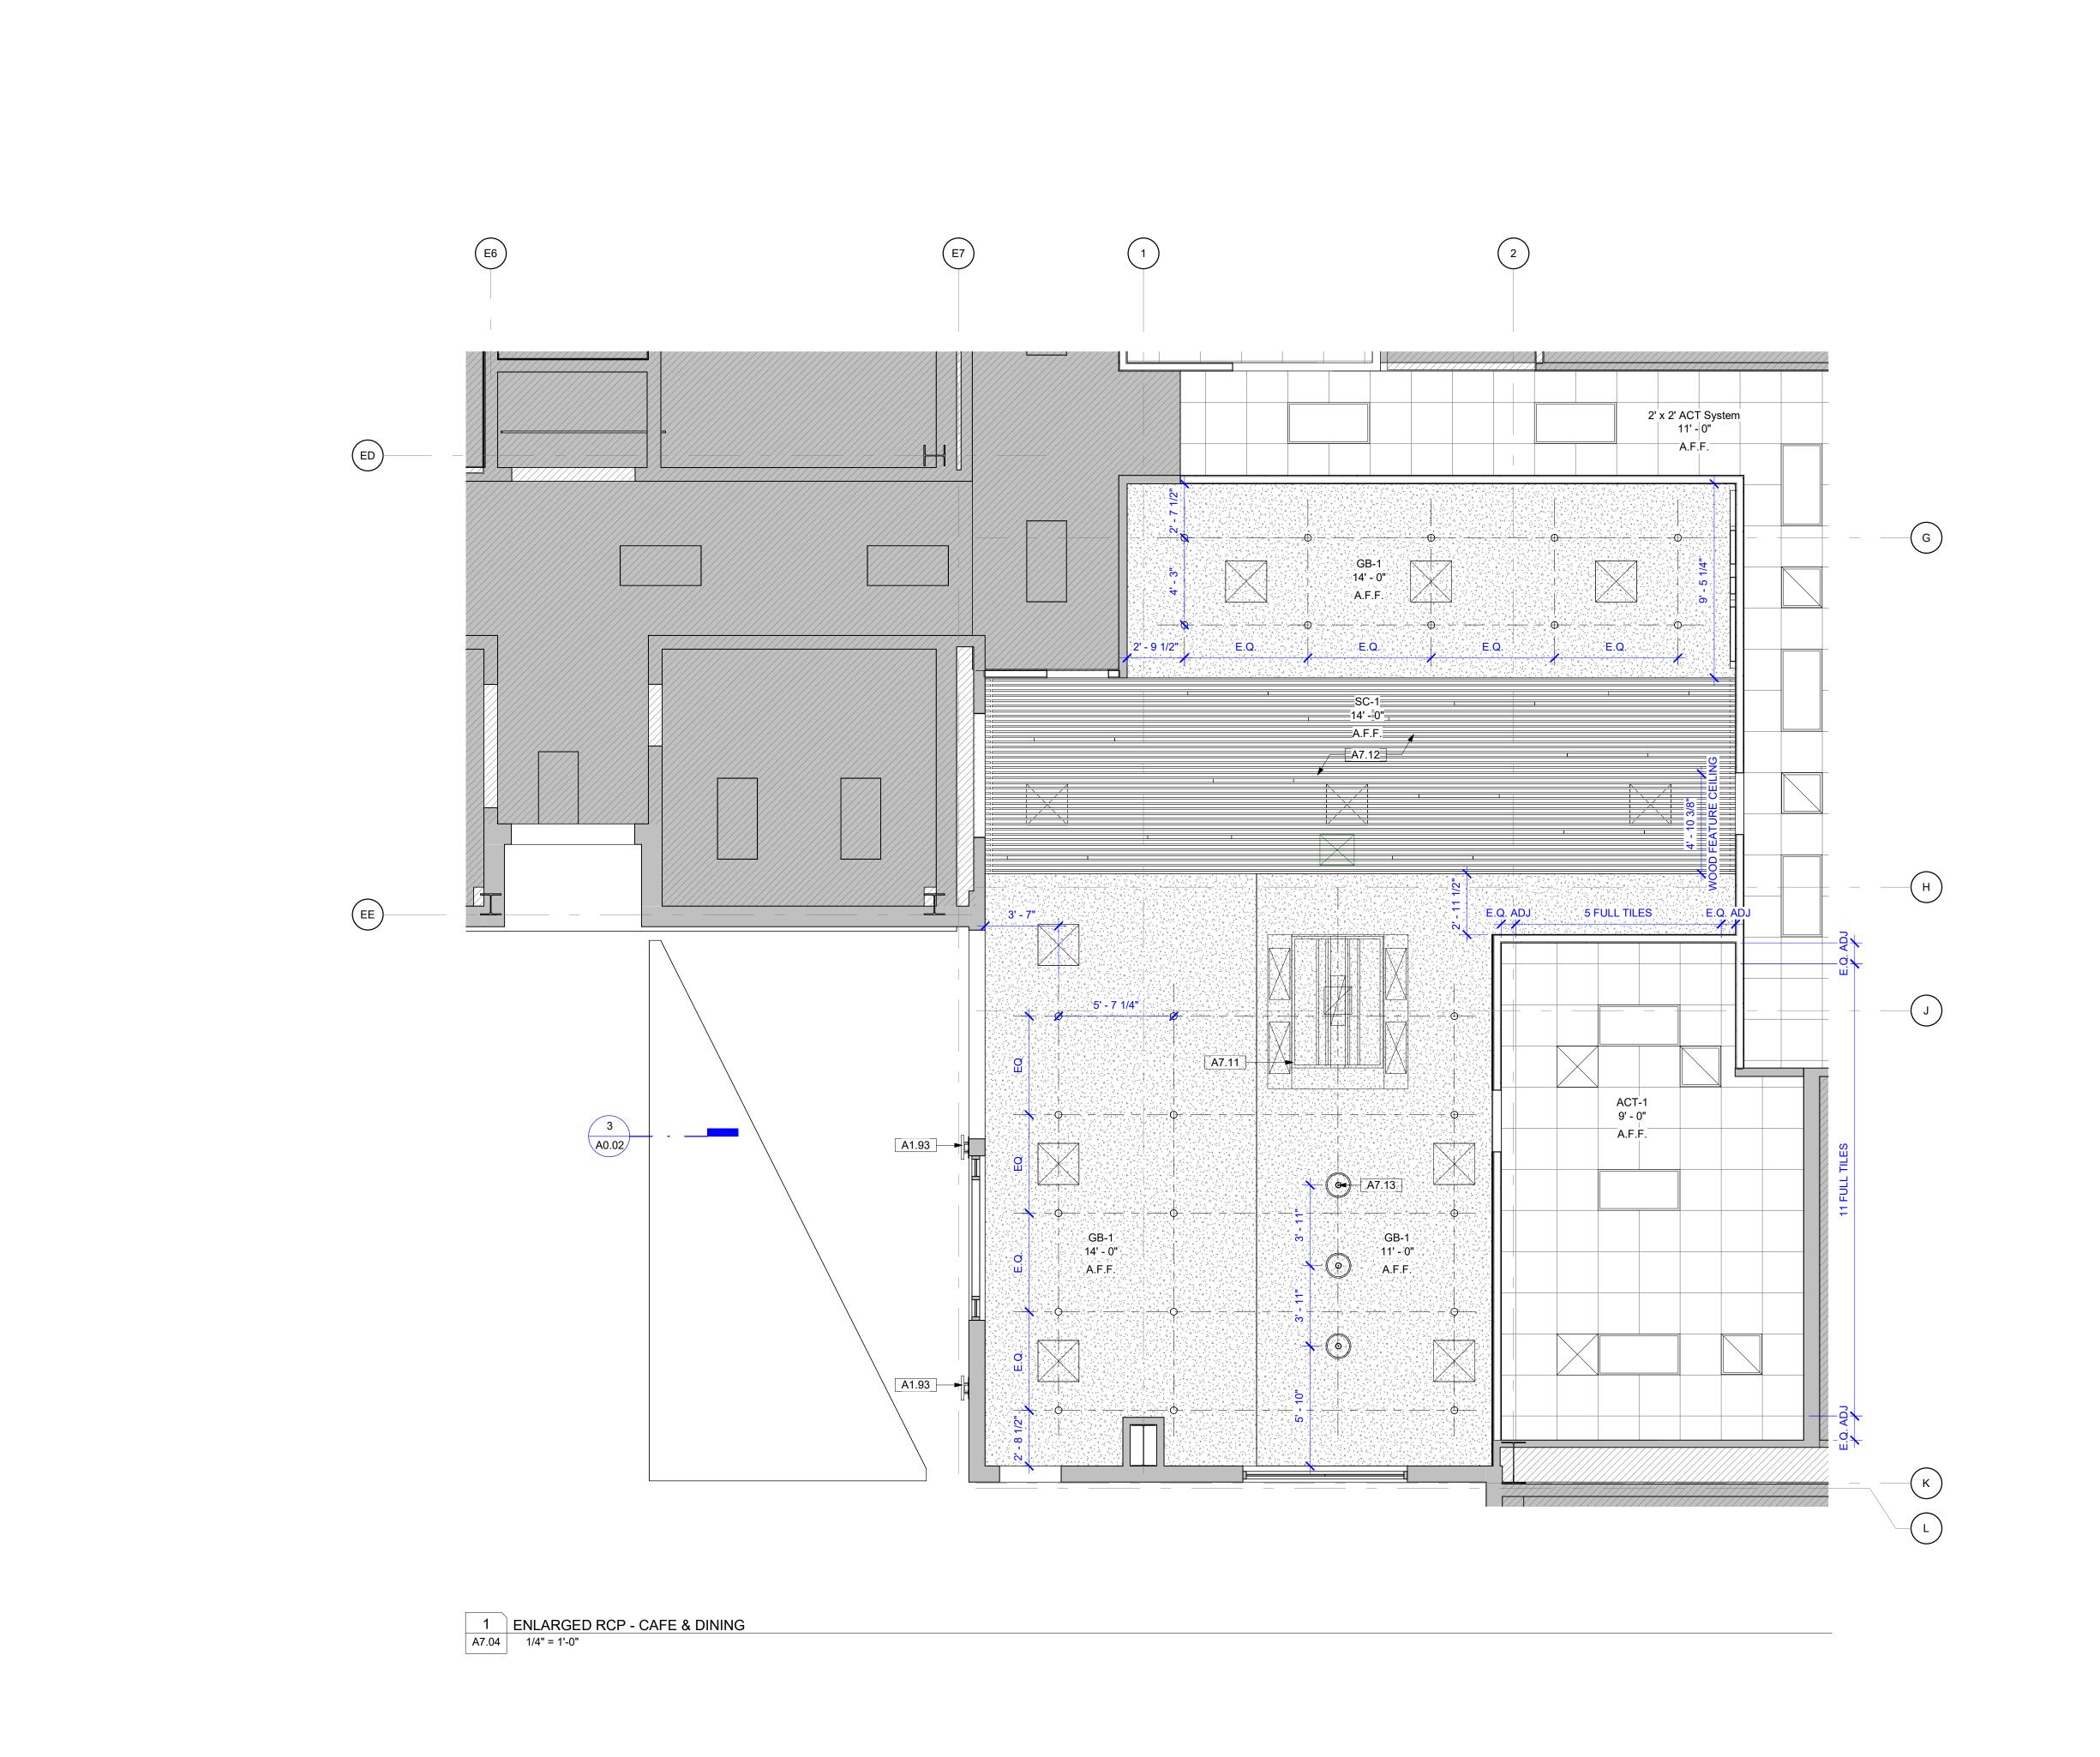

RCP LEGEND ACT-1: 2x2 ACOUSTICAL CEILING GP-1: GYPSUM BOARD CEILING WV-1: WOOD VENEER CEILING woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443 2x4 RECESSED LED LIGHT Erik Wismar, AIA **EXISTING LIGHTING** EXISTING CEILING TO REMAIN LINEAR RECESSED LIGHT

4" DOWNLIGHT, RECESSED

DECORATIVE PENDANT LIGHT

POWERED BATHROOM VENT

SUPPLY DIFFUSER, RE: MECH.

RETURN AIR DIFFUSER, RE: MECH.

RCP GENERAL NOTES

- REFER TO SPECIFICATIONS FOR CEILINGS TILES AND GRID.
- 2. FOR ALL INTERIOR FINISHES REFER TO FINISH SCHEDULE.
- LIGHTING TYPES AND PLACEMENTS: REFER TO ELECTRICAL DRAWINGS.
- DIFFUSER TYPES AND PLACEMENT: REFER TO MECHANICAL DRAWINGS.
- SPRINKLER HEADS SHALL BE LOCATED AT THE CENTER OF 2x2 TILES, AND CENTERED ON HALF OF THE 2x4 TILES


KEYNOTES - ARCHITECTURAL

A1.93	NEW EXTERIOR PACK LIGHT; RE: ELECX
A7.11	NEW ACCUREX HOOD VENT. RE: MECH
A7.12	NEW WOOD SLAT CEILING SYSTEM
A7.13	DECORATIVE PENDANT LIGHT. CENTER ON COUNTERTOP BELOW


PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024



REVIS	SIONS	
no.	descripton	date
ENLARGED REFLECTED CEILING		

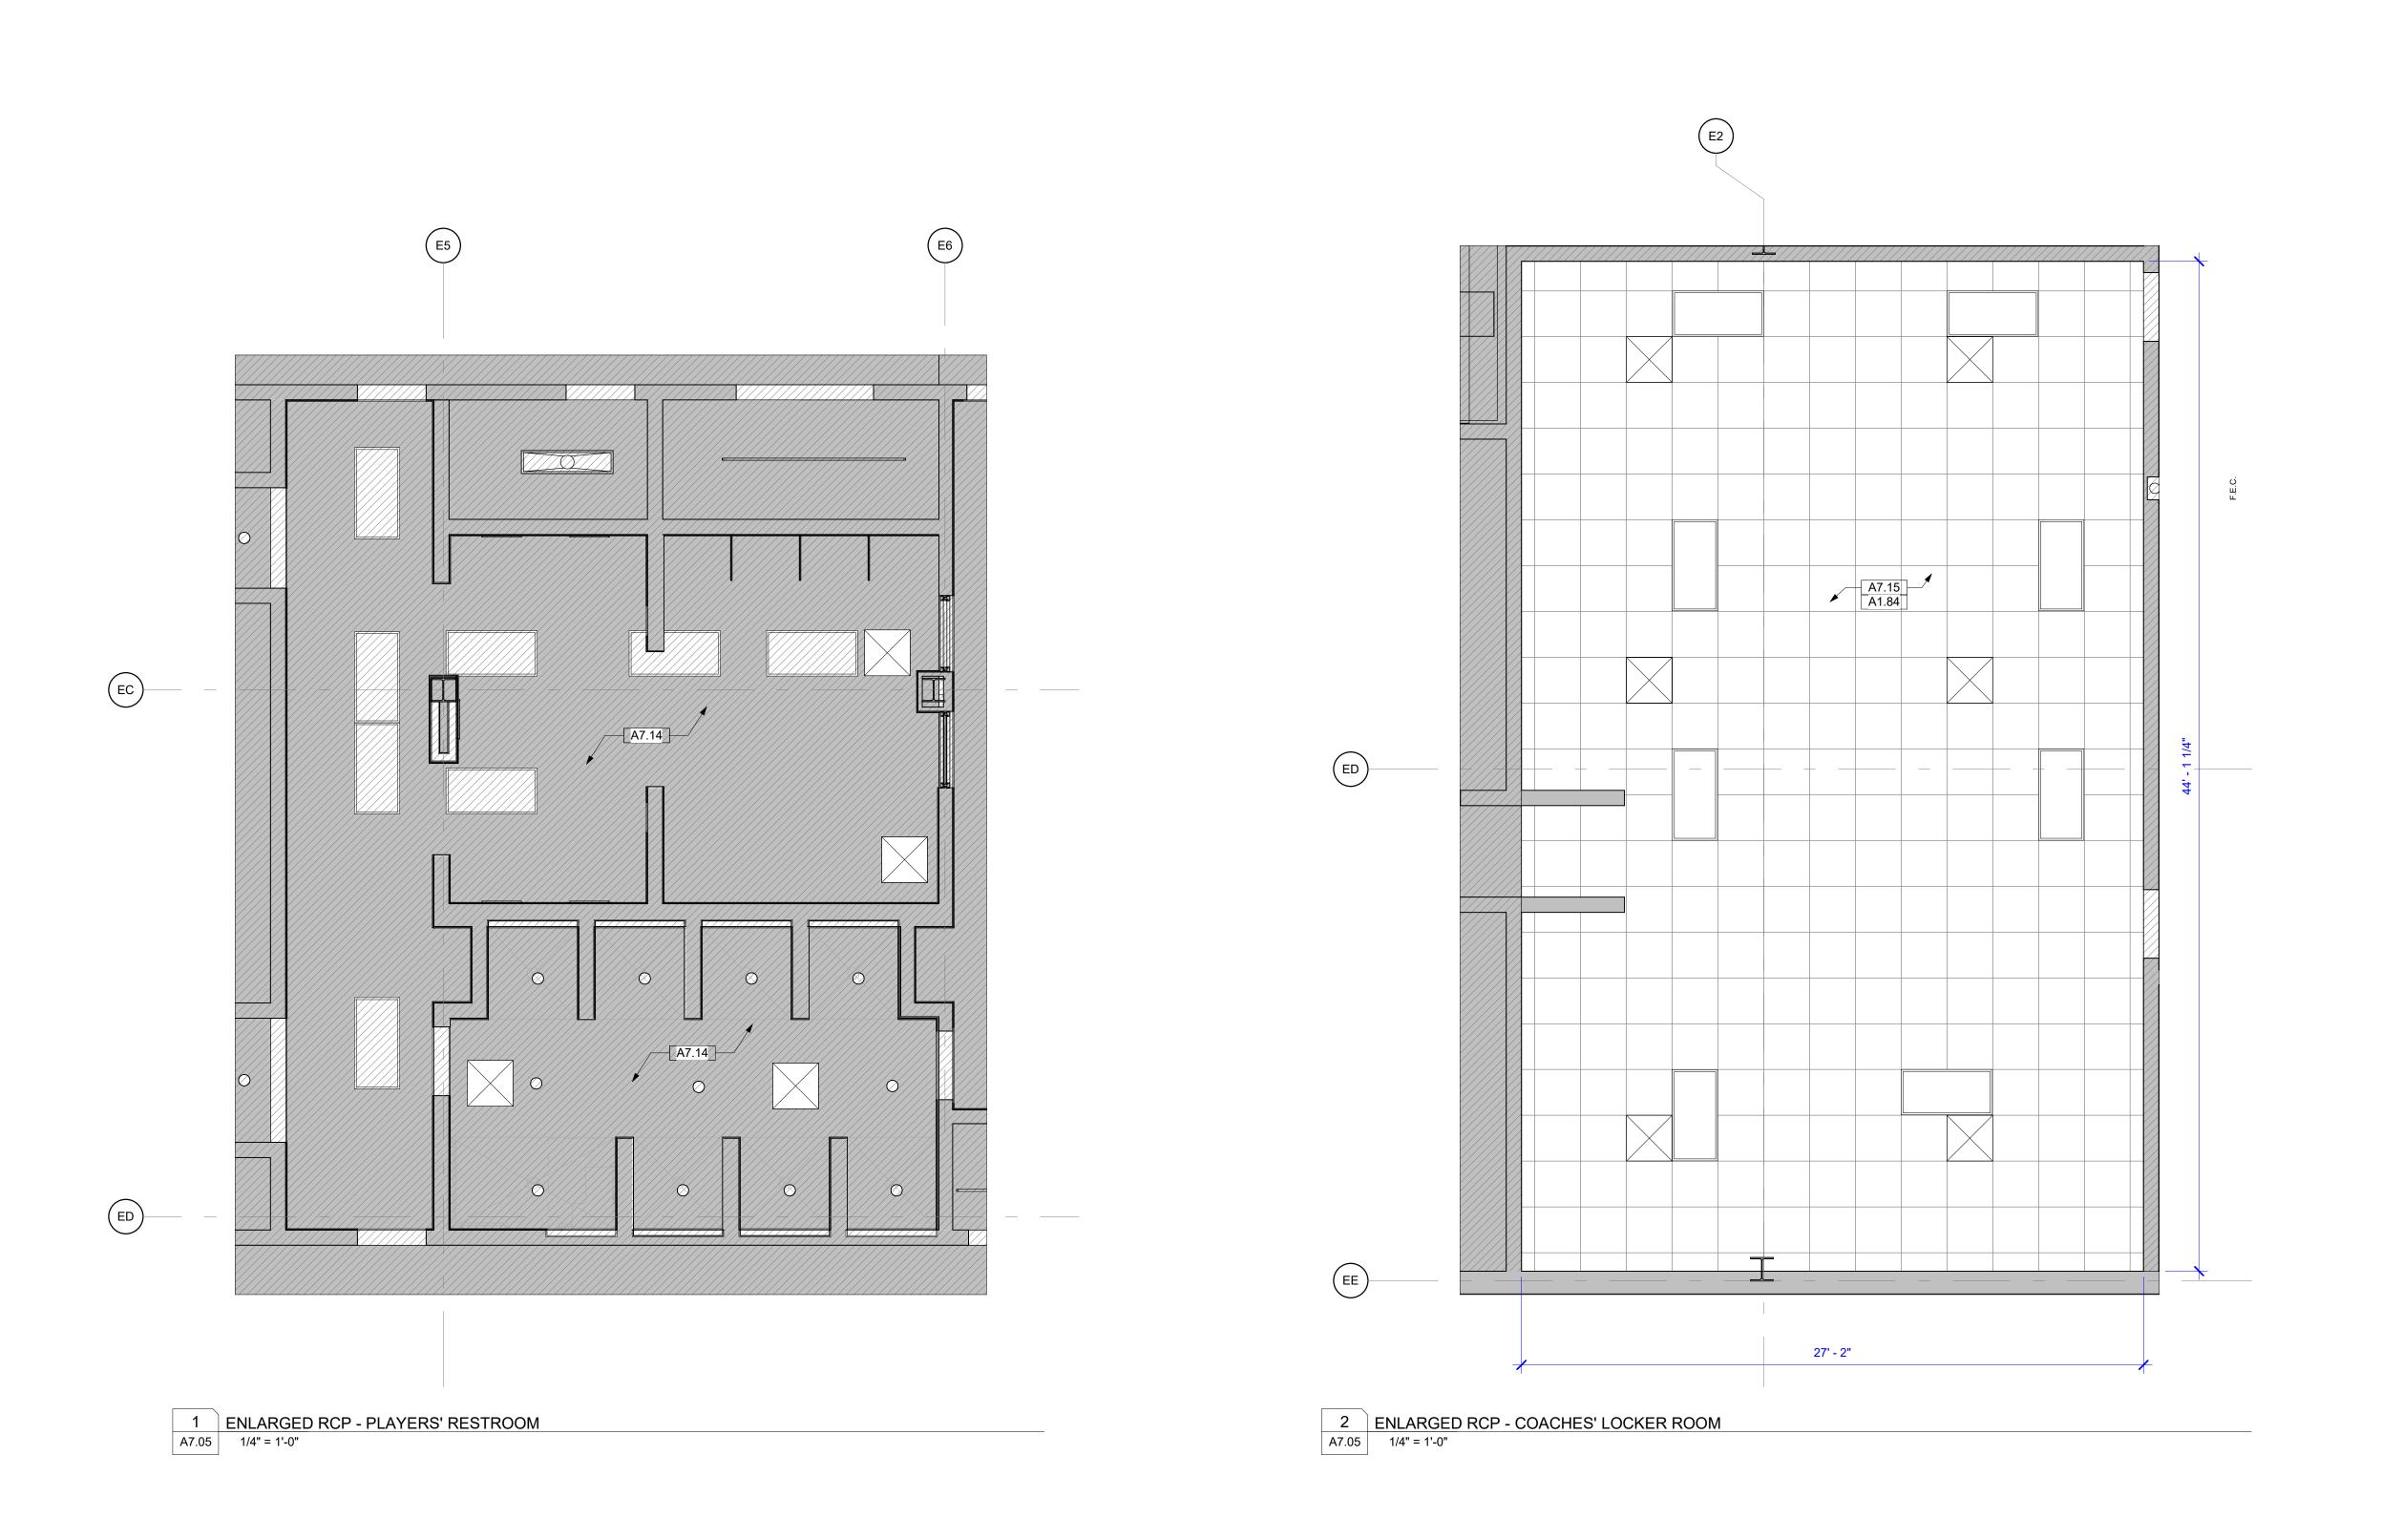

RCP LEGEND ACT-1: 2x2 ACOUSTICAL CEILING GP-1: GYPSUM BOARD CEILING woodward design group WV-1: WOOD VENEER CEILING 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443 2x4 RECESSED LED LIGHT Erik Wismar, AIA **EXISTING LIGHTING** EXISTING CEILING TO REMAIN LINEAR RECESSED LIGHT O 4" DOWNLIGHT, RECESSED

OF THE 2x4 TILES

KEYNOTES - ARCHITECTURAL

5. SPRINKLER HEADS SHALL BE LOCATED AT THE CENTER OF 2x2 TILES, AND CENTERED ON HALF

DECORATIVE PENDANT LIGHT

POWERED BATHROOM VENT

SUPPLY DIFFUSER, RE: MECH.

1. REFER TO SPECIFICATIONS FOR CEILINGS TILES

2. FOR ALL INTERIOR FINISHES REFER TO FINISH

LIGHTING TYPES AND PLACEMENTS: REFER TO ELECTRICAL DRAWINGS.

DIFFUSER TYPES AND PLACEMENT: REFER TO MECHANICAL DRAWINGS.

RCP GENERAL NOTES

AND GRID.


RETURN AIR DIFFUSER, RE: MECH.

A1.84 NEW LED LIGHTS AND CONTROLS IN EXISTING LOCATIONS A7.14 EXISTING CEILING TO REMAIN. REPLACE LIGHTING AND CONTROLS IN ALL LOCATIONS A7.15 NEW 2'-0" X 2' ACT AND TRACK

> PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana

WDG PROJECT NO | AR2315


CONSTRUCTION DOCUMENTS 04.15.2024



	4	
no.	descripton	date

PLANS



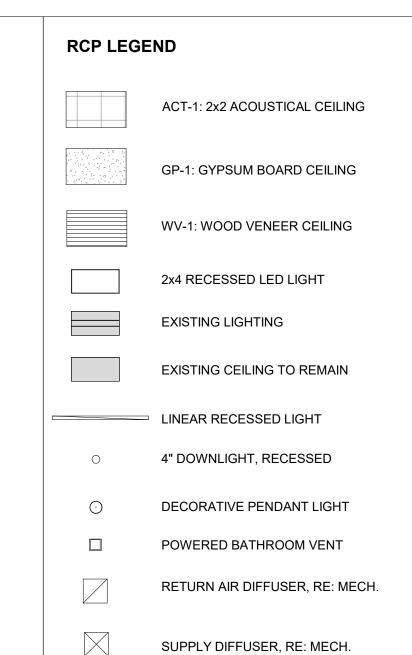

RCP GENERAL NOTES

- REFER TO SPECIFICATIONS FOR CEILINGS TILES
 AND GRID.
- 2. FOR ALL INTERIOR FINISHES REFER TO FINISH SCHEDULE.
- 3. LIGHTING TYPES AND PLACEMENTS: REFER TO ELECTRICAL DRAWINGS.
- 4. DIFFUSER TYPES AND PLACEMENT: REFER TO
- MECHANICAL DRAWINGS.
- 5. SPRINKLER HEADS SHALL BE LOCATED AT THE CENTER OF 2x2 TILES, AND CENTERED ON HALF OF THE 2x4 TILES

KEYNOTES - ARCHITECTURAL

A1.84	NEW LED LIGHTS AND CONTROLS IN EXISTING LOCATIONS
A1.85	REPLACE ACT AND TRACK WITH NEW
A7.15	NEW 2'-0" X 2' ACT AND TRACK
A7.16	NEW 2'-0" X 2'-0"

PELICANS CAMPUS IMPROVEMENTS


woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443


Erik Wismar, AIA

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024



no.	descripton	dat
110.	accompton.	dat

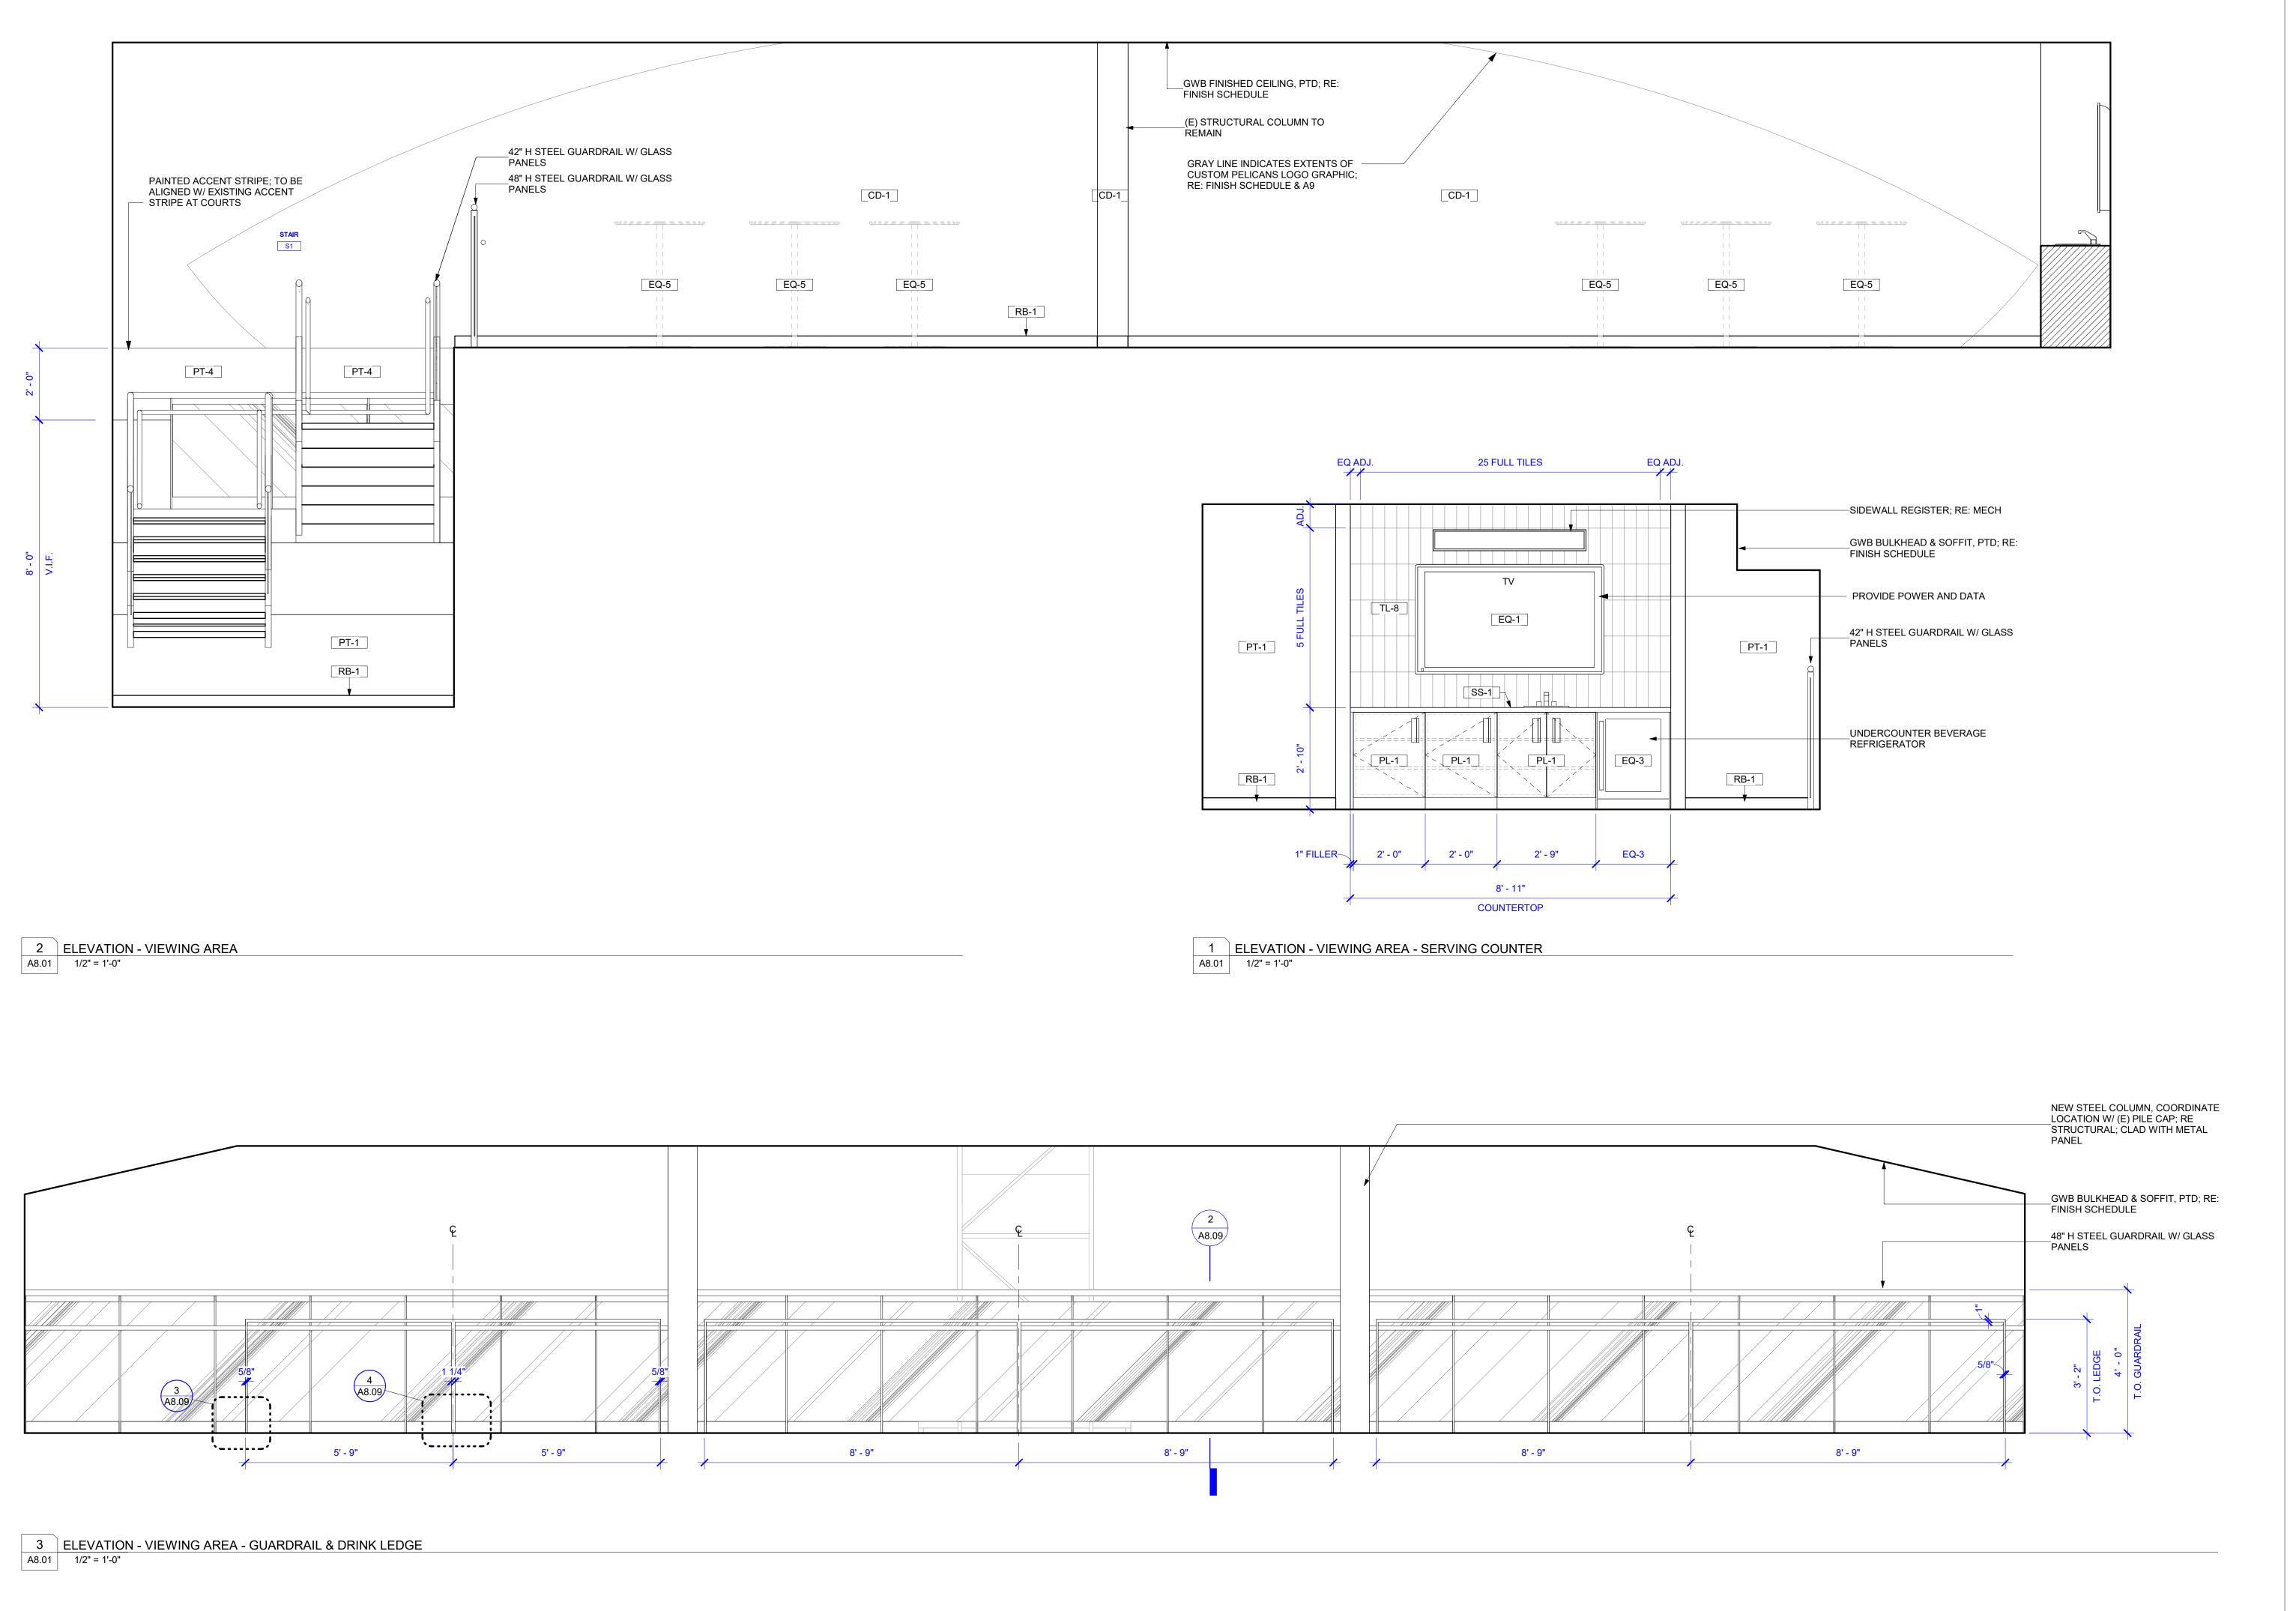

PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana


WDG PROJECT NO | AR2315


CONSTRUCTION DOCUMENTS 04.15.2024

REVISIONS


no. descripton date


INTERIOR ELEVATIONS & DETAILS

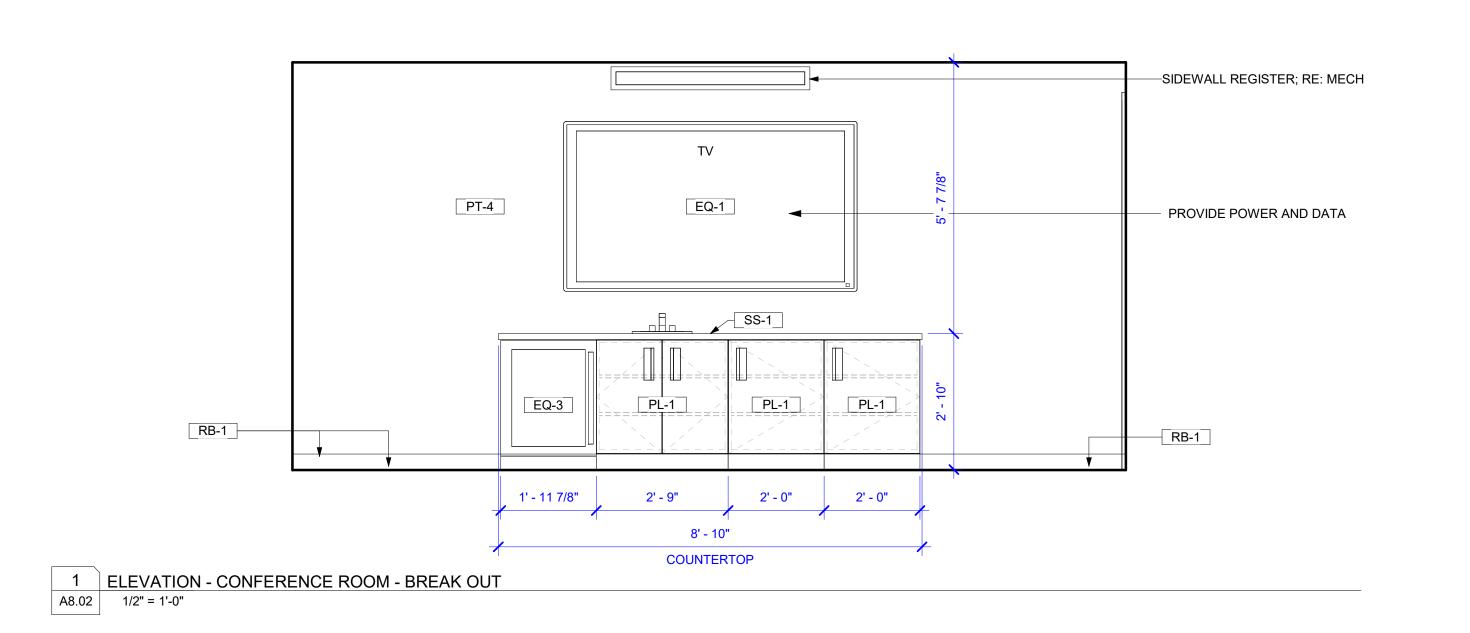

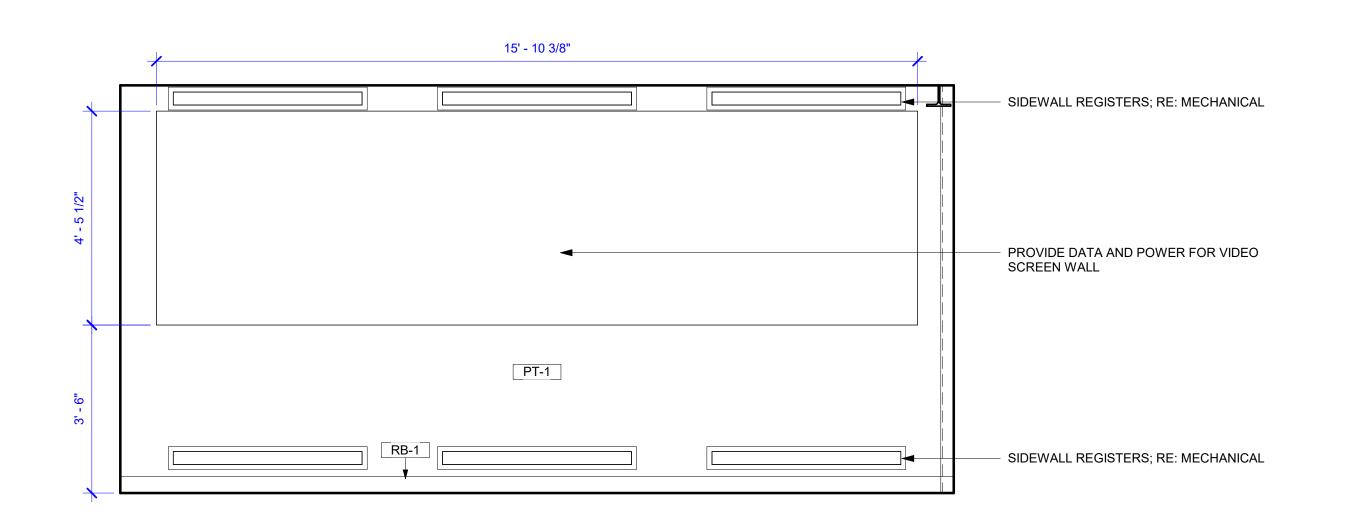

2 ELEVATION - CONFERENCE ROOM - PRESENTATION WALL W/ CREDNEZA
A8.02 1/2" = 1'-0"

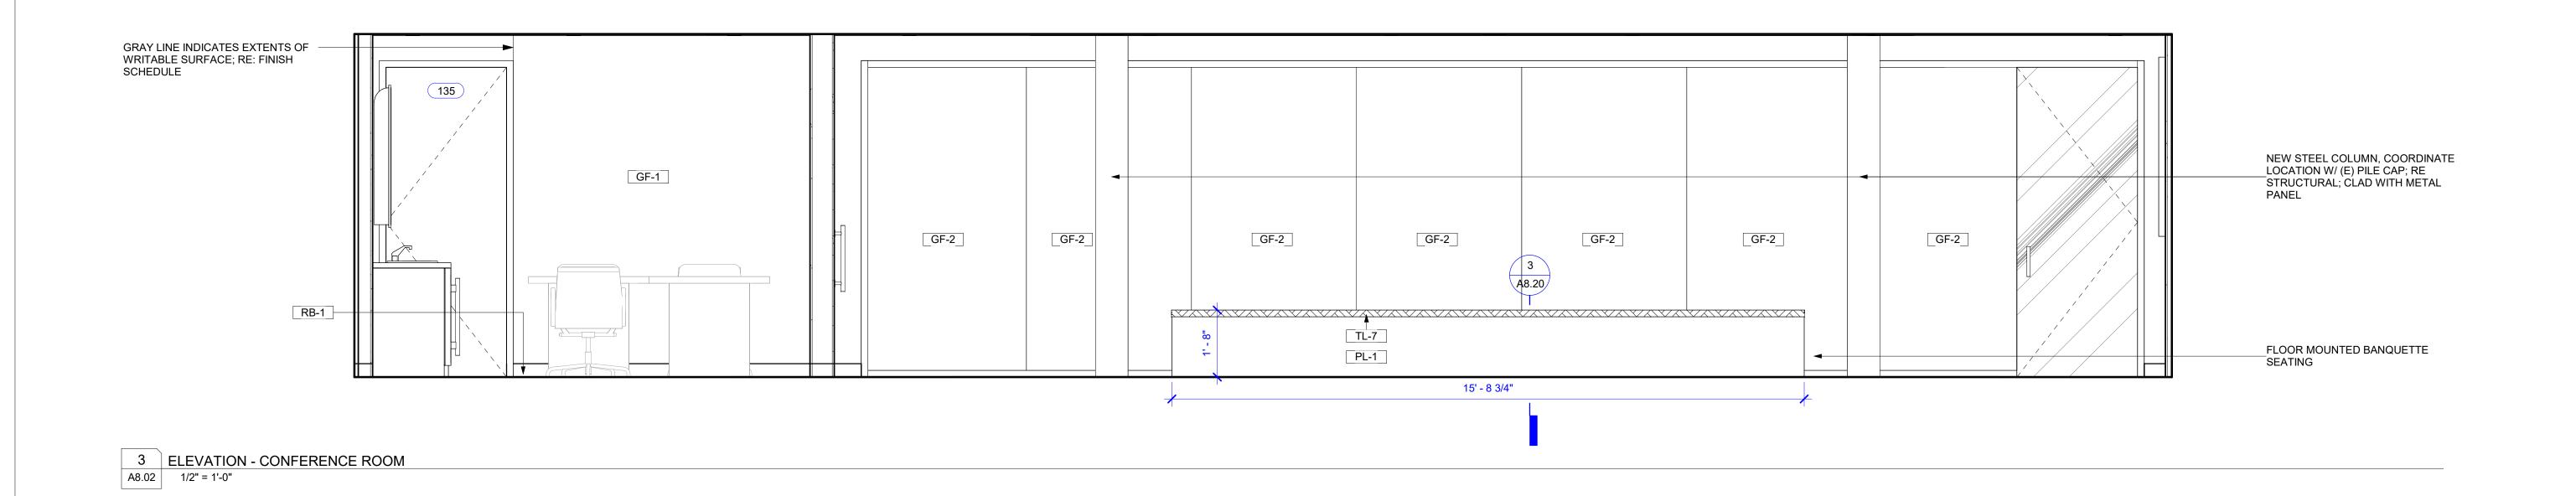

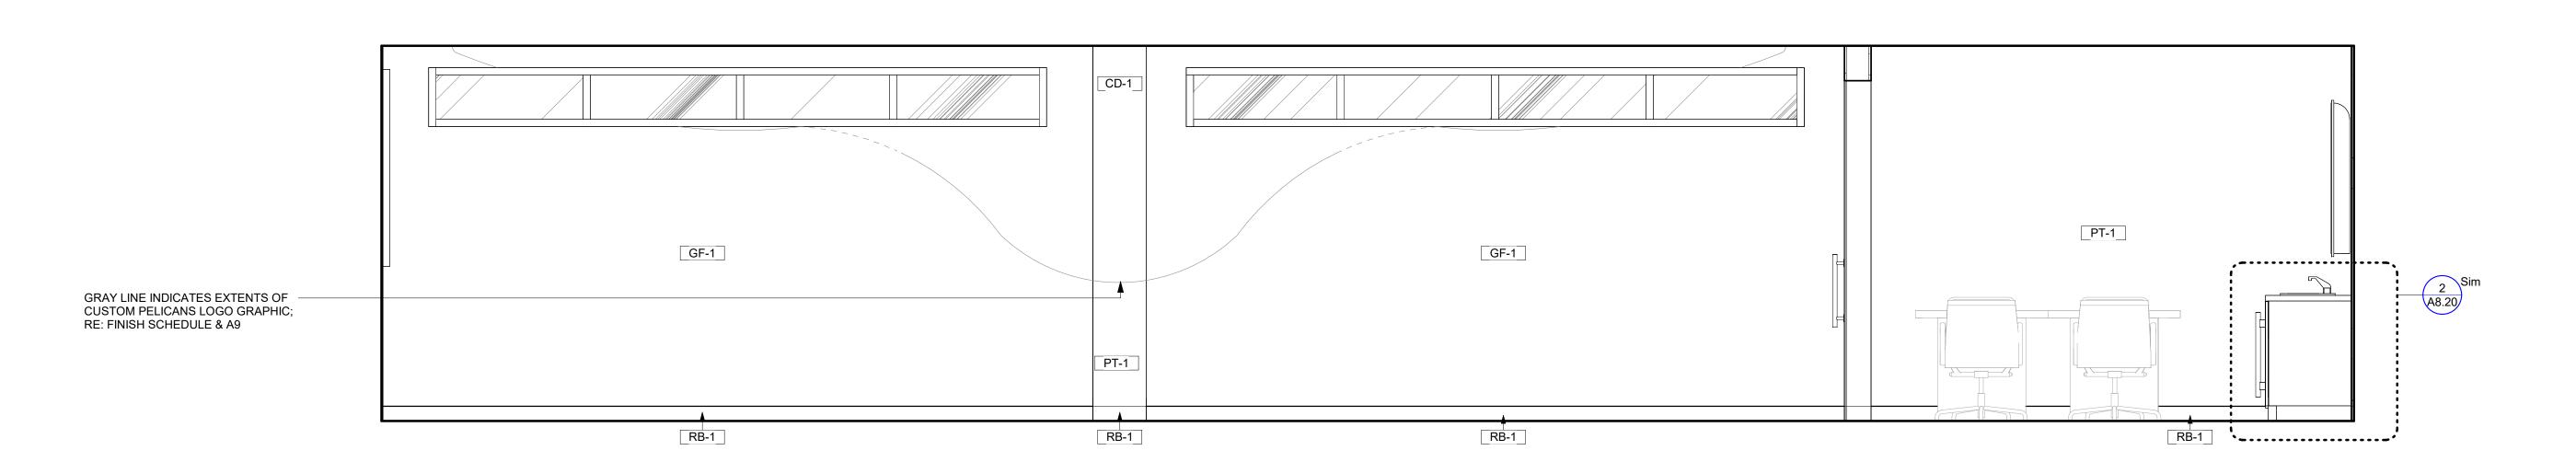

4 ELEVATION - CONFERENCE ROOM - PRESENTATION WALL
A8.02 1/2" = 1'-0"

PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana

woodward design group


1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA

WDG PROJECT NO | AR2315



INTERIOR ELEVATIONS & DETAILS

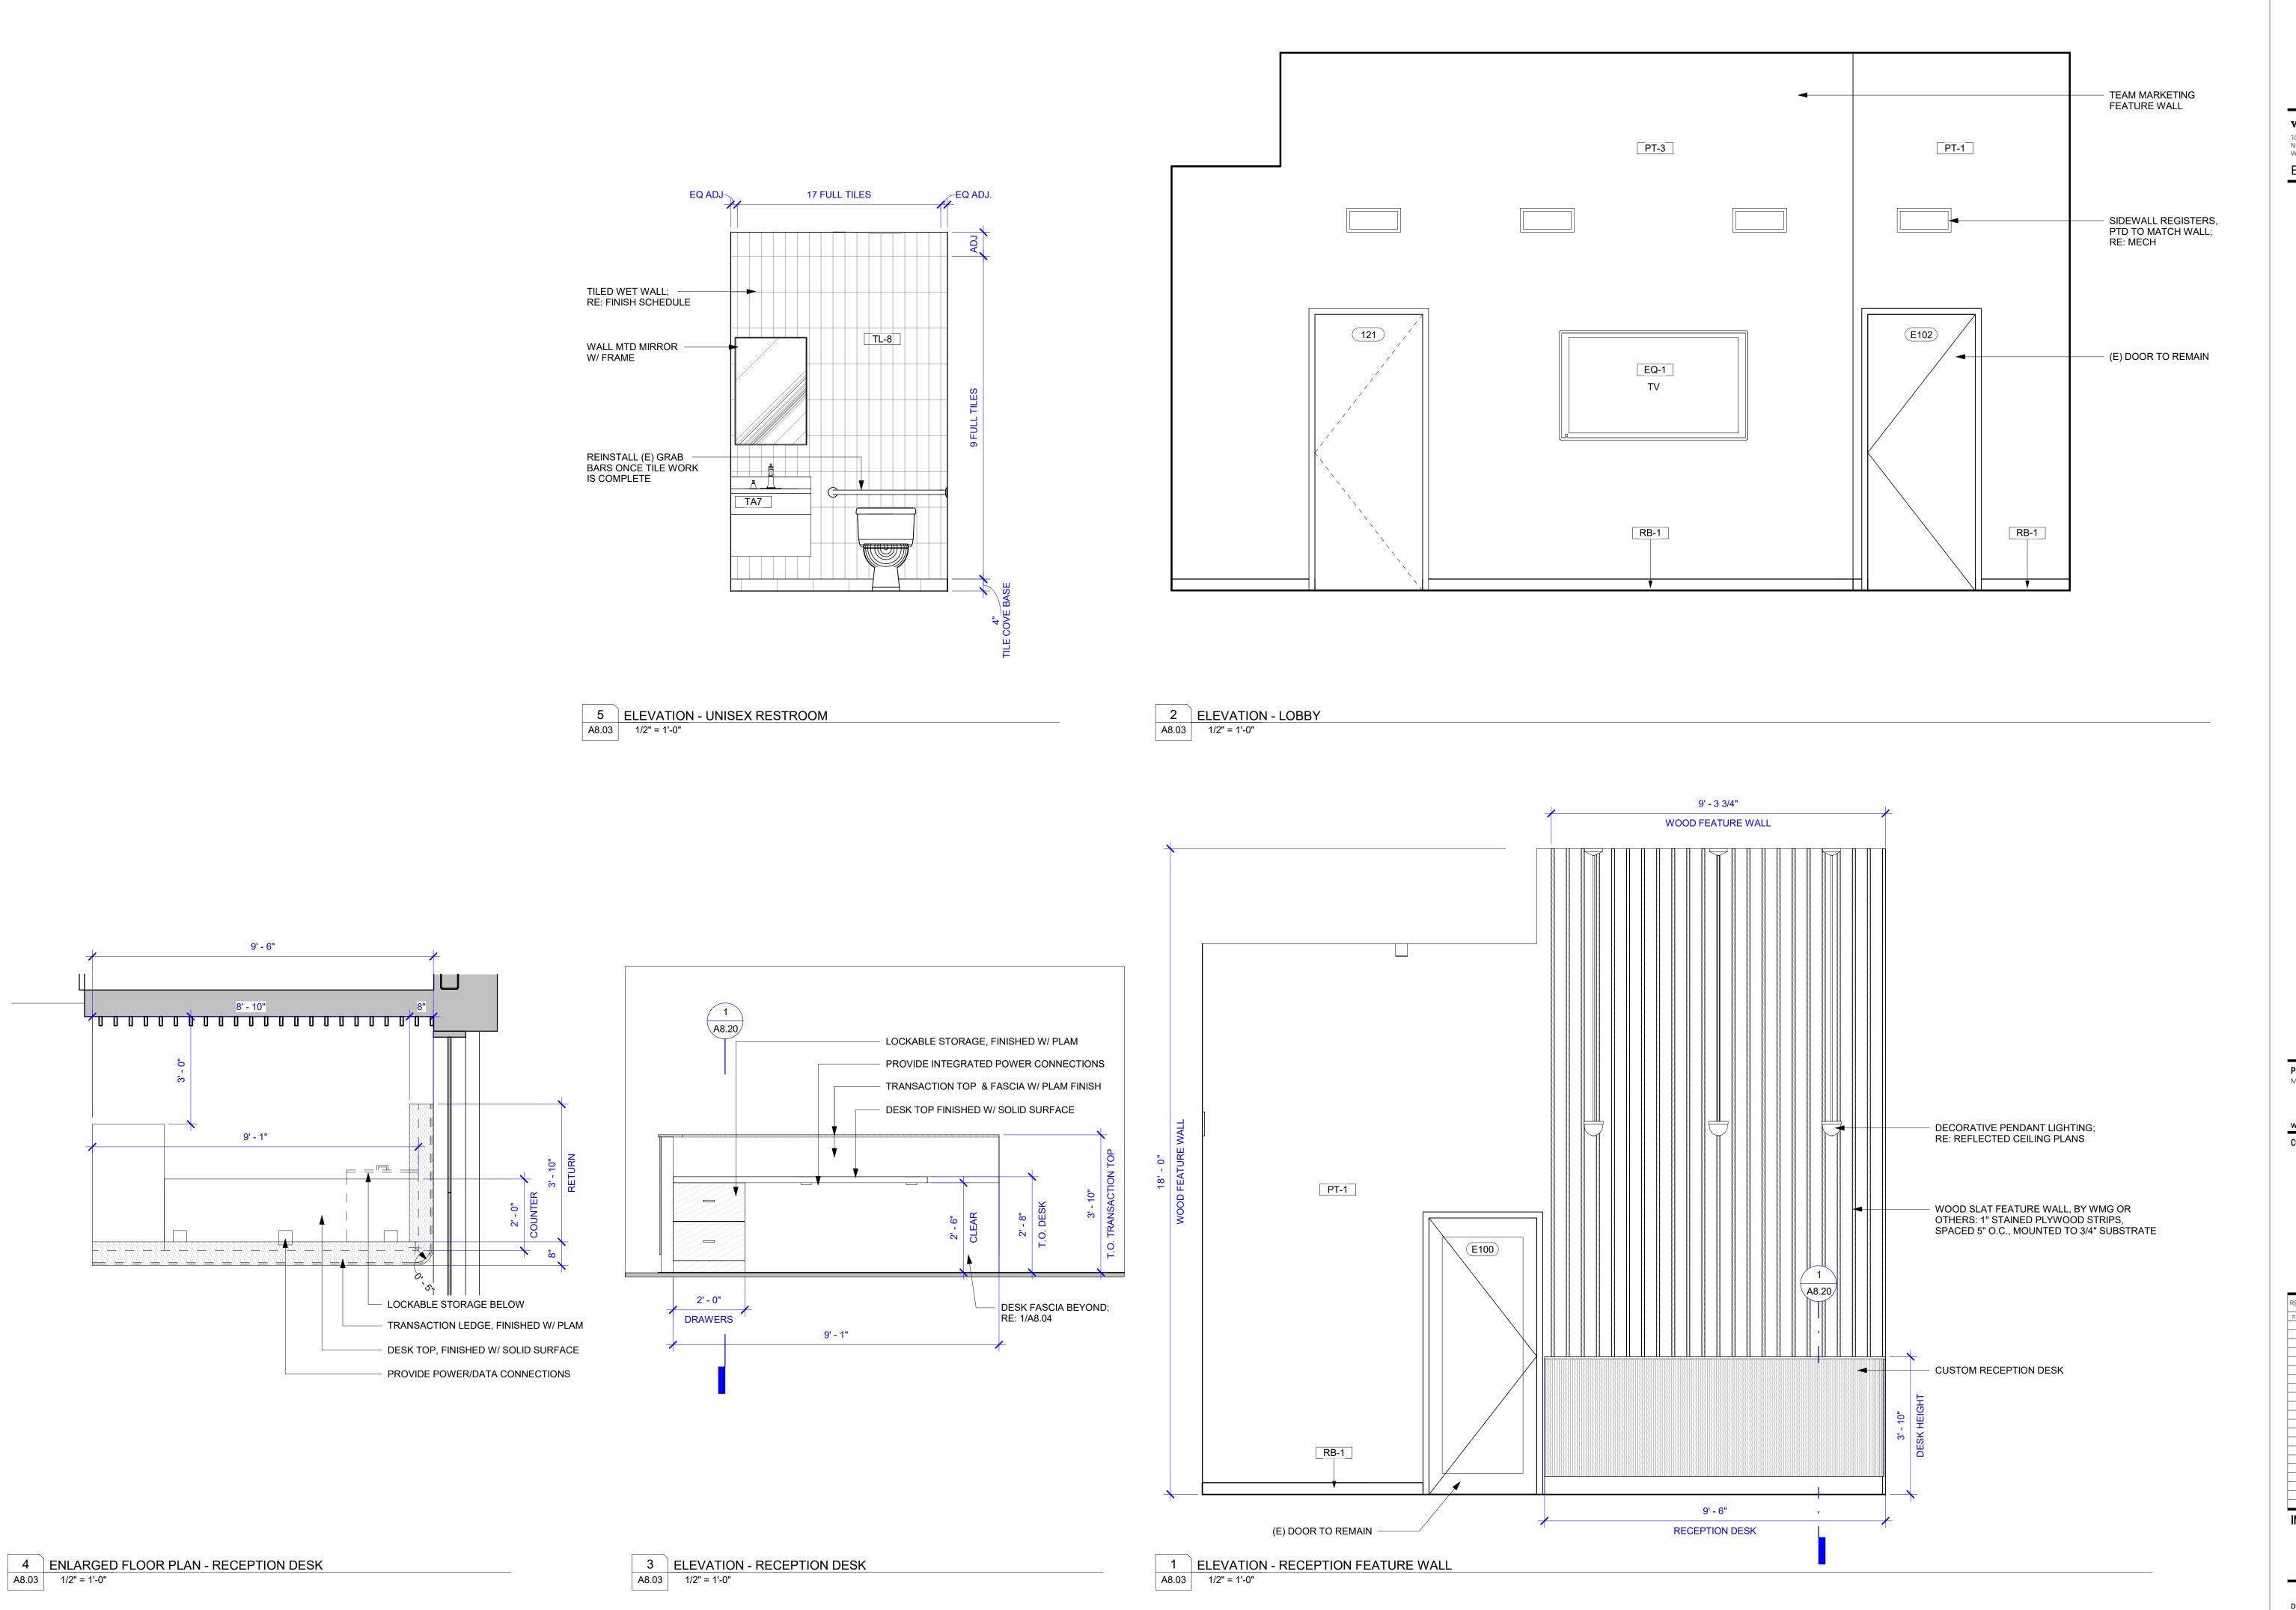

PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana


WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024

REVISIONS

no. descripton date

INTERIOR ELEVATIONS & DETAILS

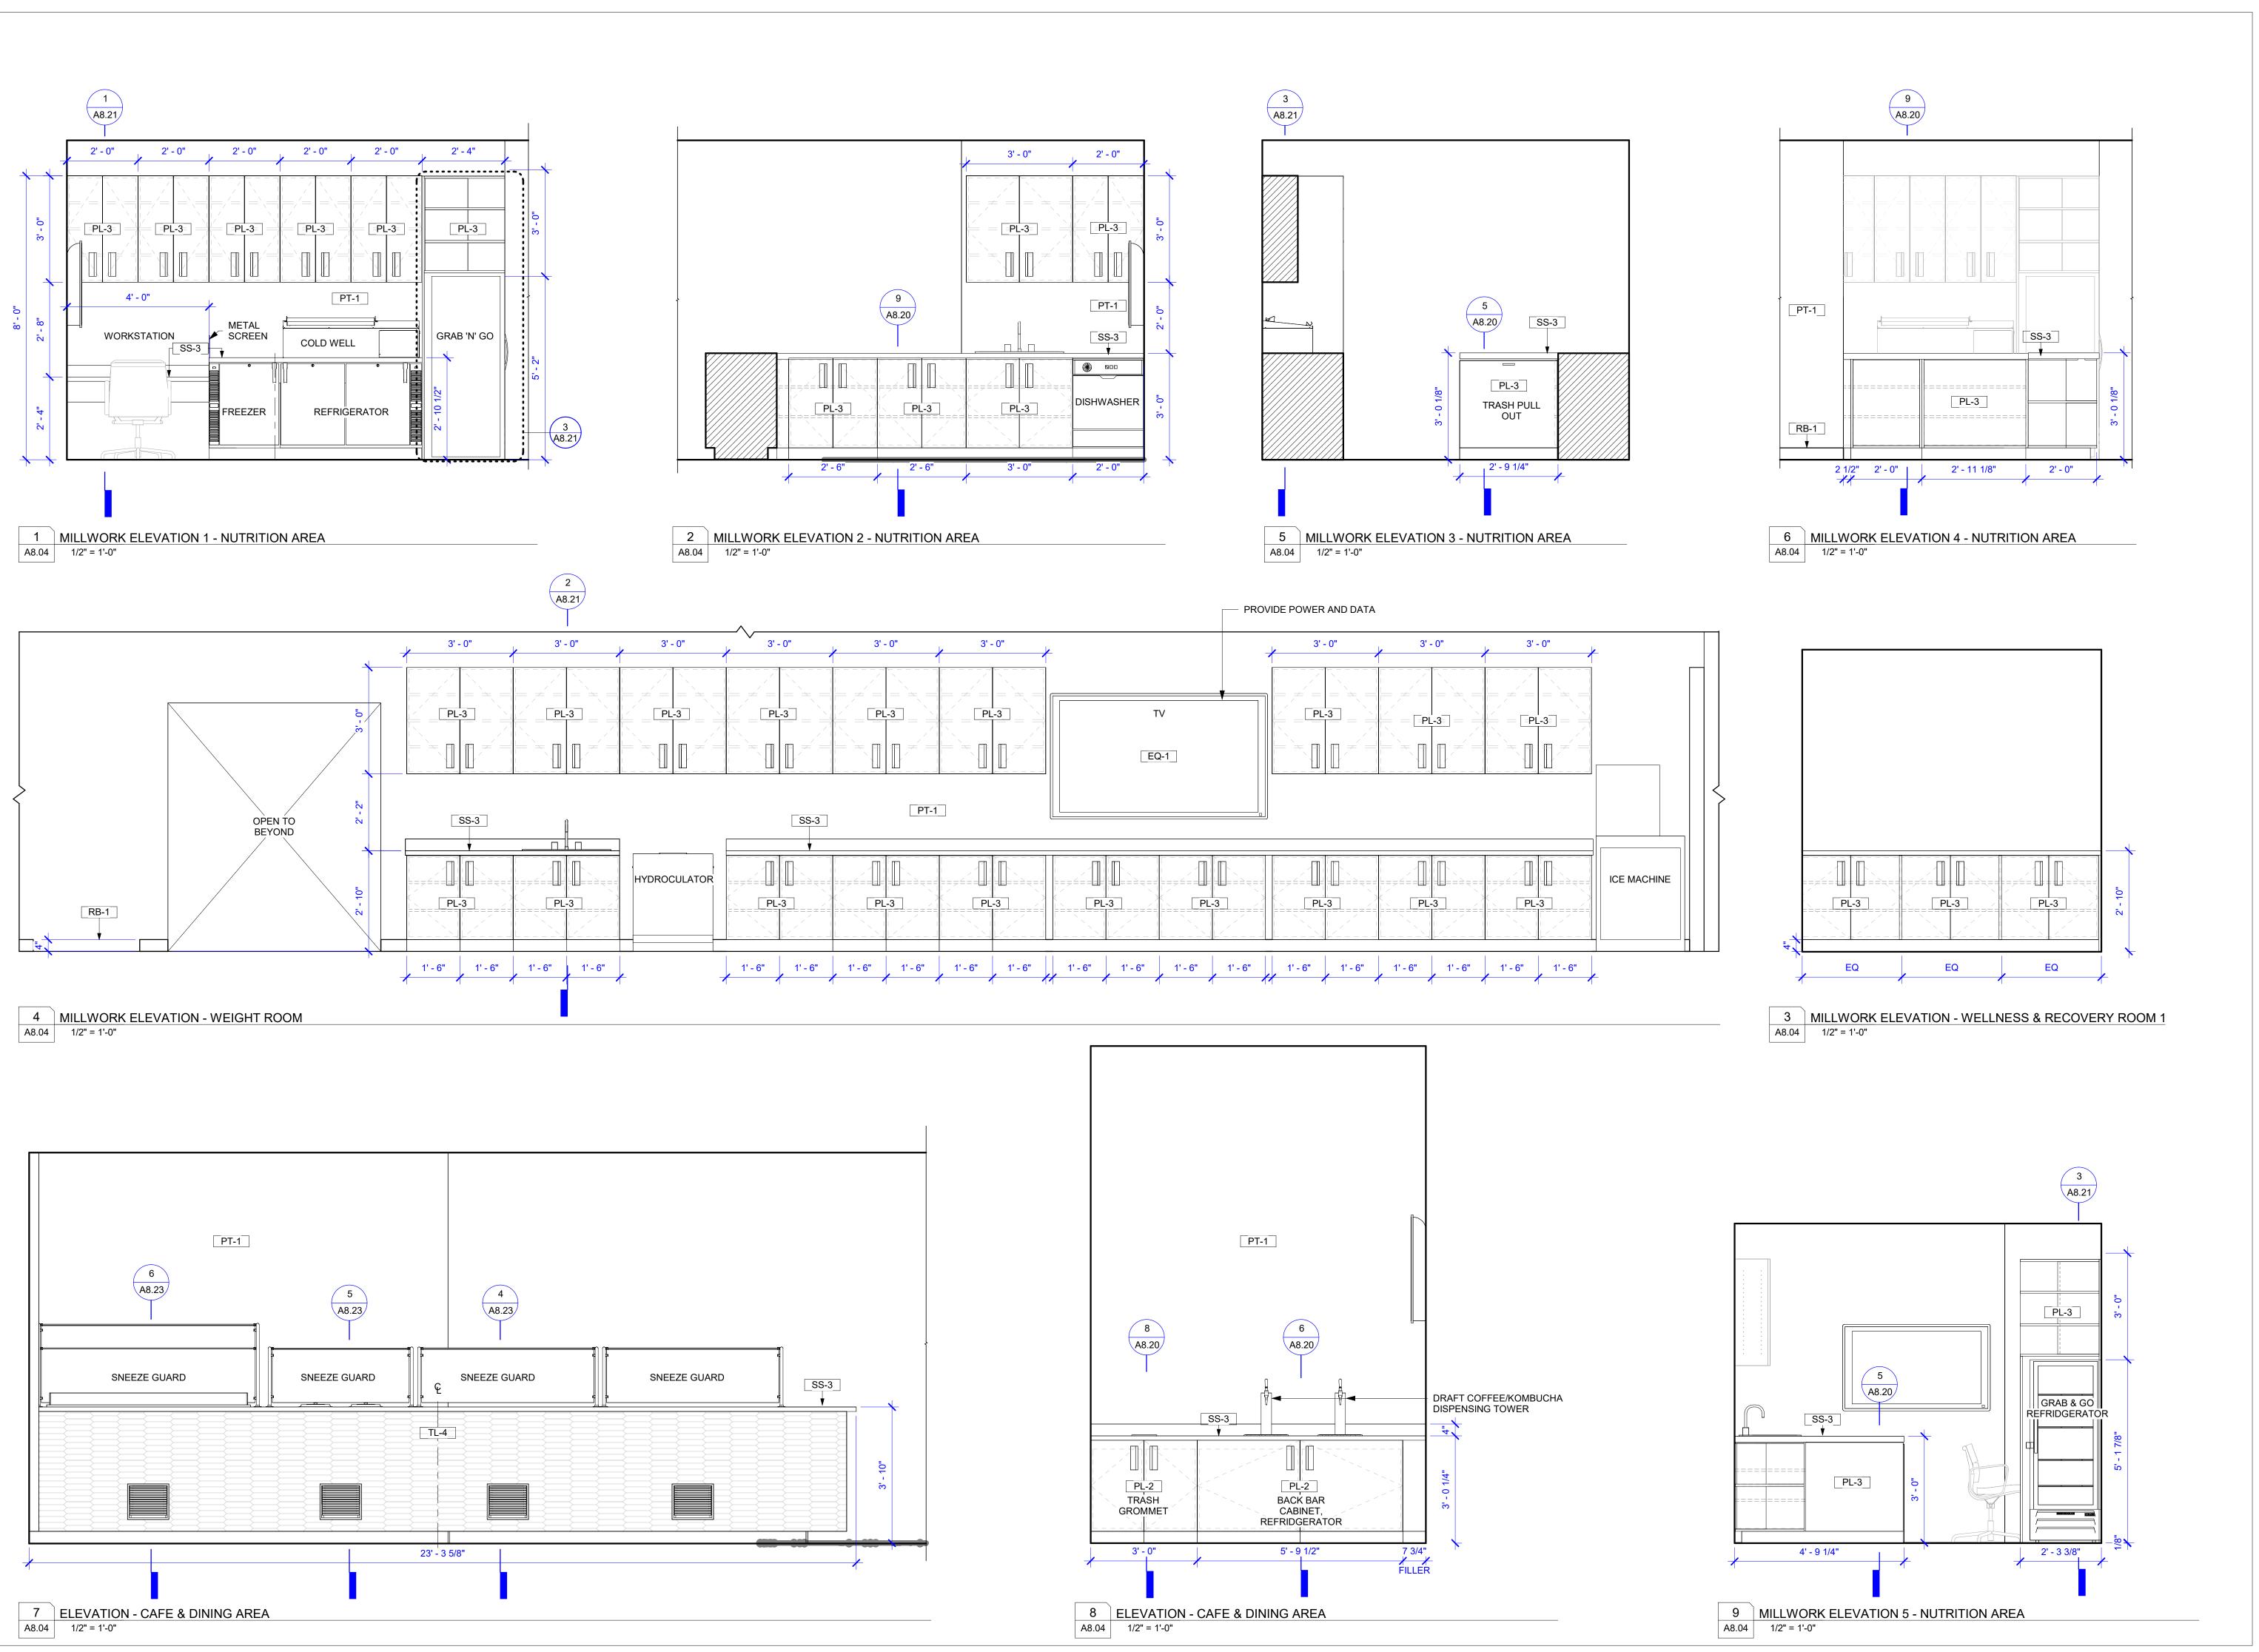

Erik Wismar, AIA

PELICANS CAMPUS IMPROVEMENTS


Metairie, Louisiana

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024

CONSTRUCTION DOCUMENTS 04.15.2024

INTERIOR ELEVATIONS & DETAILS

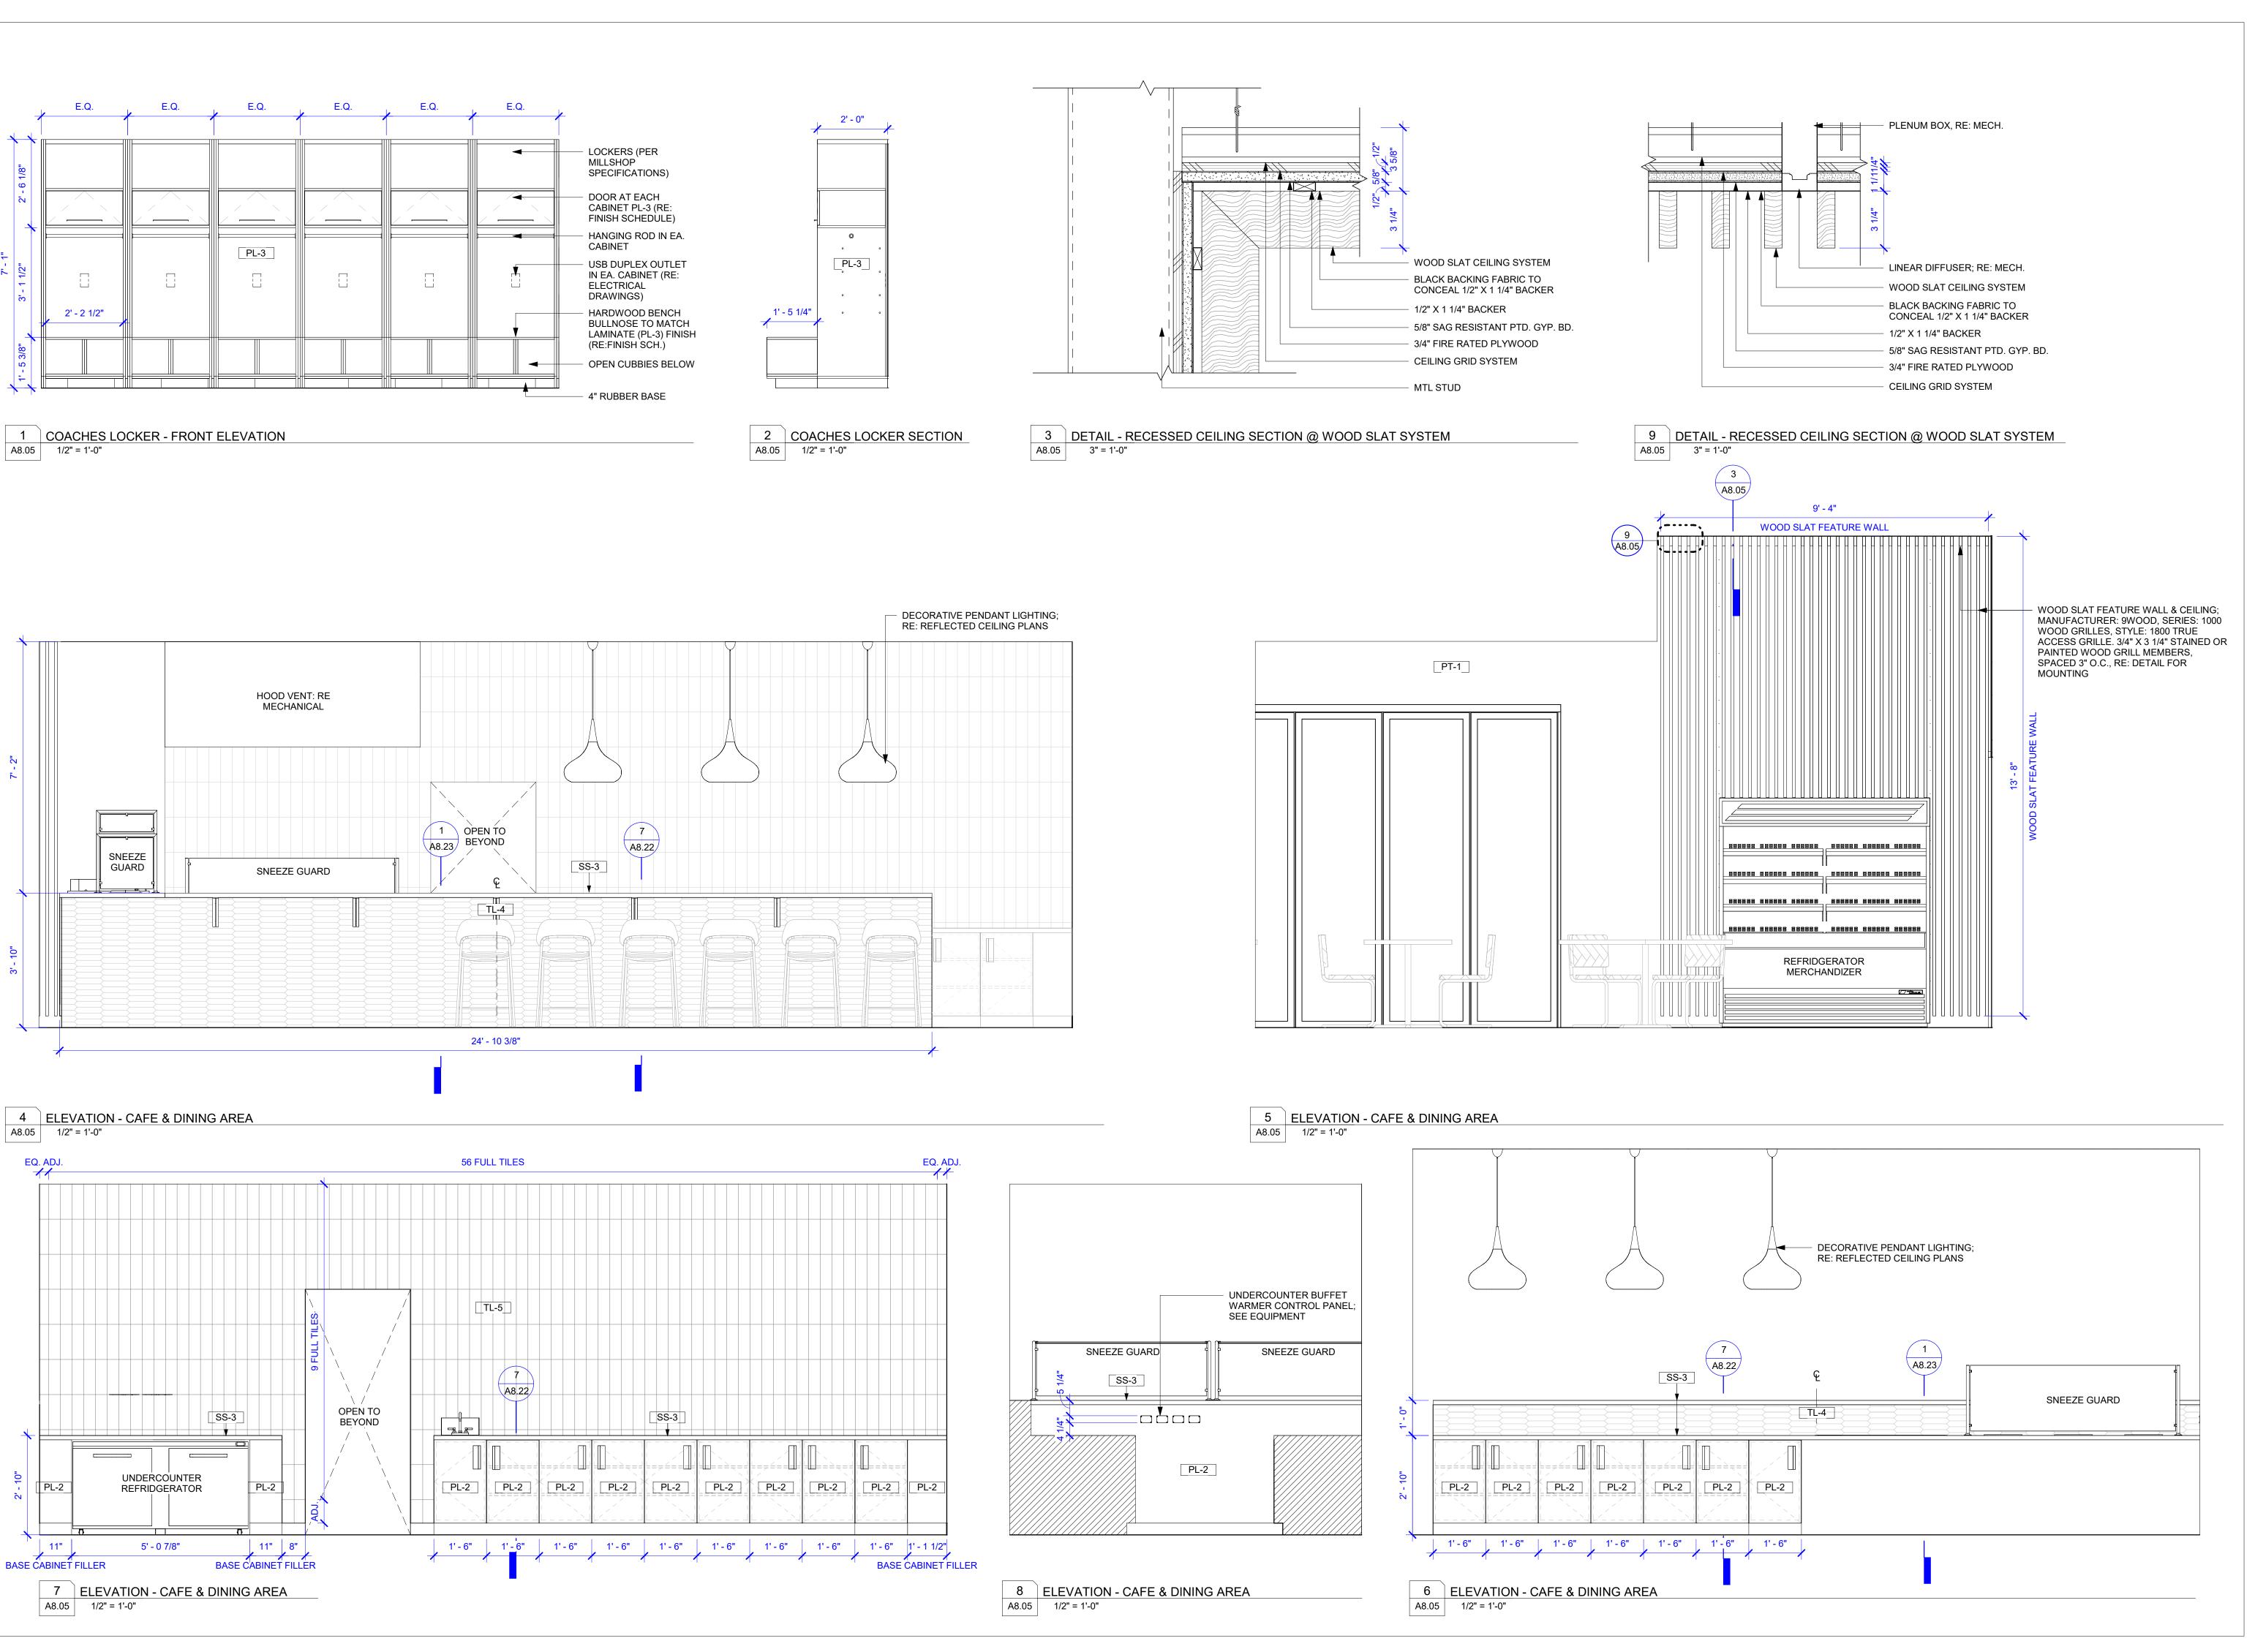


PELICANS CAMPUS IMPROVEMENTS

WDG PROJECT NO | AR2315 CONSTRUCTION DOCUMENTS 04.15.2024

INTERIOR ELEVATIONS & DETAILS

A8.05

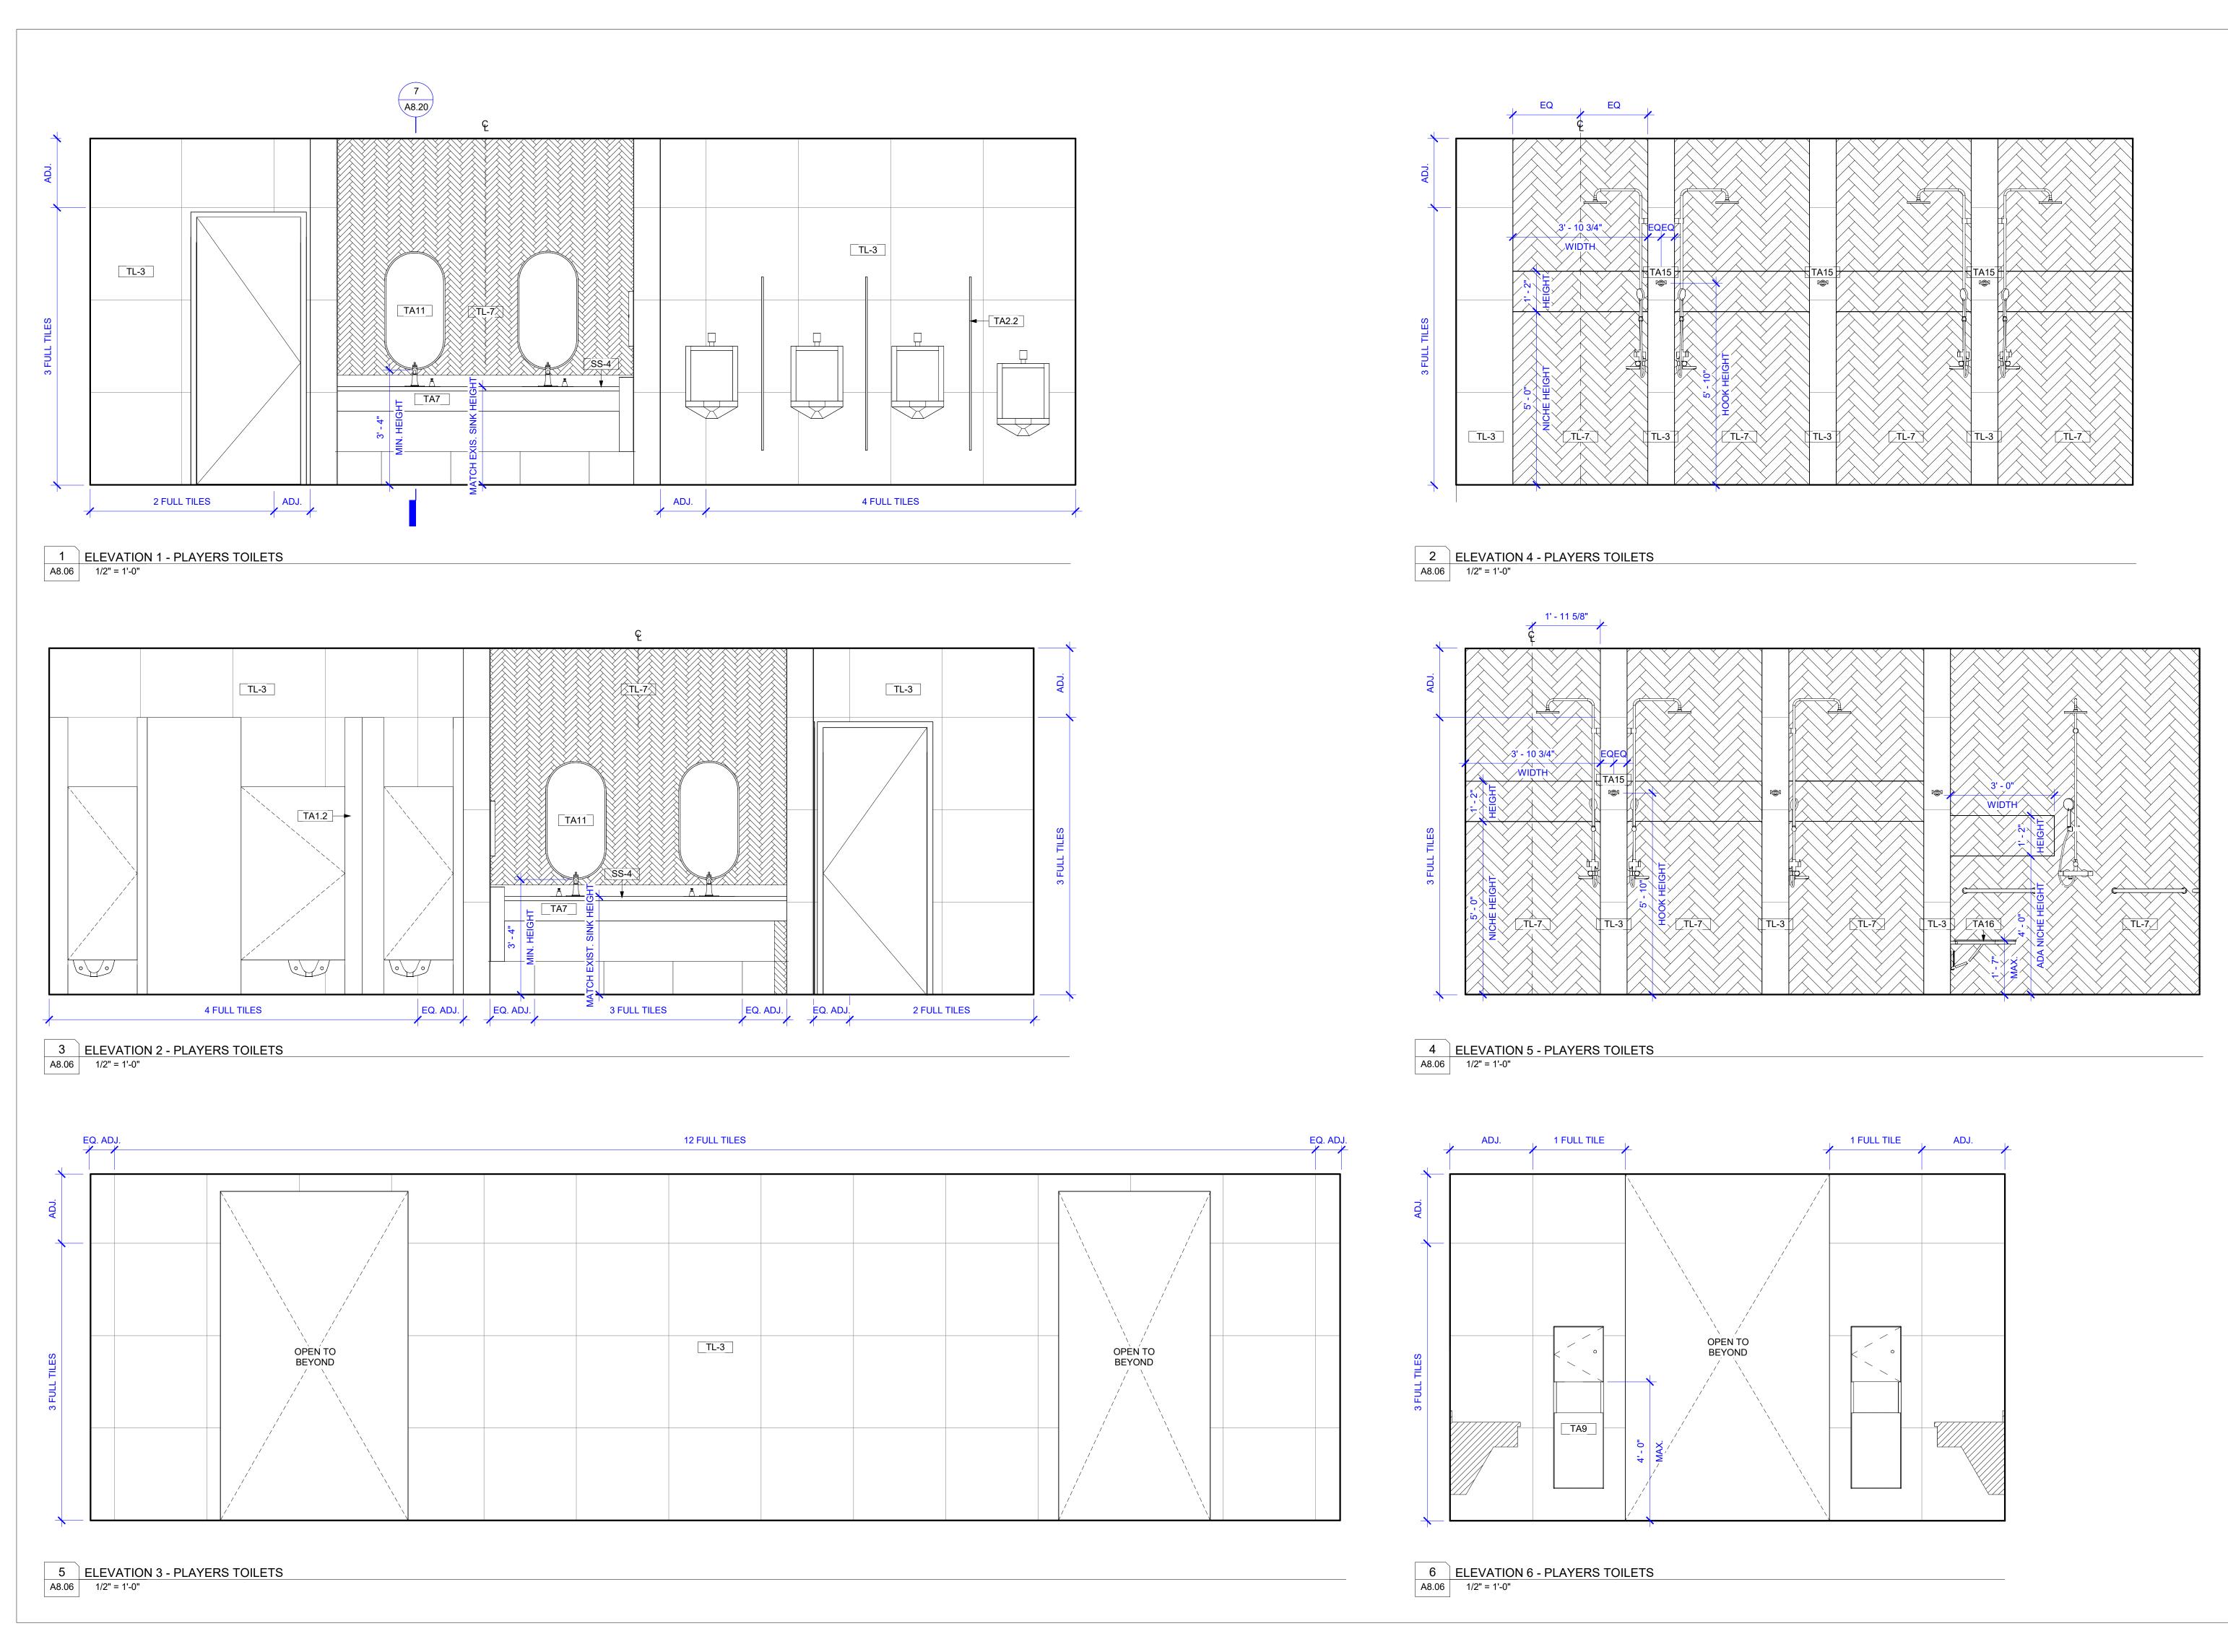


PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana

WDG PROJECT NO | AR2315


CONSTRUCTION DOCUMENTS 04.15.2024

INTERIOR ELEVATIONS & DETAILS



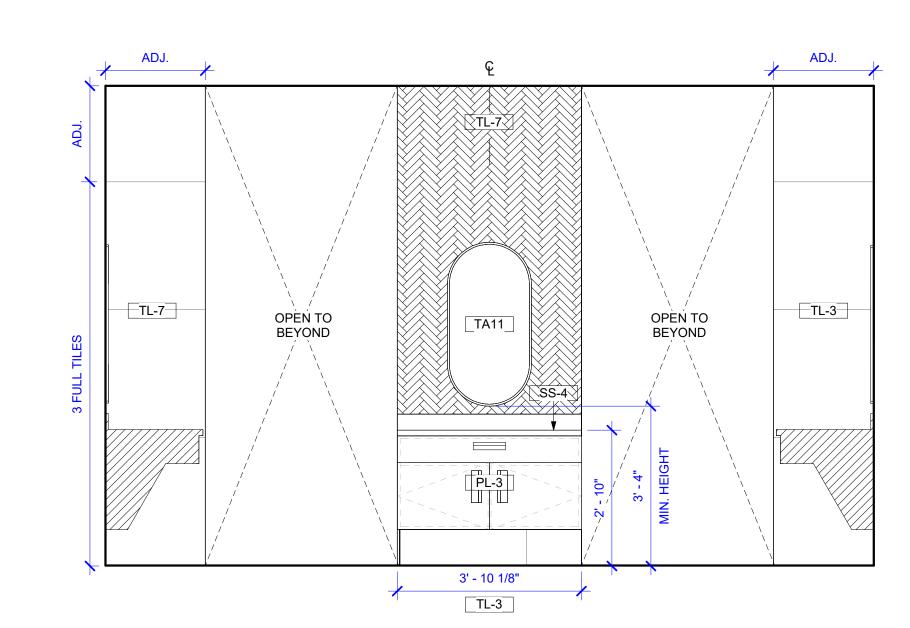

1 ELEVATION 7 - PLAYERS TOILETS
A8.07 1/2" = 1'-0"

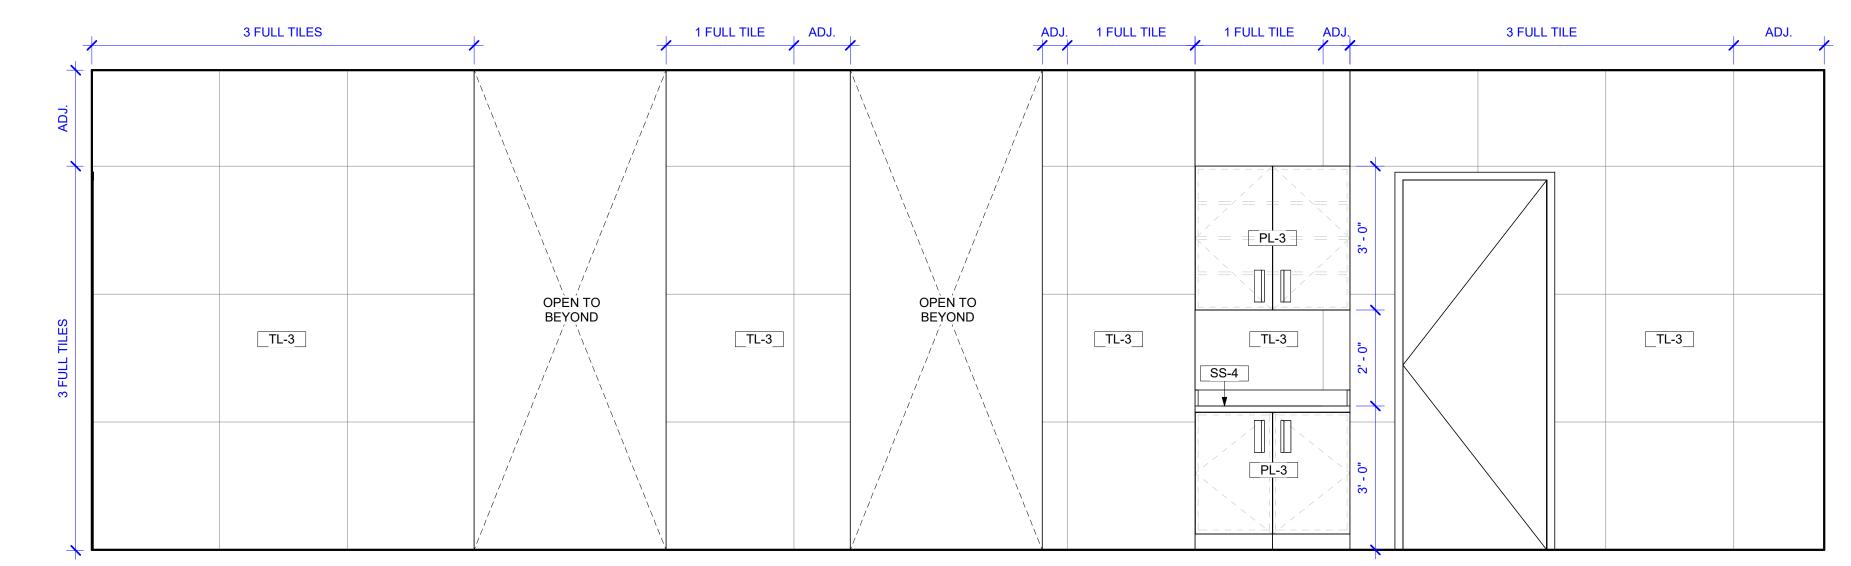


2 ELEVATION 8 - PLAYERS TOILETS
A8.07 1/2" = 1'-0"

PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana


WDG PROJECT NO | AR2315


CONSTRUCTION DOCUMENTS 04.15.2024



INTERIOR ELEVATIONS & DETAILS

DRAWN BY | Author A8.07

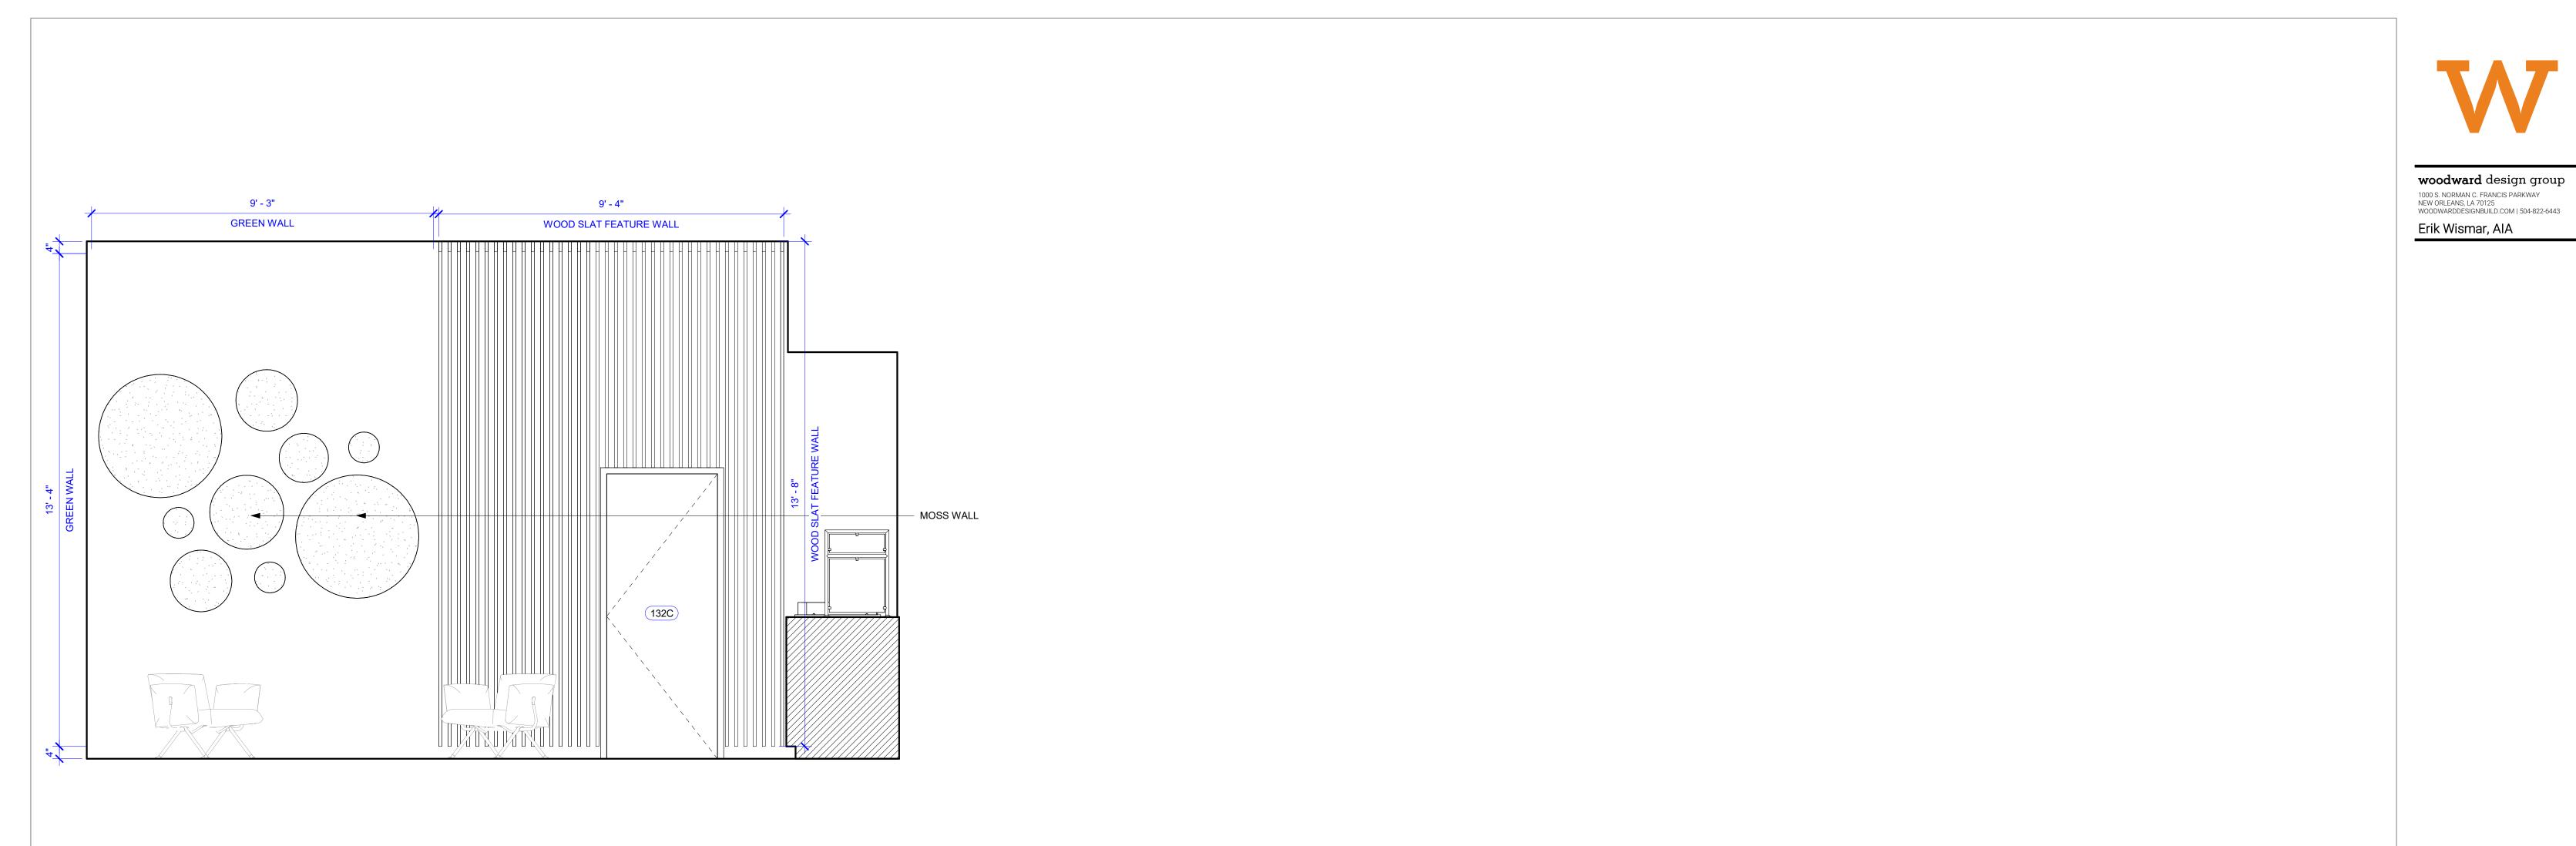

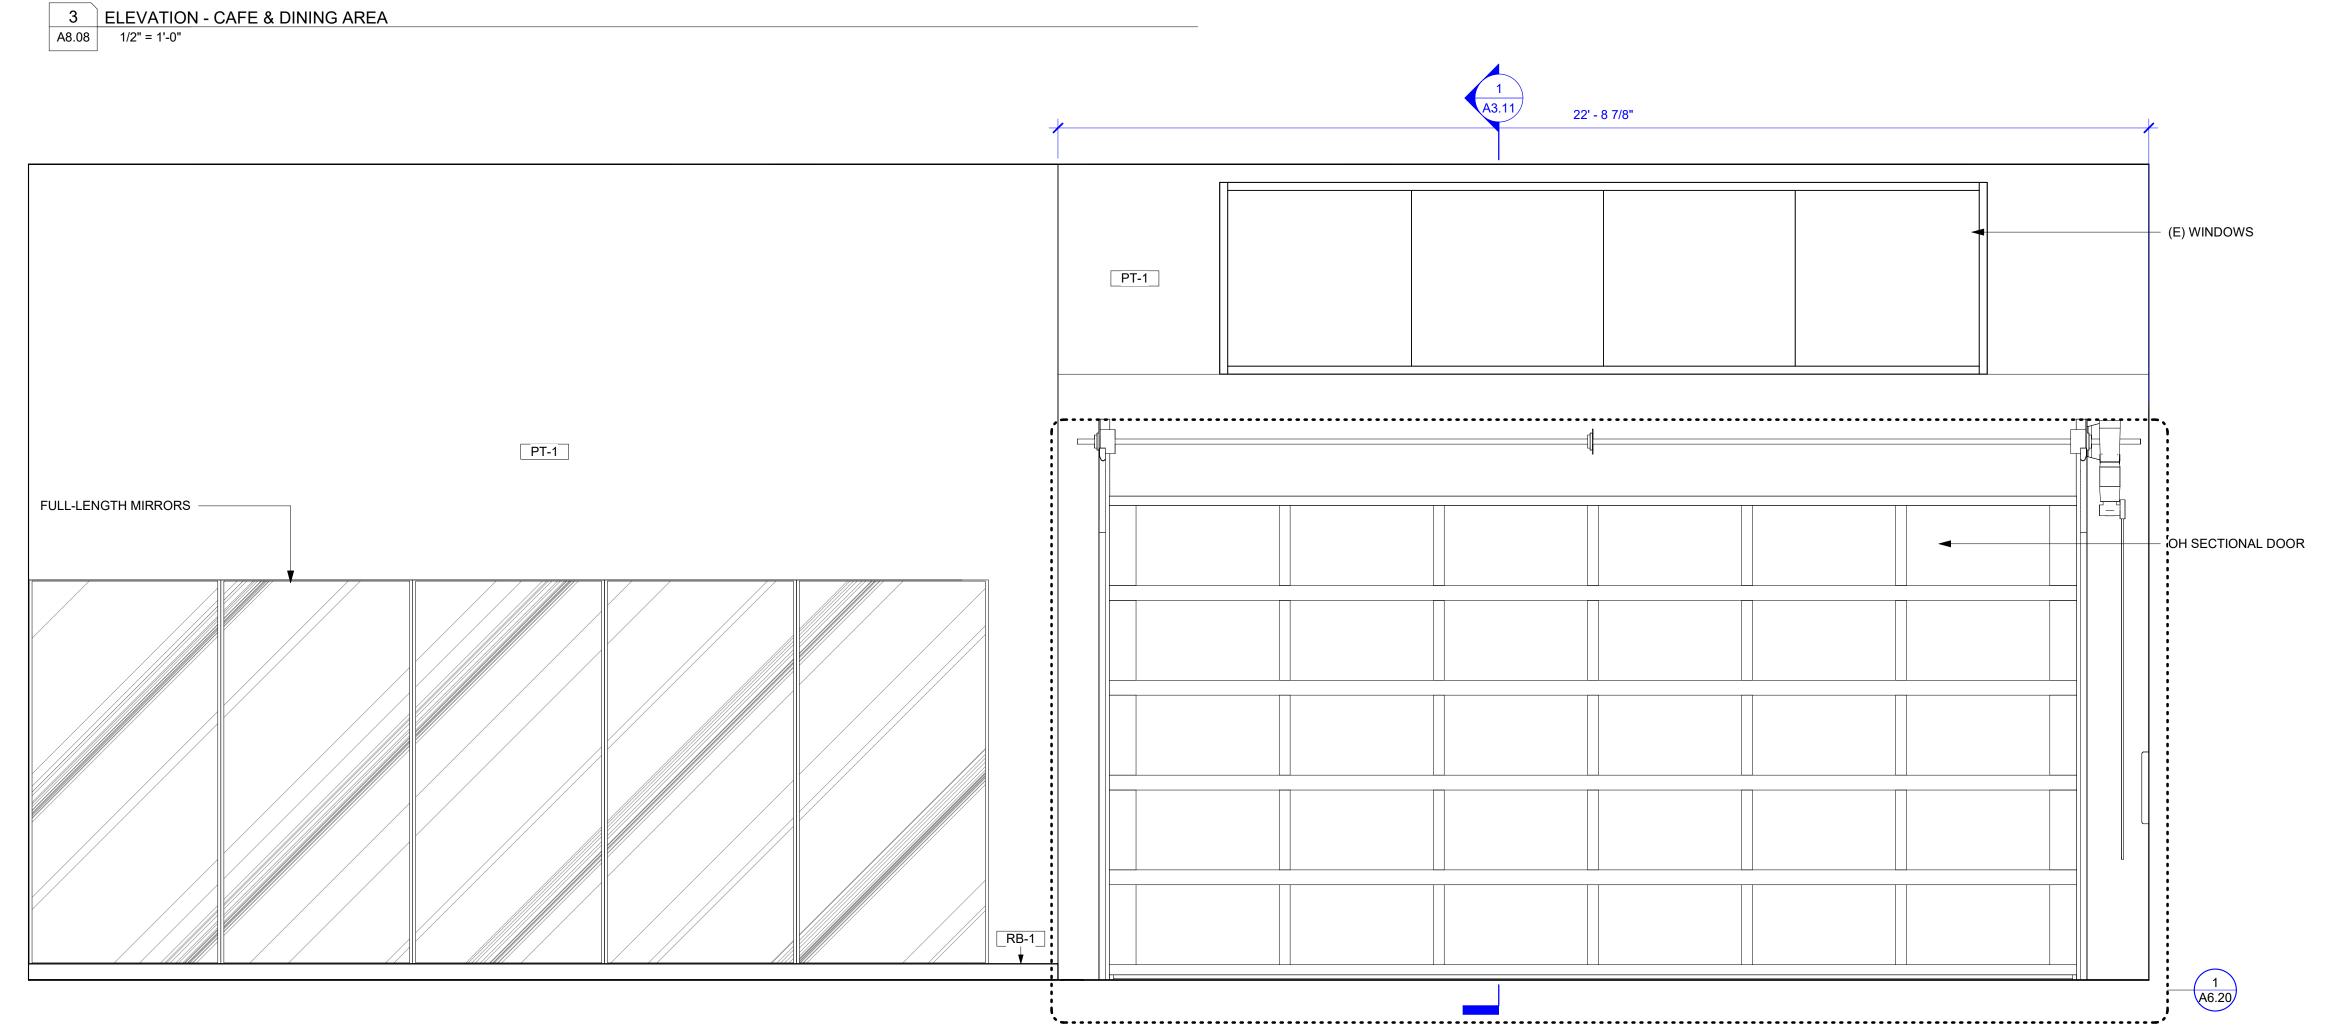

PELICANS CAMPUS IMPROVEMENTS
Metairie, Louisiana

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024


REVISIONS

no. descripton date

INTERIOR ELEVATIONS & DETAILS


DRAWN BY | Author

1 ELEVATION - WEIGHT ROOM OVERHEAD DOOR
A8.08 1/2" = 1'-0"

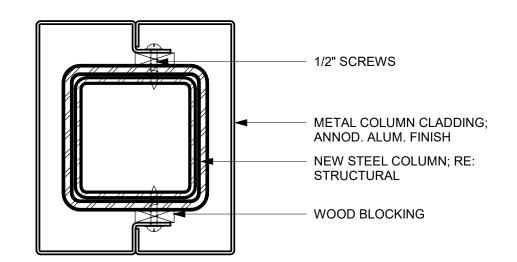



5 DETAIL - COLUMN CLADDING

A8.09 3" = 1'-0"

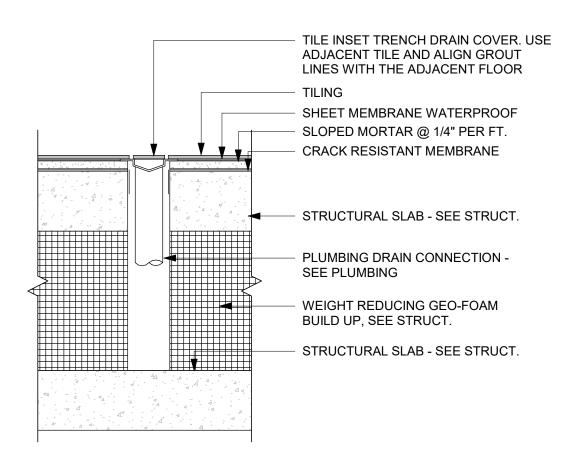


7 DETAIL @ SHOWER TRENCH DRAIN
A8.09 3" = 1'-0"

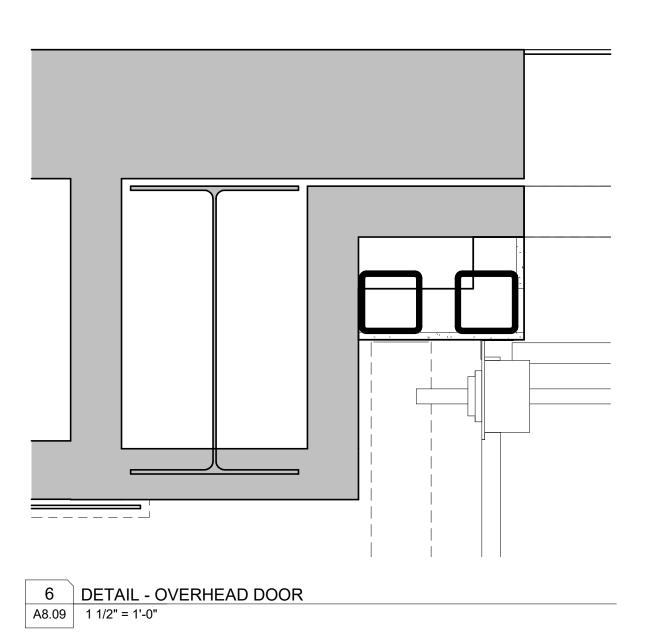

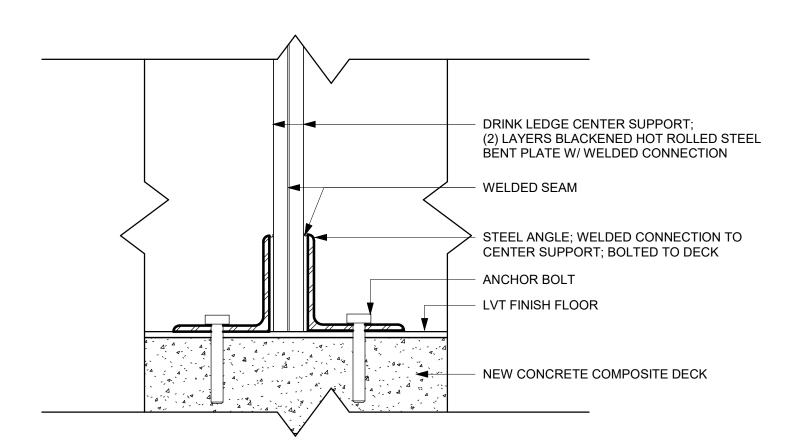


4 DETAIL - VIEWING AREA - DRINK LEDGE @ CENTER SUPPORT


A8.09 3" = 1'-0"

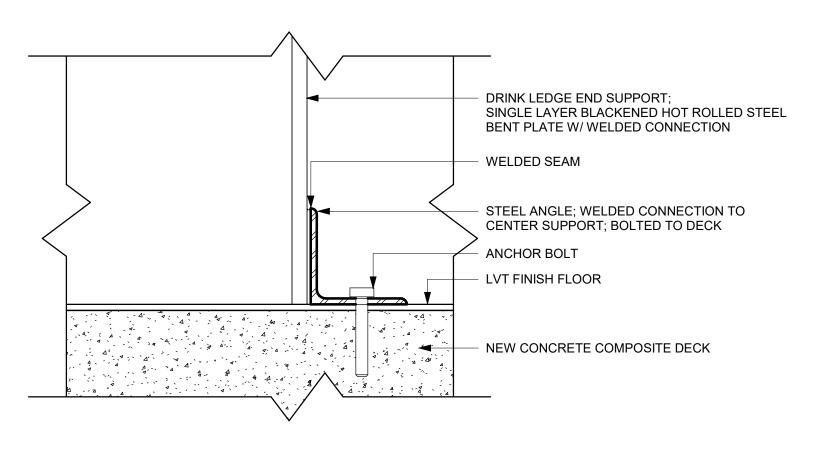

3 DETAIL - VIEWING AREA - DRINK LEDGE @ END SUPPORT
A8.09 3" = 1'-0"

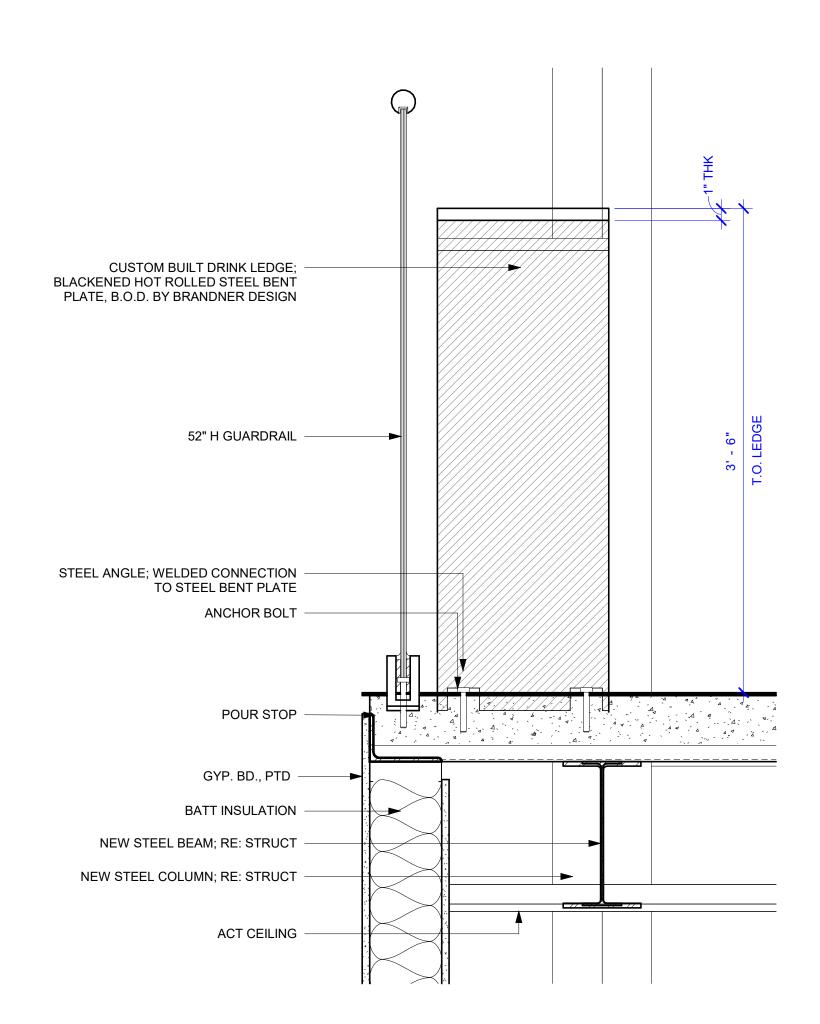

2 DETAIL - VIEWING AREA - GUARDRAIL & LEDGE A8.09 1 1/2" = 1'-0"

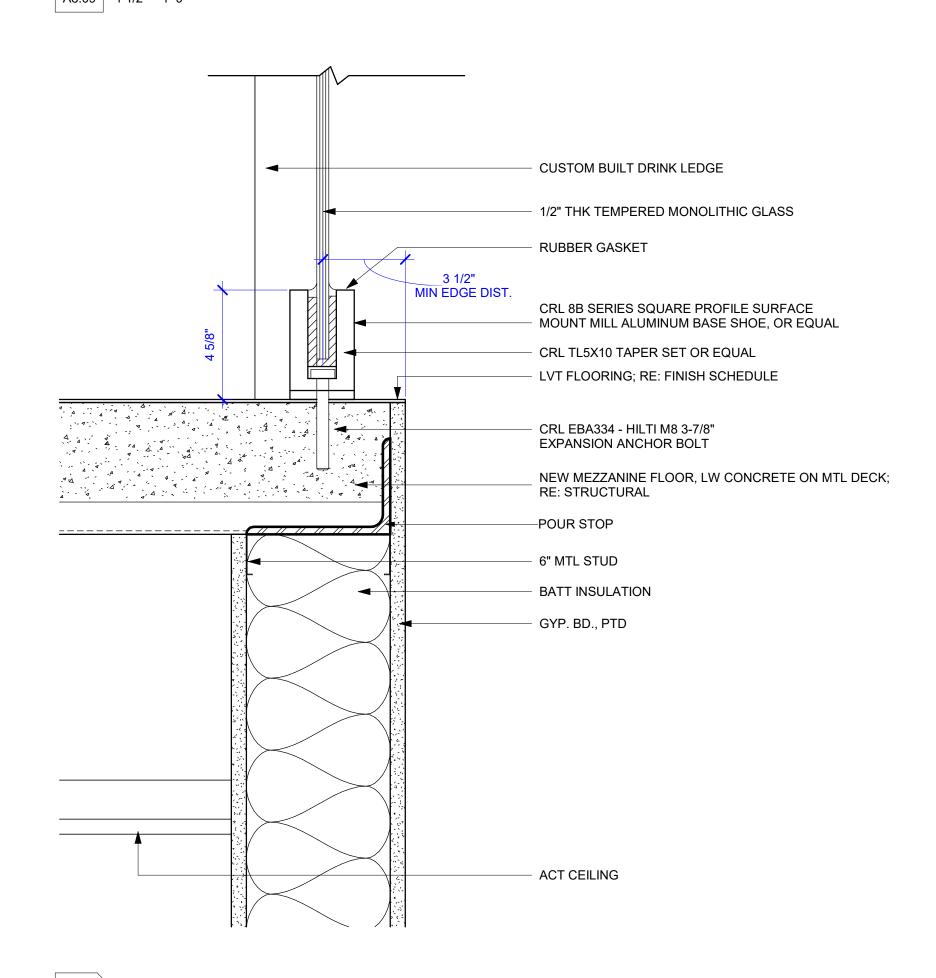

1 DETAIL - GUARDRAIL @ VIEWING AREA
A8.09 3" = 1'-0"

woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443 Erik Wismar, AIA


PELICANS CAMPUS IMPROVEMENTS

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024

INTERIOR ELEVATIONS & DETAILS

A8.09

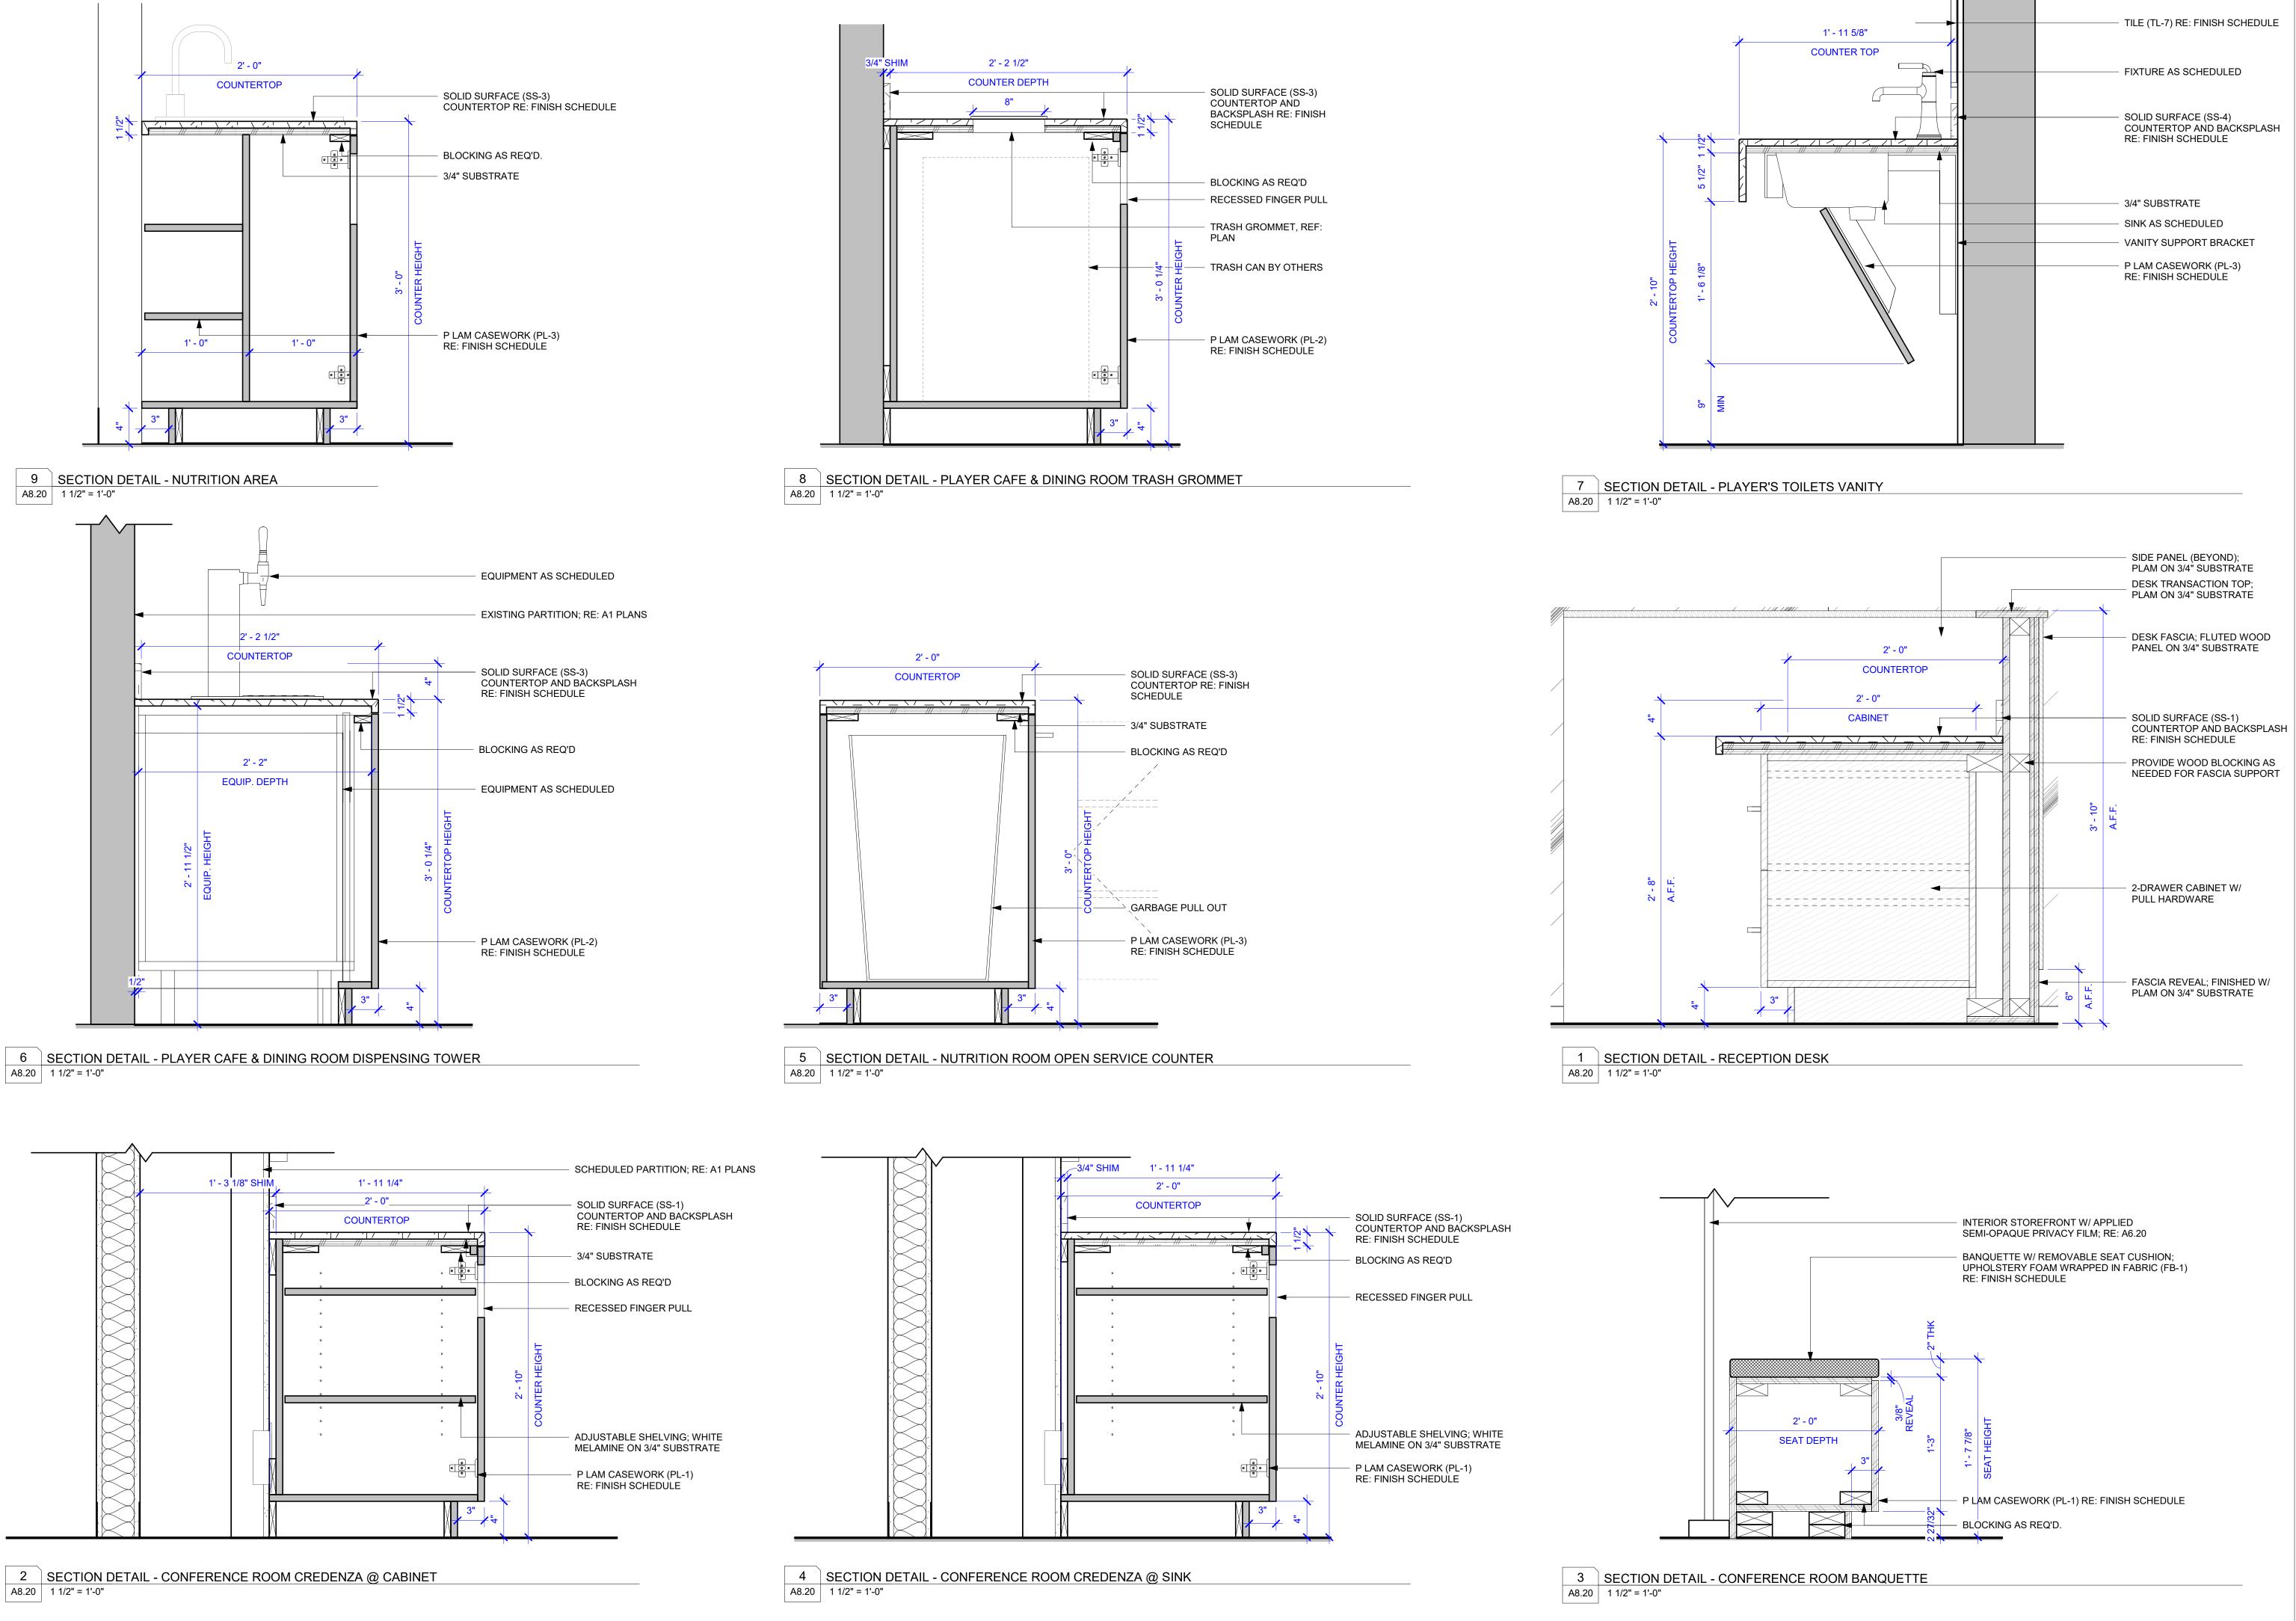


PELICANS CAMPUS IMPROVEMENTS

WDG PROJECT NO | AR2315 CONSTRUCTION DOCUMENTS 04.15.2024

MILLWORK SECTIONS & DETAILS

A8.20

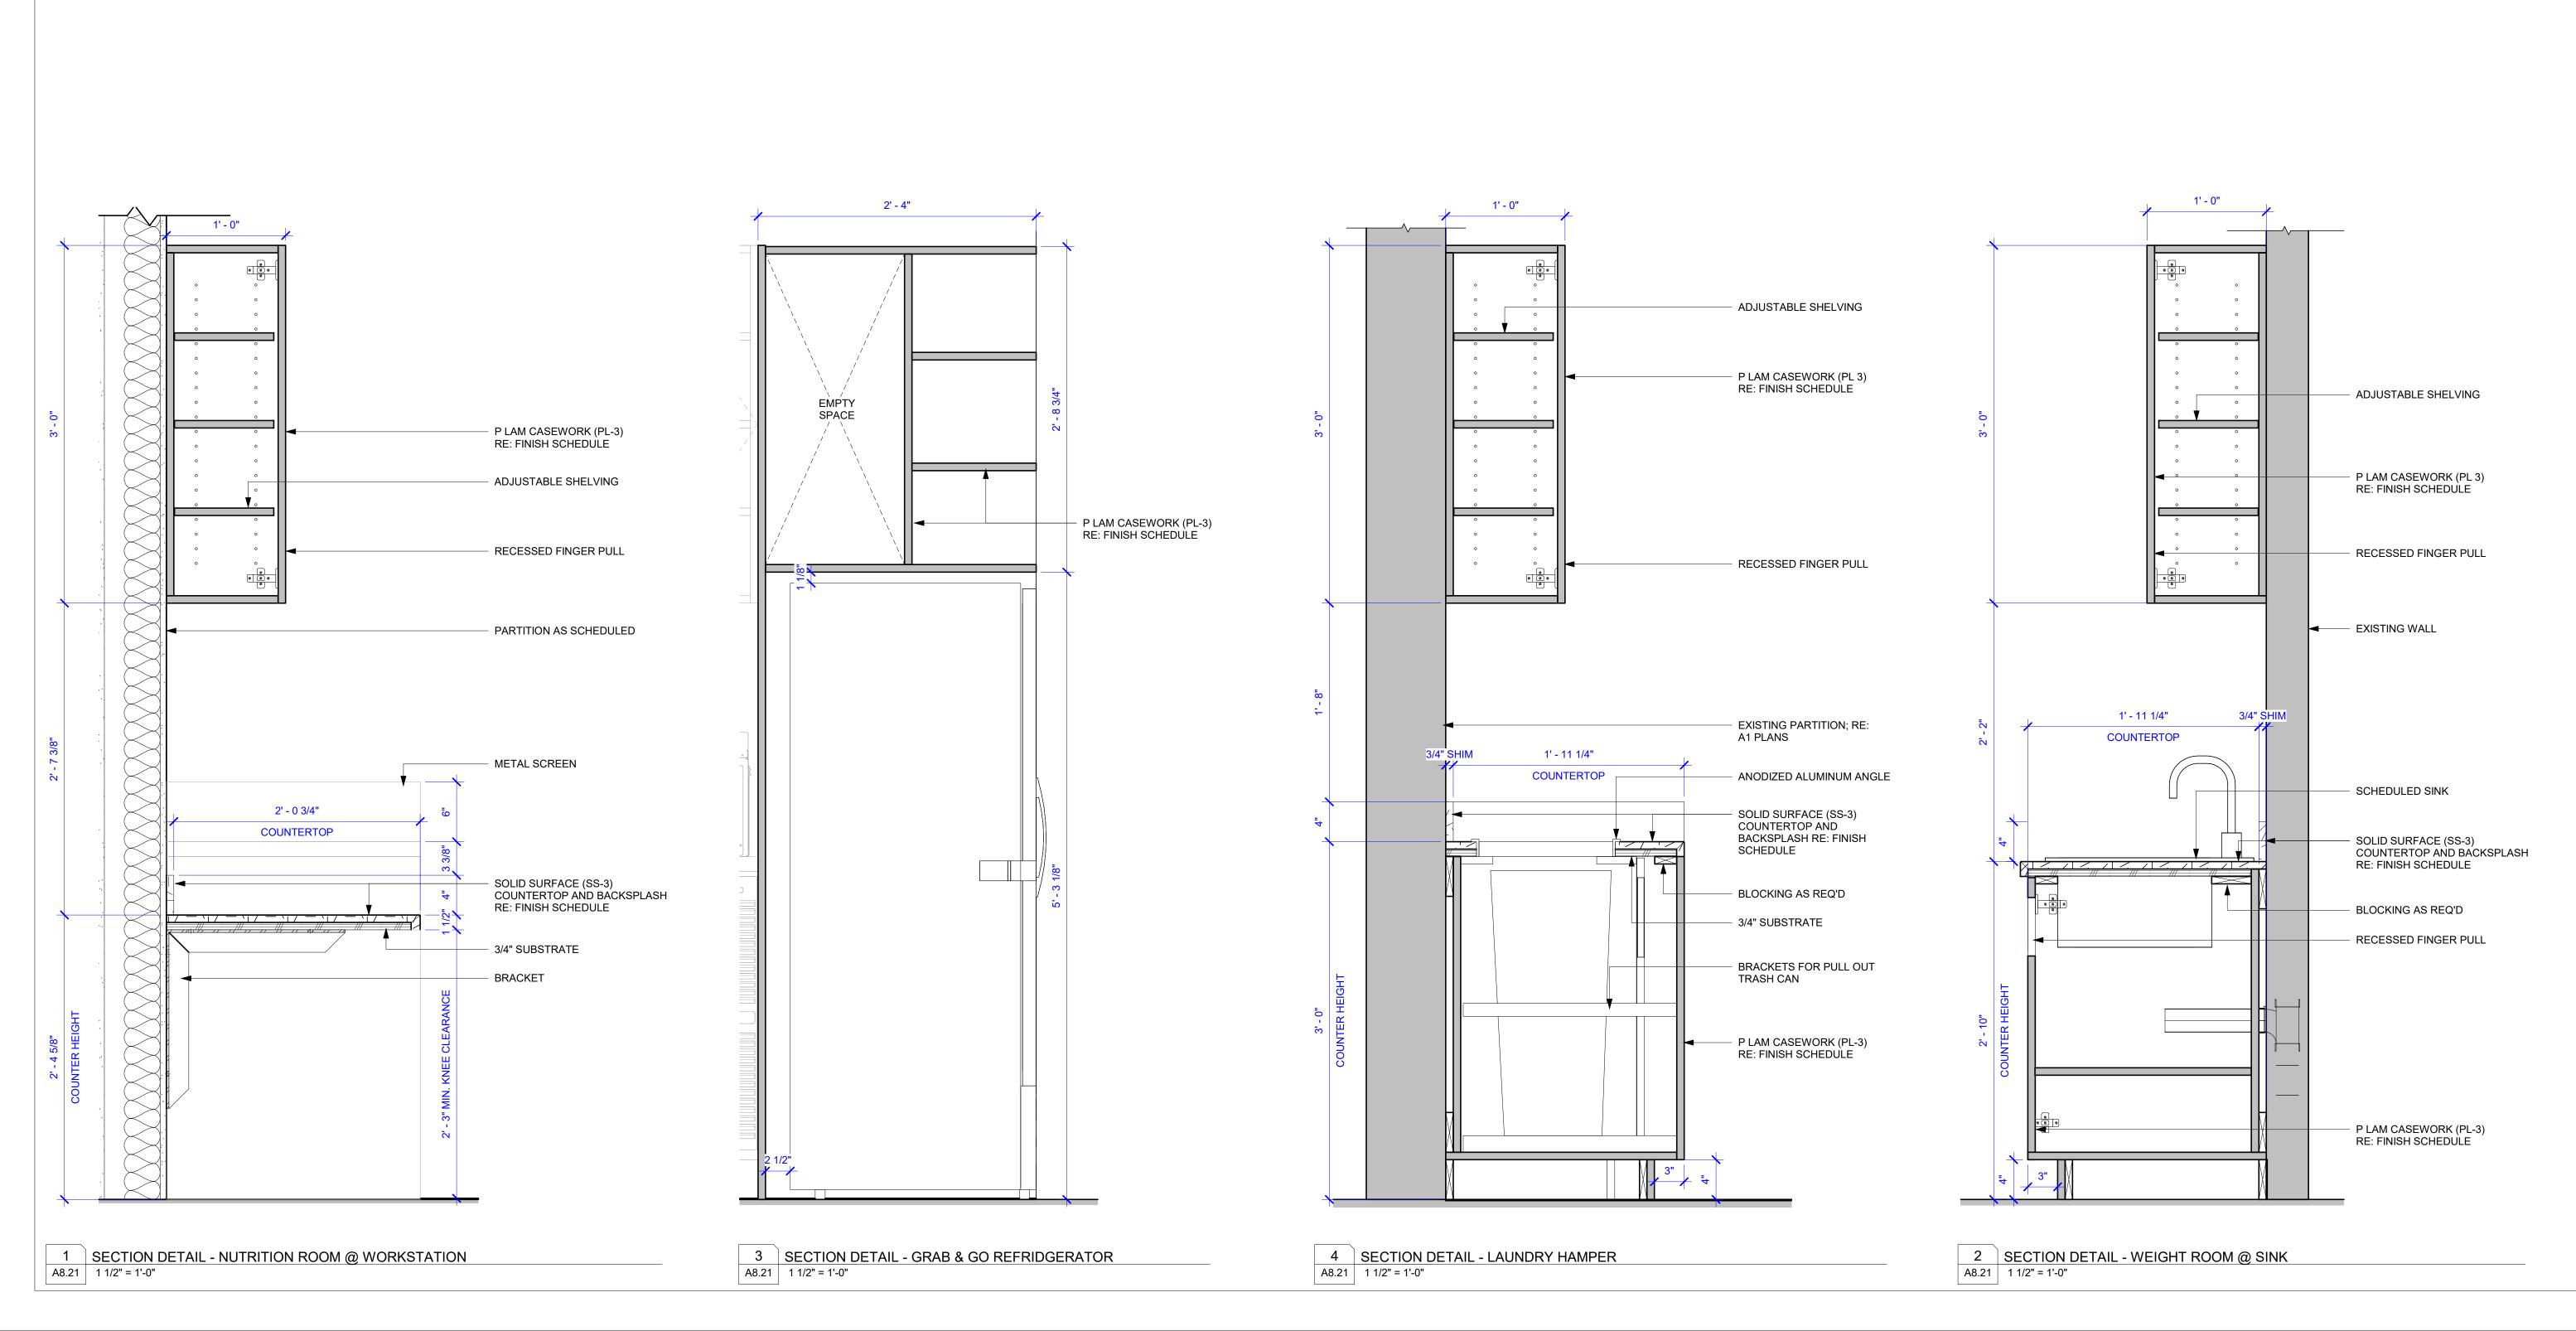


PELICANS CAMPUS IMPROVEMENTS

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024

MILLWORK SECTIONS & DETAILS

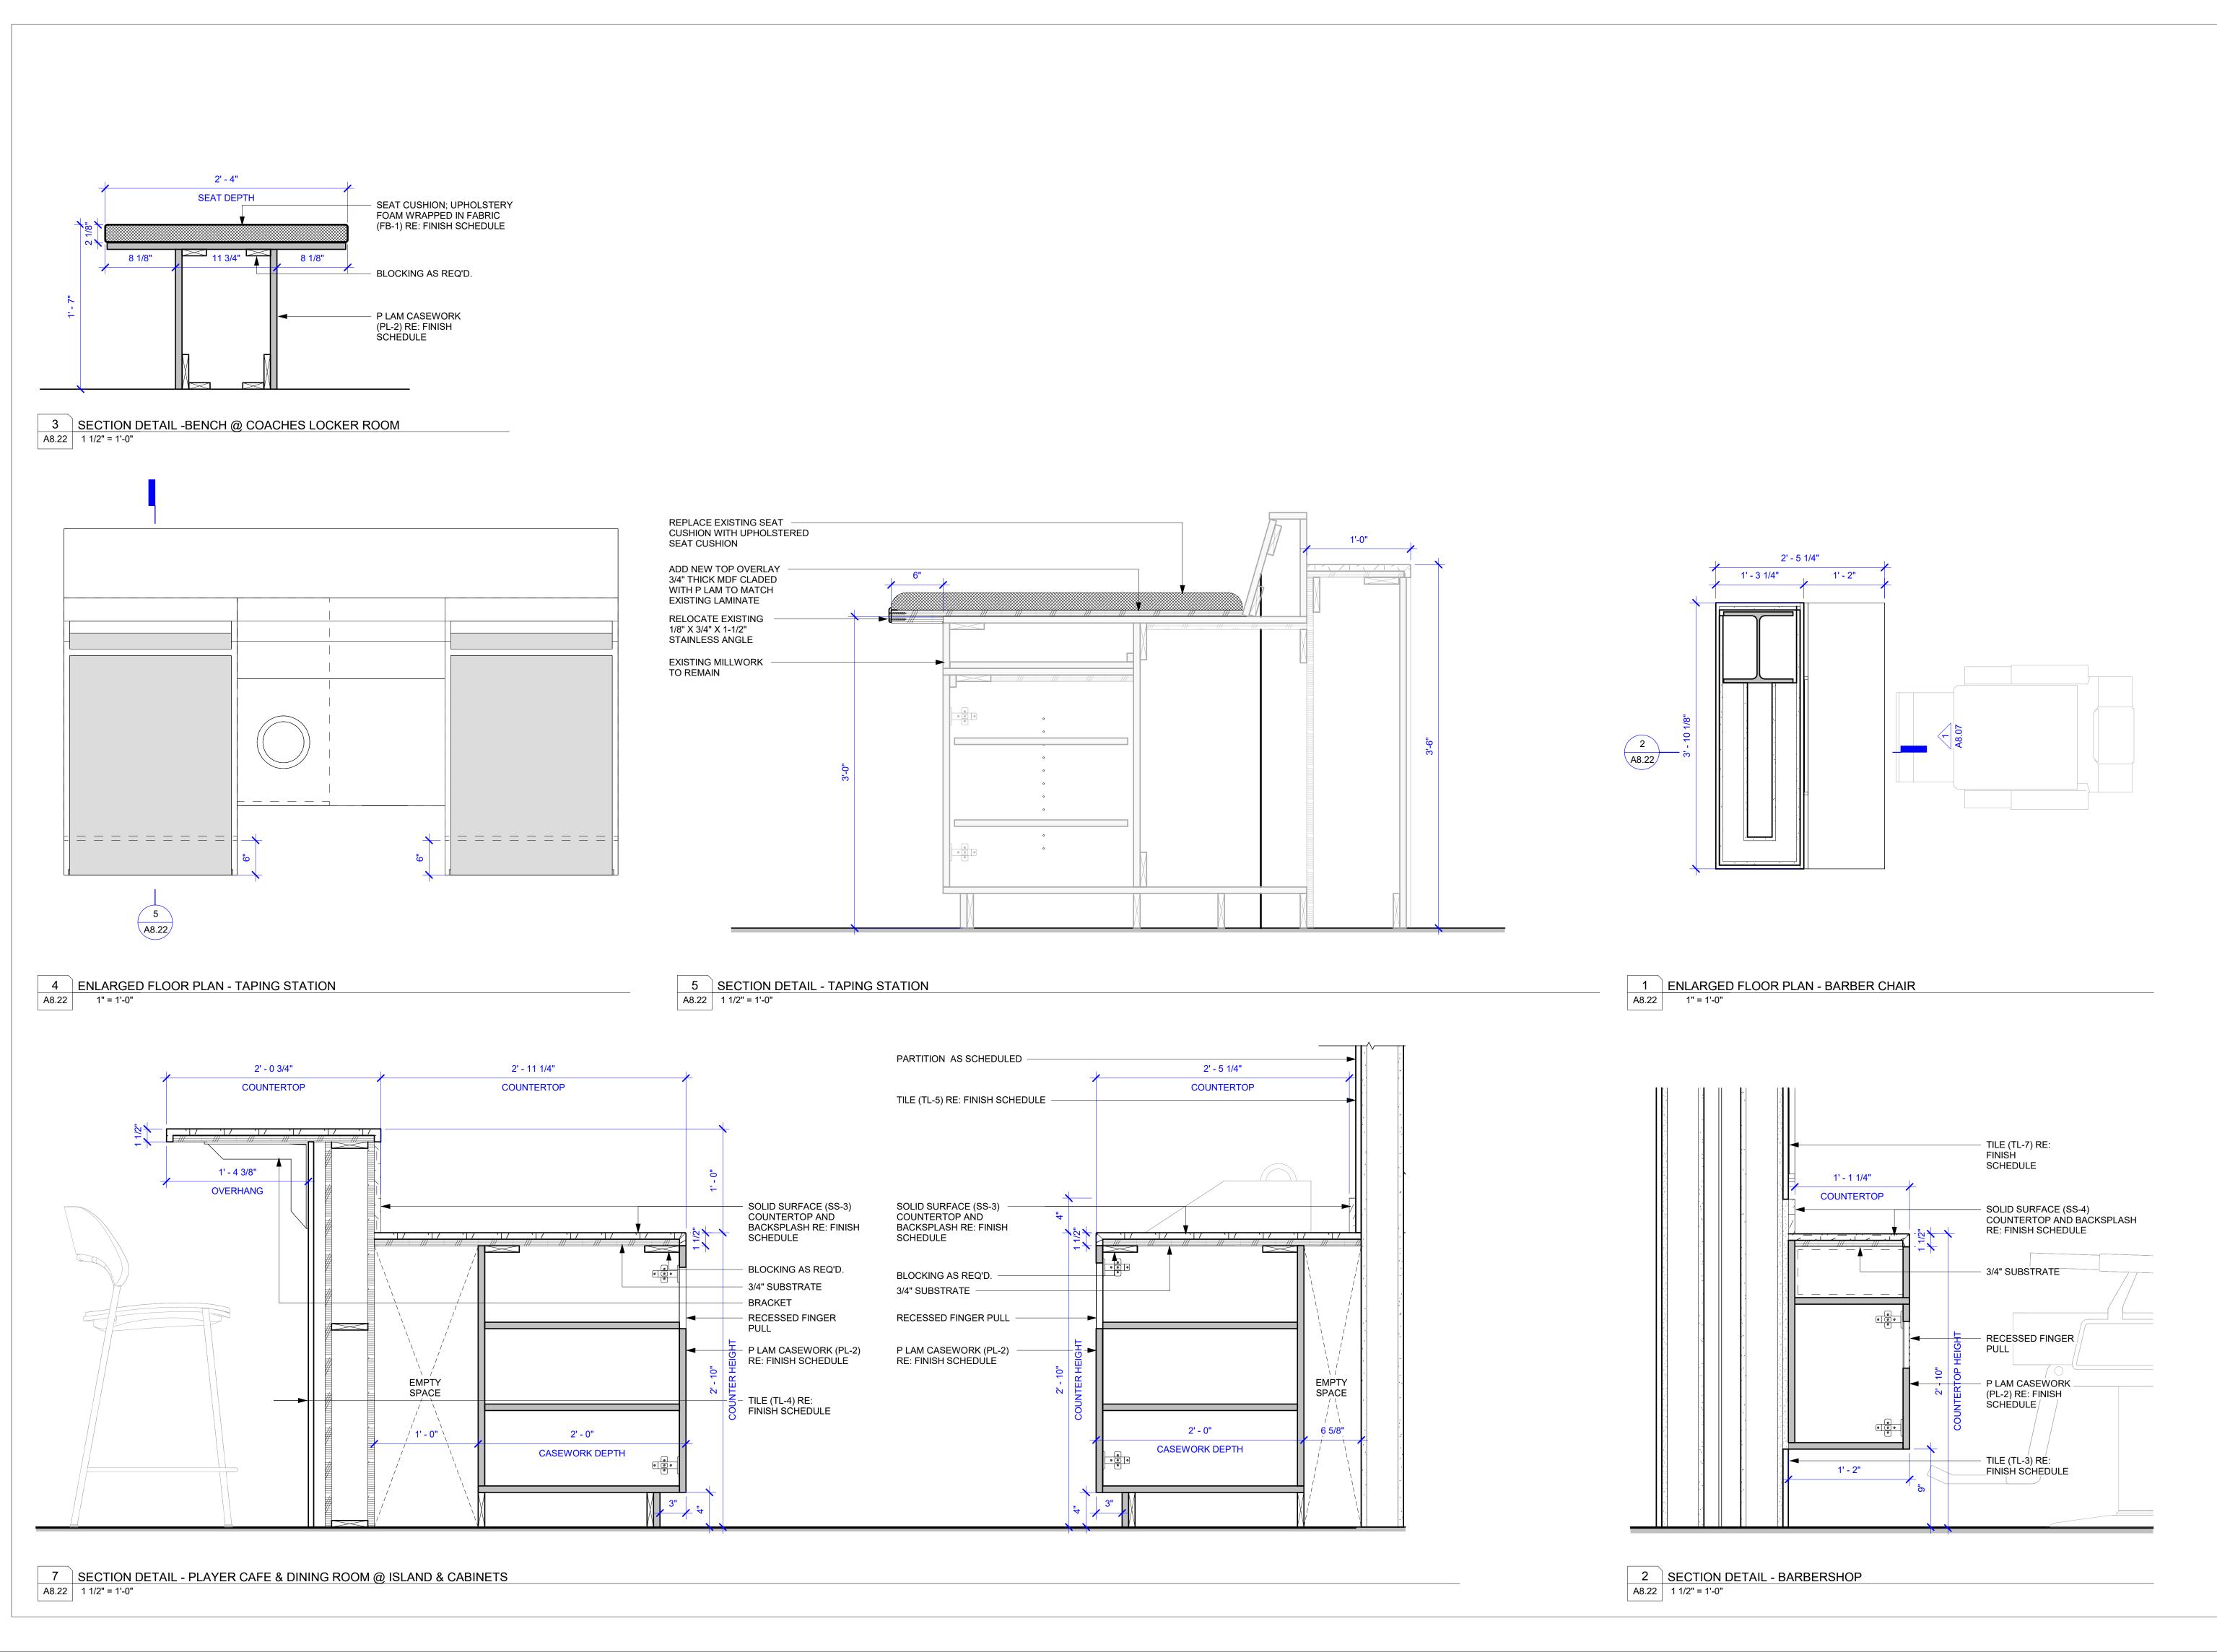

woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY
NEW ORLEANS, LA 70125
WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA

PELICANS CAMPUS IMPROVEMENTS
Metairie, Louisiana

CONSTRUCTION DOCUMENTS 04.15.2024

WDG PROJECT NO | AR2315

MILLWORK SECTIONS & DETAILS



SNEEZE GUARD

BRACKET

SOLID SURFACE (SS-3) COUNTERTOP AND

BACKSPLASH RE: FINISH SCHEDULED

BLOCKING

34* SUBSTRATE

RECESSED FINGER PULL

PLAM CASEWORK (PL-2) RE: FINISH SCHEDULE


TILE (TL-4) RE: FINISH SCHEDULE

TILE (TL-4) RE: FINISH SCHEDULE


14/Y X 12H LOUVER @ EA DROP N:
POWDER COATED TO PLAM FINISH

1 SECTION DETAIL - PLAYER CAFE & DINING ROOM @ HOT COLD SHELF


A8.23 1 1/2" = 1'-0"

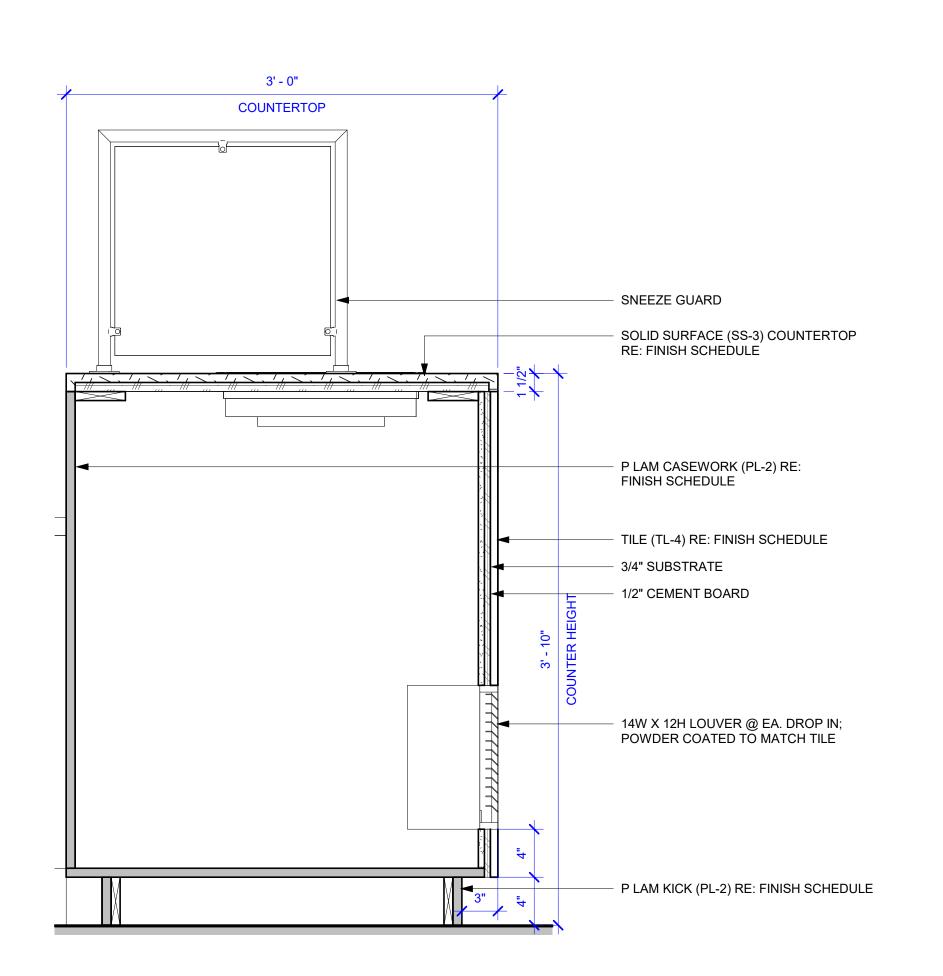



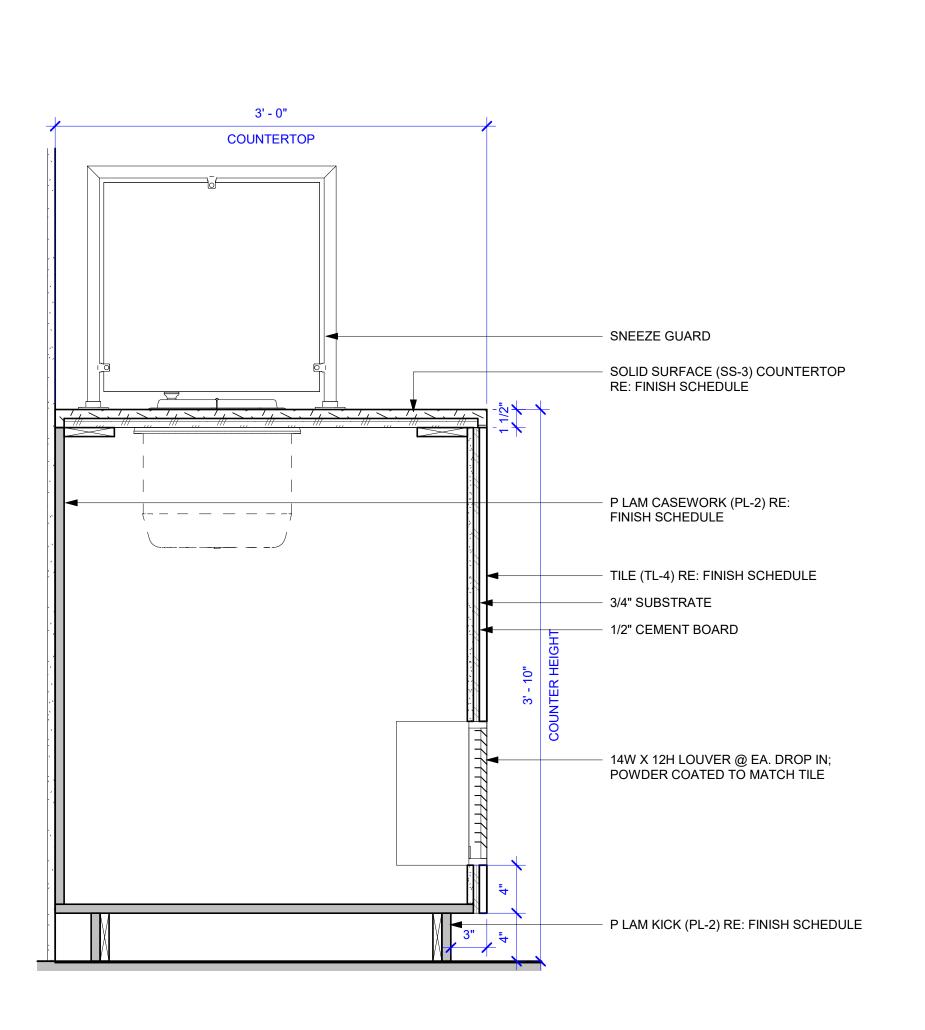



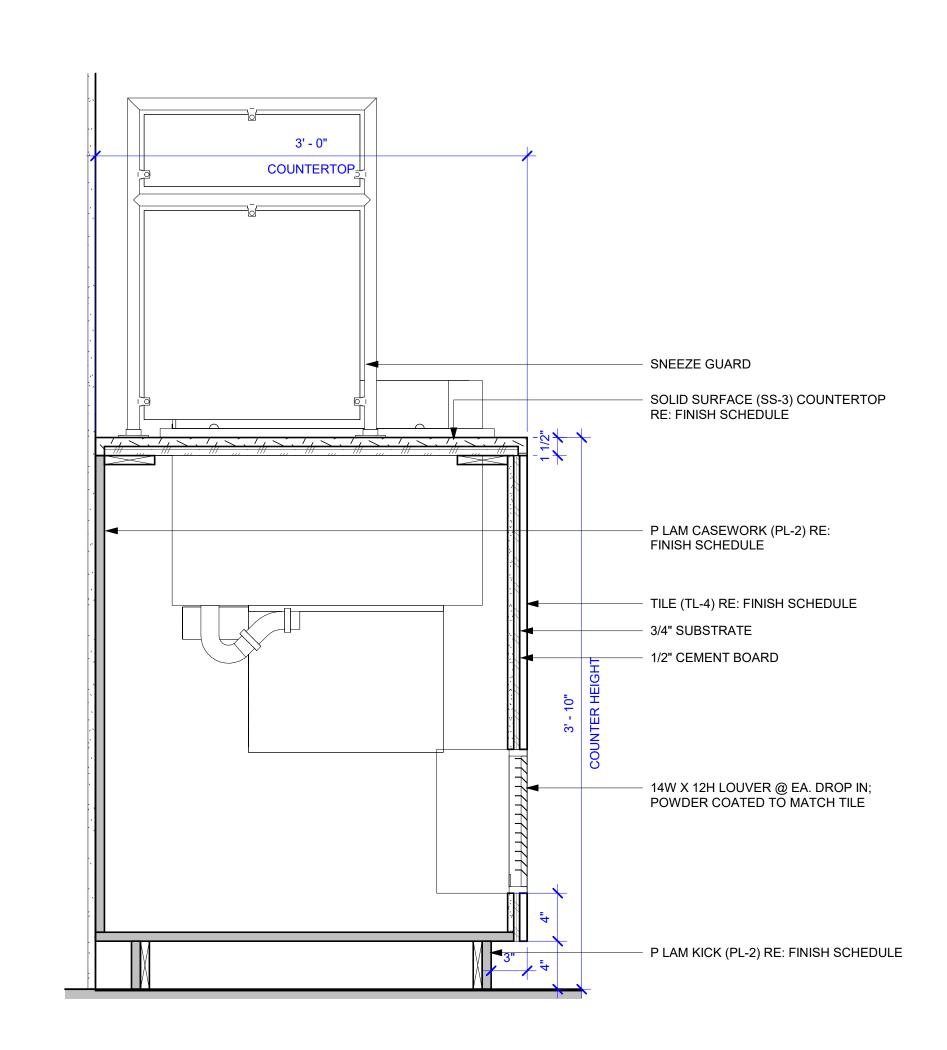

6 SECTION DETAIL - PLAYER CAFE & DINING ROOM @ COLD FOOD WELL UNIT

A8.23 1 1/2" = 1'-0"

PELICANS CAMPUS IMPROVEMENTS
Metairie, Louisiana

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024

no. descripton date

DRAWN BY I WDG A8.23

- All work shall conform to the "2021 International Building Code" and to all other applicable Federal, State, and Local
- In case of conflict between the General Notes and details, the most stringent requirements shall govern. Work not indicated on a part of the drawings but reasonably implied to be similar to that shown at corresponding places shall be repeated
- The structural drawings shall govern the work for all structural features, unless noted otherwise. The architectural
- drawings shall govern the work for all dimensions Prior to fabrication and/or erection of any materials, the Contractor shall field verify all pertinent existing dimensions, elevations, and conditions and shall report any discrepancies to the Structural Engineer of Record or the Architect
- immediately upon discovery. If the existing field conditions do not permit the installation of the work in accordance with the details shown, the Contractor shall notify the Architect/Engineer immediately and provide a sketch of the condition with his proposed modification of the details given on the Contract Documents. Do not commence work until condition is resolved and modification is approved by the Architect.
- Verify the location of all existing utilities before commencing any work. Any interference shall be brought to the attention of the Structural Engineer.
- Where alterations involve the existing supporting structure, the Contractor shall provide shoring and protection required to ensure the structural integrity of the existing structure.
- Shop drawings for all structural materials to be submitted to Architect for review prior to the start of fabrication or commencement of work. Review period shall be a minimum of two weeks
- All materials shall be stored to protect them from exposure to the elements.
- All columns shall be centered on grid lines unless noted otherwise.
- All column footings and pile caps shall be centered on columns unless noted otherwise.
- All wall footings shall be centered on walls unless noted otherwise Unless otherwise noted or detailed, concrete pads for mechanical equipment shall be 8" thick (minimum) and
- reinforced with #4 @ 12" o.c. each way centered. Substitution of expansion or adhesive anchors for embedded anchors shall not be permitted unless specifically
- approved in writing by the Structural Engineer of Record prior to pouring the concrete containing the anchors. Backfill both sides of all foundation and retaining walls equally until low side is up to finish grade. Do not backfill any
- walls until concrete has reached its specified 28-day compressive strength. Permanent stability of the building and components is not provided until the erection is completed as shown on the AISC Code of Standard Practice for Buildings and Bridges. Per Sect 7.10.3 of "Temporary supports, such as temporary guys, braces, falsework, cribbing or other elements required for the erection operation will be determined,
- furnished and installed by the erector." Weights of mechanical equipment shown on the structural plans are for units specified by the Mechanical Engineer. Contractor shall verify weights and any substitutions that result in increased weight shall be approved by the
- The contractor shall ensure that no construction load exceeds the design live loads indicated on the structural drawings and that these loads are not put on the structural members prior to the time that all framing members and
- their connections are in place. The size and location of equipment pads and penetrations through the structure for mechanical, electrical, and plumbing work shall be verified by the Contractor. Openings and penetrations not specifically shown on the structural
- drawings shall be subject to approval by the Structural Engineer of Record. Isolate the sides and top of anchored veneer from the structure so that lateral seismic and wind forces resisted by the structure are not imparted to the veneer. See architectural plans and specification for joints in the veneer and
- attachments to the walls. Waterstops shall be Waterstop-RX Volclay waterproofing by American Colloid Company or approved equal unless
- Expansion Joint Filler shall be non-extruded premolded material composed of fiberboard impregnated with asphalt conforming to the requirements of ASTM D1751 unless noted otherwise.
- If additional information or details are deemed as required by the contractor or subcontractors, or if discrepancies arise and require a clarification either in these plans or specifications, it is the responsibility of the contractor to request additional information or clarification in writing to the Architect/Engineer as promptly as possible.
- Refer to Architectural drawings for additional information to be coordinated with the structural drawings.

2.0 METAL DECK


- Metal deck shall be designed and detailed in accordance with the "Design Manual for Floor Decks and Roof Decks" of the Steel Deck Institute (SDI), latest edition. All composite steel floor deck shall be in conformance with the
- "Specifications for Composite Steel Floor Deck" of the SDI, latest edition. Deck properties are based on products manufactured by New Millenium. Decks by other manufacturer's may be supplied provided load carrying capacity based on manufacturer's standard load tables, deflection characteristics, and UL fire ratings equal or exceed those of materials specified and if approved by the Architect and Structural
- Install in accordance with SDI suggested Specifications unless noted otherwise on the drawings. Individual deck sheets shall extend over at least three spans, with laps to be placed over supports.
- Deck supplier shall provide all additional framing, closure angles and plates, pour stops, screed angles, and roof sump pans as required at the edges of all openings and at all slab depressions, or changes of deck direction,
- including those which have not been detailed. Roof and non-composite decks shall be attached to steel supports, including the edge support parallel to the deck span with powder actuted fasteners equal to Hilti X-HSN 24 for attachment to bar joist and Hilti X-ENP19 for attachment to other steel elements at 12 inches OC interior (36/4 pattern) and 6 inches OC at edge of deck sheet. Fasten side laps with #10 self-tapping screws at 36 inches OC maximum spacing.
- Steel deck supplier shall submit shop drawings indicating the shear stud placement if shear studs are present. Prior to and during concrete placement, the floor deck shall be planked to prevent damage to the deck.
- Concentrated and impact loads shall be avoided. All beam shear studs shall be 3/4"Ø x 3-1/2" long Nelson S3F or an approved equal. Minimum spacing of studs
- shall be 4-1/2" longitudinally and 3" transversely. Steel roof and floor deck shall be supported around all opening, columns, roof penetrations, hips, and valleys.
- Roof and floor deck openings larger than 12" which are not shown on the drawings shall be brought to the attention of the EOR.
- No mechanical or electrical piping, fixtures, units or systems may be hung directly from the roof deck. The installer that will be using the tools to attach the powder-actuated frame fasteners shall be trained and certified by fastener manufacturer's representative on the general use of powder-actuated technology and fastening guidelines for the attachment of steel deck. The installer that will be using the tools to attach the screw fasteners shall be trained by fastener manufacturer's representative on the proper tools and fastening guidelines for the attachment of steel deck.

3.0 CAST-IN-PLACE CONCRETE

- Concrete shall be designed and detailed in accordance with the Building Code Requirements for Structural Concrete (ACI 318 latest edition), and constructed in accordance with the CRSI Manual of Standard Practice.
- All concrete shall have a minimum 28-day compressive strength of 4,000 psi. Air entrainment shall be 4 to 6 percent in all exposed concrete work.
- All concrete shall be normal weight concrete (144 pcf +) with all cement conforming to ASTM C150, Type I. Maximum aggregate size shall be 1-1/2 inches for footings and 3/4" for walls and slabs, conforming to ASTM C33.
- All second upper floors concrete shall be lightweight concrete (±110 pcf) with all cement conforming to ASTM C330. Submit to Architect/Engineer reinforcing steel shop drawings for approval and mix designs for review prior to placing
- Arrangement and bending of reinforcing steel shall be in accordance with ACI 315 Detailing Manual, latest edition. Reinforcing steel shall be new and all bars shall be deformed and shall conform in ASTM 615 Grade 60.
- Placing of concrete shall not start until the placement of reinforcing has been approved by the Inspection Agency. Unless noted otherwise, bar laps shall be Class B tension laps and shall be lapped with minimum lengths as listed in
- the schedule, where splices are required in reinforcing. Provide suitable wire spacers, chairs, ties, brickettes etc. for supporting reinforcing steel in the proper position while
- placing concrete. Do not "wet stick" dowels. Typical minimum concrete protective covering for reinforcement shall be 1-1/2"; minimum cover shall be 2" on
- surfaces in contact with the earth and 3" at earth-formed surfaces.
- All welded wire fabric shall conform to ASTM A-185 and shall be lapped a minimum of (2) wire spaces.
- Bonding agent shall be used where new concrete is placed against existing concrete. Chamfer all exposed concrete corners unless noted otherwise on Architectural Drawings.
- The concrete slabs shall be finished flat and level within tolerance, to the elevation indicated on the drawings. The
- Contractor shall provide the means by which the maximum and minimum concrete slab thickness can be monitored and verified during and after the placing and finishing operations. Early drying out of concrete, especially during the first 24 hours, shall be carefully guarded against. All surfaces
- shall be moist cured or protected using a membrane curing agent applied as soon as forms are removed. If membrane curing agent is used, exercise care not to damage coating. Cold weather concreting shall be in accordance with ACI-306. Hot weather concreting shall be in accordance with
- Throughout construction, the concrete work shall be adequately protected against damage due to excessive loading,
- construction equipment, materials or methods, ice, rain, snow, excessive heat, and freezing temperatures. Prepare concrete test cylinders from each day's pour. Cylinders shall be properly cured and stored. Sample fresh
- concrete in accordance with ASTM C172. Retain laboratory to provide testing service. Slump per ASTM C143I air content per ASTM C231 or C173, cylinder tests per ASTM C31 and C39. One (1) set of six (6) cylinders for each 50 cubic yards for each mix used. Reports of all tests to be submitted to the Architect.
- Locations and sizes of openings, sleeves, etc. required for other trades must be verified by these trades before
- All slots, sleeves, trenches, and other embedded items shall be set and secured against movement before the concrete is placed. See Architectural, Electrical, Mechanical, Plumbing, and Vendor drawings for sizes and
- As part of the submittal process, the Electrical and Mechanical Contractor(s) shall submit a proposed routing plan for all pipes, conduits, or other devices to be embedded in the concrete. The submittal shall show specific sizes and locations of all proposed embed items referencing proximity to beam, column, and slab edges.
- Conduits and pipes embedded in concrete slabs may be no larger than 1/3 of the slab thickness (based on the maximum outside diameter) and shall have a center-to-center spacing no less than three (3) conduit diameters. Regardless of diameter, the minimum clear spacing between conduits or reinforcing shall be one (1) inch.
- No aluminum conduits, devices, or fixtures may be embedded into the concrete so that the aluminum is in direct No conduits shall be placed in slabs within 12 inches of column face or face of bearing wall.
- Corner bars shall be provided for all horizontal reinforcing bars at the intersections and corners of all strip footings, beams, and walls unless noted otherwise. Corner bars shall be of the same size and grade as the horizontal
- reinforcing they connect. See Typical Details for more information. Saw cuts shall be made as soon as the concrete can support the saw without damaging the surface (maximum (8) hours from the start of the concrete pour).

4.0 COLD FORMED FRAMING

- Light gage metal framing shall be designed and detailed according with the "Specification for the Design of Cold-Formed Steel Structural Members", American Iron and Steel Institute, latest edition.
- All stud and/or joist framing members shall be of the type, size, and gage as required by design. Size and gage shall
- not be less than shown on drawings. All cold-formed framing shall be designed by an Engineer registered in the State that project is located. Engineer
- Stamped Shop Drawings and calculations showing member sizes, locations, and connection details shall be submitted to the project EOR for approval. Light gage metal framing properties are based on products manufactured by Clark Dietrich. Members by other manufacturer's may be supplied provided load carrying capacity based on manufacturer's standard load tables, and
- deflection characteristics equal or exceed those of materials specified and if approved by the Architect and Structural
- All galvanized studs, joists, track, bridging, and accessories, 12, 14, and 16 gage, shall be formed from steel that corresponds to the requirements of ASTM A653, Grade 50, with a minimum yield of 50,000 psi.
- All galvanized studs, joist, and track, bridging and accessories, 18 and 20 gage, shall be formed from steel that corresponds to the requirements of ASTM A653, Grade 33, with a minimum yield of 33,000 psi.
- All studs, joist, and accessories, shall be formed from steel having a G60 galvanized coating in conformance with Light gage metal roof framing (purlins and girts) properties are based on products manufactured by MBCI. Members by other manufacturer's may be supplied provided load carrying capacity based on manufacturer's standard load
- tables, and deflection characteristics equal or exceed those of materials specified and if approved by the Architect and Structural Engineer. All galvanized purlins and girts (cee and zee shapes) 12, 14, and 16 gage, shall be formed from steel that
- corresponds to the requirements of ASTM A570, Grade 55, with a minimum yield of 55,000 psi. Unless noted otherwise, all cold-rolled elements shall be connected with #10 AISI-1022 steel screws having a
- minimum diameters out to out of threads = 0.190".
- Cutting of steel framing shall be by saw, shear or plasma cutting equipment only. Temporary bracing shall be provided until erection is complete and all attached adjacent framing is complete.
- Insulation shall be placed in components inaccessible to the insulation contractor after their installation. Splices in axially loaded studs are not permitted
- Where splicing of track is necessary between stud spacing, a piece of stud shall be placed between adjacent tracks and fastened by welds or screws to each side of the track, each end.
- Studs shall be plumbed, aligned, and securely attached to the flanges or webs of both upper and lower tracks. Axially loaded studs shall be installed in a manner which will assure that ends of the studs are positioned against the
- inside track web, prior to stud and track attachment. Studs shall be squarely cut and positively clamped and positioned until properly fastened.
- Wall stud bridging shall be attached in a manner to prevent stud rotation. Bridging, of the type and spacing shown on the Contract or Shop Drawings shall be installed prior to loading. Bridging spacing shall be as required by design but shall not exceed 5'-0" OC.
- Provision for structure vertical movement shall be provided where indicated on the plans using vertical slide clips or other means. Frame both sides of expansion joints with separate studs; do not bridge the expansion joints with stud system components.
- Framed wall openings shall include headers and supporting studs as shown on the plans and shop drawings. Provide additional jack and king studs as required at all openings which exceed 24 inches.
- Joists shall be located directly over bearing studs or a load distribution member to be provided at the top track. Provide an additional joist under parallel, non-load bearing partitions that run more than 1/3 the span of the joist. Connections shall be by welding, riveting, bolting or other approved fastening devices or methods providing positive
- attachment and resistance to loosening. Fasteners shall be of compatible material. Welded connections shall be performed in accordance with AWS Specification for Welding Sheet Steel in Structures,
- Contractor shall refer to installation instructions published by the screw manufacturer and ASTM C954 for minimum spacing and edge distances requirements and torque requirements.
- Standard cold-rolled number designations are as follows per AISA/SSMA:



IBER LABEL:	600 S 162 - 54	_
600 = 6"	DEPTH X 100	

S - STUD OR JOIST B MEMBER TYPE: T - TRACK U - CHANNEL

F - FURRING CHANNEL 162 = 1-5/8" = 1.62" x 100 C FLANGE WIDTH: 54 = 0.054" X 1000

10 GA. 118 12 GA. 97 14 GA. 68 16 GA. 54 18 GA. 43 20 GA. 33

THICKNESS

(MILS)

5.0 ADHESIVE SET ANCHORS AND DOWELS

THICKNESS IN MILS:

A MEMBER DEPTH:

- Unless noted otherwise, Hitli HIT-HY 270 epoxy system shall be used for an adhesive anchor in hollow CMU or
- Unless noted otherwise, Hilti HIT-HY 200 epoxy system shall be used for an adhesive anchor or dowel in concrete or concrete masonry
- Where base material is hollow block brick or other material containing pockets or voids, a screen tube, per manufacturers recommendations, shall be employed in the system. Where embedment depths are not specifically called out on the drawings, notify the Structural Engineer of Record
- for depth required. A minimum depth required to develop the yield strength of the rod or reinforcing bar will be considered the minimum acceptable without written instructions stating otherwise.
- Follow manufacturer's requirements for minimum depth of base material, minimum edge distances, and minimum bolt/bar spacing. Anchor capacity used shall be based on the technical data published by Hilti or such other method approved by the
- EOR. Substitution requests for alternate products must be approved in writing by the EOR prior to use. Contractor shall provide calculations demonstrating that the substituted product is capable of achieving the performance values of the specified product. Substitutions will be evaluated by their having and ICC ESR/ESL showing compliance with the relevant building code for seismic, load resistance, installation category, and availability of comprehensive installation instructions. Adhesive anchor evaluations will also consider creep, in-service temperature and installation temperature.
- The contractor shall arrange an anchor manufacturer's representative to provide on-site isntallation training for all of the anchoring products specified. The EOR must receive documented confirmation that all of the contractor's personnel who install anchors are trained prior to the commencement of installing anchors.

L/240

Existing reinforcing bars in the concrete structure may conflict with the specific anchor locations. Unless noted otherwise on the drawings that the bars can be cut, the contractor shall review the existing structural drawings and shall locate the position of the reinforcing bars at the locations of the concrete anchors by the use of Hilti Ferroscan, Hilti PS 1000, ground penetration radar, x-ray, chipping or other approved means.

6.0 DESIGN DATA

Governing Design Code: 2021 International Building Code Building Occupancy Category: II Live Load: Wind Load (ASCE 7-16): Basic Wind Speed 142 mph Exposure Category Enclosed Enclosure Class Roof Slope Mean Roof Height 22'-0" **Deflection Limitations** Floor Members Live

Dead+Live

7.0 STRUCTURAL STEEL

- Fabrication and erection of structural steel shall conform to "The Manual of Steel Construction", Fourteenth Edition, American Institute of Steel Construction (AISC) including Specifications for Structural Steel Buildings, Specification for Structural Joints Using ASTM A325 or A490 Bolts, and
- AISC Code of Standard Practice. All welding shall be performed by certified welders and shall conform to "Structural Welding Code
 - ANSI/AWS D1.1-92", American Welding Society (AWS). ASTM A992 or A572, Grade 50 Wide flange and S- shapes: ASTM A36 Structural C and L shapes & plates
 - ASTM A53, Grade B (35 ksi yield) Steel pipe: Steel tubing (square or rect.): ASTM A500, Grade B (46 ksi yield) Steel tubing (round): ASTM A501
- Galvanized structural steel Structural shapes and rods ASTM A123 ASTM A153

Bolts, fasteners and hardware

- Anchor rods shall conform to ASTM F1554, unless noted otherwise. Anchor bolts shall be headed with a nut and washer at the lower end.
- Steel members shown on plan shall be equally spaced unless noted otherwise All connections shall be "Framed Beam Connections" designed in accordance with the AISC Manual and the ends reactions from the "Uniform Load Tables", but not less than 6 kips. Provide double angle connections or knife plates connections for full depth of supporting beam, unless otherwise approved. Minimum two (2) bolts per connection. Unless otherwise noted, composite beams to be designed for

80 percent of the "total" uniform load capacity. Single angle connections are not acceptable. All beam

combination with a 10 kip axial force (acting in both tension and compression). The Fabricator shall be responsible for the design and adequacy of all connections that are not designed or fully detailed on the Contract Documents. Shop Drawings, depicting the configuration and fabrication details, along with calculations sealed by a Registered Professional Engineer licensed to practice in the state in which the project is located, shall be submitted to the structural Engineer of Record for review.

to column connections shall be designed for the minimum shear reaction indicated above in

- 14. All bolted connections shall be with ASTM A325 high strength bolts, 3/4" minimum diameter, unless
- noted otherwise. Field test bolted connections and shear studs in accordance with AISC. Where possible, all bolt holes in structural steel shall be drilled or punched in the shop. Any holes
- required to be made a the project site shall be mechanically drilled or punched. No burning of holes All connections shall be symmetrical about the axis of the member connected. Provide only one grade
- of bolt for each bolt diameter to be used in the connections. Do not mix grades of bolts.
- Unless noted otherwise, all cap and base plates shall be welded to the columns continuously all around with a 1/4" fillet weld
- Welding electrodes shall be E70XX for manual arc welding and F7X-EXXX for submerged arc welding. All welders shall be certified by the AWS. Minimum weld size shall be 3/16" unless noted otherwise.
- Existing framing requiring welding shall be thoroughly cleaned to ensure proper welding. Provide temporary shoring when welding to existing steel.
- Use low-hydrogen electrodes when welding to existing steel Field welded surfaces within 4 inches of weld shall be cleaned and ground smooth. After welding coat the exposed area with appropriate primer/paints as specified.
- Visually inspect all fillet welds. 10 percent of all field fillet welds in primary connections and multi-pass welds shall be tested by the magnetic particle method, complying with ASTM E709, performed on the root pass and on the finished weld.
- 100 percent of full penetration welds shall have ultrasonic inspection, complying with ASTM E164. 100 percent of welds in beam and column moment connections shall have ultrasonic inspection,
- complying with ASTM E164. Unless noted otherwise, every weld shall develope the full strength of the lesser of the members it joints. All butt, groove, or bevel welds shall be complete, full pentration.
- Erector shall provide a Ceritfied Welding Inspector and Quality Control Expert (AWS Certified). Submit shop drawings for fabrication and erection of structural steel. Clearly indicate coordinated dimensions of mechanical unit and roof penetration sizes. Shop and Erection drawings must show all shop/floor and field welds. Initial shop drawing submittal shall include proposed connection details and
- job standards. Provide signed and sealed calculations for all non-standard connection details showing design capacities. Splices in structural steel not shown on the structural drawings will not be accepted withough specific
- approval of the Structural Engineer. The General Contractor and Steel Erector shall notify the Structural Engineer of any fabrication or
- erection errors or deviations and receive written approval before any field corrections are made. Alternate connection details may be used if such details are submitted to the engineer for review and approval. However, the engineer shall be the sole judge of acceptance and the Contractor's bid shall anticipate the use of those details shown on the drawings. The Contractor is responsible for the
- design of such alternate details which he proposes. Main support members for the metal deck are shown. During preparation, submission, and review of shop drawings, any additional angles or miscellaneous attachment details required to support the
- metal deck at the required elevation shall be provided by the Structural Steel Contractor. All steel shall be painted with shop standard primer unless noted otherwise. Steel angles and plates along with bolts and washers, in direct contact with exterior finish masonry.
- and all exterior exposed structural steel, shall be hot-dipped galvanized per ASTM A123 and A153. Spandrels and columns adjacent to masonry shall have adjustable masonry ties. Use low-hydrogen electrodes when welding to existing steel
- The steel structure is a non-self-supporting steel frame and is dependent upon diaphragm action of the metal roof deck and attachment to the masonry walls for stability and for resistance to wind and seismic forces. Provide all temporary supports required for stability and for resistance to wind and seismic forces until these elements are complete and are capable of providing this support.
- All dissimilar metals shall be treated or properly separated to prevent galvanic and/or corrosive All handrails shall be designed per IBC Chapter 16 including a 200 lb concentrated point load and, in public spaces, a 50 pound per linear foot line load. See Chapter 16 for all design requirements for
- handrails. Stamped calculations by an Engineer licensed in the State where the project is located shall be provided by the Fabricator. All vehicle barriers shall be design per IBC Chapter 16 including a 6000 lb concentrated point load. See Chapter 16 for all design requirements for vehicle barriers. Stamped calculations by an Engineer licensed in the State where the project is located shall be provided by the Fabricator.

GENERAL CONTRACTOR

ABBREVIATIONS

ADDITIONAL

GAUGE

GRADE BEAM

AB	ANCHOR BOLT	HT	HEIGHT
&	AND	Н	HIGH
ARCH	ARCHITECTURAL	HK	HOOK
BM	BEAM	HORIZ	HORIZONTAL
BS	BOTH SIDES	IF	INSIDE FACE
B, BOTT	BOTTOM	INSUL	INSULATION
BOS	BOTTOM OF STEEL	JT	JOINT
BP	BASE PLATE	Ĺ	ANGLE
CANT	CANTILEVERED	LF	LAID FLAT
C	CENTER LINE	LG	LONG
CG	CENTER OF GRAVITY	LLH	LONG LEG HORIZONTAL
C/C	CENTER TO CENTER	LLV	LONG LEG VERTICAL
CLR	CLEARANCE, CLEAR	MANUF	MANUFACTURER
COL	COLUMN	MAX	MAXIMUM
CONC	CONCRETE	MECH	MECHANICAL
CMU	CONCRETE MASONRY UNITY	MTL	METAL
CONN	CONNECTION	MIN	MINIMUM
CONT	CONTINUOUS	MO	MASONRY OPENING
COORD	COORDINATE	NS	NON SHRNK
DEFL	DEFLECTION	OC	ON CENTER
DTL	DETAIL	OH	OPPOSITE HAND
DIAG	DIAGONAL	OF	OUTISDE FACE
DIA, Ø	DIAMETER	PC	PIECE
DIM	DIMENSION	PL	PLATE
DWLS	DOWELS	PAF	POWDER ACUTATED FASTENER
DN	DOWN	QTY	QUANTITY
DWG, DWGS		REINF	REINFORCING
EA	EACH	REQ'D	REQUIRED
EF	EACH FACE	SCHD	SCHEDULE
EW	EACH WAY	SOG	SLAB ON GRADE
EOS	EDGE OF CONCRETE SLAB	SQ	SQUARE
EL, ELEV	ELEVATION	STD	STANDARD
EMBED	EMBEDMENT	STL	STEEL
EQ	EQUAL	STIFF	STIFFENER
EQUIP	EQUIPMENT	TRANS	TRANSVERSE
EX, EXIST	EXISTING	T	TOP
EXP	EXPANSION	TOSL	TOP OF CONCRETE SLAB
EXT	EXTERIOR	TOS	TOP OF STEEL
FS	FAR SIDE	TYP	TYPICAL
FIN	FINISH	UN, UNO	UNLESS NOTED OTHERWISE
FL, FLR	FLOOR	VIF	VERIFY IN FIELD
FTG	FOOTING	VERT	VERTICAL
GALV	GALVANIZED	WWR, WWF	WELDED WIRE REINFORCEMET/FABRIC
0.4	044105	,	WITH

WD

WOOD **WORK POINT**




1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443 Nicholas Mannix, PE

woodward engineering group

WDG PROJECT NO IAR2315 CONSTRUCTION DOCUMENTS 04/15/2024

Pelicans Campus Improvements


5600 Airline Hwy Metairie LA

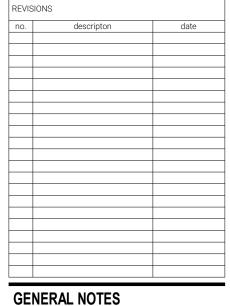

S0.00

DRAWN BY | Author



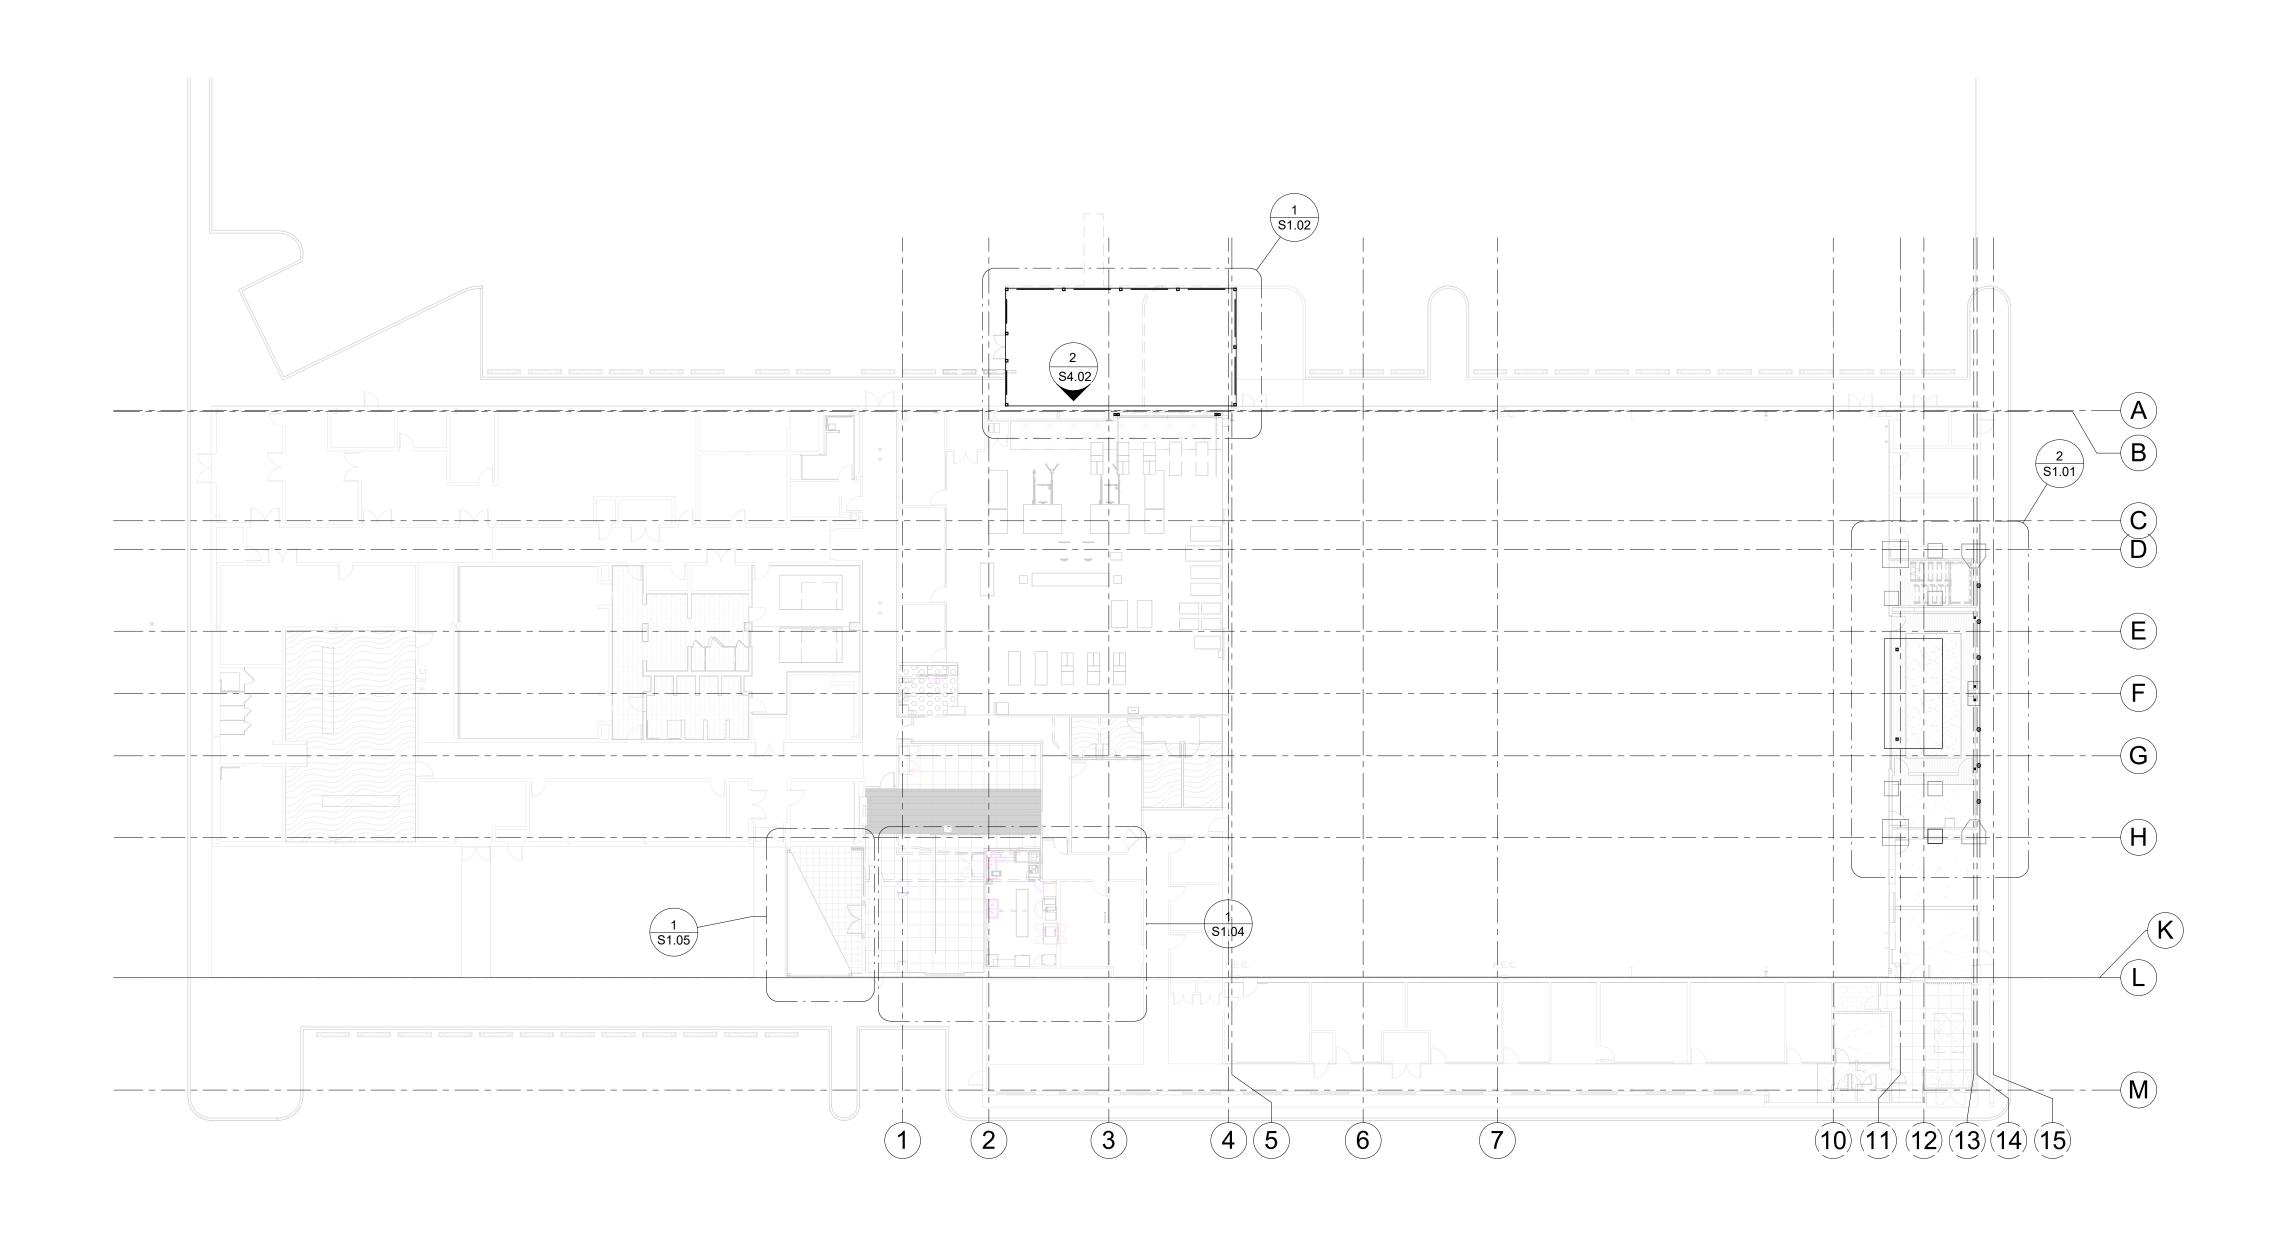

1 OVERALL PLAN S1.00 1" = 20'-0"

Pelicans Campus Improvements 5600 Airline Hwy Metairie LA

WDG PROJECT NO |AR2315

CONSTRUCTION DOCUMENTS 04/15/2024



no.	descripton	date
110.	descriptori	date
		_

OVERALL PLAN


DRAWN BY |Author \$1.00

FOUNDATION AND GROUND FLOOR PLAN NOTES

- 1. EXISTING GROUND FLOOR SLAB ELEVATION IS REFERENCED AS DATUM FI EVATION 0'-0"
- 2. TOP OF SLAB ELEVATION IS AT DATUM UNLESS NOTED THUS X'-XX" ON PLAN
- 3. BOTTOM OF BASE PLATE ELEVATIONS IS -0'-6" UNLESS NOTED THUS X'-XX"
- 4. SEE DRAWINGS S0.00 AND S0.01 FOR GENERAL NOTES AND TYPICAL DETAILS
- 5. PROVIDE VAPOR RETARDER BELOW SLAB
- 6. COORDINATE SLAB DEPRESSIONS, EMBEDMENT REQUIREMENTS AND OPENING WITH ARCH AND MEP DWGS
- 7. COORD ALL NEW AND EXISTING UNDERGROUND UTILITIES WITH FOUNDATIONS AND SUBIT ALL PURPOSED SLEEVE LOCATION TO ARCH / ENG
- 8. EXISTING SLAB AND PILES TO REMAIN UNO


FRAMING PLAN NOTES


- 1. TOP OF MEZZANINE SLAB ELEVATION =10'-0".
- 2. TOP OF STEEL ELEVATION IS 9'-6 1/2" U.N.O.
- 3. SEE DRAWING S0.00 FOR GENERAL NOTES.
- 4. SEE DRAWINGS S0.01 FOR TYPICAL DETAILS.
- 5. DENOTES SPAN OF 3 1/2" LIGHTWEIGHT CONCRETE ATOP 2" DEEP-18GAUGE COMPOSITE STEEL FLOOR DECK (5 1/2" TOTAL THICKNESS) REINFORCED WITH 6X6-W2.0xW2.0.

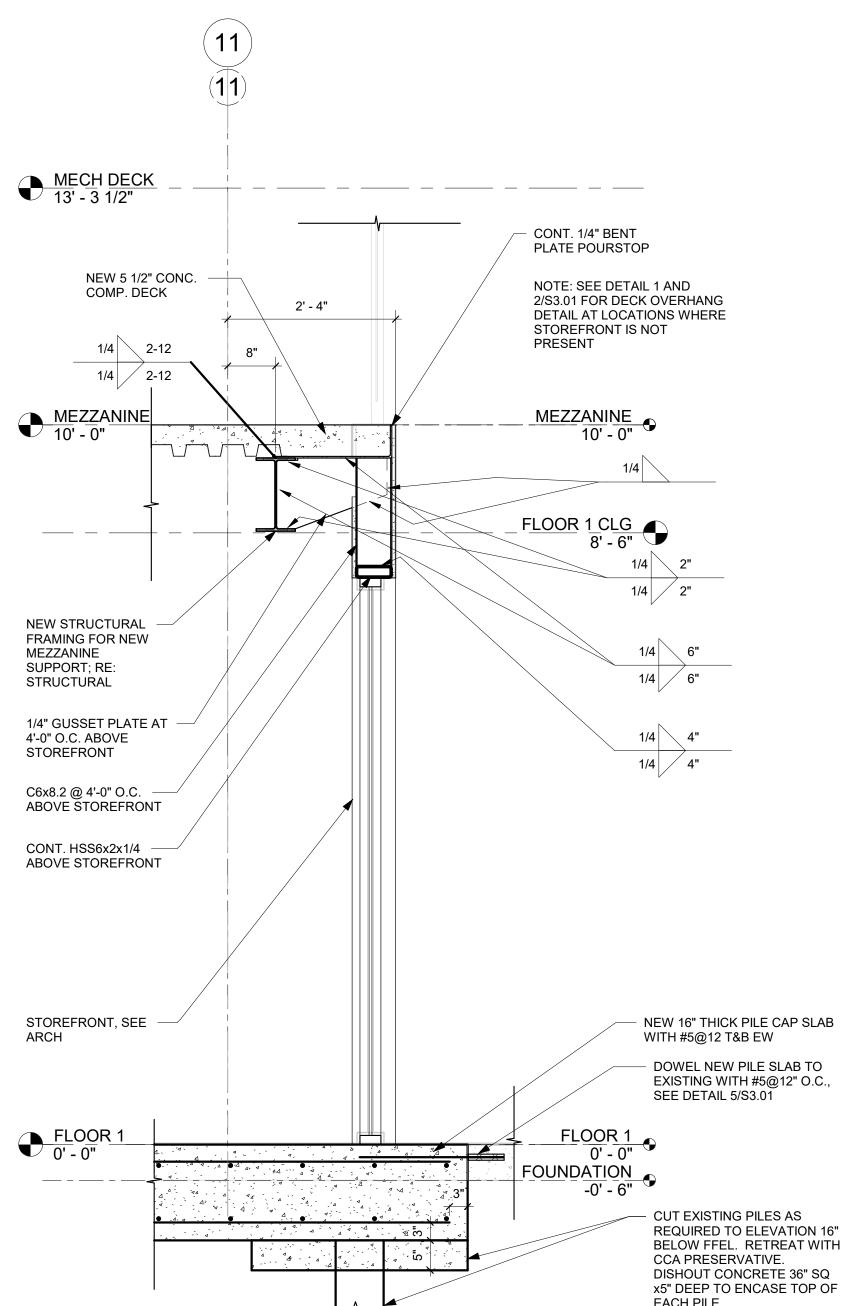

1 MEZZANINE SECTION ABOVE STOREFRONT

S1.01 3/4" = 1'-0"

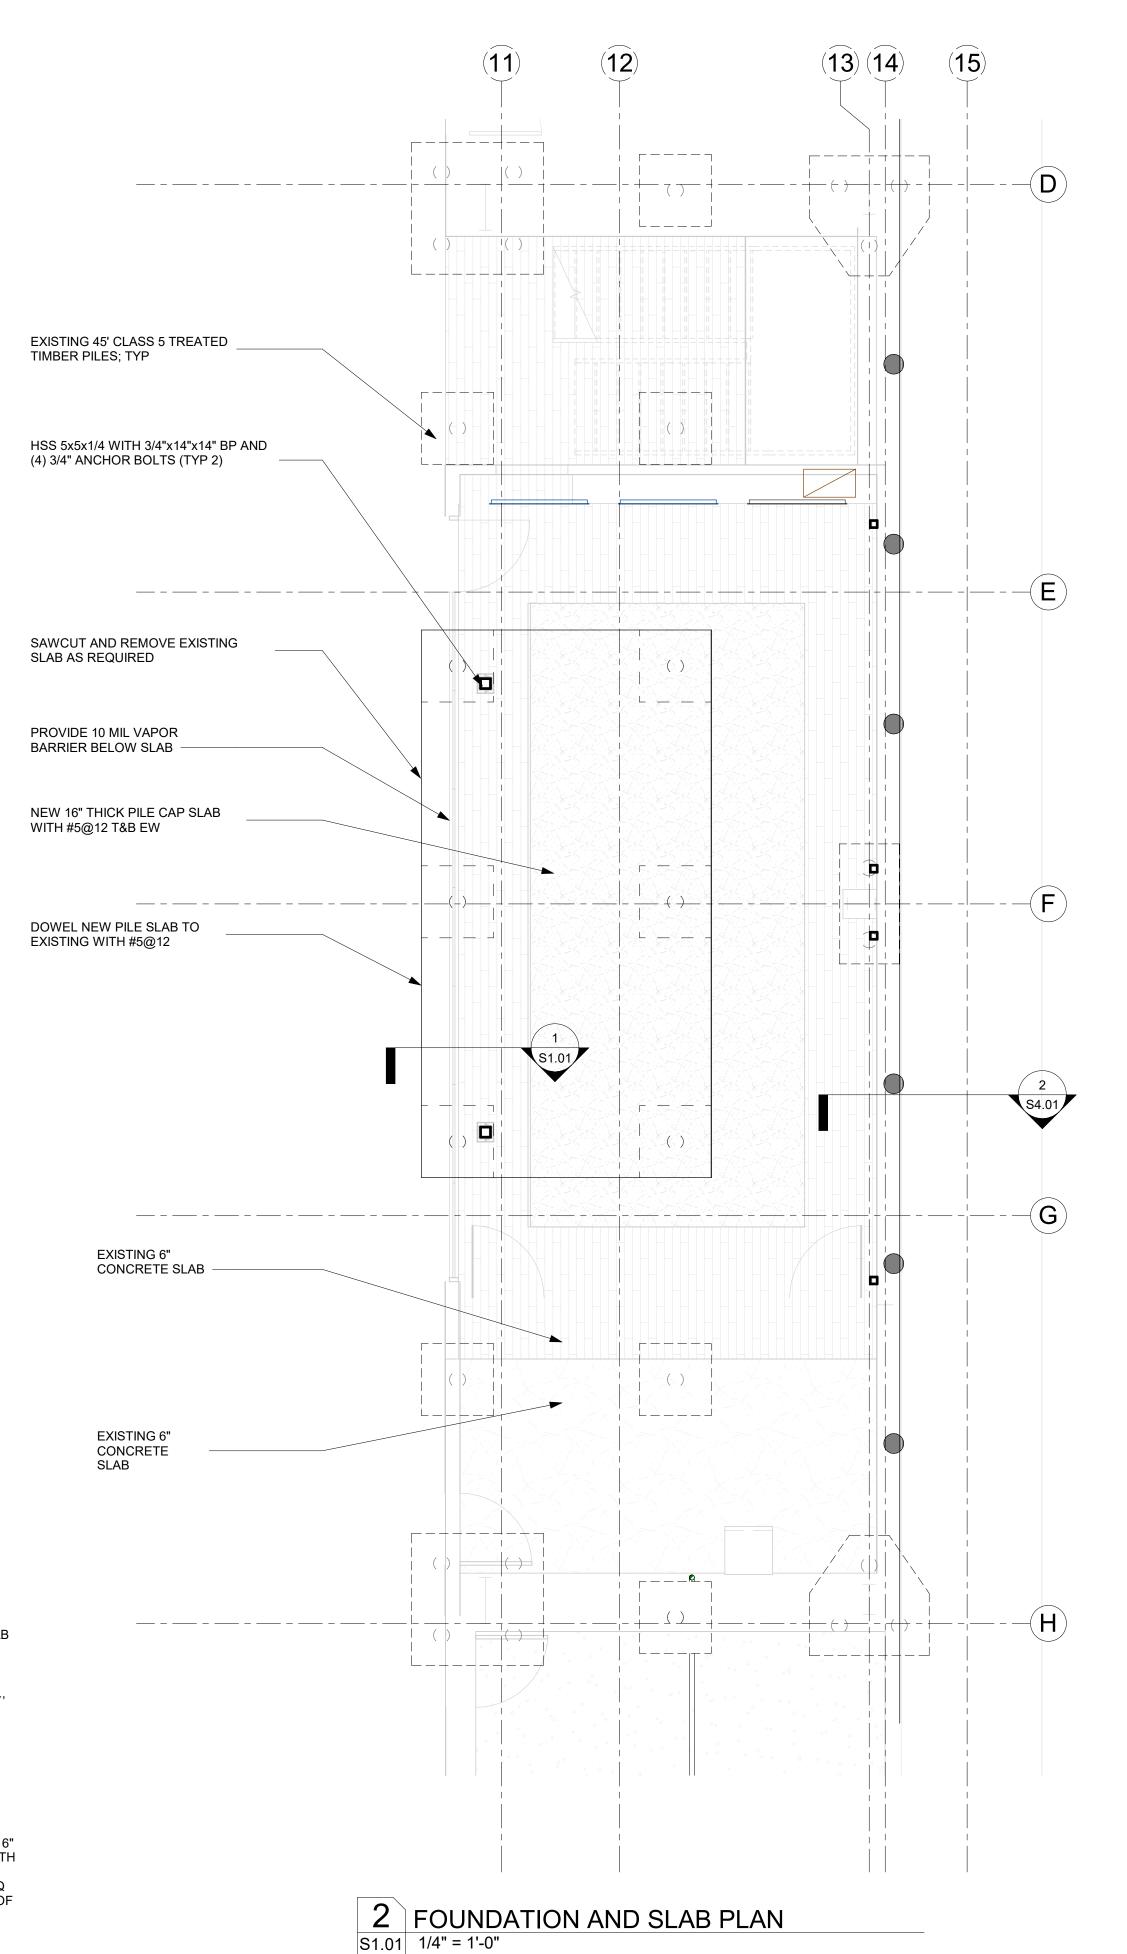

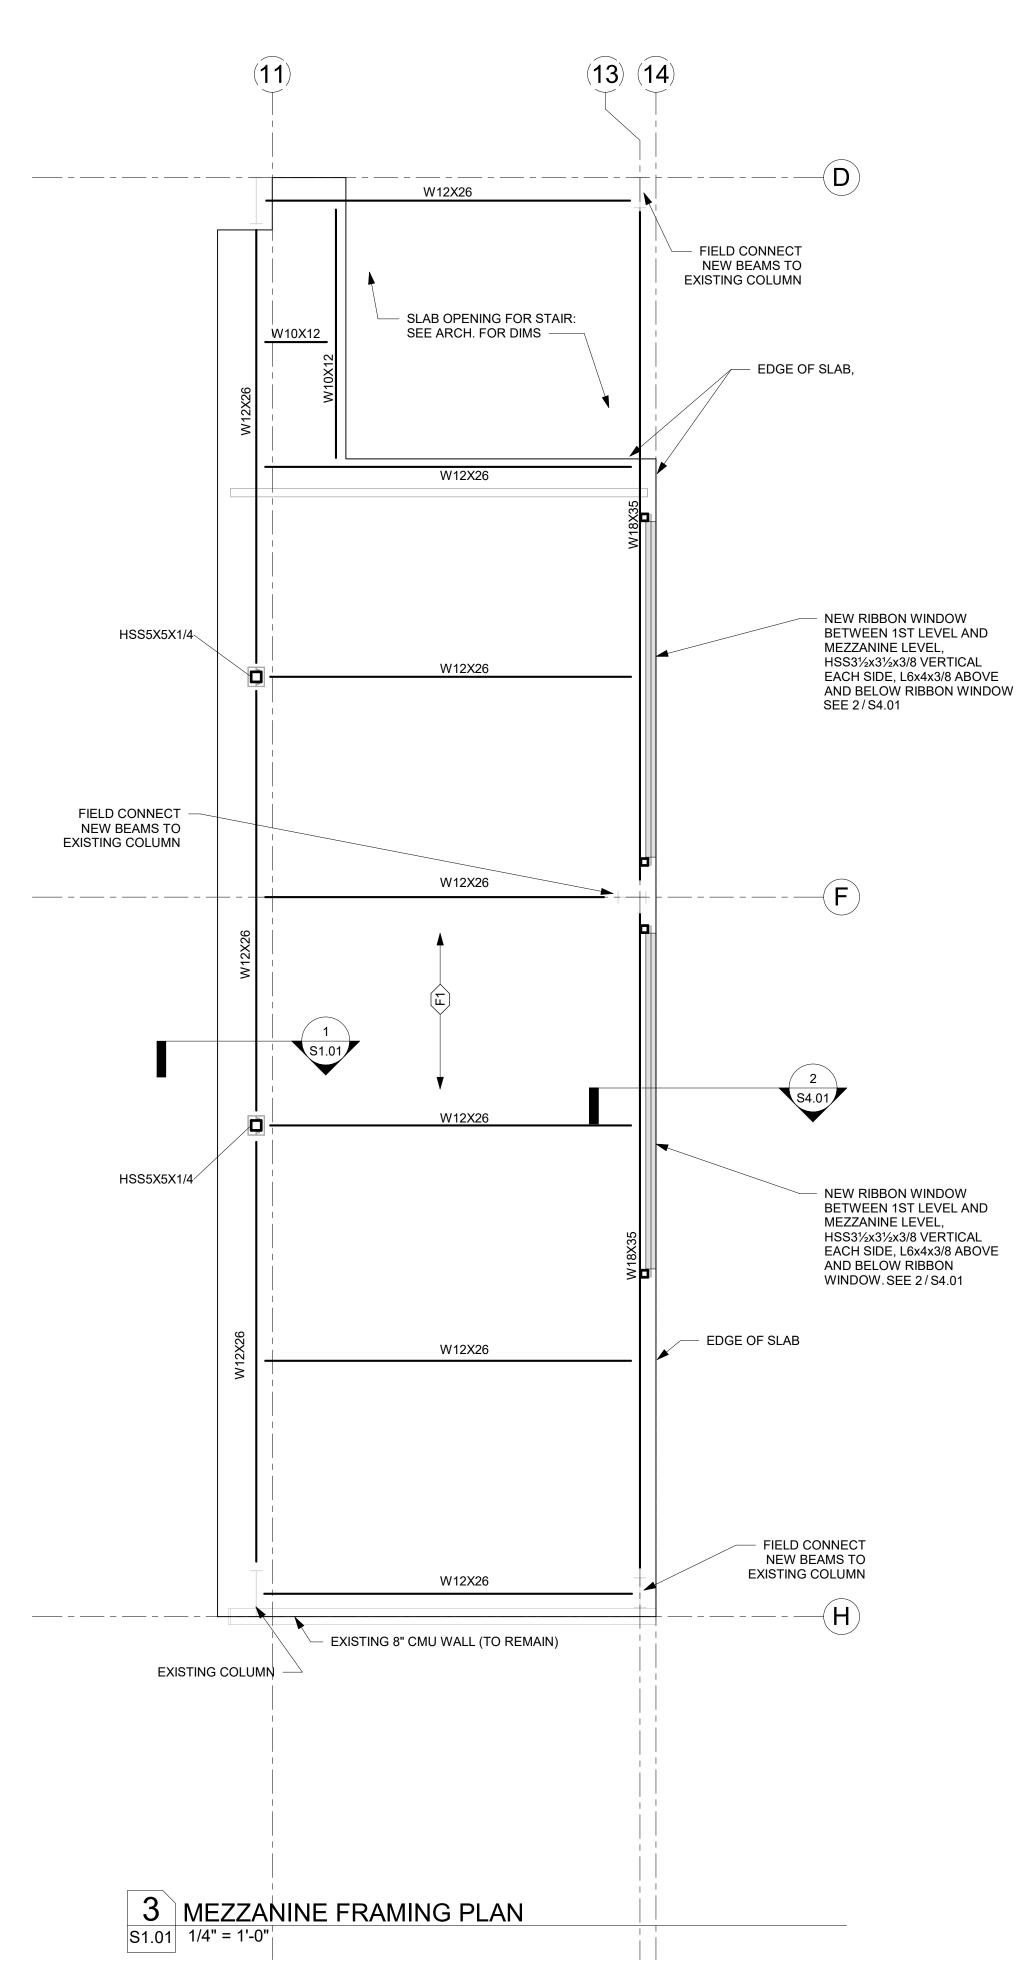



woodward engineering group

1000 S. NORMAN C. FRANCIS PARKWAY
NEW ORLEANS, LA 70125
WOODWARDDESIGNBUILD.COM | 504-822-6443

Nicholas Mannix, PE


Pelicans Campus Improvements 5600 Airline Hwy Metairie LA

WDG PROJECT NO |AR2315

CONSTRUCTION DOCUMENTS 04/15/2024

NOTFORTION

DRAWN BY | WEG \$1.01

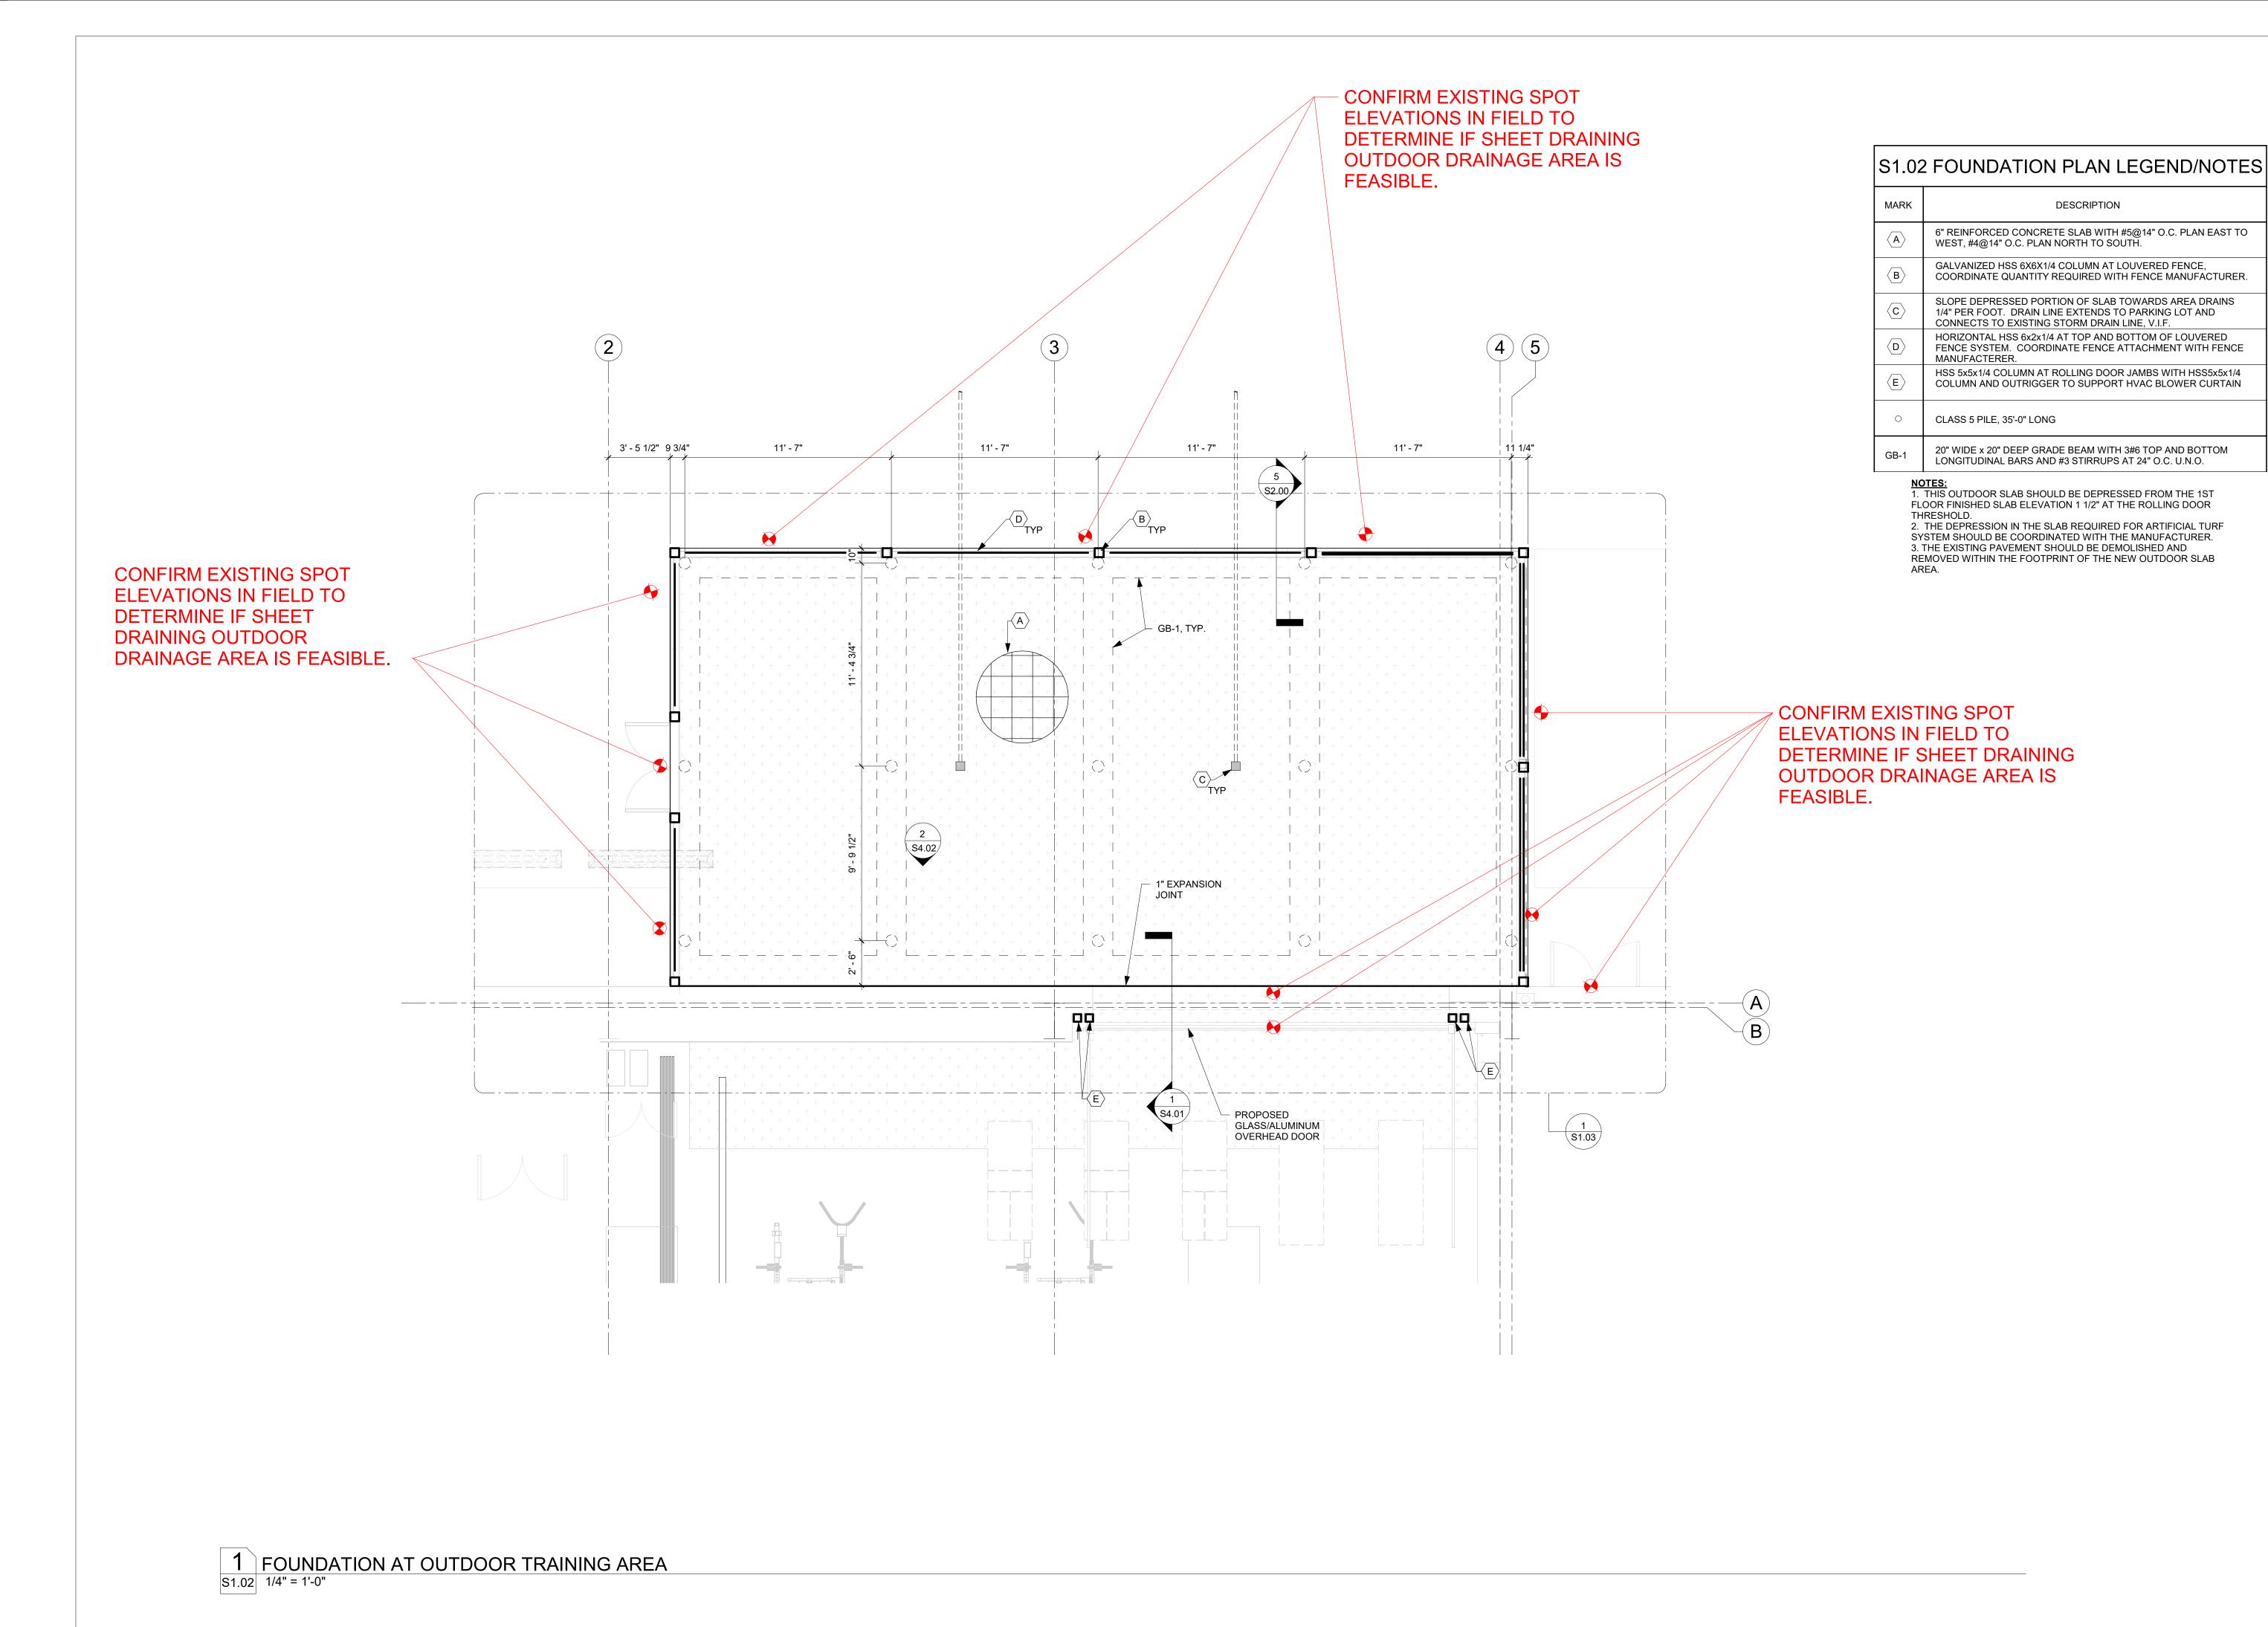



1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443 Nicholas Mannix, PE


Pelicans Campus Improvements

WDG PROJECT NO |AR2315 CONSTRUCTION DOCUMENTS 04/15/2024


no.	descripton	dat
110.	descriptori	dut
		+
		+
		_
		_

FOUNDATION AT OUTDOOR

DRAWN BY | WEG \$1.02

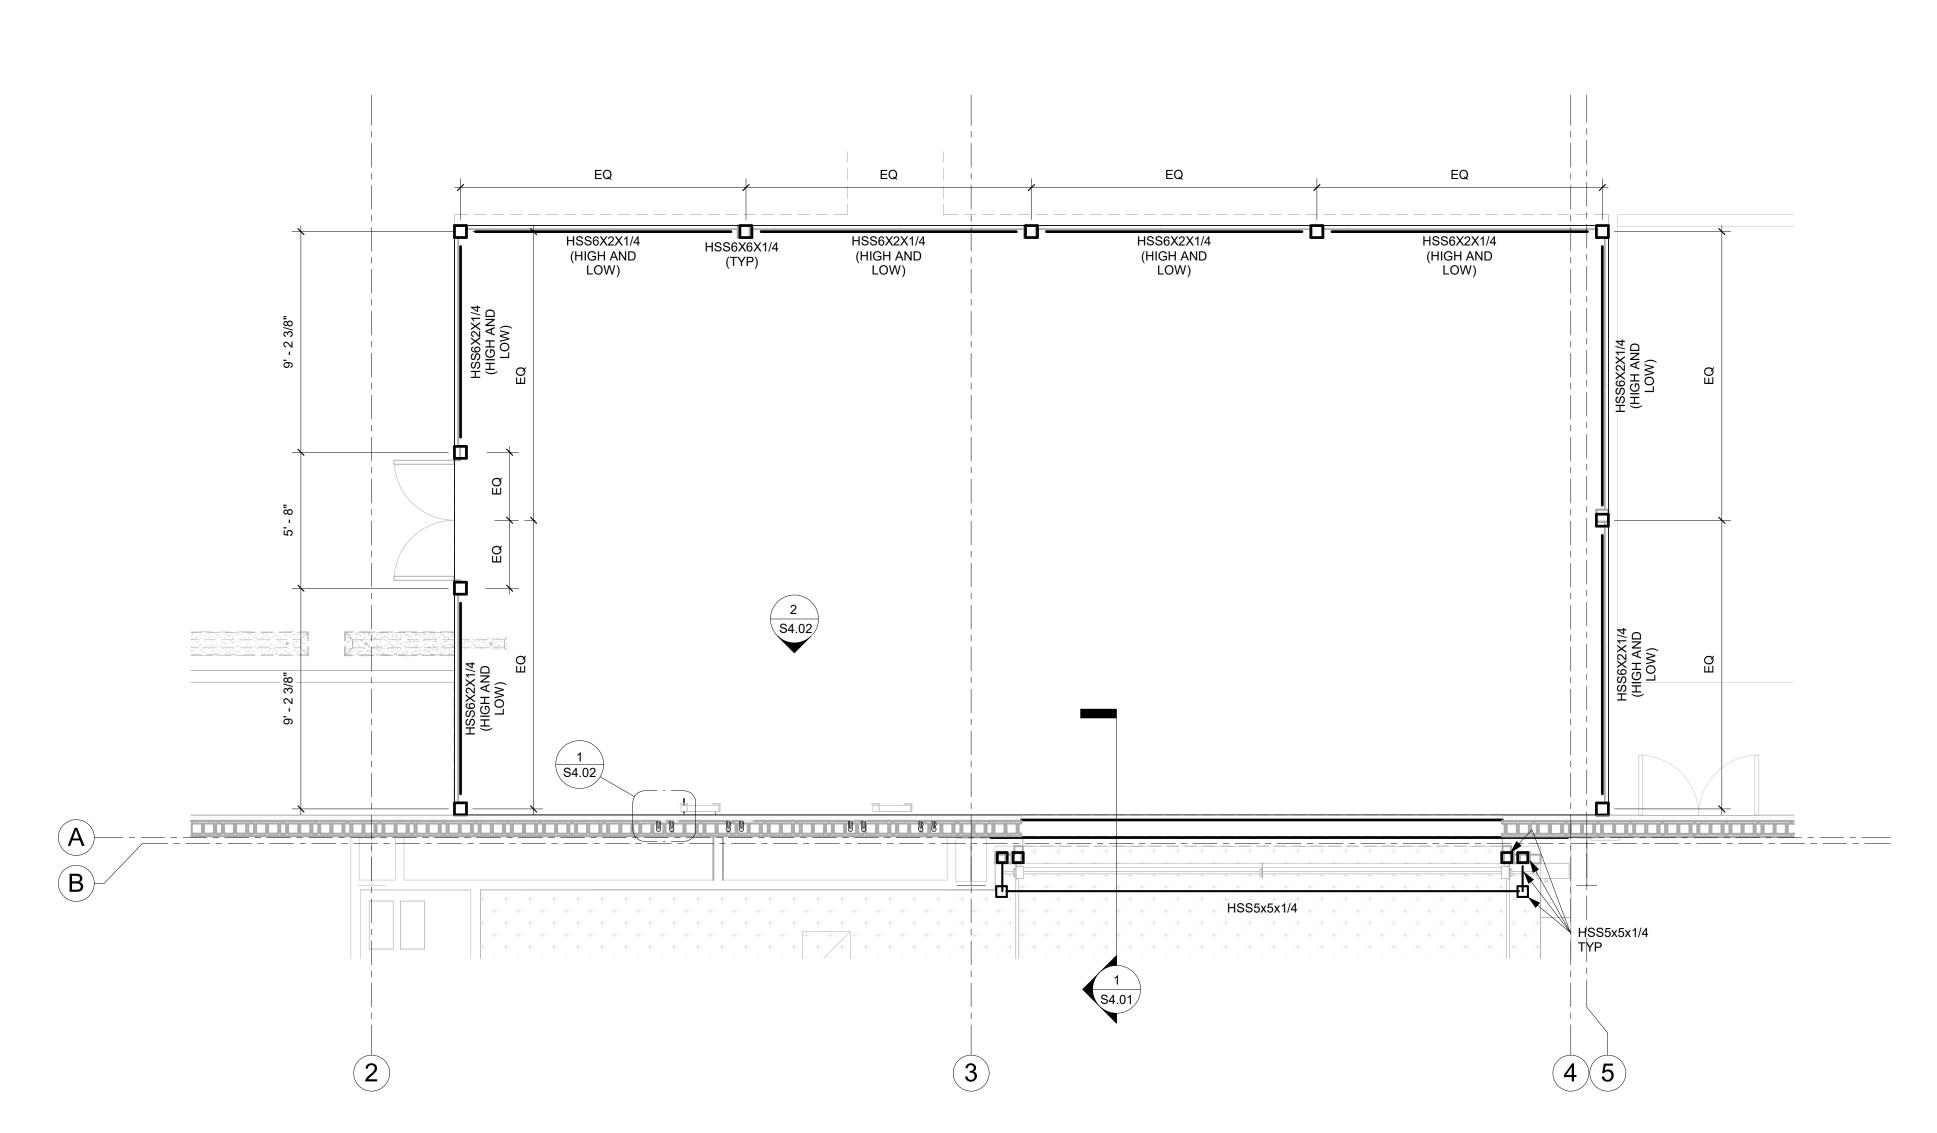

1 FRAMING PLAN AT OUTDOOR FENCE AND OVERHEAD DOOR
S1.03 1/4" = 1'-0"

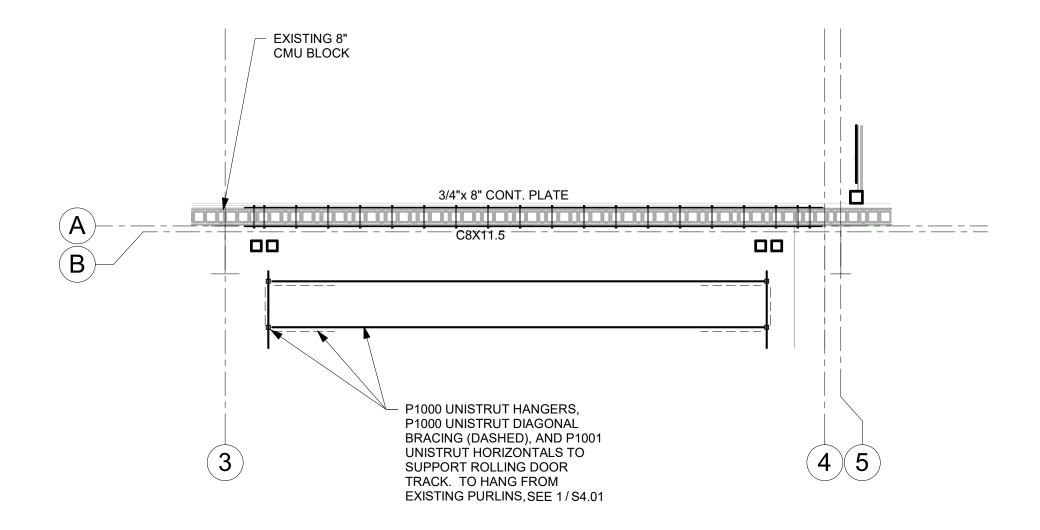

2 ABOVE NEW OPENING @ SECTIONAL DOOR S1.03 1/4" = 1'-0"



woodward engineering group

1000 S. NORMAN C. FRANCIS PARKWAY
NEW ORLEANS, LA 70125
WOODWARDDESIGNBUILD.COM | 504-822-6443 Nicholas Mannix, PE


Pelicans Campus Improvements 5600 Airline Hwy Metairie LA


WDG PROJECT NO |AR2315 CONSTRUCTION DOCUMENTS 04/15/2024

	4	1-4
no.	descripton	date


FRAMING PLAN AREA B


DRAWN BY | Author \$1.03

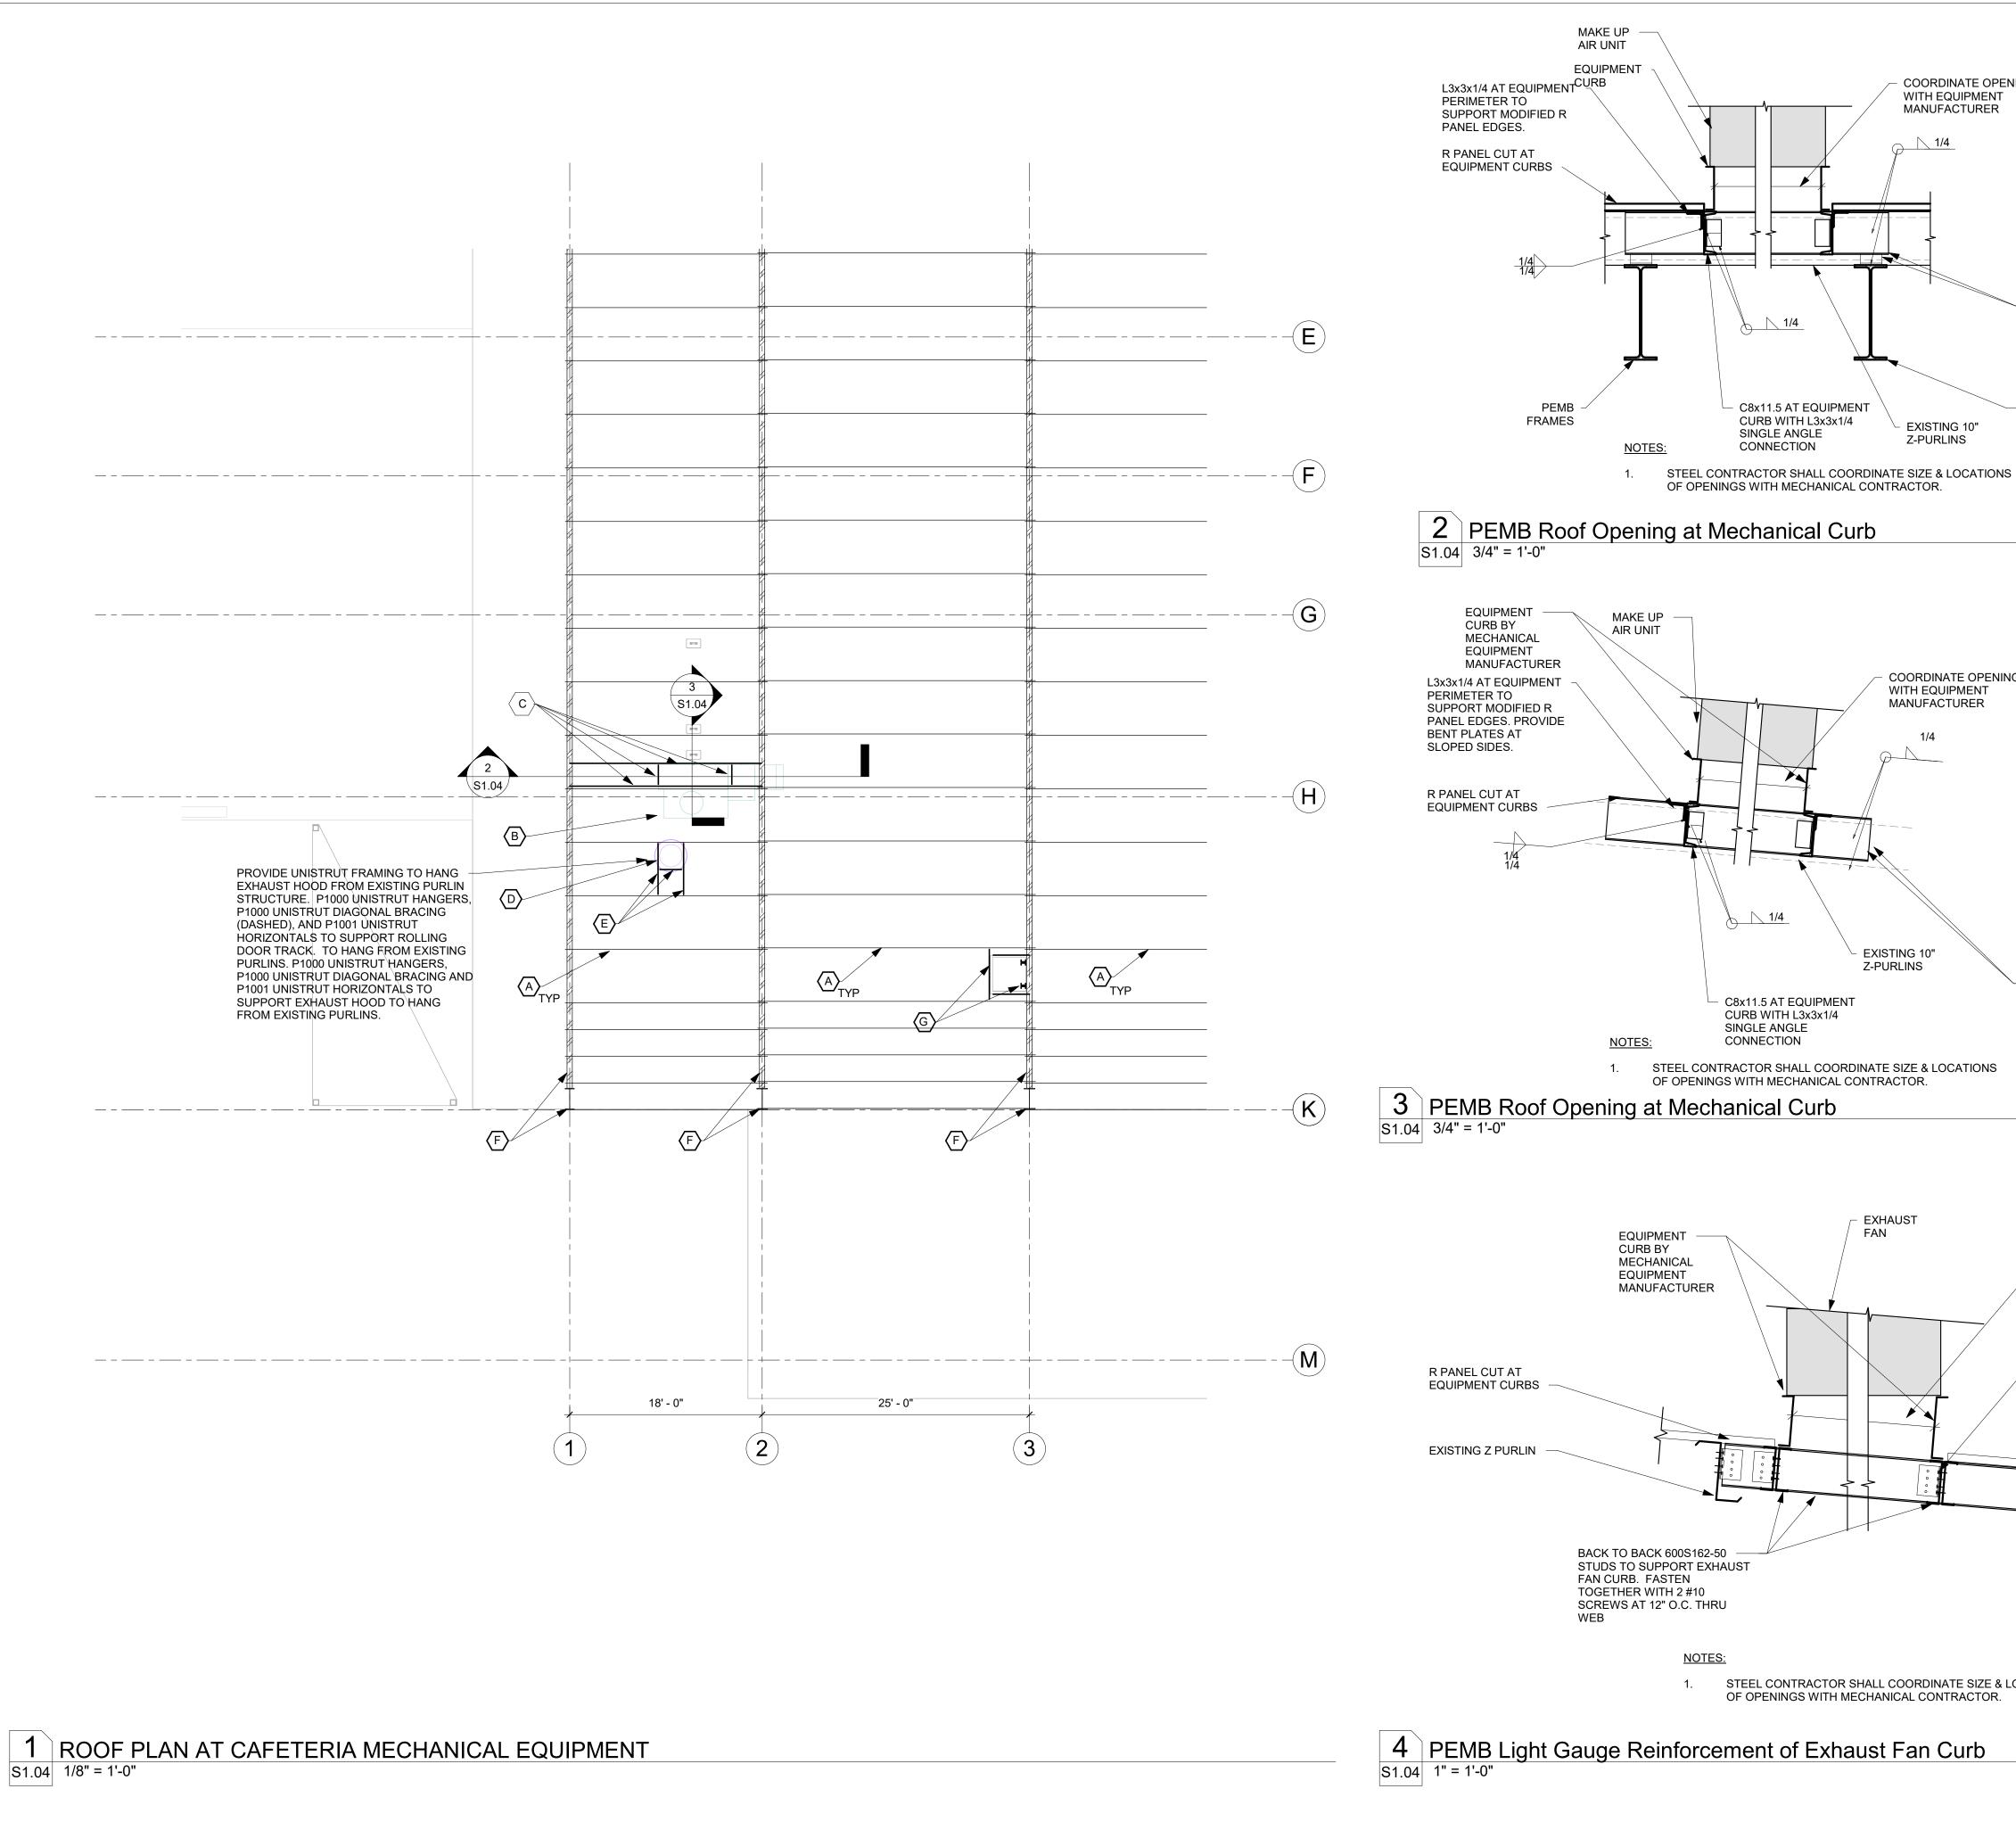

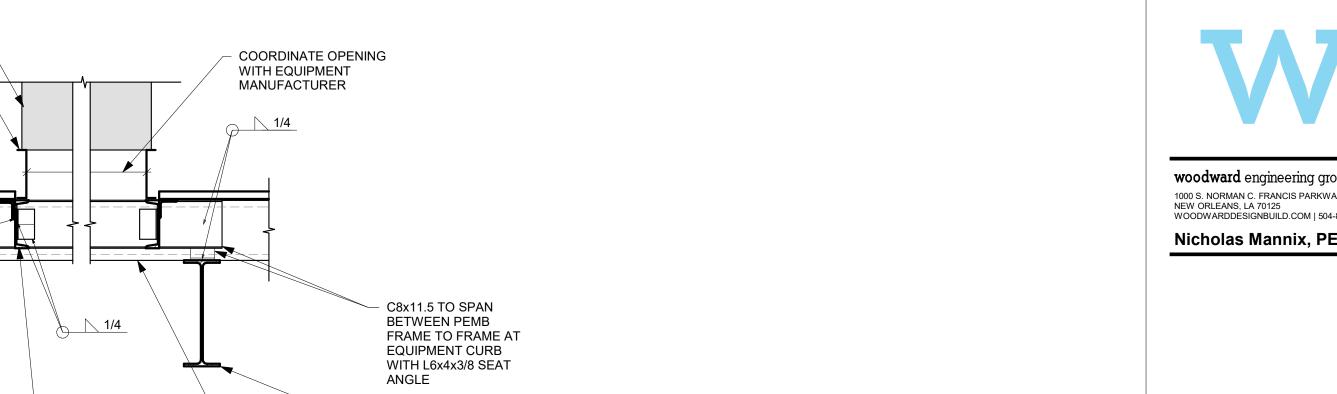

FRAMES

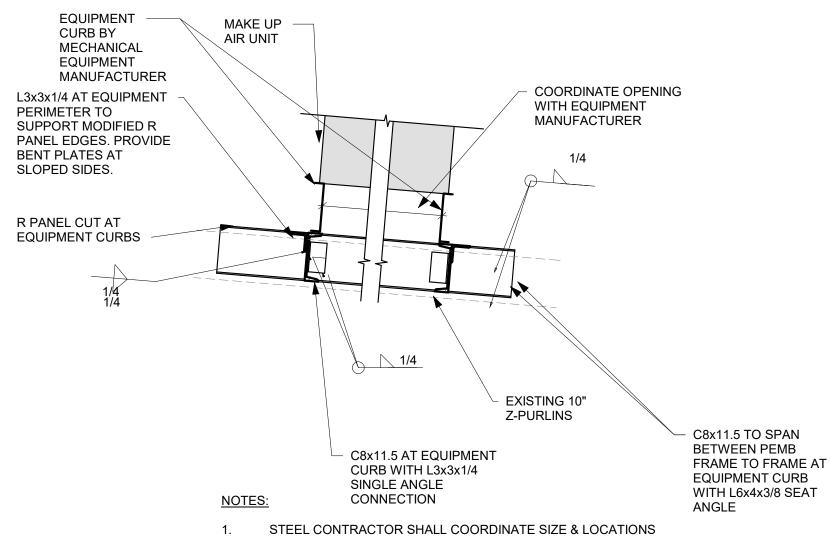

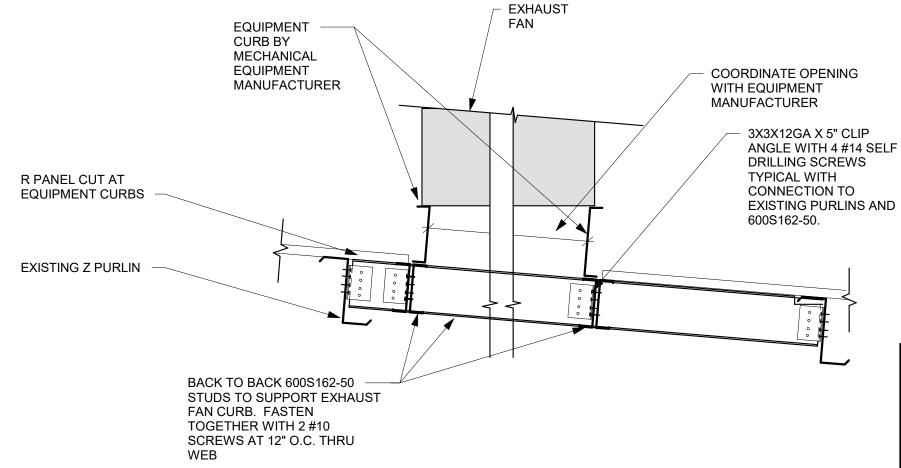

STEEL CONTRACTOR SHALL COORDINATE SIZE & LOCATIONS OF OPENINGS WITH MECHANICAL CONTRACTOR.

S	31.04 ROOF PLAN LEGEND/NOTES
ARK	DESCRIPTION
A	EXISTING 10" Z PURLINS. VERIFY EXISTING PURLIN LOCATIONS IN THE FIELD, APPROXIMATE LOCATIONS DEPICTED.
В	TEMPERED MAKE UP AIR UNIT, APPROXIMATELY 1200 LBS. VERIFY WITH MECHANICAL PRIOR TO PROCUREMENT OF STRUCTURAL REINFORCEMENT MEMBERS

C8X11.5 FROM PEMB FRAME TO FRAME BENEATH THE PERIMETER OF THE TEMPERED MAKE UP AIR UNIT AT UNDERSIDE OF EQUIPMENT CURB. BELT DRIVE UPBLAST CENTRIFUGAL ROOF EXHAUST FAN, APPROXIMATELY 160 LBS. VERIFY WITH MECHANICAL PRIOR TO PROCUREMENT OF STRUCTURAL REINFORCEMENT MEMBERS. $\left\langle \mathbf{E}\right\rangle$

EXISTING PRE ENGINEERED METAL BUILDING FRAMES AND COLUMNS

(2)600S162-54 FROM EXISTING Z PURLIN TO Z PURLIN, (2)600S162-54 TO (2)600S162-54 BENEATH THE PERIMETER OF THE ROOF HATCH. PROVIDE VERTICAL (2)600S162-54 BETWEEN EXISTING MECHANICAL MEZZANINE AND ROOF STRUCTURE.

woodward engineering group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443 Nicholas Mannix, PE


Pelicans Campus Improvements 5600 Airline Hwy Metairie LA

WDG PROJECT NO |AR2315

CONSTRUCTION DOCUMENTS 04/15/2024

ROOF PLAN AT CAFETERIA MECHANICAL EQUIPMENT

S1.04

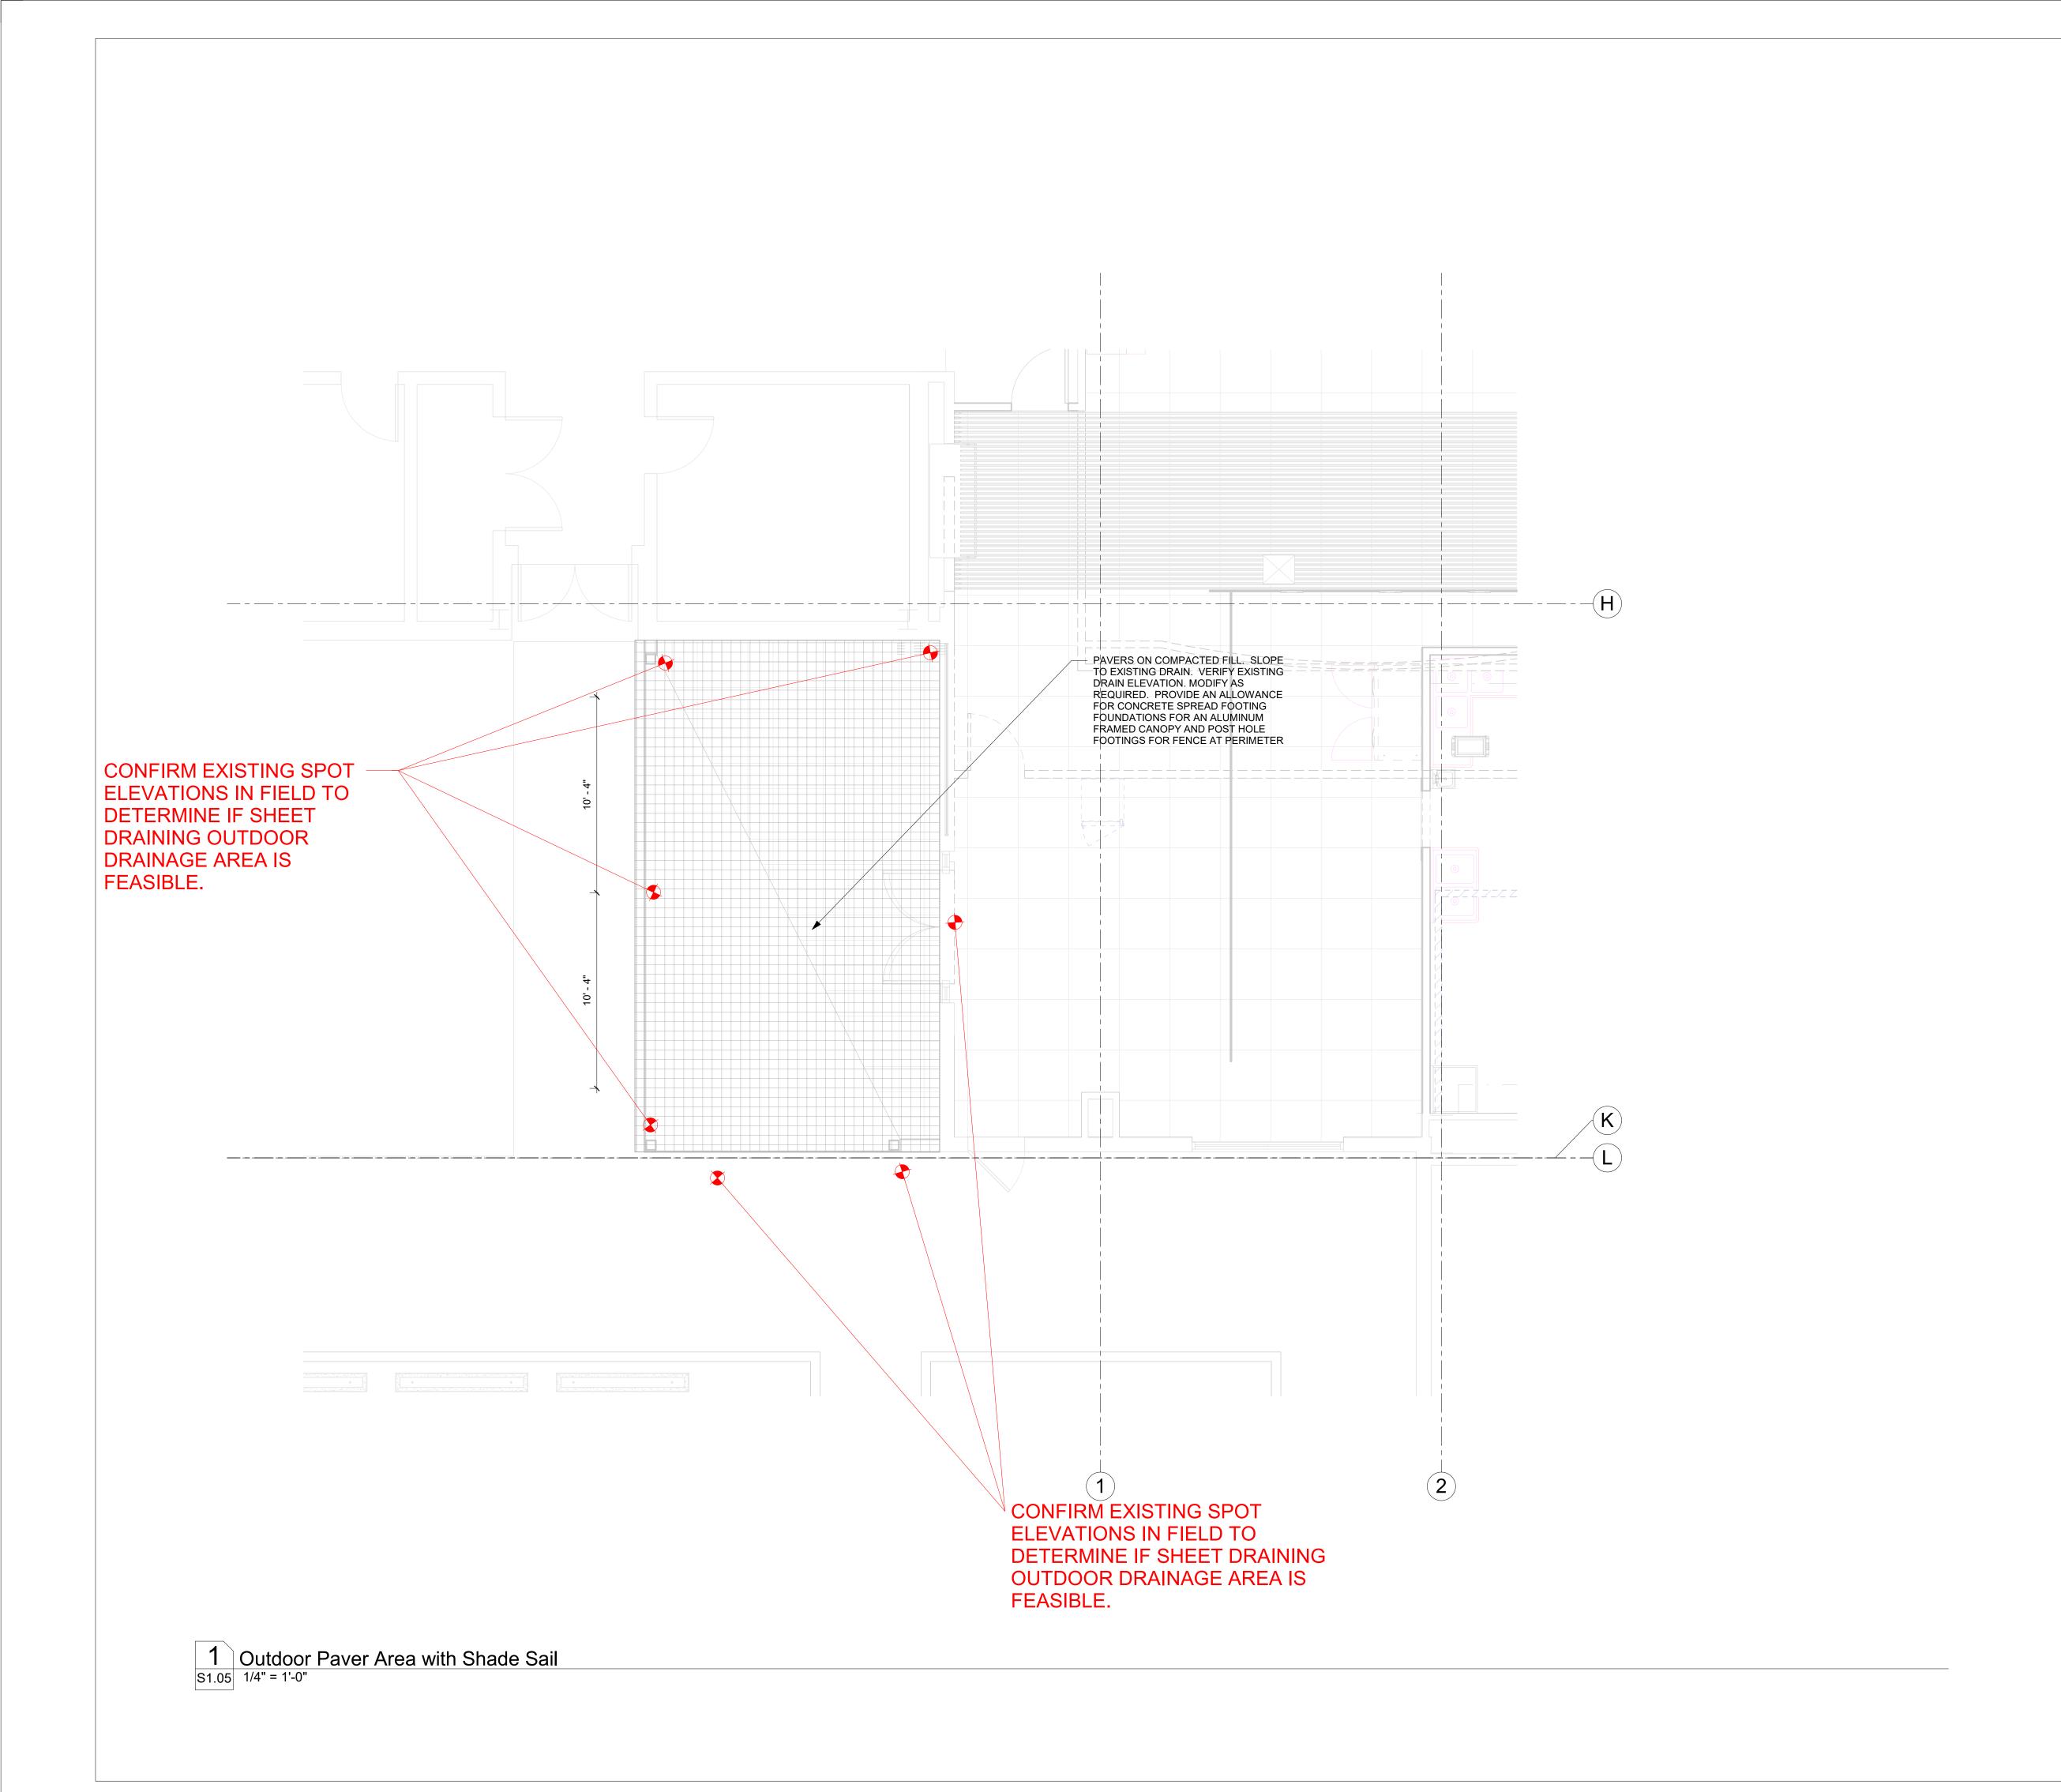




Nicholas Mannix, PE


Pelicans Campus Improvements 5600 Airline Hwy Metairie LA

WDG PROJECT NO |AR2315 CONSTRUCTION DOCUMENTS 04/15/2024


OUTDOOR PAVER AREA

DRAWN BY | Author \$1.05

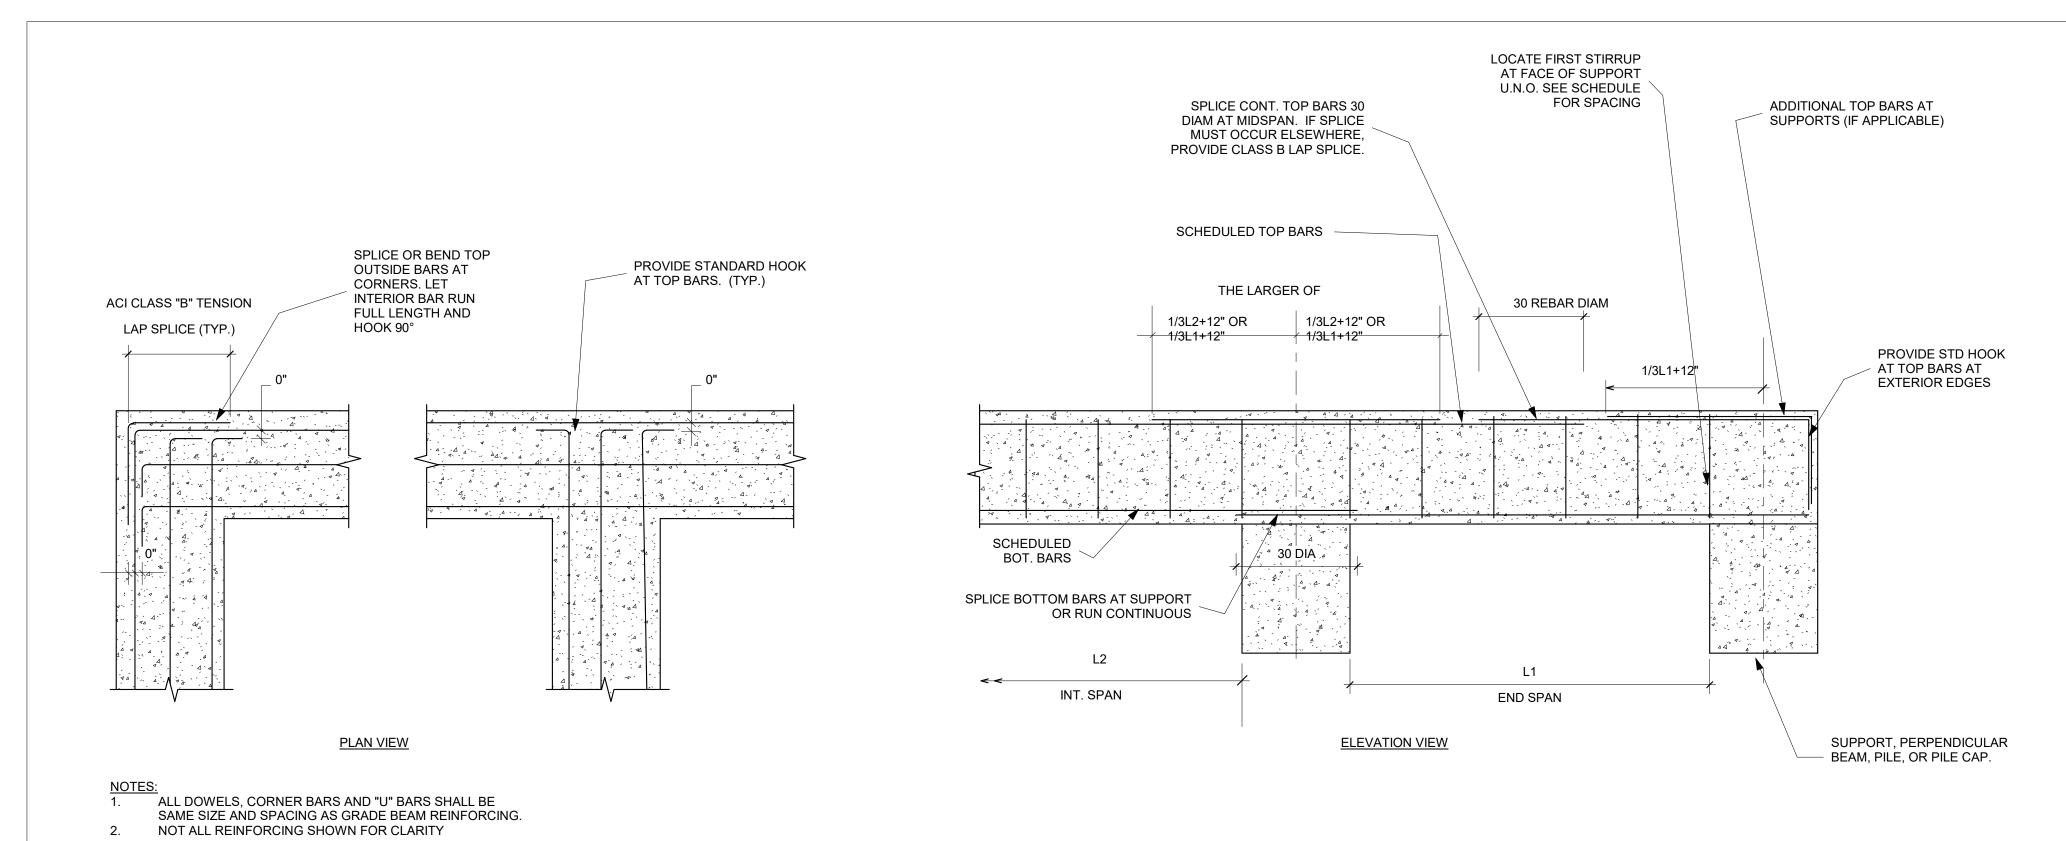

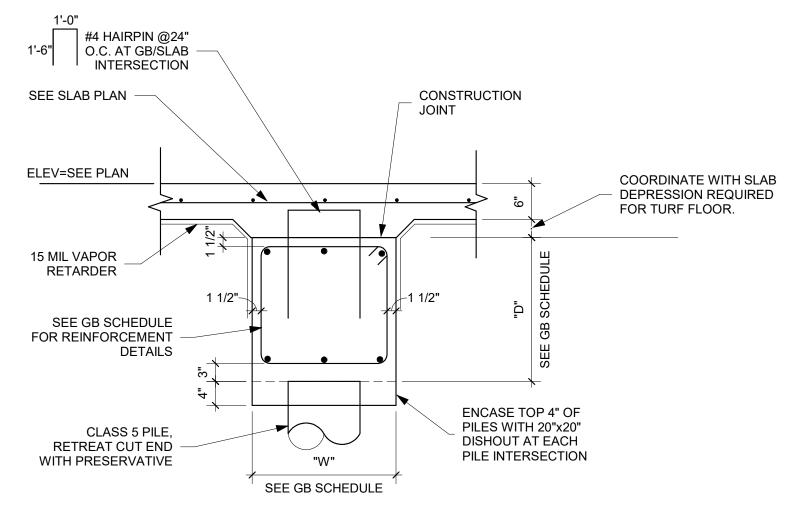



2 Typical Reinforced Concrete Grade Beam Section S2.00 3/4" = 1'-0"

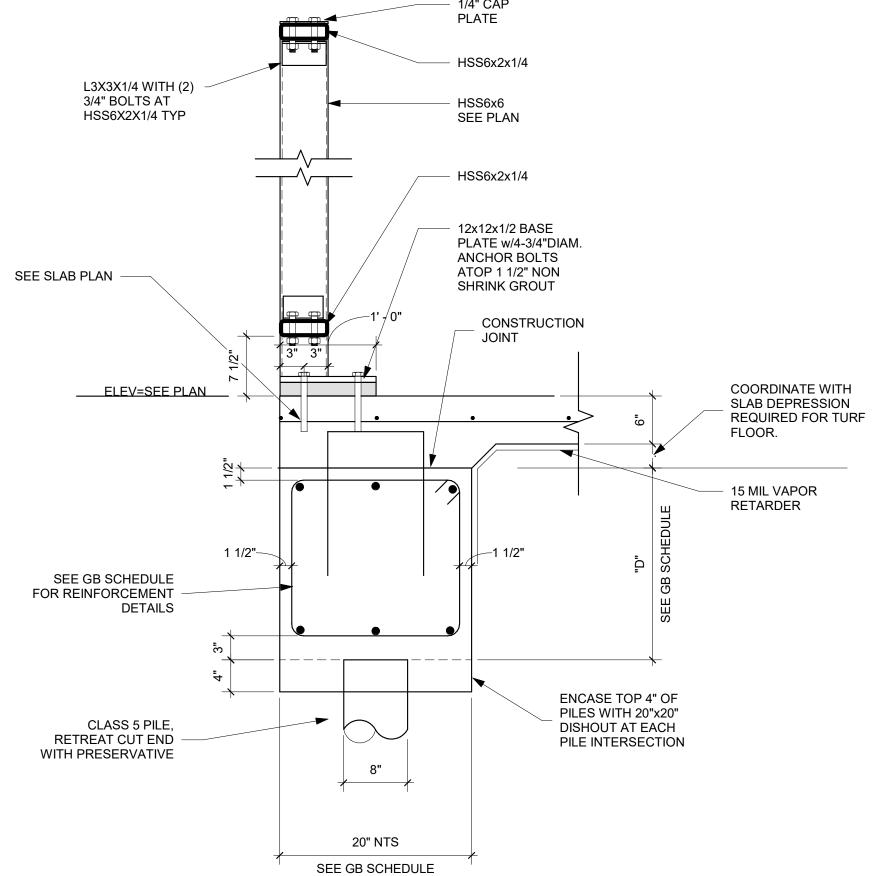

5 Typical Reinforced Concrete Grade Beam Section


S2.00 1" = 1'-0" FINAL CONDITION SHALL BE HOT DIPPED GALVANIZED.

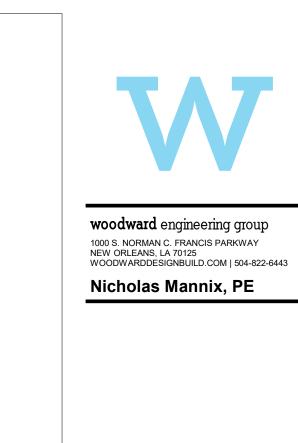

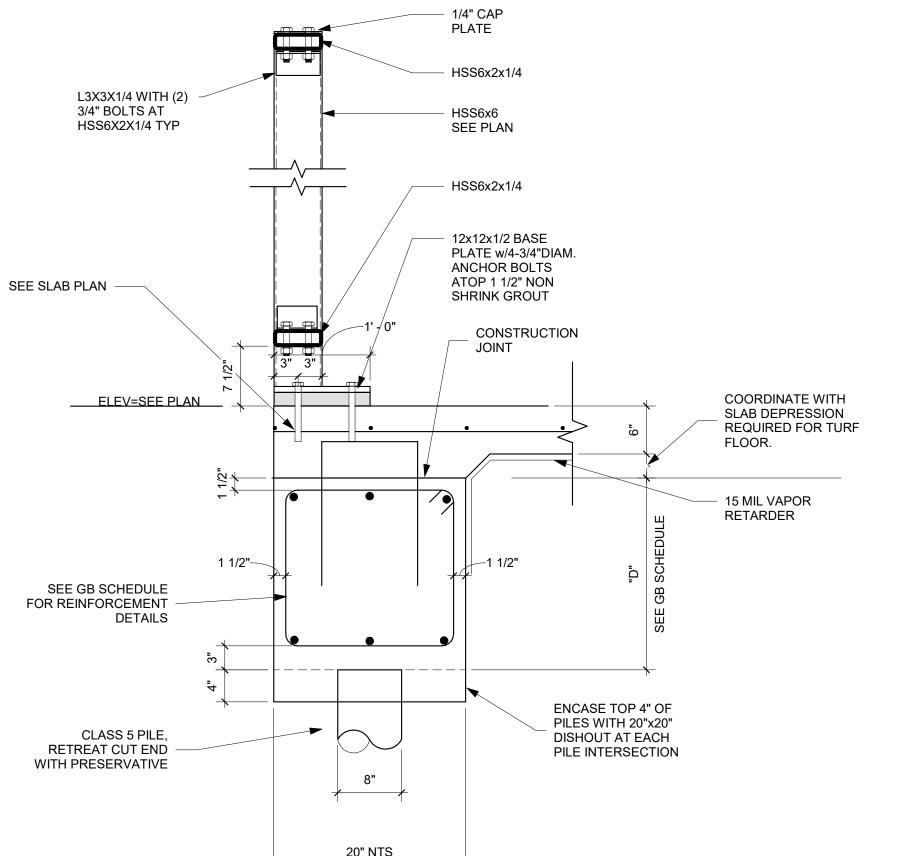



Pelicans Campus Improvements 5600 Airline Hwy Metairie LA


WDG PROJECT NO |AR2315 CONSTRUCTION DOCUMENTS 04/15/2024

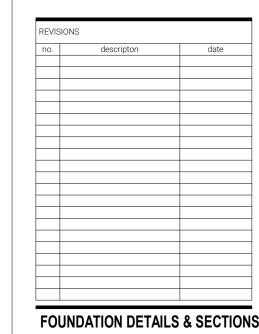

S2.00 DRAWN BY | Author

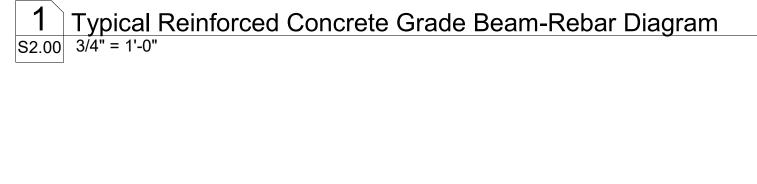


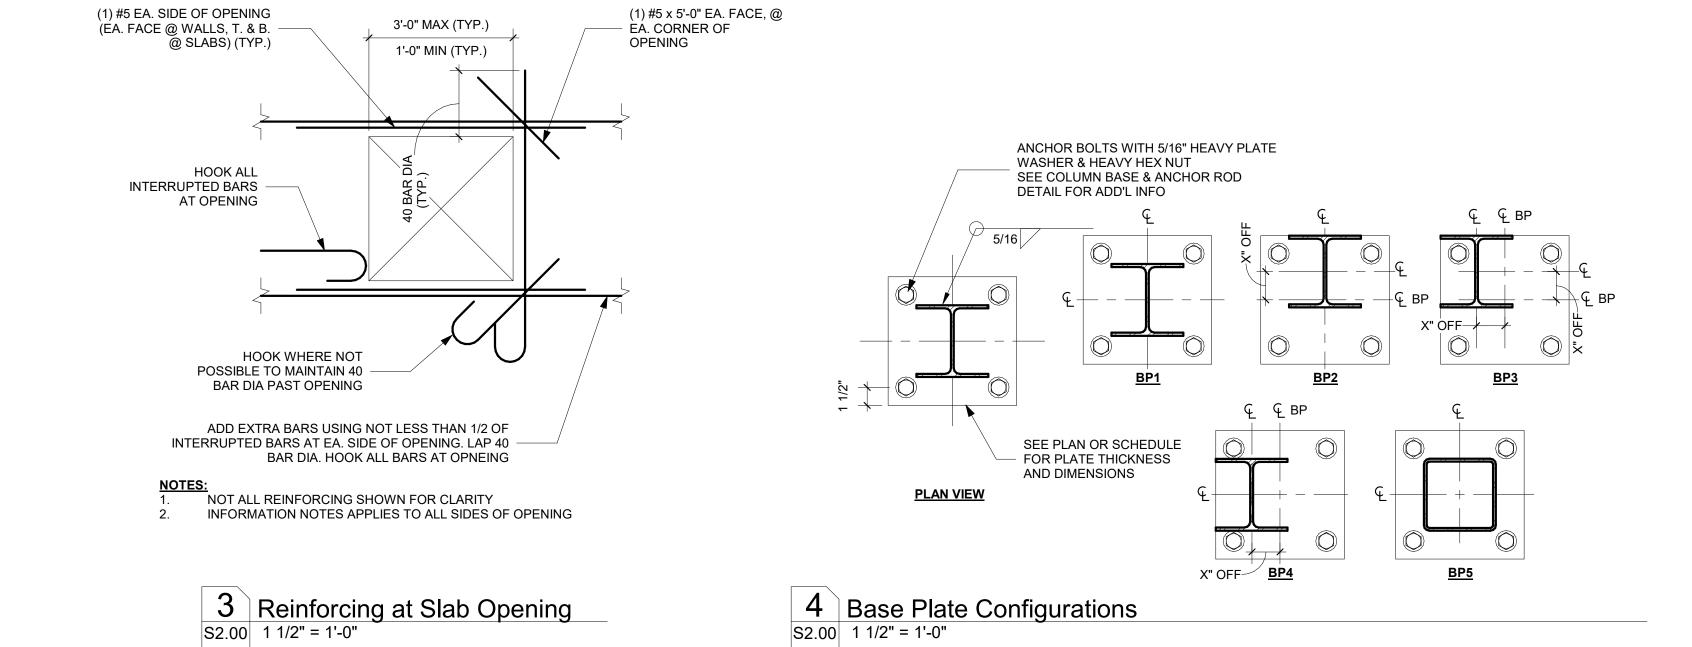

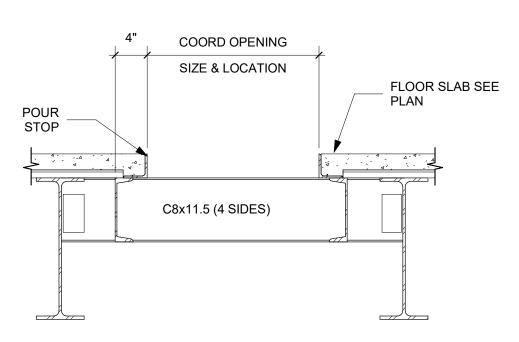

- NOTES:

 PROVIDE FRAME AT FLOOR OPENING WHERE ANY DIMENSION EXCEEDS 1'-0"
 WHEN OPENING SIZE EXCEEDS 5'0" IN EITHER DIRECTIONS, VERIFY ALL SIZES w/ ENGINEER
 EDGES OF ALL FLOOR PENETRATIONS SHALL BE SEALED TO MAINTAIN FIRE RATING PER ACCEPTED UL DETAILS
 STEEL CONTRACTOR SHALL COORDINATE SIZE & LOCATIONS OF OPENINGS WITH THE TRADE REQUIRING THE OPENINGS
- 1 Framed Floor Opening
 s3.00 1" = 1'-0"

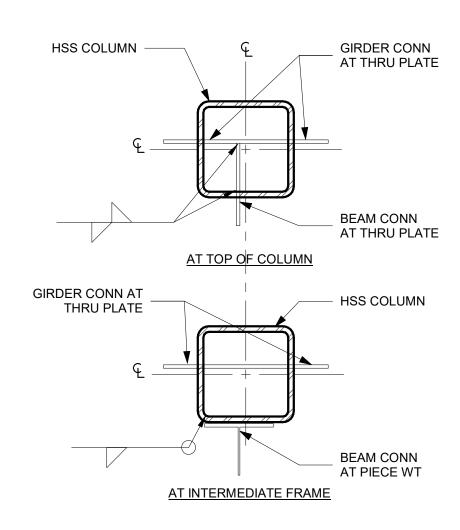

2 HSS Thru-Plate Connection s3.00 3" = 1'-0"

woodward engineering group

1000 S. NORMAN C. FRANCIS PARKWAY
NEW ORLEANS, LA 70125
WOODWARDDESIGNBUILD.COM | 504-822-6443 Nicholas Mannix, PE

Pelicans Campus Improvements 5600 Airline Hwy Metairie LA


WDG PROJECT NO |AR2315 CONSTRUCTION DOCUMENTS 04/15/2024




no.	descripton	date
110.	descriptori	uate

TYPICAL STEEL FRAMING DETAILS


DRAWN BY | Author \$3.00

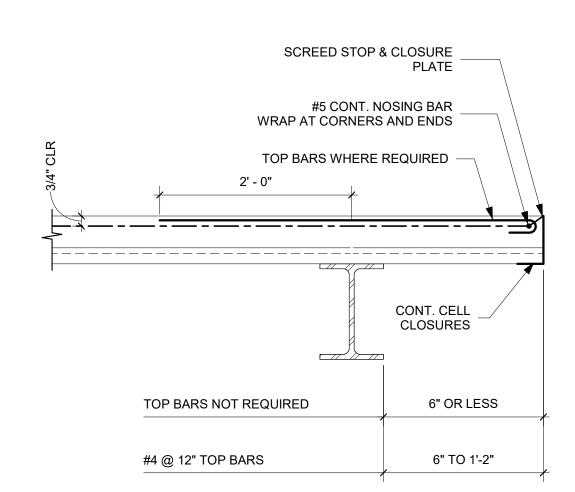

1 Concrete Deck Overhang (Deck Bearing on Beam)
S3.01 1" = 1'-0"

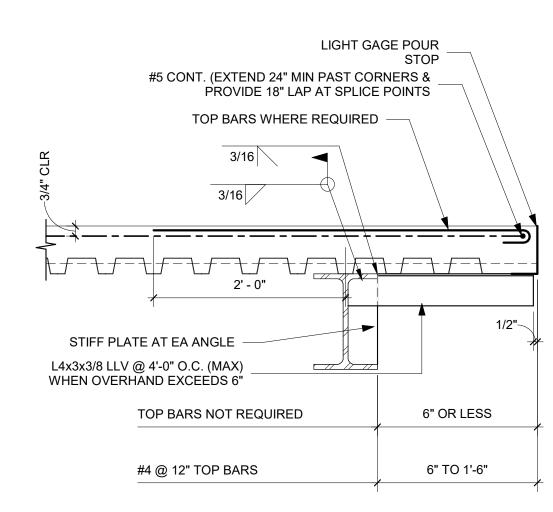


2 Concrete Deck Overhang (Deck Spanning Parallel to Beam)
s3.01 1" = 1'-0"

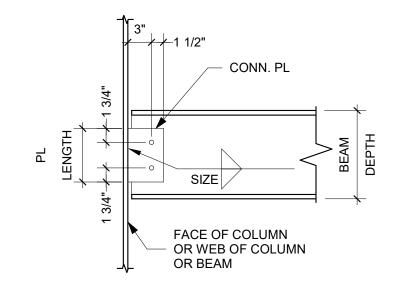

BEAM	¾"Ø A325N BOLTS	CONNECT	ION PLATE	WELD SIZE
DEPTH	NO.	LENGTH	THICK.	(E70XX)
W6	2	6 1/2"	1/4"	3/16"
W8	2	6 1/2"	1/4"	3/16"
W10	3	9"	1/4"	3/16"
W12	3	9 1/2"	3/8"	3/16"
W14	3	9 1/2"	3/8"	3/16"
W16	4	12 1/2"	3/8"	3/16"
W18	5	15 1/2"	3/8"	5/16"
W21	6	18"	3/8"	5/16"
W24	7	21"	3/8"	5/16"
W27	8	24"	3/8"	5/16"
W30	8	24 1/2"	1/2"	3/8"
W33	9	27 1/2"	1/2"	3/8"
W36	9	27 1/2"	1/2"	3/8"
NFORMATION TABLE 10-4	N FROM AISC	MANUAL TAE	BLE 7-1, SEC1	ΓΙΟΝ 8, AND

3 W-Shape Single Plate Connections
| 3 | 1" = 1'-0"

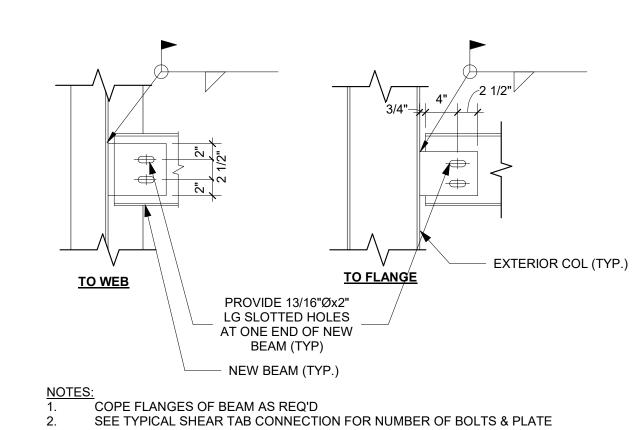


New Beam to Existing Column Shear Connection

| 1" = 1'-0"


SLAB TRENCH, COORDINATE WITH MEP AND ARCHITECTURAL #5@12" O.C. MAX EACH WAY AT SLAB PATCH EXISTING SLAB - #5 @ 12" O.C. x 2'-0" BAR HAMMER DRILLED AND EPOXIED 6" INTO EXISTING - 15 MIL VAPOR RETARDER SLAB USING HILTI HY200 ADHESIVE. REBAR TO BE PLACED AT SLAB MID-DEPTH AT PERIMETER OF SLAB TRENCH

5 Typical Detail-Slab Patch

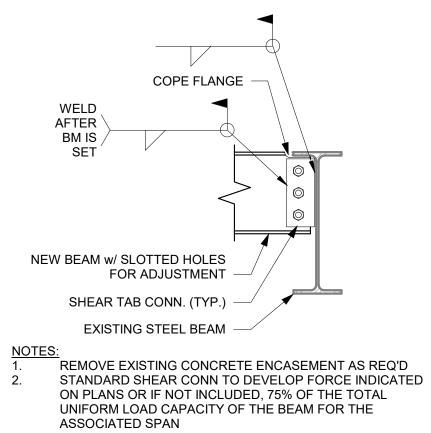

6 New Beam to Existing Beam Shear Connection

S3.01 1" = 1'-0"

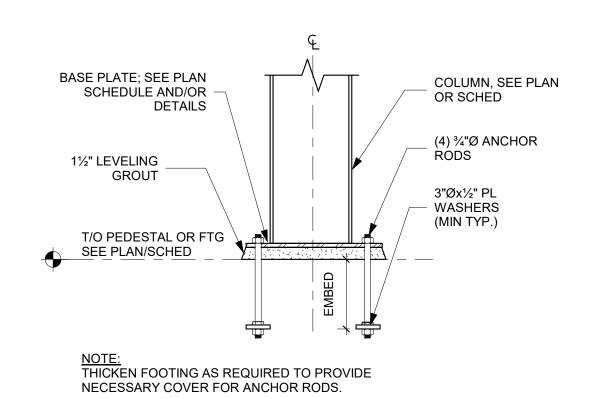

7 Column Base and Leveling Plate
S3.01 1" = 1'-0"

Pelicans Campus Improvements 5600 Airline Hwy Metairie LA

woodward engineering group

Nicholas Mannix, PE

1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443

WDG PROJECT NO |AR2315


CONSTRUCTION DOCUMENTS 04/15/2024




no.	descripton	date
110.	descriptori	uale
_		
_		
	•	

TYPICAL NOTES AND DETAILS

DRAWN BY | Author \$3.01

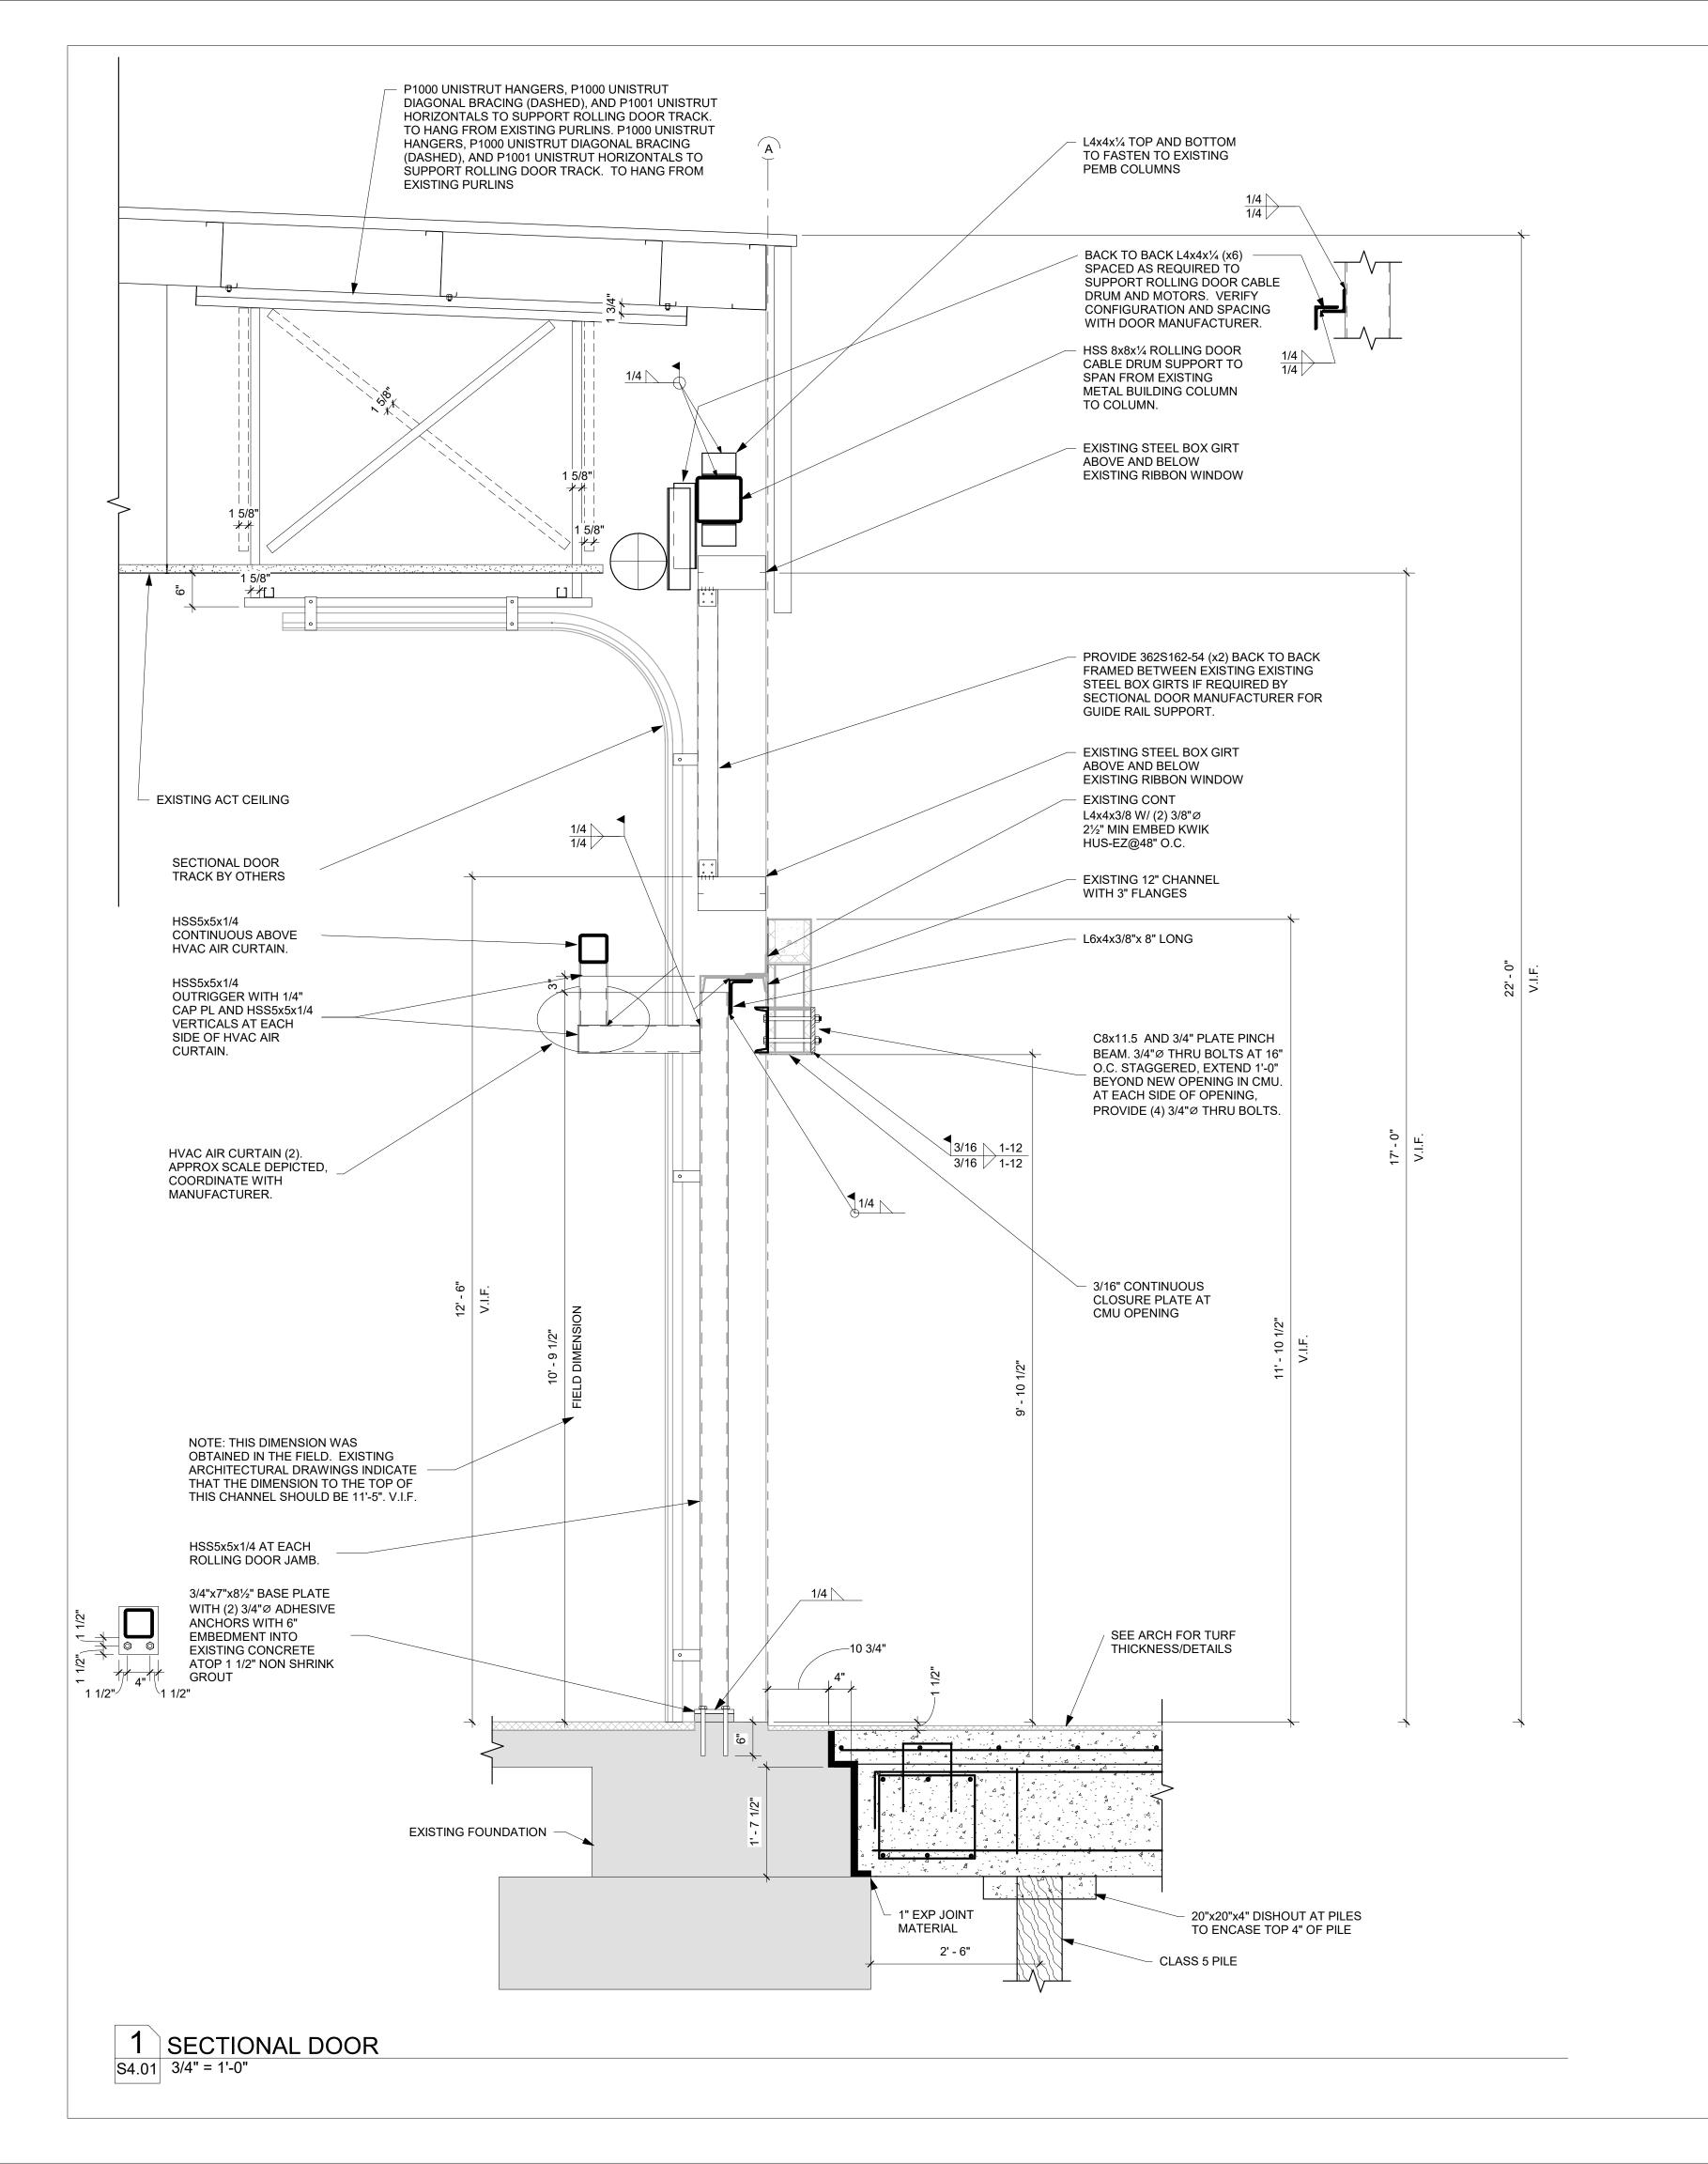

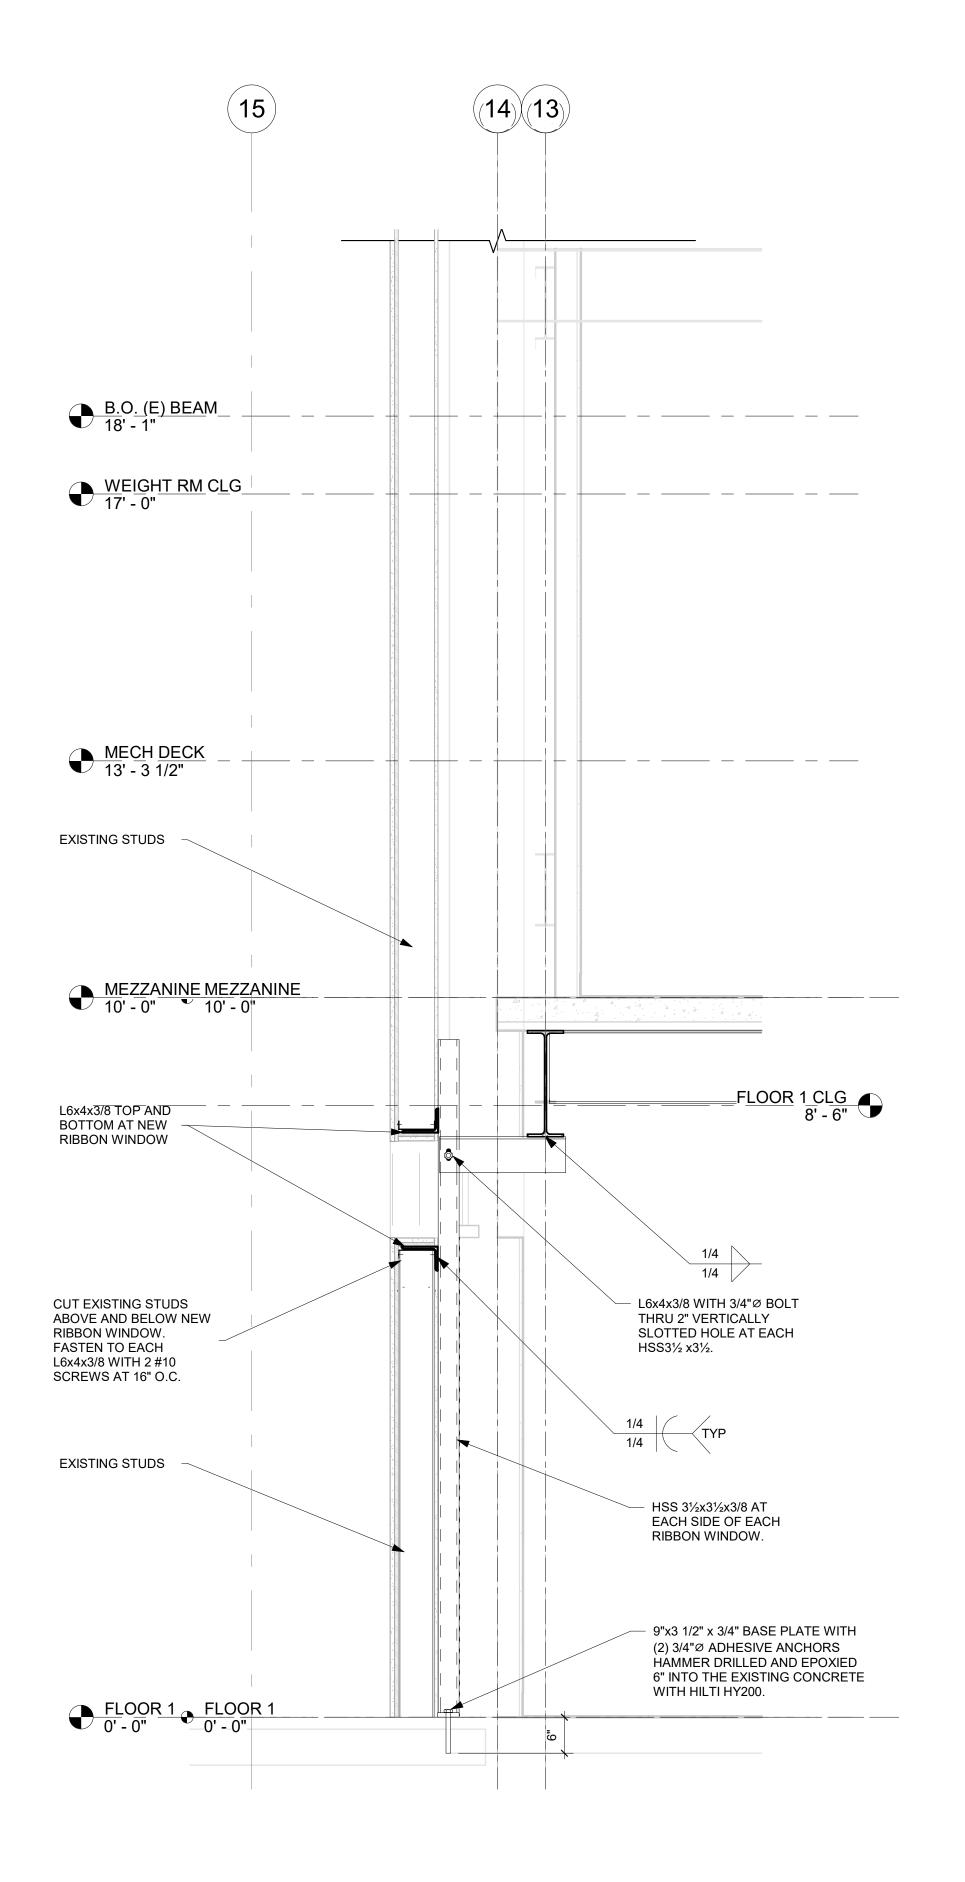

2 SECTION AT RIBBON WINDOWS

S4.01 3/4" = 1'-0"

woodward engineering group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443

Nicholas Mannix, PE


Pelicans Campus Improvements 5600 Airline Hwy Metairie LA


WDG PROJECT NO |AR2315

CONSTRUCTION DOCUMENTS 04/15/2024

ENLARGED PLANS, SECTIONS AND DETAILS

S4.01

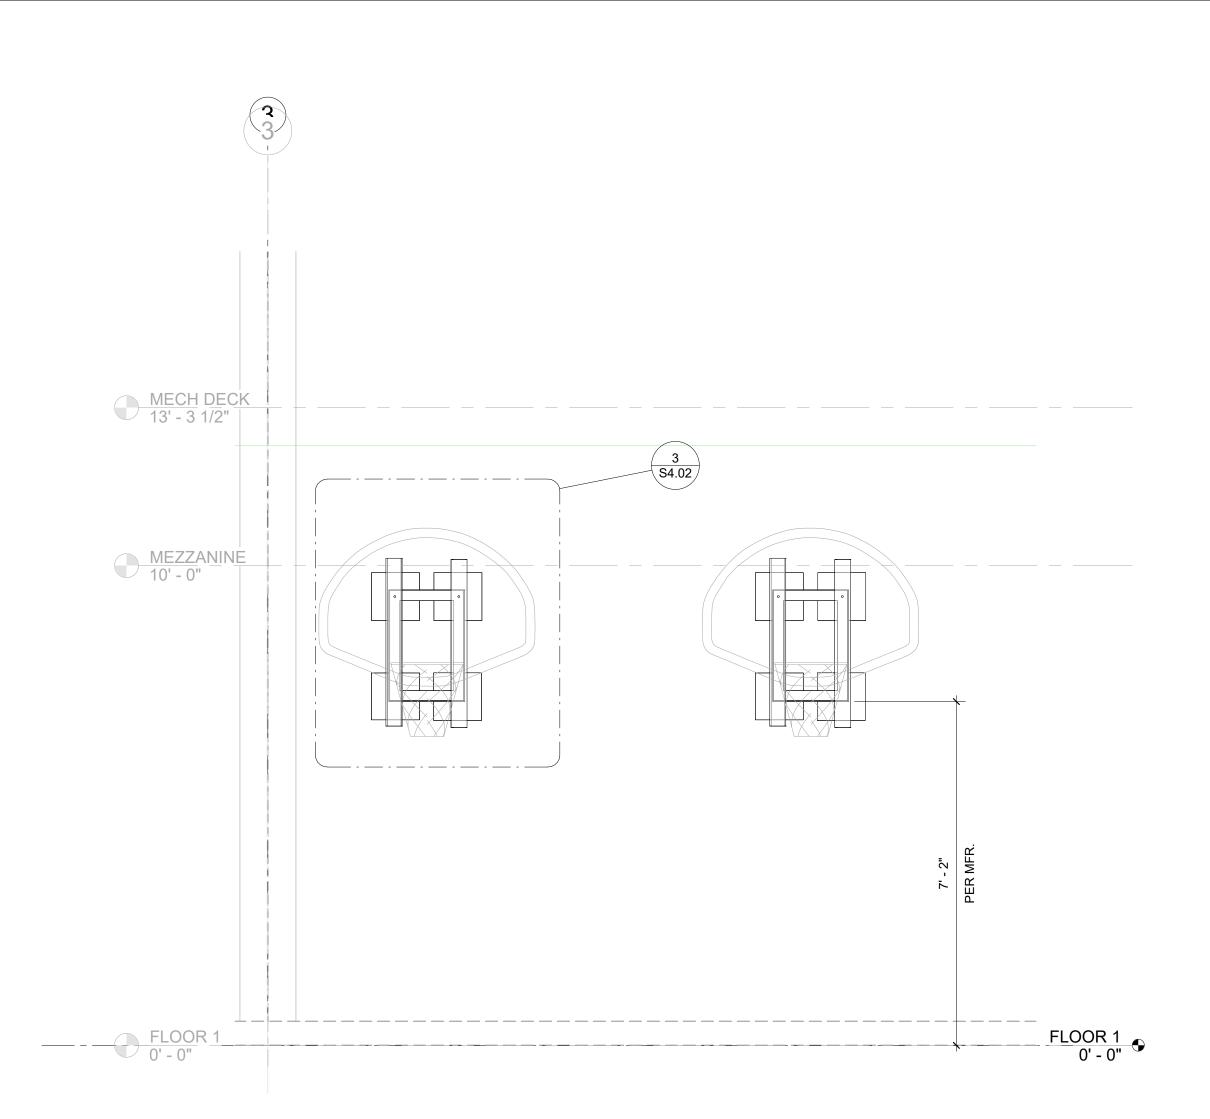

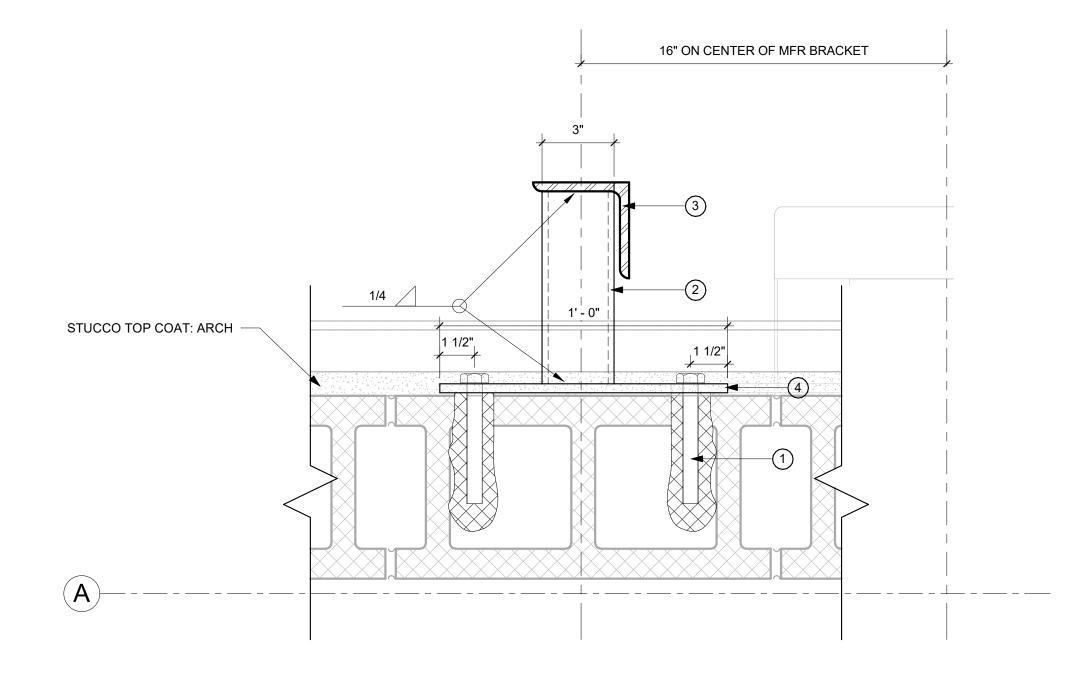


SHEET S4.02 LEGEND

- 5/8" DIAM HILTI 270 w/HIT-SC SCREENED ANCHOR w/5" EMBED INTO HOLLOW BLOCK GALVANIZED
- 3" STANDARD PIPE GALVANIZED
- L4x4x3/8" ANGLE GALVANIZED
- 12"x12" 3/8" PLATE GALVANIZED
- GOAL KING PLATINUM FRAME: SEE MFR'S SPECIFICATIONS

NOTE: STEEL DEPICTED IS SHOWN FOR THE PURPOSE OF ESTABLISHING AN ALL INCLUSIVE PRICE. THE EXACT DIMENSIONS , SHAPES AND CONFIGURATION OF STRUCTURAL STEEL REQUIRED MUST BE COORDINATED WITH THE EQUIPMENT

1 DETAIL A-A- BASKETBALL GOAL SUPPORT BRACKET
S4.02 3" = 1'-0"

2 STRUCTURAL GOAL SUPPORT ELEV S4.02 1/2" = 1'-0"

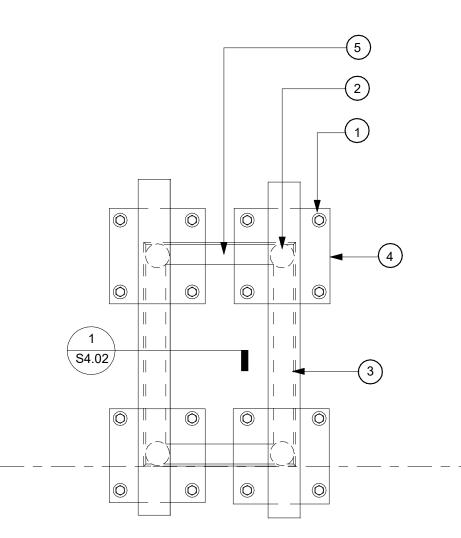

3 GOAL STRUCTURE ELEVATION S4.02 1" = 1'-0"

Installation (GOAL KING)

Safety Cable Eye Bolt 🗪 6" to 16" (16" is optimal) 19" Top Holes (required) 16" On Center Center Holes Above your bracket you need an additional 6 - 16 inches for Bottom Holes (required) -Before moving on confirm you have read and understand all safety instructions on page 3.

Mount at 86" to have the maximum amount of

134" and still achieve 10ft

If mounted below 86" the system will NOT adjust

Playing Surface

up to 10ft.

adjustment. Can be mounted between 86" -

regulation height.

1) Installation Location

Choose the proper location to mount your Wall King system. Use the diagram to the left to make sure your bracket is high enough to be adjusted up to 10ft. If you install your bracket higher than 86 inches your system will still adjust to 10ft but will not adjust down as far. If you install your bracket below 86 inches your system will not adjust up to 10ft.

The wall surface needs to be level and flat so that your bracket will be level. The wall must either be wood siding, brick, or stone and be structurally sound.

Ensure that the structure you are mounting to is structurally sound and sufficient to handle the stresses of the Wall King. Contact a professional engineer regarding this.

the safety cable to attach to the wall (16 inches being optimal). You must have full access to the rear side of the wall to

complete the installation.

The overhang is 3ft from the wall to the front of the backboard.

2) Marking and Drilling Bracket Mounting Holes

Using a pencil, mark the 2 top mounting holes, 2 bottom holes, 2 of the 6 center holes (1 on the left and 1 on the right), and the safety cable eye bolt hole while ensuring the bracket is level. (Total of 7 holes to be drilled)

Once marked check the wall to make sure there is nothing in the way of drilling through the wall. Example: electric wiring, steel braces/studs, water lines, gas lines, or anything else.

Brick/Stone Wall:

Next using the provided drill bit(s), drill each hole. Use the #38 masonry drill bit and a hammer drill to go through the brick or stone. Once through the brick or stone switch to the #39 wood drill bit to go through the rest of the wall.

Wood/Siding Wall:
Using the #39 wood drill bit, drill each hole.

woodward engineering group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443

Nicholas Mannix, PE


Pelicans Campus Improvements 5600 Airline Hwy Metairie LA

WDG PROJECT NO |AR2315 CONSTRUCTION DOCUMENTS 04/15/2024


REVISION	NS .	
no.	descripton	date

ENLARGED PLANS, SECTIONS AND DETAILS


S4.02 DRAWN BY | Author

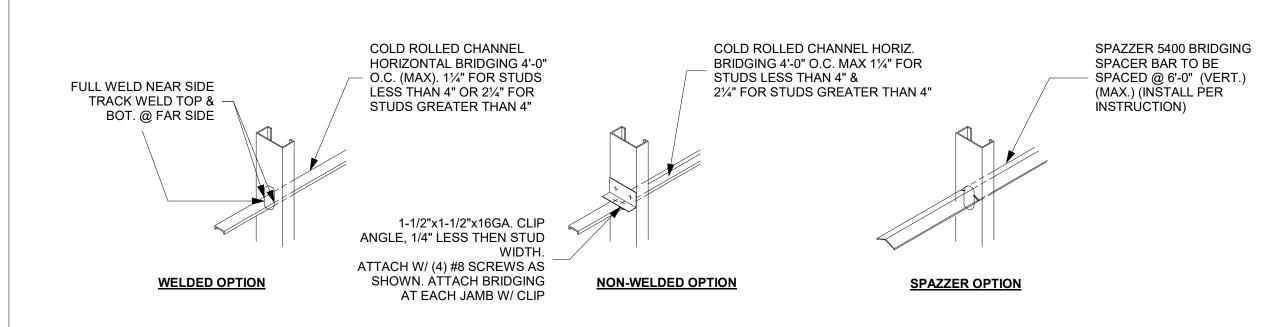


46 Bridging Options
S5.00 N.T.S

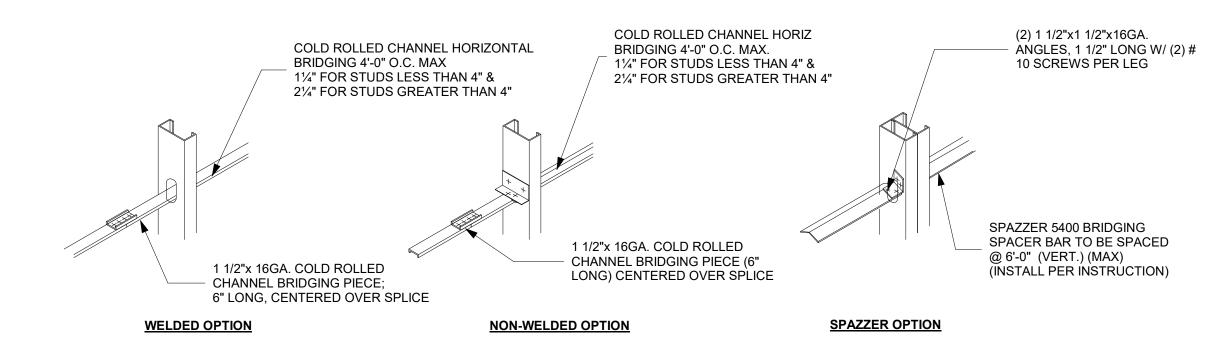

50 Bridging Splice Options
S5.00 N.T.S

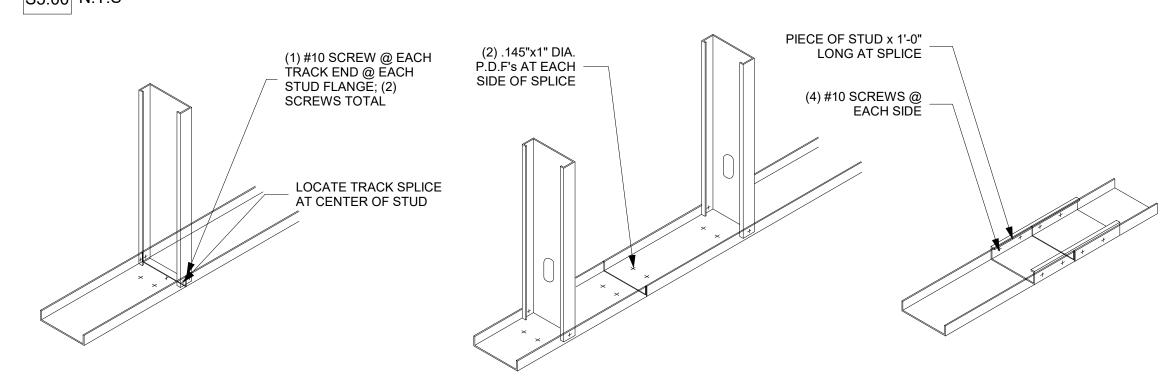


51 Track Splicing Options
S5.00 N.T.S

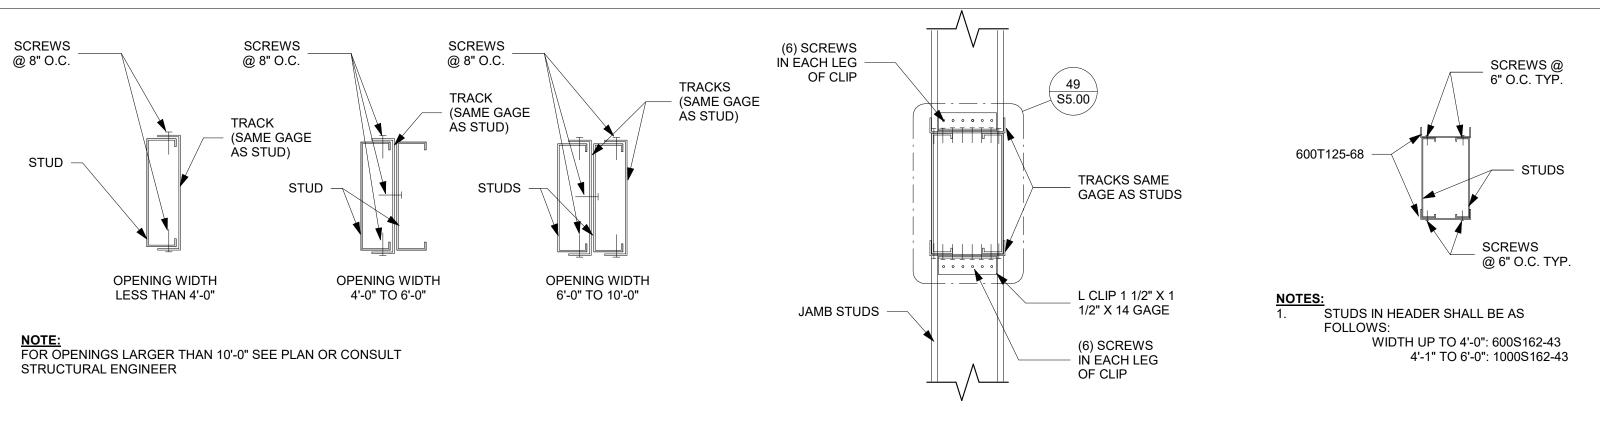

48 Light Gauge Exterior Jamb 55.00 1 1/2" = 1'-0"

49 Typical Exterior Sill Header

S5.00 1" = 1'-0"

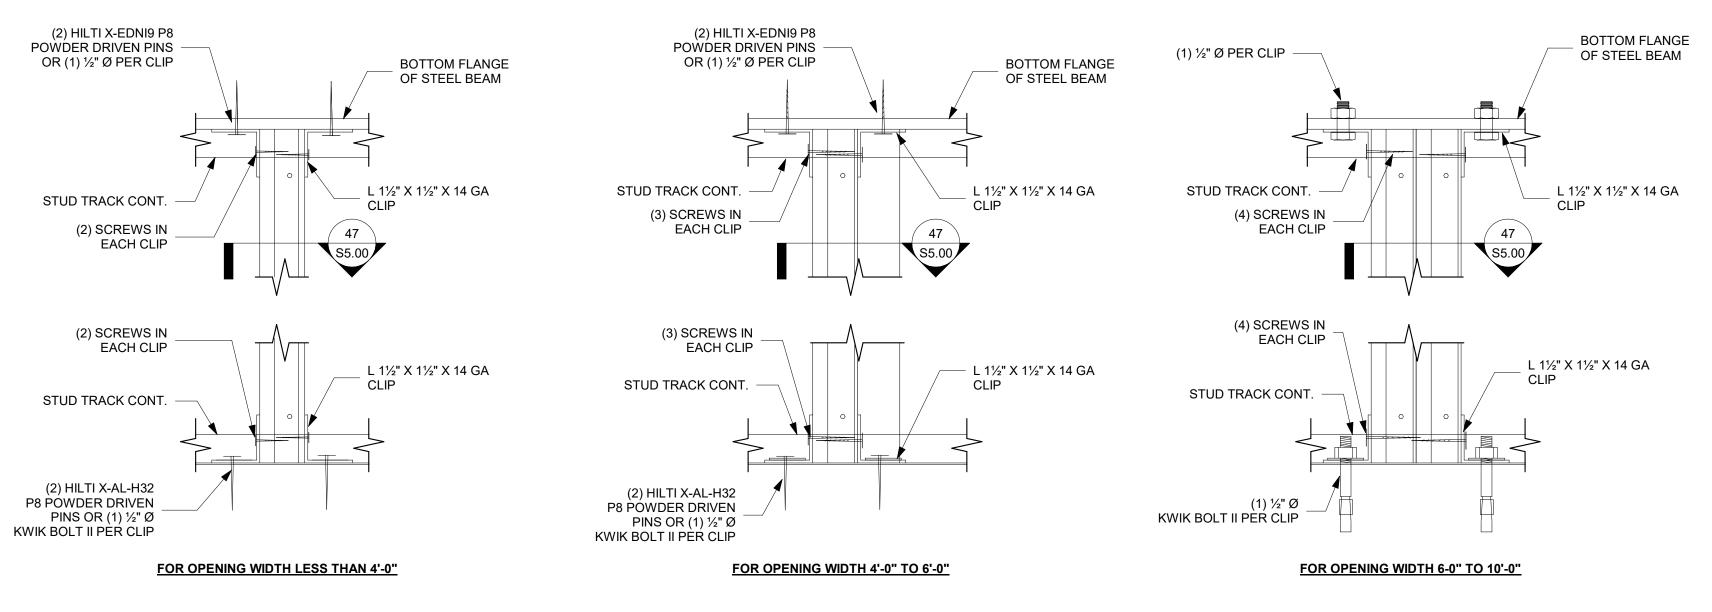

1. TYPICAL CONNECTION TO CONCRETE AT BOTTOM OF STUDS AND TOSTEEL BEAM AT TOP OF STUDS SHOWN 2. IF CONCRETE AT TOP, CONNECTION IS SAME AS SHOWN AT BOTTOM OF STUDS

47 Light Gauge Exterior Wall Opening Jamb 55.00 1" = 1'-0"

52 Stud End Connection Details

S5.00 3" = 1'-0"

Pelicans Campus Improvements

woodward engineering group

Nicholas Mannix, PE

1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443


WDG PROJECT NO |AR2315 CONSTRUCTION DOCUMENTS 04/15/2024




	ONS	_
no.	descripton	date
		•

DETAILS

DRAWN BY [M.E.S./H.A.A. **\$5.00**

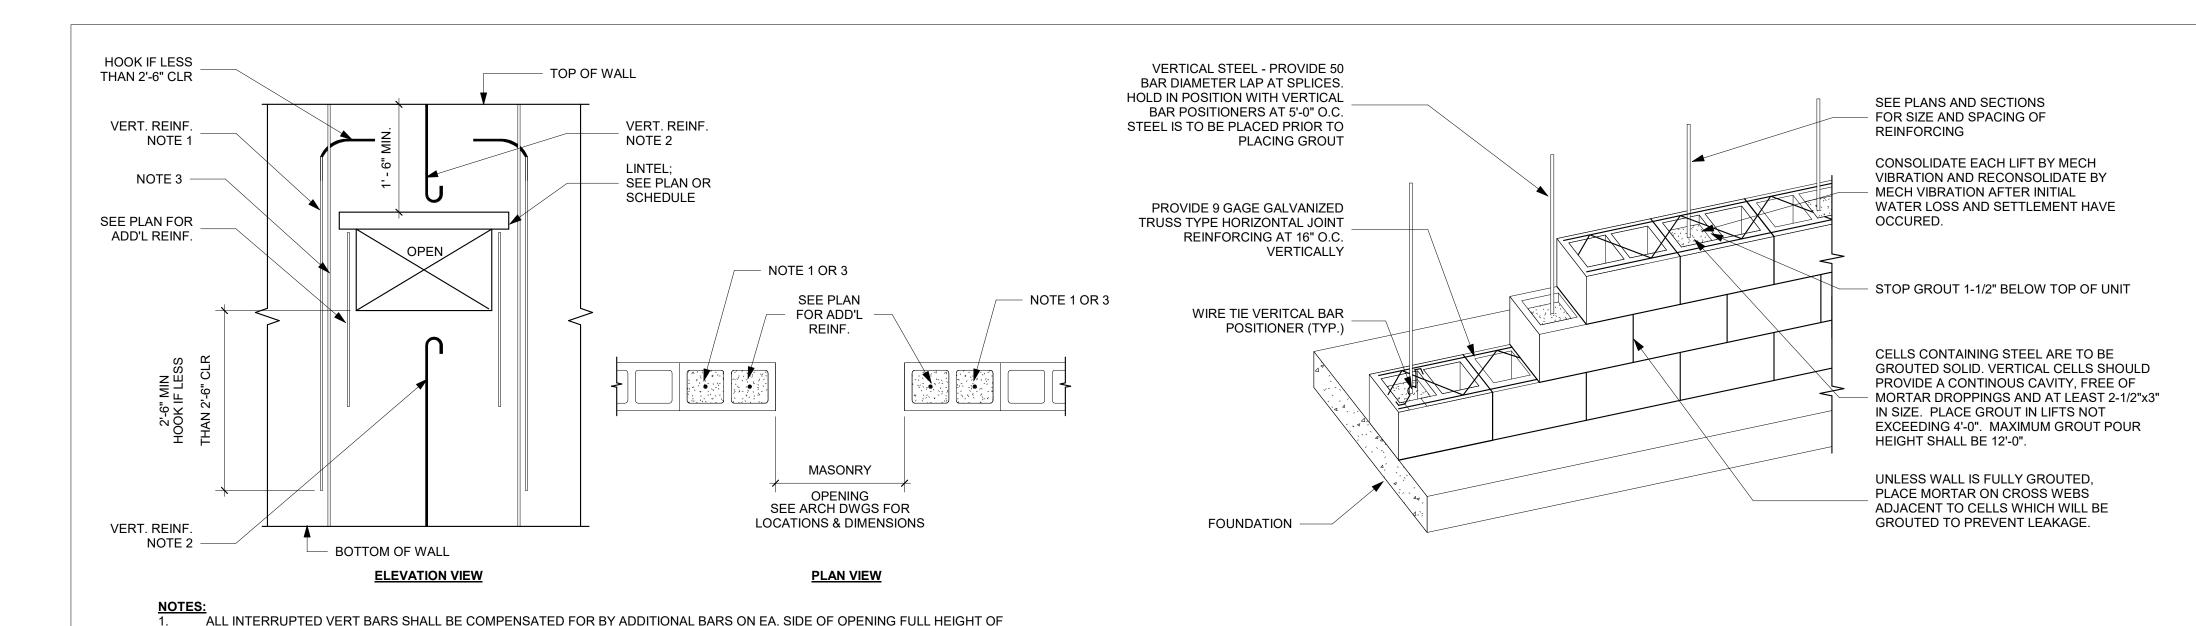


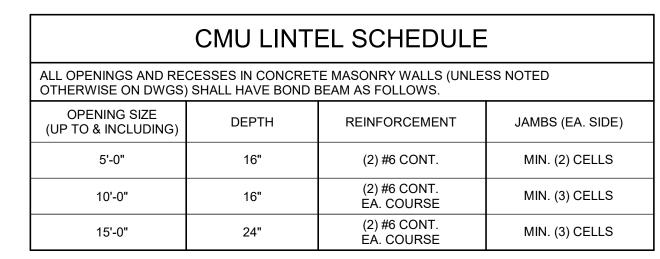

2 CMU Lintel Schedule

- BOTTOM OF LINTELS SHALL OCCUR AT TOP OF MASONRY OPENING REINFORCEMENT NOTED SHALL BE CONTINOUS PLACED AS SHOWN. KNOCK-OUT BLOCKS ARE PEMITTED TO BE USED IN PLACE OF U-BLOCK SEE TYPICAL DETAILS FOR MORE INFORMATION. CALCULATION ASSUMES fm 1500 PSI, 10 FT OF WIND TRIBUTARY AREA, FULLY GROUTED LINTEL w/ TYPE S MORTAR
 - SEE TYPICAL MASONRY BOND BEAM DETAIL FOR CONT. REINF. SPACING.



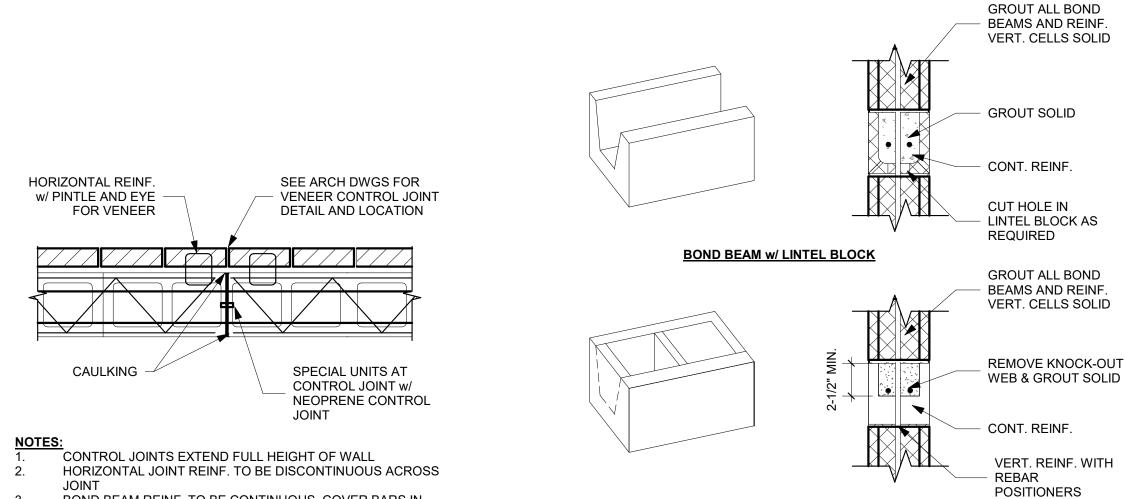


BOND BEAM REINF. TO BE CONTINUOUS. COVER BARS IN GREASE COATED WRAP OR PROVIDE JOINT STABILIZER 4. MAX CONTROL JOINT SPACING = 25'-0" 4 Masonry Wall Control Joint

S6.00 N.T.S

6 Bond Beam Reinforcement

BOND BEAM w/ KNOCK-OUT WEB BLOCK

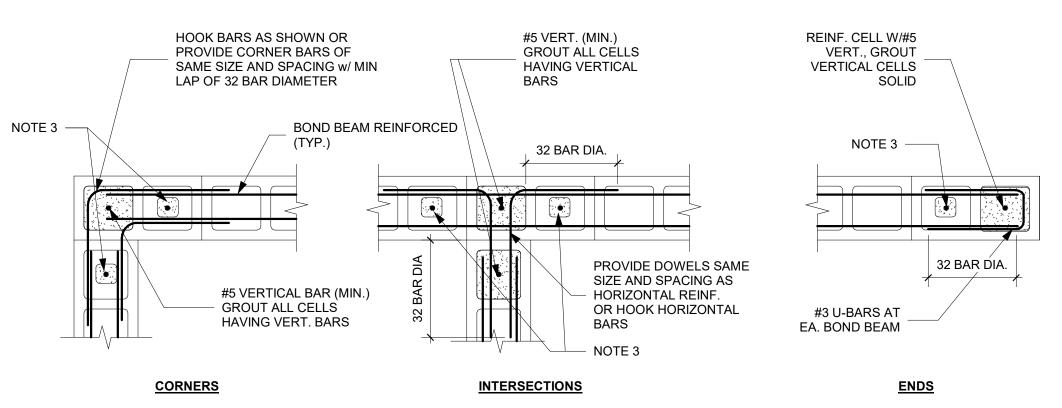

S6.00 N.T.S

UNLESS OTHERWISE NOTED OR SPECIFIED, AT POINTS WEHRE CONCRETE MASONRY WALLS MEET OR INTERSECT. LAY 50% OF UNITS IN MASONRY BOND WITH ALTERNATE UNITS HAVING A BEARING ON NOT LESS THAN 4" ON THE UNIT

WALL. TOTAL AREA OF ADDITIONAL BARS SHALL EQUAL AREA OF INTERRUPTED BARS. PROVIDE MIN. (2) #5 EA. SIDE OF OPENING.

SIZE & SPACING OF REINF. INDICIATED ON PLAN. PROVIDE HOOKED ENDS ON ALL DISCONTINIOUS BARS. PROVIDE MIN (2) #5 EA. SIDE OF OPENING FOR UNREINFORCED WALL

1 Masonry Wall Opening Reinforcing

- UNLESS OTHERWISE NOTED, PROVIDE DOWELS FROM CONCRETE FOOTING OR WALL BELOW WITH SAME SIZE AND
- SPACING AS VERTICAL BARS AT LEVEL BELOW. LAP 50 BAR DIAMETER MINIMUM UNO. PROVIDE ADD'L REINFORCED GROUTED CELLS IN WALLS WHICH EXCEED 8" NOMINAL WIDTH.

3 Vertical Bar Intersections

Pelicans Campus Improvements 5600 Airline Hwy Metairie LA

woodward engineering group

Nicholas Mannix, PE

1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443

WDG PROJECT NO |AR2315 CONSTRUCTION DOCUMENTS 04/15/2024

REVISIONS		
no.	descripton	date

TYPICAL CONCRETE MASONRY **DETAILS**

S6.00

			ELECTR					
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION		SYMBOL	DESCRIPTION
	LIGHTING		POWER	ATS	TRANSFER SWITCH - AUTOMATIC OR MANUAL AS NOTED			TELEPHONE / DATA / TELEVISION
	SURFACE, SUSPENDED OR RECESSED FLUORESCENT		120V. DUPLEX RECEPTACLE WALL / FLOOR MOUNTED	MTS	TRANSFORMER - INFORMATION AS NOTED		4	TELEPHONE OUTLET WITH PLATE
ENA E	(TYPE DETERMINES MOUNTING) EMERGENCY SURFACE, SUSPENDED OR RECESSED FLUORESCENT - BATTERY	/ _	120V. DUPLEX GROUND FAULT INTERRUPTER RECEPTACLE	PANEL			 ₩	WALL TELEPHONE OUTLET WITH PLATE
	OR EM. GENERATOR (TYPE DETERMINES MOUNTING) SURFACE OR RECESSED DOWNLIGHT	_	SINGLE RECEPTACLE (TYPE AS NOTED)	_	PANELBOARD			TELEPHONE OUTLET FLOOR BOX WITH PLATE
	(TYPE DETERMINES MOUNTING) LIFE-SAFETY BATTERY BACK-UP SURFACE OR RECESSED FIXTURE		120V. QUADRUPLEX RECEPTACLE WALL / FLOOR MOUNTED					DATA & TELEPHONE OUTLET PROVIDE DUAL RJ-45 OUTLET
LIVI	(TYPE DETERMINES MOUNTING) WALL WASHER FIXTURE	· · /	SPECIAL RECEPTICAL (TYPE AS NOTED)					CONFIGURATION DATA & TELEPHONE OUTLET FLOOR BOX WITH PLATE
	SURFACE, SUSPENDED OR RECESSED	+	120V BOTTOM 1/2 SWITCHED DUPLEX RECEPTACLE - IVORY UON		FIRE ALARM			DATA OUTLET WITH PLATE
	FLUORESCENT FIXTURE (TYPE DETERMINES MOUNTING) EMERGENCY SURFACE, SUSPENDED OR RECESSED FLUORESCENT - BATTERY		WIREMOLD - LENGTH AS INDICATED ON DRAWINGS - TYPE "A" SEE SCHEDULE	HF F	FIRE ALARM STROBE WALL / CEILING MOUNTED - "A"=15cd OR AS NOTED			DATA OUTLET FLOOR BOX WITH PLATE
	OR EM. GENERATOR (TYPE DETERMINES MOUNTING) WALL BRACKET FIXTURE	A	120V DUPLEX RECEPTACLE IN A SURFACE MOUNTED WIREMOLD OUTLET BOX	HH H	FIRE ALARM HORN WALL / CEILING MOUNTED		 <∫WAP	WIRELESS ACCESS POINT
FM	EMERGENCY WALL BRACKET FIXTURE - BATTERY OR EM. GENERATOR	₩W U	700 WIREMOLD TO RECESSED OUTLET BOX WITH WM EXTENSION		FIRE ALARM SPEAKER WALL / CEILING MOUNTED			CABLE TV DROP
<u> </u>	FLUORESCENT STRIP FIXTURE (TYPE DETERMINES MOUNTING)		JUNCTION BOX	+ +			V	
	WALL MOUNTED SCONCE	HJ T	JUNCTION BOX - WALL MOUNTED TRANSFORMER - KVA AS DENOTED	FFH FH	FIRE ALARM STROBE/SPEAKER COMBINATION WALL / CEILING MOUNTED FIRE ALARM HORN/STROBE COMBINATION WALL / CEILING MOUNTED		A _{CTV} <	CCTV CAMERA - INDOOR - NEMA 1- "A" DENOTES SCHEDULE TYPE
	CEILING MOUNTED EXIT SIGN - SHADED AREAS INDICATE FACES - WHEN	T			FIRE ALARM ROTARY BEACON			CCTV DOME CAMERA WITH WEATHER PROOF - EXTERIOR MOUNTED
	SHOWN ARROWS INDICATE DIRECTION OF EXIT - BATTERY OR EM. GEN. WALL MOUNTED EXIT SIGN - SHADED AREAS INDICATE FACES - WHEN		NON-FUSIBLE SAFETY SWITCH, SIZE NOTED (FRAME/V/POLES)	F	FIRE ALARM PULL STATION		N CTV WP	OCT V DOIVIE CAIVIENA WITH WEATHER PROOF - EXTERIOR MOUNTED
	SHOWN ARROWS INDICATE DIRECTION OF EXIT - BATTERY OR EM. GEN.		FUSIBLE SAFETY SWITCH, SIZE NOTED (FRAME/V/POLES/FUSE)		FIRE ALARM MANUAL PULL STATION - KEY OPERATED			ANOCELL ANECLIC
	BATTERY POWERED EMERGENCY LIGHT TRACK LIGHTING (T) (TE RETERMINES MOUNTING)		DISCONNECTOTOR STARTER COMBINATION STARTER - "##" DENOTES NEMA SIZE	⊢ ⊢ ⊢ K ⊚	FIRE ALARM MANUAL PULL STATION - KEY OPERATED FIRE ALARM 10" BELL			MISCELLANEOUS PACING SYSTEM VOLUME CONTROL
	TRACK LIGHTING (TYPE DETERMINES MOUNTING) GROUND AND POLE MOUNTED SITE FIXTURES (TYPE DETERMINES MOUNTING)	##		F			V V	PAGING SYSTEM VOLUME CONTROL
7	, , ,	(HP)	ELECTRIC MOTOR - HP AS NOTED		FIRE ALARM SMOKE DETECTOR FIRE ALARM SMOKE DETECTOR WITH SOUNDER BASE		HOA	HAND - OFF - AUTOMATIC CONTROLLER
PC LC	PHOTO CELL		PANELBOARD - FLUSH MOUNTED				+C	CLOCK, SINGLE FACE - CLOCK AND RECEPTACLE AS SPECIFIED.
	LIGHTING CONTACTOR - NAME AS DESIGNATED		PANELBOARD - SURFACE MOUNTED	(H)	HEAT DETECTOR		+C ₂	CLOCK, DOUBLE FACE - CLOCK AND RECEPTACLE AS SPECIFIED.
	LIQUE FIVELINE MODIFIEDO	=	GROUND	(F)	FLAME DETECTOR DUCT SMOKE DETECTOR - SUPPLY OR RETURN AIR DUCT		cs	CALL SWITCH - WALL MOUNTED
	LIGHT FIXTURE MODIFIERS			→ ▼T	PROVIDE 120 VAC POWER AND INTERCONNECTION TO FACP		DS	DOOR SWITCH MOUNTED IN DOOR JAMB
	DESIGNATES FIXTURE TYPE - SEE LIGHTING FIXTURE SCHEDULE	40	RECEPTACLE MODIFIERS	□ □ □ □ □ □ □ □ □ □ □ □ □ □ □ □ □ □ □	BEAM DETECTOR (TRANSMITTER)		Р	DOOR OPEN PUSH PLATE
	DESIGNATES SWITCH - SEE LIGHTING DRAWINGS		ABOVE COUNTER		BEAM DETECTOR (RECEIVER)		CR	CARD READER
INL	NIGHT LIGHT - WIRE FIXTURE TO REMAIN ON WHEN OTHER FIXTURES ON CIRCUIT ARE OFF		ABOVE FINISHED FLOOR	₹	FIRE ALARM FLOW & TAMPER SWITCH		MD	MOTION DETECTOR
			ABOVE FINISHED GRADE	FACP	FIRE ALARM CONTROL PANEL		K	KEYPAD
	SWITCHES		FURNITURE MOUNTED	FAA	FIRE ALARM ANNUNCIATOR PANEL			MAGNETIC DOOR HOLDER
\$	NORMAL SWITCH - TOGGLE		GROUND FAULT CIRCUIT INTERRUPTER RECEPTACLE	FADC	FIRE ALARM DIGITAL COMMUNICATION DIALER		TV	TV CABLE AND CONTROL OUTLET
OS	OCCUPANCY SENSOR - CEILING MOUNT - DUAL TECH. TYPE (PIR & ULTRASONIC)		ICE MAKER	PS	PRESSURE SWITCH		MC	MICROPHONE
00		IG	ISOLATED GROUND	LS	LEVEL SWITCH		PS	SPEAKER - CEILING MOUNTED
os _{\$}	OCCUPANCY SENSOR - WALL MOUNT - DUAL TECH. TYPE (PIR & ULTRASONIC)	MW	MICROWAVE	\$/0	UNIT COMBINATION 120V SMOKE AND CARBON MONOXIDE DETECTOR		PS	SPEAKER - WALL MOUNTED
		REF	REFRIGERATOR	S	UNIT 120V SMOKE DETECTOR			
1	SWITCH MODIFIERS	TV	TELEVISION					
	NO MODIFIER - SINGLE POLE SWITCH	UC	UNDER COUNTER REFRIGERATOR		CIRCUITRY			
2	DOUBLE POLE SWITCH - CENTER OFF	D	DEDICATED					
	THREE WAY SWITCH	WP	WEATHERPROOF					
4	FOUR WAY SWITCH	,	ONELINE					
K	SINGLE POLE SWITCH - KEY OPERATED	M / M	METER / METER WITH ENCLOSURE		CONCEALED CIRCUIT IN CONDUIT	SOLID		
V	VARIABLE INTENSITY CONTROL		CIRCUIT BREAKER	/ - \	EXPOSED CIRCUIT IN CONDUIT	DASHED 2		
IT	INTERVAL TIMER CONTROL SWITCH		SWITCH - SINGLE POLE, SINGLE THROW		BELOW GRADE OR CONCEALED IN SLAB CIRCUIT IN CONDUIT	PHANTOM 2		
Р	PILOT LIGHT - LIT WHEN OFF	<u> </u>	SWITCH - SINGLE POLE, DOUBLE THROW	UG	UNDERGROUND WIRING IN CONDUIT - SITE WORK			REFERENCE TAGS
OS	OCCUPANCY SENSOR SWITCH - DUAL TECHNOLOGY TYPE (PIR & ULTRASONIC)		FUSE	1/3 or 1/3/5	GROUPED HOMERUN WITH SHARED NEUTRAL			REFERENCE NOTE.
VS	VACANCY SENSOR SWITCH - DUAL TECHNOLOGY TYPE (PIR & ULTRASONIC)		FUSED SWITCH	2,4, 2,4,6	MULTIPOLE HOMERUN, CONDUCTORS AS REQUIRED BY EQUIPMENT			SPECIFIC NOTE REFERENCE.
М	MOTOR RATED SWITCH WITH THERMAL OVERLOAD	\sim	RELAY - NORMALLY OPEN					CALL OUT REFERENCE.
LV	LOW VOLTAGE CONTROL SWITCH	0 10	RELAY - NORMALLY CLOSED		CONDUIT TURNED UP			FEEDER REFERENCE.
AC	ABOVE COUNTER - COORDINATE HEIGHT WITH ARCH./G.C.	0 0	PUSH BUTTON - NORMALLY OPEN	<u> </u>	CONDUIT TURNED DOWN			REVISION REFERENCE.
UC	UNDER COUNTER - COORDINATE HEIGHT WITH ARCH./G.C.		PUSH BUTTON - NORMALLY CLOSED]	CONDUIT STUB OUT			
,			GENERATOR					1

NOTE: NOT ALL SYMBOLS APPEAR ON DRAWINGS



woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443 Erik Wismar, AIA

307 WEST MAPLE RIDGE DR. METAIRIE, LA 70001

PELICANS CAMPUS IMPROVEMENTS 5800 Airline Drive Metairie, Louisiana

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024

		4/12/202							
REVISIONS									
no.	descripton	date							

ELECTRICAL SCHEDULES

GENERAL NOTES

- WORK PERFORMED SHALL AT A MINIMUM BE IN ACCORDANCE WITH THE LATEST APPLICABLE EDITION ADOPTED BY THE AUTHORITY HAVING JURISDICTION OF THE STANDARDS LISTED BELOW. WHERE THESE SPECIFICATIONS, PLANS, AND NOTES ARE MORE STRINGENT THAN ADOPTED CODE THEY SHALL TAKE PRECEDENCE. IN CASE OF CONFLICT, OBTAIN A DECISION FROM THE ARCHITECT
- 1. THE NATIONAL ELECTRICAL CODE NFPA 70 2020 EDITION (NEC)
- 2. ENTERGY CUSTOMER INSTALLATION STANDARDS FOR ELECTRIC SERVICE.
- NFPA 101 LIFE SAFETY CODE
- 4. NFPA 90A STANDARD FOR THE INSTALLATION OF AIR CONDITIONING AND VENTILATING SYSTEMS 5. NFPA 90B STANDARD FOR THE INSTALLATION OF WARM AIR HEATING AND AIR CONDITIONING
- 6. ASHRAE STANDARD 90.1
- 7. ICC/ANSI A117.1 ACCESSIBLE AND USABLE BUILDINGS AND FACILITIES
- 8. ADA STANDARDS FOR ACCESSIBLE DESIGN 8.1. 28 CFR PART 35.151
- 8.2. ADAAG AMERICANS WITH DISABILITIES ACT ACCESSIBILITY GUIDELINES 9. APPLICABLE STATE AND LOCAL CODES/ORDINANCES
- 10. APPLICABLE HEALTH CODES
- 11. OSHA 1926 SAFETY AND HEALTH REGULATIONS FOR CONSTRUCTION
- 12. NECA 1 STANDARD PRACTICE OF GOOD WORKMANSHIP IN ELECTRICAL CONSTRUCTION 13. INTERNATIONAL BUILDING CODE (IBC)
- 1. INCLUDE THE COSTS TO INCORPORATE ALL CODES AND ORDINANCES REQUIRED BY ANY AUTHORITY HAVING JURISDICTION ON THE PROJECT INTO THE BASE BID FOR THE PROJECT. NO ADDITIONAL FUNDS WILL BE ALLOCATED FOR WORK TO CONFORM TO REGULATIONS AND REQUIREMENTS AND/OR TO OBTAIN APPROVAL OF WORK.
- 2. THE TERM "PROVIDE" MEANS TO FURNISH AND INSTALL.
- 3. IF A CONFLICT OCCURS BETWEEN DRAWINGS, SPECIFICATIONS, AND/OR NOTES BID THE GREATER QUANTITY AND/OR QUALITY.
- 4. ELECTRICAL EQUIPMENT AND COMPONENTS SHALL BE LOCATED ABOVE BASE FLOOD ELEVATION OR GRADE ELEVATION. WHICHEVER IS HIGHER.
- 5. COMPLETELY BOND AND GROUND ENTIRE ELECTRICAL SYSTEM IN ACCORDANCE WITH THE CURRENT NEC ARTICLE 250 IN IT'S ENTIRETY.
- 6. DRAWINGS ARE DIAGRAMMATICAL. ALL ELECTRICAL EQUIPMENT LOCATIONS ARE APPROXIMATE ONLY. FOR ALL MEASUREMENTS, USE ARCHITECTURAL, MECHANICAL OR OTHER RESPECTIVE DIVISION'S PLANS AND FIELD SURVEYS. COORDINATE WITH AIR CONDITIONING WORK, CABINET WORK, PARTITION WORK, ETC., WHEN NEEDED. LAYOUT OF EQUIPMENT, ACCESSORIES, SPECIALTIES, WIRING AND CONDUIT SYSTEMS ARE STRICTLY DIAGRAMMATIC UNLESS SPECIFICALLY DIMENSIONED, AND DO NOT INDICATE EVERY REQUIRED FITTING, ELBOW, TRANSITION, JUNCTION BOX OR SIMILAR ITEMS THAT ARE REQUIRED FOR A COMPLETE INSTALLATION.
- 7. COORDINATE PHASING AS DIRECTED BY ARCHITECTURAL DRAWINGS AND THE GENERAL CONTRACTOR. MAKE ALL TEMPORARY CONNECTIONS NECESSARY ACCORDING TO ELECTRICAL
- 8. ARCHITECT BASE DRAWINGS HAVE PREFERENCE. ALL DISCREPANCIES WITH BASE DRAWINGS IN ELECTRICAL SET TO BE CLARIFIED WITH CONTRACTOR, ARCHITECT AND ELECTRICAL ENGINEER.
- 9. REFER TO ARCHITECTURAL REFLECTED CEILING PLAN FOR CEILING TYPES AND EXACT LOCATION OF ALL FIXTURES. VERIFY CEILING TYPES WITH ARCHITECT PRIOR TO ORDERING LIGHT FIXTURES TO ENSURE COMPATIBLE FIXTURE TRIMS AND MOUNTING HARDWARE.
- 10. CONTRACTOR TO COORDINATE ALL CONDUITS AND ELECTRICAL DEVICES/BOXES WITH ARCHITECT AS RELATED TO WALL CONSTRUCTION TYPE PRIOR TO INSTALLATION.
- 11. CONTRACTOR TO COORDINATE ALL UTILITY SERVICE REQUIREMENTS WITH OWNER OR TENANT AND LOCAL UTILITY SERVICE PROVIDER FOR ALL UTILITIES REQUIRED BY OWNER OR TENANT (ELECTRICAL, PHONE, CABLE, DATA. ETC.) AND PROVIDE A FULL INSTALL INCLUDING CONDUIT, DEMARK POINTS, JUNCTION BOXES, ETC. IN ACCORDANCE WITH RESPECTIVE UTILITY'S REQUIREMENTS.
- 12. PROVIDE COMPLETE INSTALLATION, INCLUDING ALL MINOR ITEMS. THIS INCLUDES ELECTRICAL, PHONE, CABLE, DATA, AS WELL AS ANY OTHER SYSTEMS SHOWN IN THESE DRAWINGS. PROVIDE ALL MOUNTING HARDWARE FOR LIGHTING FIXTURES AND OTHER ELECTRICAL EQUIPMENT REQUIRED FOR A COMPLETE INSTALL.
- 13. CONTRACTOR IS RESPONSIBLE FOR COORDINATION WITH GENERAL CONTRACTOR ON THE APPLICATION FOR PERMIT AND REMITTANCE OF ALL FEES. IN ADDITION, CONTRACTOR TO PROVIDE FINAL INSPECTION CERTIFICATE.
- 14. CONTRACTOR SHALL CAREFULLY INVESTIGATE STRUCTURAL CONDITIONS, WALL AND CHASE LOCATIONS AND ROOM FINISHES AND MAKE ACTUAL MEASUREMENTS ON THE JOB SO THAT ALL ELECTRICAL EQUIPMENT SUCH AS PANELBOARDS, SWITCHES, RECEPTACLES, LIGHTING FIXTURES, FIRE ALARM STATIONS, HORNS, ANNUNCIATORS, CONDUITS AND ACCESSORIES SHALL HAVE ADEQUATE CLEARANCES AS REQUIRED BY NEC AND BY THE MANUFACTURER'S REQUIRED INSTALLATION PRACTICES. ALL EQUIPMENT SHALL BE CONNECTED IN A WAY THAT ALLOWS AMPLE MAINTENANCE SPACE AND PASSAGE SPACE.
- 15. CONTRACTOR SHALL CONTINUOUSLY MAINTAIN ADEQUATE PROTECTION OF STORED MATERIALS AND INSTALLED WORK. ALL FIXTURES AND EQUIPMENT SHALL BE TIGHTLY COVERED WITH SHEET POLYETHYLENE OR WATERPROOF TARPAULIN AND PROTECTED AGAINST DIRT, RUST, MOISTURE, CHEMICAL AND MECHANICAL INJURY REGARDLESS OF LOCATION. MATERIALS SHALL NOT BE STORED DIRECTLY ON EARTH ON IN AREAS WHERE THEY WILL BE SUBJECT TO PHYSICAL INJURY FROM VEHICLE TRAFFIC OR CONSTRUCTION EQUIPMENT. CONDUIT OPENINGS SHALL BE CAPPED OR PLUGGED DURING INSTALLATION. KEEP STOCK OF MATERIAL AND EQUIPMENT STORED ON THE PREMISES IN A NEAT AND ORDERLY MANNER.
- 16. AT THE END OF EACH WORK DAY, THE CONTRACTOR SHALL REMOVE ALL DEBRIS, SURPLUS MATERIALS OR FOREIGN MATTER CAUSED BY THE PERFORMANCE OF ELECTRICAL WORK ON THE PREMISES. UPON COMPLETION OF THE WORK THE CONTRACTOR SHALL BE RESPONSIBLE FOR LEAVING THE PREMISES IN A CLEAN CONDITION.
- 17. NO INSTALLATION WILL BE CONSIDERED COMPLETE UNTIL THE PROPER OPERATION OF ALL ELECTRICAL EQUIPMENT HAS BEEN DEMONSTRATED TO THE SATISFACTORY OF THE OWNER OR ITS AUTHORIZED REPRESENTATIVE. ALSO, ANY RECORD DRAWINGS, BOOKS NECESSARY TO MAINTAIN OR REPLACE ANY CONTRACTOR SUPPLIED MATERIAL SHALL BE COMPILED AND PRESENTED TO THE OWNER IN A FORM SUITABLE FOR REPRODUCTION.
- 18. ALL TERMINATIONS SHALL BE LISTED FOR 75 DEGREES C UNLESS OTHERWISE NOTED.
- 19. ALL CABLE SHALL BE COPPER UNLESS OTHERWISE NOTED.
- 20. BRANCH CIRCUITS WITH UNMARKED CONDUCTOR AMOUNTS AND SIZES SHALL DEFAULT TO #12 COPPER CONDUCTORS IN CONDUIT.
- 21. ALL BRANCH CIRCUITRY INSTALLATION AND LOADING SHALL COMPLY WITH THE NEC.
- OUTLET: A POINT ON THE WIRING SYSTEM AT WHICH CURRENT IS TAKEN TO SUPPLY UTILIZATION RECEPTACLE: A CONTACT DEVICE INSTALLED AT THE OUTLET FOR THE CONNECTION OF AN
- 23. MULTI-WIRE BRANCH CIRCUITS SHALL BE PROVIDED WITH A COMMON DISCONNECT AT THE SOURCE. THE DISCONNECT SHALL BE EITHER A MULTI-POLE CIRCUIT BREAKER OR INDIVIDUAL CIRCUIT BREAKERS WITH LISTED HANDLE TIES. ALL CIRCUIT CONDUCTORS OF EACH MULTI-WIRE BRANCH CIRCUIT SHALL BE GROUPED AND TIED TOGETHER IN AT LEAST ONE LOCATION IN THE PANEL. MULTI-WIRE BRANCH CIRCUITS SHALL ONLY SERVE SINGLE POLE LINE-TO-NEUTRAL LOADS.

- 24. MULTI-WIRE BRANCH CIRCUITS SHALL BE PROVIDED WITH A COMMON DISCONNECT AT THE SOURCE. THE DISCONNECT SHALL BE EITHER A MULTI-POLE CIRCUIT BREAKER OR INDIVIDUAL CIRCUIT BREAKERS WITH LISTED HANDLE TIES. ALL CIRCUIT CONDUCTORS OF EACH MULTI-WIRE BRANCH CIRCUIT SHALL BE GROUPED AND TIED TOGETHER IN AT LEAST ONE LOCATION IN THE PANEL. MULTI-WIRE BRANCH CIRCUITS SHALL ONLY SERVE SINGLE POLE LINE-TO-NEUTRAL LOADS.
- 25. WORKMANSHIP TO MEET NECA 1 GUIDELINES. PUT INTO OPERATION AND TEST ALL ELECTRICAL EQUIPMENT. ALL CIRCUITS SHALL BE TESTED BY CONTRACTOR FOR PROPER VOLTAGE AND PHASE ROTATION; CONTINUITY; PROPER POLARITY; PROPERLY FUNCTIONING GROUND FAULT INTERRUPTERS AND OTHER OUTLETS AND EQUIPMENT; AND FOR ELECTRICAL ISOLATION OF ALL UNGROUNDED CONDUCTORS FROM GROUND AND FROM THE CONDUIT SYSTEM. CONTRACTOR SHALL BALANCE THE LOADS ON EACH PANEL TO WITHIN 15% BETWEEN MAXIMUM AND MINIMUM CURRENTS.
- 26. CONDUIT AND TUBING SHALL BE RUN IN STRAIGHT LINES FOLLOWING BUILDING LINES. IN GENERAL BENDS SHALL BE AT 90 DEGREES AND CONDUIT AND TUBING SHALL BE ROUTED PARALLEL AND PERPENDICULAR TO WALLS AND OTHER CONDUITS AND TUBING. GROUP CONDUIT WHERE PRACTICAL. GROUPED CONDUITS SHALL BE RUN WITH EQUIDISTANT SPACING (DERATE ACCORDING TO NFPA 70 REQUIREMENTS). USE CONDUIT BODIES TO MAKE SHARP CHANGES IN DIRECTION. THE ENTIRE INSTALLATION SHALL BE DONE IN A NEAT AND WORKMAN LIKE MANNER. ROUTING IN EXPOSED AREAS SHALL BE APPROVED BY THE
- 27. RACEWAYS AND CABLES SHALL BE INSTALLED CONCEALED UNLESS OTHERWISE NOTED.
- 28. ALL WORK SHALL BE PROPERLY SUPPORTED FROM THE BUILDING STRUCTURE IN AN APPROVED MANNER AND FASTENED TO BUILDING CONSTRUCTION WITH LISTED AND CODE
- 29. TYPE MC (METAL-CLAD) CABLE IS ALLOWED CONCEALED FOR BRANCH CIRCUITS. 29.1. USE ANTI-SHORT BUSHINGS WITH FLEXIBLE CONDUIT.
- 30. TYPE NM CABLE (ROMEX) IS NOT ALLOWED.
- 31. RACEWAYS PENETRATING THROUGH ANY ROOF SHALL HAVE ROOF PITCH POCKETS AND FLASHING WITH CAULKING AND PIPE SLEEVE. INSTALLATION SHALL BE WATERTIGHT. ROOF MOUNTED CONDUIT SYSTEMS SHALL BE INSTALLED ON SYNTHIC RECYCLED RUBBER SUPPORT BASES SPACED TO MEET NEC REQUIREMENTS FOR THE SIZE OF THE CONDUIT.
- 32. RACEWAYS AND OUTLETS PASSING THROUGH OR INSTALLED IN FIRE RATED CONSTRUCTION SHALL BE SEALED WITH U.L LISTED FIRE RATED SEALANT SYSTEM IN ACCORDANCE WITH SEALANT MANUFACTURERS' RECOMMENDATIONS. WHERE ELECTRICAL RACEWAYS ARE INSTALLED THROUGH RATED FLOORS OR WALLS, THE CONTRACTOR SHALL PROVIDE APPROPRIATE FIRE RATED DEVICES APPROVED BY ALL REQUIRED LOCAL AUTHORITIES FOR THE INTENDED APPLICATION. REFER TO ARCHITECTURAL DRAWINGS FOR ADDITIONAL INFORMATION.
- 33. MAINTAIN FIRE RATING OF WALLS, FLOORS, AND CEILINGS WHEN PERFORMING WORK AND INSTALLING DEVICES, BOXES, ETC. USE FIRE CAULK, "PUTTY PADS," AND OTHER APPROVED AND APPROPRIATE METHODS TO MAINTAIN RATING.

GENERAL NOTES (POWER)

- 1. INSTALL EQUIPMENT SO THAT CLEAR WORKING SPACE REQUIREMENTS OF THE NEC ARE MET.
- 3. ALL ELECTRICAL DISTRIBUTION EQUIPMENT SHALL BE OF THE SAME MANUFACTURER, INCLUDING: PANELBOARDS, TRANSFORMERS, DISTRIBUTION PANELS, SWITCHBOARDS, DISCONNECTS, MOTOR STARTERS, ETC.
- 4. PANELS, SWITCHBOARDS, MOTOR CONTROL CENTERS ARE TO BE FULLY RATED. NO SERIES RATED EQUIPMENT IS ALLOWED.
- PROVIDE TYPEWRITTEN PANELBOARD SCHEDULES TO PANELBOARD DOORS DEPICTING THE FINAL AS-BUILT CONDITIONS AT PROJECT COMPLETION. INDICATE DEVICE AND ROOM
- 6. COORDINATE ELECTRICAL SERVICE TRANSFORMER AND SERVICE REQUIREMENTS WITH THE LOCAL ELECTRICAL UTILITY COMPANY PRIOR TO CONSTRUCTION.
- 7. NO MORE THEN TEN DUPLEX OUTLETS ARE ALLOWED ON A 120V 20A BRANCH CIRCUIT.
- 8. LENGTH OF RECEPTACLES SHALL RUN VERTICALLY. DO NOT MOUNT OUTLETS BACK TO BACK ON OPPOSITE SIDES OF PARTITIONS.
- 9. ALL EXTERIOR RECEPTACLES SHALL BE LISTED WEATHER-RESISTANT TYPE, BE GFI PROTECTED, AND HAVE AN ENCLOSURE/COVERPLATE THAT IS WEATHERPROOF (WITH THE ATTACHMENT PLUG CAP INSERTED OR REMOVED).
- 10. PROVIDE GROUND FAULT CIRCUIT INTERRUPTERS TYPE RECEPTACLES FOR ALL 15 AND 20 AMPERE, 120 VOLT, CONVENIENCE RECEPTACLES IN BATHROOMS, KITCHEN AREAS, ROOF TOPS, EXTERIOR AND WITHIN 6 FOOT OF ALL SINKS.
- 11. THESE DRAWINGS HAVE BEEN COORDINATED WITH MECHANICAL AND PLUMBING DRAWINGS. ELECTRICAL CONTRACTOR TO COORDINATE FUSE, CIRCUIT BREAKER, WIRE, CONDUIT. DISCONNECT, ETC. SIZES WITH MANUFACTURERS' RECOMMENDATIONS OF EQUIPMENT AND UNITS ACTUALLY INSTALLED AND MODIFY AS NECESSARY TO ACCOMMODATE.
- 12. COORDINATE WITH MECHANICAL CONTRACTOR TO PROVIDE 120V FEEDS TO ACTUATED AND INTERLOCKED HVAC DAMPERS FROM NEAREST GENERAL RECEPTACLE CIRCUIT.

GENERAL NOTES (LIGHTING)

- 1. ALL EXIT SIGNS SHALL BE INSTALLED AS PER NFPA. WALL MOUNTED EXIT SIGNS SHALL BE MOUNTED SO THAT THE BOTTOM EDGE OF THE SIGN IS 2" CLEAR OF THE DOOR LINTEL OR FINISHED DOOR TRIM. WHERE WALL MOUNTING AFFECTS FIRE RATING OF THE AREA (SUCH AS STAIR ENCLOSURES), EXIT SIGN SHALL BE CEILING MOUNTED. THE BOTTOM OF THE SIGN MUST BE OUT OF THE EGRESS PATH OR ABOVE THE MINIMUM HEADROOM HEIGHT.
- 2. ALL ADJUSTABLE FIXTURES SHALL BE LOCATED AND PROPERLY AIMED AS DIRECTED BY THE ARCHITECT OR LIGHTING DESIGNER. ALL AIMING OF BUILDING FACADE LIGHTING SHALL BE PERFORMED BY CONTRACTOR AT NIGHT. ADJUSTABLE SUSPENDED FIXTURES HUNG WITH CHAIN OR CABLE SHALL HAVE SLACK IN THE SUPPORT AVAILABLE TO MOVE THE FIXTURE AS DIRECTED BY ARCHITECT OR LIGHTING DESIGNER.
- 3. MOUNT ALL OCCUPANCY SENSORS/SWITCHES IN A MANNER THAT DOES NOT OBSTRUCT THE INFRARED VIEW OF THE DEVICE.
- 4. DO NOT LOAD LIGHTING BRANCH CIRCUITS MORE THAN 80%.
- RECESSED FIXTURES IN FIRE RATED CEILINGS AND RETURN AIR PLENUMS SHALL BE RATED FOR THE FIRE RATING OF THE CEILING OR SHALL BE FULLY ENCLOSED IN A FIRE RATED HOUSING ACCEPTABLE TO AUTHORITY HAVING JURISDICTION.

GENERAL NOTES (COMMUNICATIONS)

- 1. COORDINATE ALL SPECIAL SYSTEMS INSTALLATION (DATA/COM, CABLE, TELEPHONE, ETC.) WITH CLIENT'S IT DIRECTOR. CABLE, DATA AND PHONE DROPS HAVE BEEN SHOWN ON THESE DRAWINGS AS A REFERENCE GUIDE. ALL DATA/COM, CABLE, TELEPHONE ETC. MUST BE PULLED IN A RACEWAY BACK TO THE DATA/COM CLOSET OR WHERE INDICATED ON
- 2. ALL COPPER DATA LINES SHALL BE TERMINATED ON ONE END IN A RJ-45 TYPE RECEPTACLE AS SHOWN ON DRAWINGS AND THE OTHER END SHALL BE TERMINATED IN A RJ-45 TYPE PLUG. IN NO CASE SHALL ANY DATA CABLE LENGTH FROM PATCH PANEL TO RJ45 RECEPTACLE EXCEED 295 FEET.
- 3. PHONE AND DATA LINES SHALL BE CATEGORY 6 CABLE.
- 4. ALL CABLES TO BE IN CONDUIT OR J-HOOK SUPPORT SYSTEM. PROVIDE CONDUIT SLEEVES
- 5. RUN COMMUNICATIONS BRANCH CABLES IN MINIMUM 3/4" CONDUIT:
- 5.1. CAT 6 CABLES
- FOR 8 CABLES, USE 2" CONDUIT. FOR 4 CABLES, USE 1" CONDUIT. FOR 2 CABLES, USE 1 1/2" CONDUIT.

			ELECTRIC
ABBR.	DEFINITION	ABBR.	DEFINITION
A	AMPERE	LTG	LIGHTING
ABC	ABOVE COUNTER	KAIC	AMPS INTERRUPTING CAPACITY x1000
AC	ABOVE COUNTER	KV	KILOVOLT
AF	AMPERE FUSE	KVA	KILOVOLT-AMPERE
AFF	ABOVE FINISHED FLOOR	KW	KILOWATT
AHJ	AUTHORITY HAVING JURISDICTION	МСВ	MAIN CIRCUIT BREAKER
AHU	AIR HANDLING UNIT	MCC	MOTOR CONTROL CENTER
AFC	ABOVE FINISHED CEILING	МСМ	CIRCULAR MILS, THOUSANDS
AT	AMPERE TRIP	MECH	MECHANICAL
ANN	ANNUNCIATOR	MFR	MANUFACTURER
APPROX	APPROXIMATE	MGAP	MEDICAL GAS ALARM PANEL
ARCH	ARCHITECT	MLO	MAIN LUGS ONLY
ATS	AUTOMATIC TRANSFER SWITCH	MTD	MOUNTED
AWG	AMERICAN WIRE GAUGE	MTG	MOUNTING
BLDG	BUILDING	MTS	MANUAL TRANSFER SWITCH
BSMT	BASEMENT	NEC	NATIONAL ELECTRICAL CODE
С	CONDUIT	NF	NON-FUSED
CAB	CABINET	NL	NIGHT-LIGHT
СВ	CIRCUIT BREAKER	NTS	NOT TO SCALE
СКТ	CIRCUIT	PNL	PANEL
CLG	CEILING	PH	PHASE
CL	CENTER LINE	Р	POLE
СТ	CURRENT TRANSFORMER	PFB	PROVISIONS FOR BREAKER
CU	COPPER	PA	PUBLIC ADDRESS
DISC	DISCONNECT	RECT	RECEPTACLE

ABBR.	DEFINITION	ABBR.	DEFINITION
DN	DOWN	REF	REFRIGERATOR
DWG	DRAWING	REQD	REQUIRED
EA	EACH	SEC	SECURITY
EDF	ELECTRIC DRINKING FOUNTAIN	SPKR	SPEAKER
EF	EXHAUST FAN	SPEC	SPECIFICATION
ELEV	ELEVATOR	SWBD	SWITCHBOARD
EP	EXPLOSION-PROOF	SWGR	SWITCHGEAR
EQPT	EQUIPMENT	TEL	TELEPHONE
EXTG	EXISTING	TTB	TELEPHONE TERMINAL BOARD
FA	FIRE ALARM	TV	TELEVISION
FACP	FIRE ALARM CONTROL PANEL	TVSS	TRANSIENT VOLT. SURGE SUPPRESSO
FCU	FAN COIL UNIT	TYP	TYPICAL
FLA	FULL LOAD AMPS	UC	UNDER COUNTER
FLR	FLOOR	UON	UNLESS OTHERWISE NOTED
GFCI, GFI	GROUND FAULT CIRCUIT INTERRUPTER	V	VOLT
GND	GROUND	VA	VOLTAMPERE
HTR	HEATER	W	WATT
НТ	HEIGHT	WH	WATER HEATER
HP	HORSE POWER	WP	WEATHER-PROOF
HW	HOT WATER	W/	WITH
HWC	HOT WATER CIRCULATING	W/O	WITHOUT
ISO	ISOLATION CONTROL POWER	XFMR	TRANSFORMER
JB	JUNCTION BOX	XFR	TRANSFER

TYPICAL MOUNTING HEIGHTS THE CONTRACTOR SHALL COORDINATE THE MOUNTING HEIGHT OF ALL FIXTURES, DEVICES, AND OUTLETS WITH ALL DRAWINGS. SPECIAL MOUNTING HEIGHTS SHOWN ON THE DRAWINGS SHALL TAKE PRECEDENCE OVER THOSE GIVEN BELOW. ALL MOUNTING HEIGHTS ARE FROM FINISHED FLOOR TO CENTERLINE OF DEVICE, UNLESS NOTED OTHERWISE. LIGHTING FIXTURES INTERIOR WALL MOUNTED, SCONCE SEE ARCHITECTURAL ELEVATIONS WALL MOUNTED, ABOVE MIRROR 0'-8" ABOVE TOP OF MIRROR WALL MOUNTED, ABOVE DOOR CENTER BETWEEN FRAME & CEILING SWITCHES WALL SWITCHES AND DIMMERS WALL SWITCHES AND DIMMERS ADA UNITS 3'-8" RECEPTACLES ABOVE COUNTER WITHOUT BACKSPLASH 0'-8" ABOVE TOP OF COUNTER ABOVE COUNTER WITH BACKSPLASH 0'-4" ABOVE TOP OF BACKSPLASH WALL ADA UNIT ELECTRICAL EQUIPMENT SAFETY SWITCH 6'-6" TO TOP OF ENCLOSURE MOTOR STARTER 6'-6" TO TOP OF ENCLOSURE PANELBOARD 6'-6" TO TOP OF ENCLOSURE

woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443 Erik Wismar, AIA

307 WEST MAPLE RIDGE DR. METAIRIE, LA 70001

PELICANS CAMPUS IMPROVEMENTS 5800 Airline Drive Metairie, Louisiana

WDG PROJECT NO LAR2315

CONSTRUCTION DOCUMENTS 04.15.2024

4/12/2024

descripton

ELECTRICAL SPECIFICATIONS

	PELICANS	CAMPUS IMPROV	/EMENTS LIGHTING FIXTURE SCHEDULE		
TYPE:	DESCRIPTION:	MANUFACTURER:	CATALOG NUMBER:	VOLTAGE:	CCT (LAMPING):
F1	6" DOWNLIGHT	ALPHABET	NU6RD-SW-25LM-35K-90-HE40-HCL-BK-BK-NC-UNV-DIM10 WITH	UNV	3500K
F1E	6" DOWNLIGHT WITH BATTERY	ALPHABET	BATTERY	UNV	3500K
F2	DECORATIVE RECEPTION PENDANT	DECORATIVE	PENDANT FIXTURE	UNV	3500K
F3	2X4 LAYIN	METALUX	24CZSCT3-UNV	UNV	3500K
F4	4" DOWNLIGHT	ALPHABET	NU4RD-SW-25LM-35K-90-HE40-HCL-BK-BK-NC-UNV-DIM10	UNV	3500K
F5	RECCESS LINEAR LIGHT	PINNACLE	EV4D-935HO-R20X12-G1-U-FSD-1-0-W-QS	UNV	3500K
F6	STAIRWELL FIXTURE	METALUX	4SWLED-40SL-LW-L835-CD1-U	UNV	3500K
F7	KITCHEN 2X2 LAY-IN	METALUX	22FP4235C	UNV	3500K
F8	CAFÉ DEORATIVE PENDANT	OCL	NO1-P1FA-24-MW-[FINISH]-LED1-35K-UNV-100-DM1	UNV	3500K
F9	CAFÉ RECESSED LINEAR LIGHT	AXIS LIGHTING	SLATE 1 SERIES	UNV	3500K
F10	CAFÉ OUTDOOR SEATING WALL SCONCE	VISA LIGHTING	OW1721-L35K(H)-MVOLT-[FINISH]	UNV	3500K
F11	2X4 RECESSED TROFFER	METALUX	24CZSCT3-UNV	UNV	3500K
F12	PLAYER BATHROOM VANITY LIGHT	STARTEK	SLIMDI-8'-500-350-SD-CL-35K-80-[FINISH]-WM-U-1C	UNV	3500K
F13	PLAYER CAFÉ UNDERCOUNTER LIGHT	DIODE	BLAZE BASIC // BLACK CHANNEL / FROSTED LENS	120V	3500K
F14	OUTDOOR TRAINING LIGHT	MCGRAW-EDISON	GWC-SA1-D-L835-U-T4FT-[FINISH]-MS-LXX-BB/GWCXX	UNV	3500K
F15	TRAINING OFFICE 1X4	METALUX	14CZ2-48HE-UNV-L835-CD1-U DF-14W-U	UNV	3500K
EM	EMERGENCY 2 HEAD BATTERY PACK	SURE LITES	AP2SQLED	120V	
EX	EXIT	BARRON	S902-WB-SR-RC-AG	120V	



woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443 Erik Wismar, AIA


PoNCE, LLC 307 WEST MAPLE RIDGE DR. METAIRIE, LA 70001

PELICANS CAMPUS IMPROVEMENTS
5800 Airline Drive
Metairie, Louisiana

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024

LIGHTING FIXTURE SCHEDULE

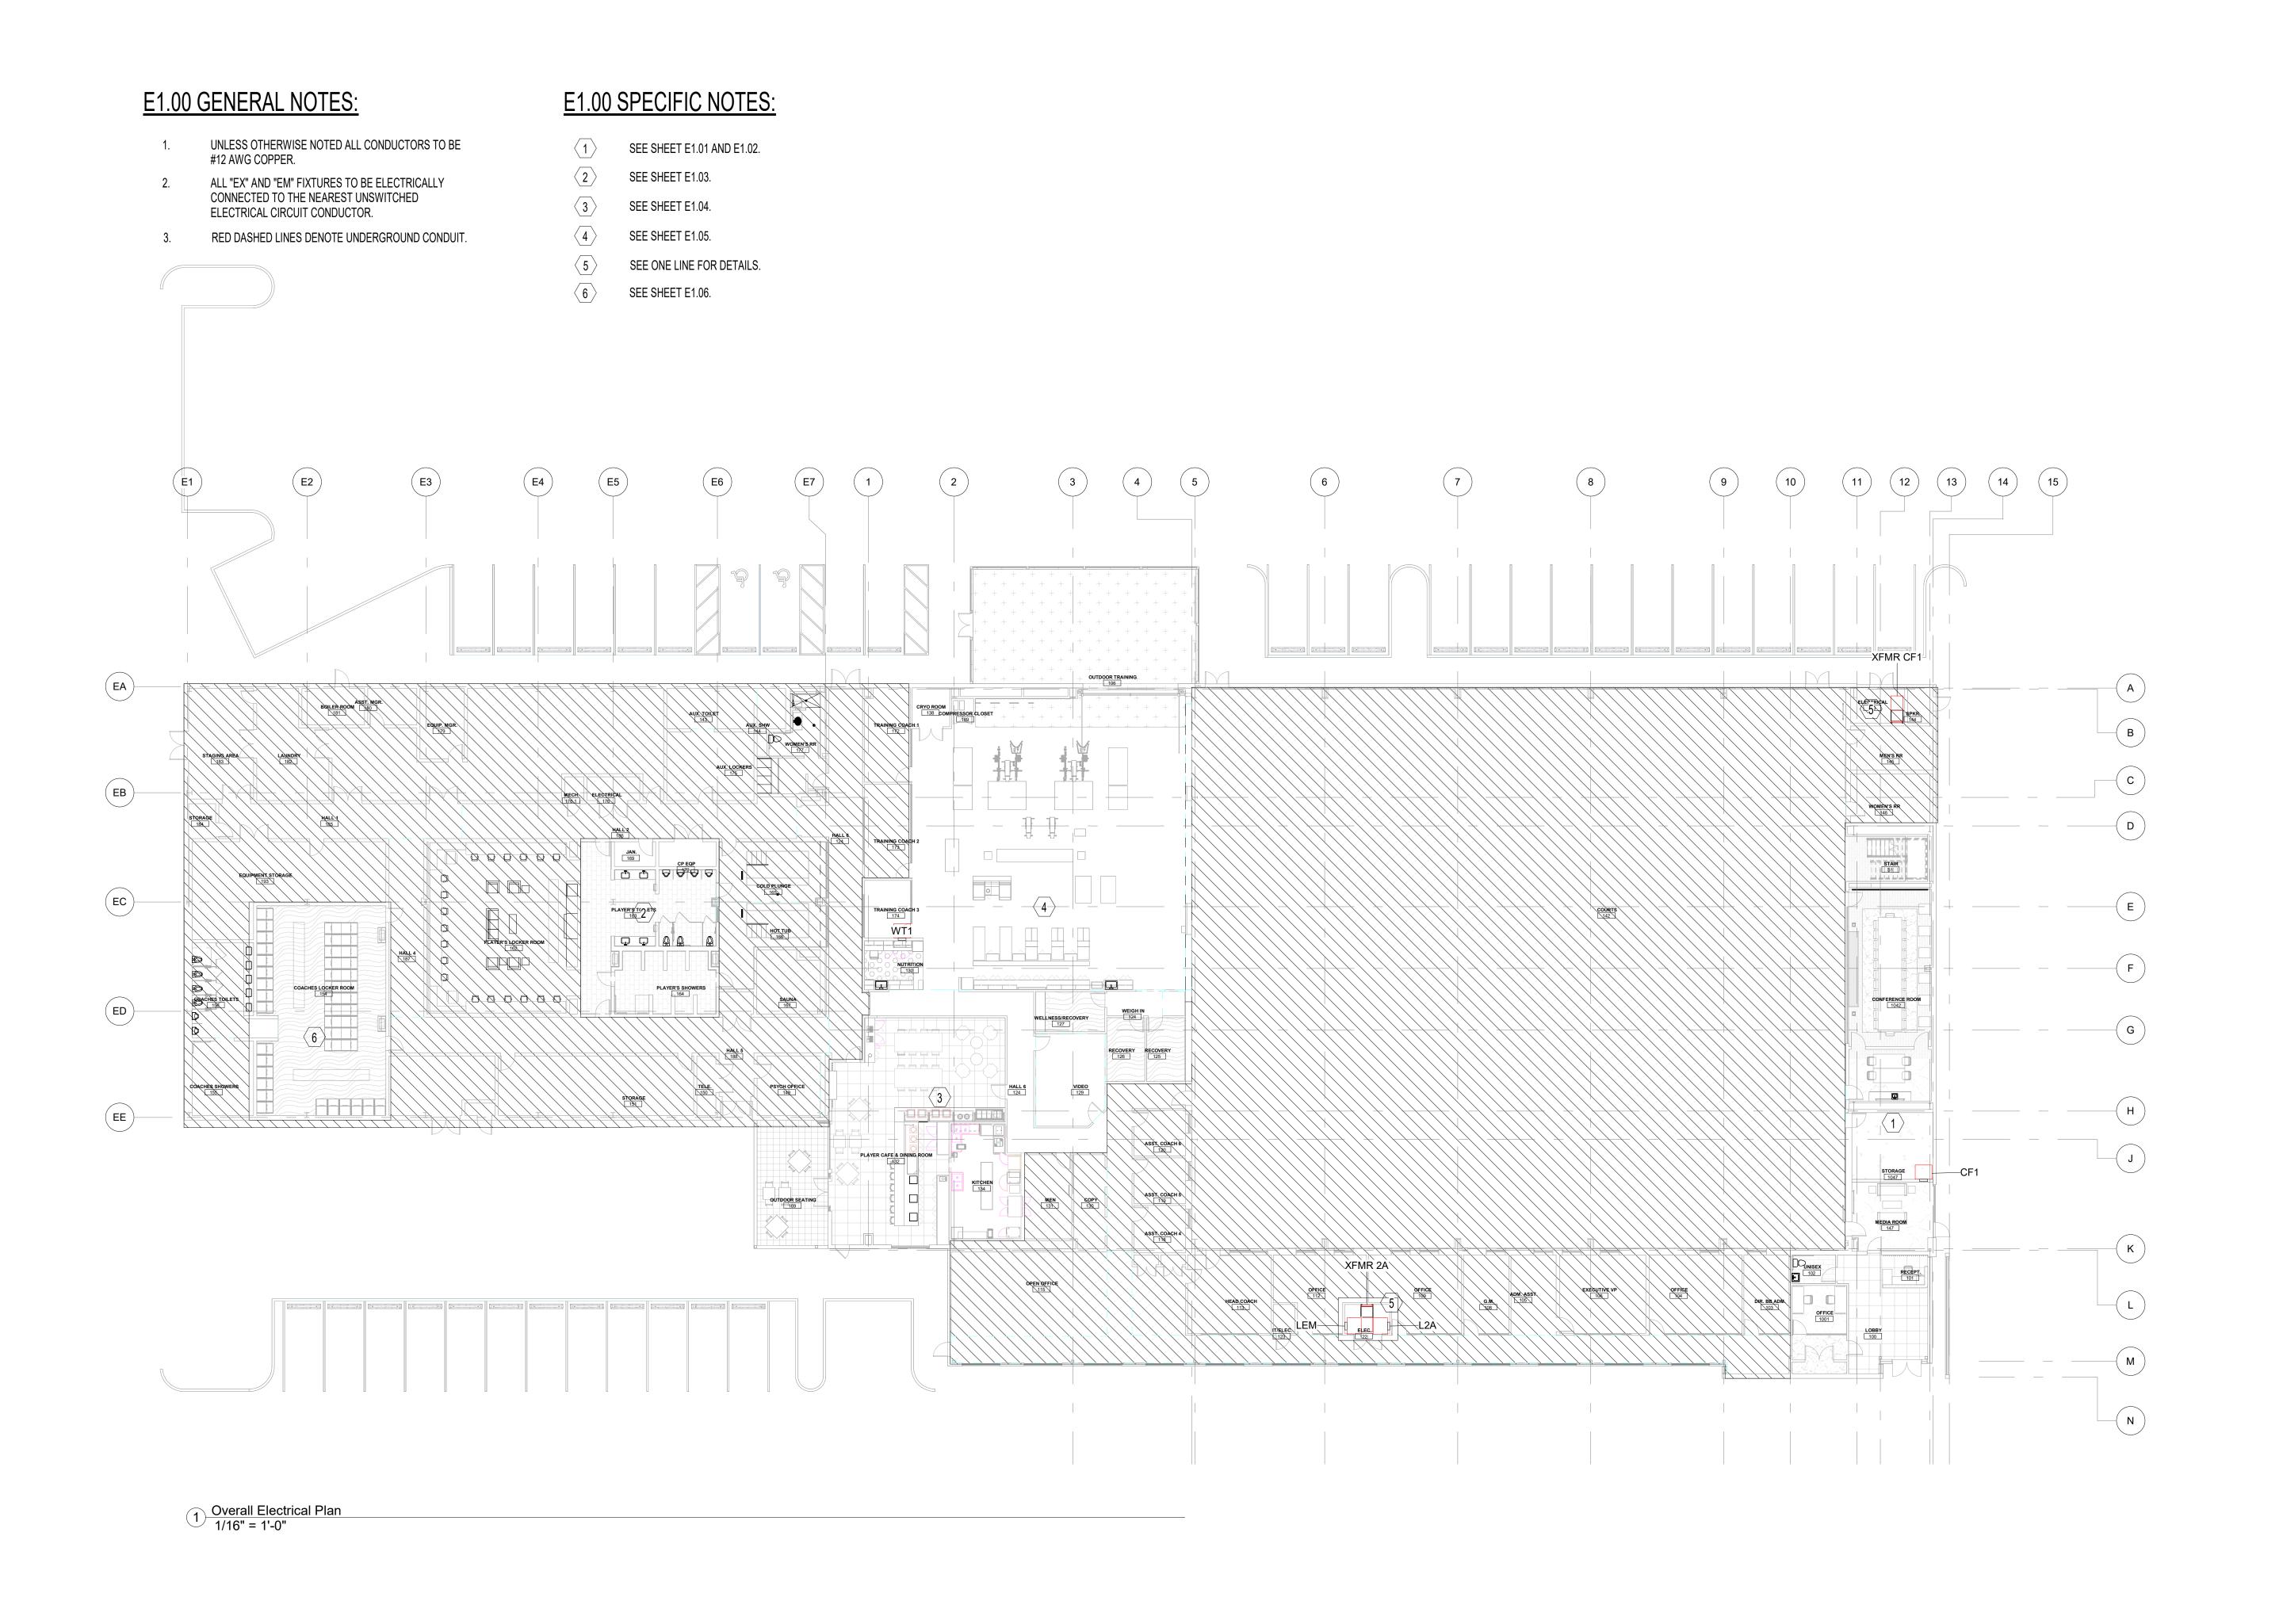




woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443 Erik Wismar, AIA



PELICANS CAMPUS IMPROVEMENTS 5800 Airline Drive Metairie, Louisiana

WDG PROJECT NO | AR2315



2/202
date
١



E1.01 GENERAL NOTES:

- 1. UNLESS OTHERWISE NOTED ALL CONDUCTORS TO BE #12 AWG COPPER.
- 2. ALL "EX" AND "EM" FIXTURES TO BE ELECTRICALLY CONNECTED TO THE NEAREST UNSWITCHED ELECTRICAL CIRCUIT CONDUCTOR.
- RED DASHED LINES DENOTE UNDERGROUND CONDUIT.
- I. ALL LIGHTING CONNECTED TO GRAFIK EYE TO BE FED WITH 0-10V 2 CONDUCTOR DIMMING WIRE FROM GRAFIK EYE CONTROLLER LOCATION.
- ROUTE LUTRON LOW VOLTAGE CABLE BETWEEN ALL GRAFIK EYE CONTROLLERS SERVING THE SAME LOCATION.
- 6. CONFIRM ALL MECHANICAL POWER REQUIRMENTS WITH MECHANICAL/PLUMBING DRAWINGS PRIOR TO ROUGH-IN.

E1.01 SPECIFIC NOTES:

- CONFIRM HEIGHT PRIOR TO ROUGH-IN.
- ROUTE ADDITIONAL CONSTANT HOT CONDUCTOR TO FIXTURE WITH BATTERY PACK FOR SWITCHING OPERATION.
- PROVIDE 1' STEM FOR EXIT FIXTURE.
- PROVIDE 4 ZONE GRAFIK EYE FOR CONFERENCE ROOM ZONES. ALL CONFERENCE ROOM LIGHTING TO BE FED FROM A SINGLE CIRCUIT. CIRCUIT TO BE FED FROM EXISTING EMERGENCY PANEL LOCATED IN EXISTING MAIN ELECTRICAL ROOM LOCATED PLAN NORTHEAST OF BUILDING.
- PROVIDE 4 ZONE GRAFIK EYE FOR LOBBY ZONES. ALL LOBBY/RECEPTION LIGHTING TO BE FED FROM A SINGLE CIRCUIT. CIRCUIT TO BE FED FROM EXISTING EMERGENCY PANEL LOCATED IN EXISTING MAIN ELECTRICAL ROOM LOCATED PLAN NORTHEAST OF BUILDING.
- GRAFIK EYE CONTROLLER LOCATION.
- 7 CONNECT FIXTURE TO EXISTING HALLWAY LIGHTING CIRCUIT.
- ACCESS CONTROL POINT. PROVIDE RACEWAY TO IT RACK FOR INSALLATION BY OTHERS.
- CCTV CAMERA LOCATION. PROVIDE RACEWAY TO IT RACK FOR INSALLATION BY OTHERS.
- EXISTING FLOOR BOX TO BE REUSED.
- REMOVE EXISTING ACCESS CONTROL DEVICE AND PROVIDE WEATHER PROOF COVER.
- LOCATION OF NEW IT RACK. QUAD
 RECEPTACLE TO BE FED FROM EXISTING 'LEM'
 PANEL IN ELECTRICAL ROOM 122. PROVIDE
 RACEWAY FROM MDF ROOM FOR NEW FIBER.
- SPEAKER LOCATION. PROVIDE RACEWAY TO IT RACK FOR INSALLATION BY OTHERS.
- LOCATION OF EXISTING FLOOR BOXES
 CONNECTED TO THE SCOREBOARD SYSTEM.
 MOVE TO NEAREST WALL.
- LOCATION OF SCREEN WALL. PROVIDE 2"
 CONDUIT TO NEW IT RACK FOR 8 DATA DROPS.
 PROVIDE 4 20A CIRCUITS FED FROM PANEL
 'CF1' FOR POWER.
- RELOCATE EXISTING SWITCHES.



woodward design group
1000 S. NORMAN C. FRANCIS PARKWAY
NEW ORLEANS, LA 70125
WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA




PELICANS CAMPUS IMPROVEMENTS 5800 Airline Drive Metairie, Louisiana

CONSTRUCTION DOCUMENTS	04.15
William Of I OT	u .\
WILL OF LOUIS	114
	TE
LARRY L. BEACHLE REG. NO. 3/313	∕ * ₹

REVISIONS		
no.	descripton	date
		+
		+

ELECTRICAL FIRST FLOOR PLAN

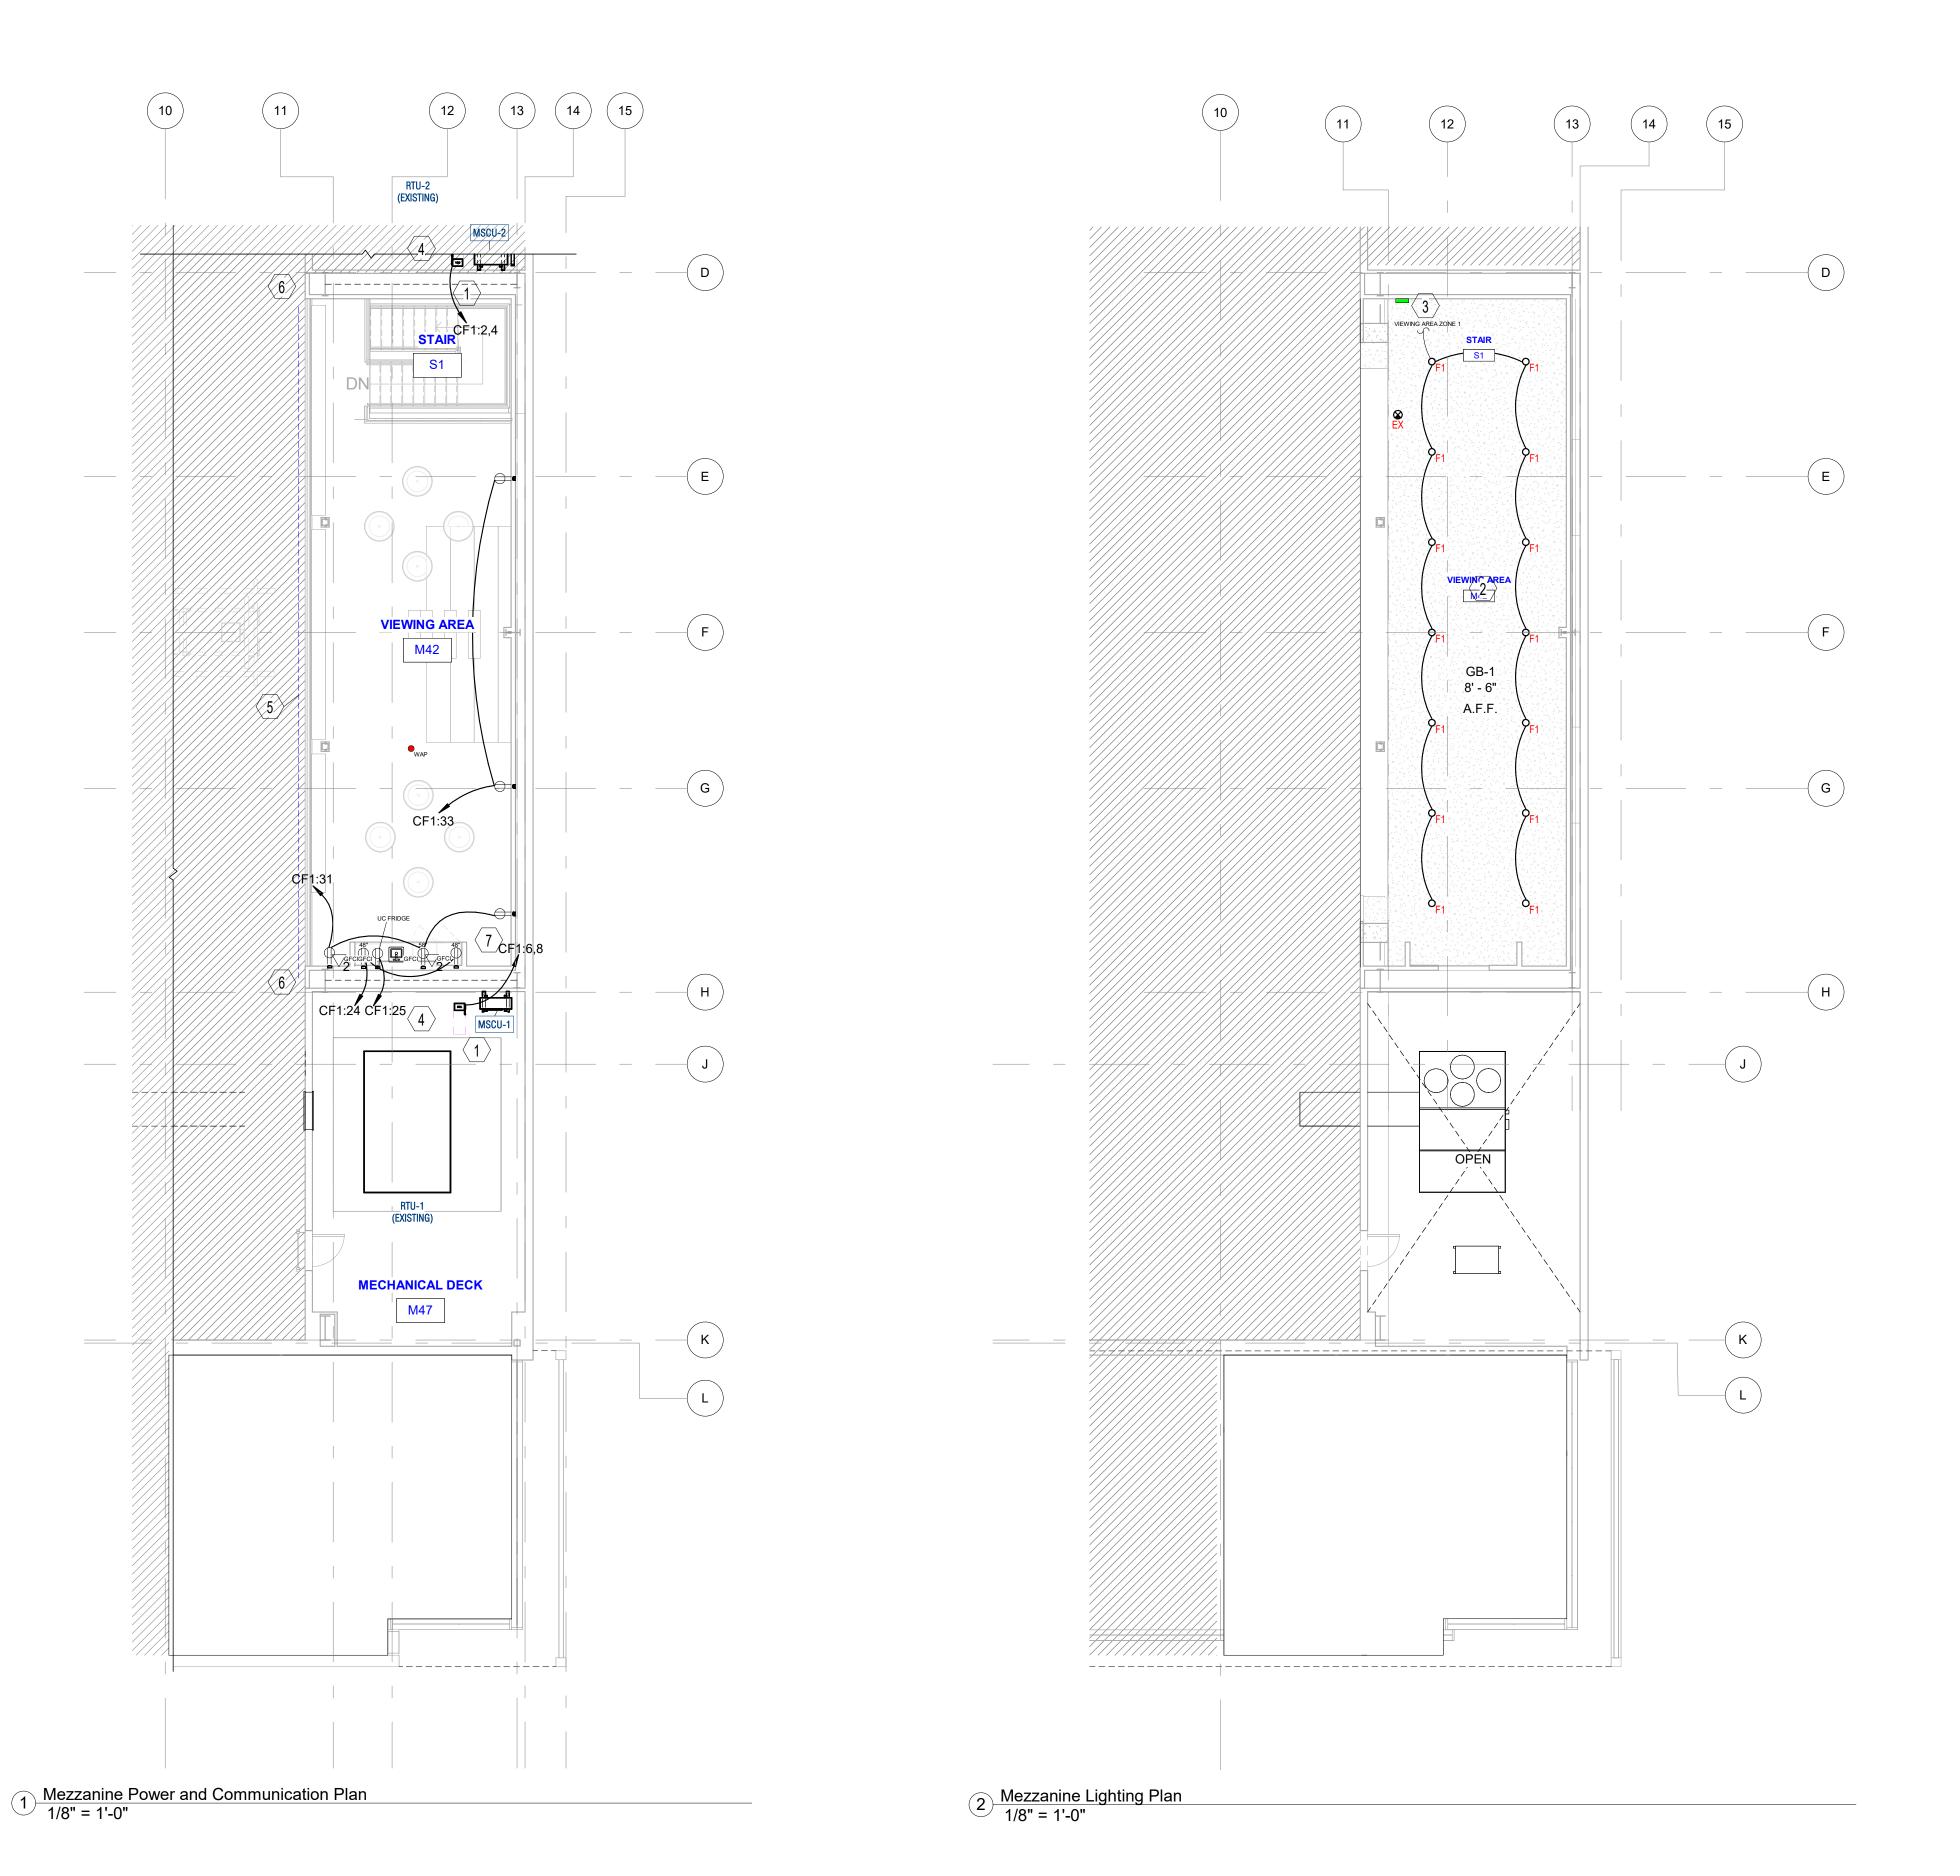

E1.02 GENERAL NOTES:

- 1. UNLESS OTHERWISE NOTED ALL CONDUCTORS TO BE #12 AWG COPPER.
- 2. ALL "EX" AND "EM" FIXTURES TO BE ELECTRICALLY CONNECTED TO THE NEAREST UNSWITCHED ELECTRICAL CIRCUIT CONDUCTOR.
- 3. RED DASHED LINES DENOTE UNDERGROUND CONDUIT.
- 4. ALL LIGHTING CONNECTED TO GRAFIK EYE TO BE FED WITH 0-10V 2 CONDUCTOR DIMMING WIRE FROM GRAFIK EYE CONTROLLER LOCATION.
- ROUTE LUTRON LOW VOLTAGE CABLE BETWEEN ALL GRAFIK EYE CONTROLLERS SERVING THE SAME LOCATION.
- 6. CONFIRM ALL MECHANICAL POWER REQUIRMENTS WITH MECHANICAL/PLUMBING DRAWINGS PRIOR TO ROUGH-IN.

E1.02 SPECIFIC NOTES:

- 3#10 + #10 GND. 3/4" C.. PROVIDE ADDITIONAL (3#12 + #12 GND. 3/4"C.) TO FAN COIL UNIT LOCATED ON FIRST FLOOR.
- PROVIDE 4 ZONE GRAFIK EYE FOR VIEWING AREA ZONES. ALL VIEWING AREA LIGHTING TO BE FED FROM A SINGLE CIRCUIT. CIRCUIT TO BE FED FROM EXISTING EMERGENCY PANEL LOCATED IN EXISTING MAIN ELECTRICAL ROOM LOCATED PLAN NORTHEAST OF BUILDING.
- GRAFIK EYE CONTROLLER LOCATION.
- IF THERE IS AN EXISTING SERVICE
 RECEPTACLE. IT IS TO REAMIN. IF NOT ADD WP
 GFCI RECEPTACLE WITH WEATHER PROOF
 COVER ON A DEDICATED CIRCUIT.
- 5 REROUTE EXISTING EXPOSED CONDUITS.
- RELOCATED EXISTING SPEAKER TO THIS
- 7 CCTV CAMERA LOCATION. PROVIDE RACEWAY TO IT RACK FOR INSALLATION BY OTHERS.

woodward design group
1000 S. NORMAN C. FRANCIS PARKWAY
NEW ORLEANS, LA 70125
WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA




PELICANS CAMPUS IMPROVEMENTS 5800 Airline Drive Metairie, Louisiana

WDG PROJECT NO | AR2315



no.	descripton	dat

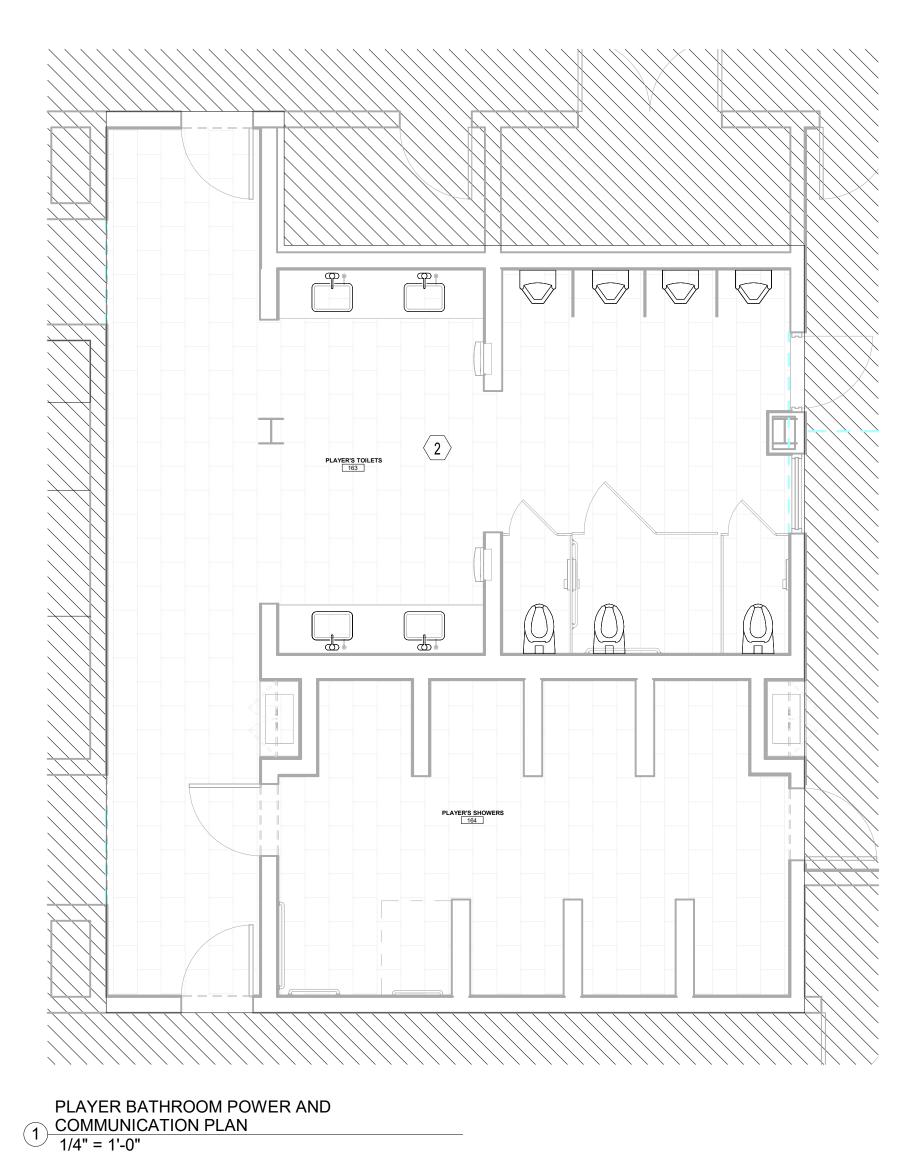

2 PLAYERS BATHROOM LIGHITNG PLAN
1/4" = 1'-0"

E1.03 GENERAL NOTES:

- 1. UNLESS OTHERWISE NOTED ALL CONDUCTORS TO BE #12 AWG COPPER.
- ALL "EX" AND "EM" FIXTURES TO BE ELECTRICALLY CONNECTED TO THE NEAREST UNSWITCHED ELECTRICAL CIRCUIT CONDUCTOR.
- 3. RED DASHED LINES DENOTE UNDERGROUND CONDUIT.

E1.03 SPECIFIC NOTES:

- REPLACE ALL EXISTING LIGHTS AND DEVICES WITH NEW. REUSE EXISTING CIRCUITS AND SWITCH LEGS.
- REPLACE ALL EXISTING RECEPTACLES. FIGURE 3 TOTAL.

PLAYER'S TOILETS

O_{F1}

 O_{F1}

O_{F1}

woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443 Erik Wismar, AIA

PoNCE, LLC 307 WEST MAPLE RIDGE DR. METAIRIE, LA 70001

PELICANS CAMPUS IMPROVEMENTS
5800 Airline Drive
Metairie, Louisiana

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024

4/12/2024

ELECTRICAL PLAYERS BATHROOM PLAN


E1.04 GENERAL NOTES:


- UNLESS OTHERWISE NOTED ALL CONDUCTORS TO BE #12 AWG COPPER.
- ALL "EX" AND "EM" FIXTURES TO BE ELECTRICALLY CONNECTED TO THE NEAREST UNSWITCHED ELECTRICAL CIRCUIT CONDUCTOR.
- RED DASHED LINES DENOTE UNDERGROUND CONDUIT.
- ALL LIGHTING CONNECTED TO GRAFIK EYE TO BE FED WITH 0-10V 2 CONDUCTOR DIMMING WIRE FROM GRAFIK EYE CONTROLLER LOCATION.
- ROUTE LUTRON LOW VOLTAGE CABLE BETWEEN ALL GRAFIK EYE CONTROLLERS SERVING THE SAME LOCATION.
- CONFIRM ALL MECHANICAL POWER REQUIRMENTS WITH MECHANICAL/PLUMBING DRAWINGS PRIOR TO ROUGH-IN.

E1.04 SPECIFIC NOTES:

- CONFIRM ALL ELECTRICAL REQUIRMENTS OF KITCHEN EQUIPMENT WITH KITCHEN DRAWINGS PRIOR TO ROUGH-IN. CONFIRM HEIGHT AND LOCATION OF ALL DEVICES.
- PROVIDE 8 ZONE GRAFIK EYE FOR CAFE ZONES. ALL CAFE LIGHTING TO BE FED FROM A SINGLE CIRCUIT. CIRCUIT TO BE FED FROM EXISTING EMERGENCY PANEL LOCATED IN ELECTRICAL ROOM LOCATED 122.
- NOT USED.
- PROVIDE 2 CEILING MOUNT OCCUPANCY SENSORS TO CONTROL KITCHEN LIGHTS. LIGHTS TO BE FED FROM EXISTING EMERGENCY PANEL IN ELECTRICAL ROOM 122.
- LIGHTS TO BE FED FROM EXISTING EMERGENCY PANEL IN ELECTRICAL ROOM 122.
- CONNECT TO EXISTING SWITCH IN ROOM. REPLACE SWITCH WITH NEW DEVICE.
- JUNCTION BOX FOR CEILING MOUNTED RECEPTACLES FOR DIGITAL SIGNS AND ORDER BOARDS. PROVIDE (1) DATA DROP TO EACH LOCATION.
- SPEAKER LOCATION. PROVIDE RACEWAY TO IT RACK FOR INSALLATION BY OTHERS.
- REUSE EXISTING FIXTURE.

- HOT WATER HEATER LOCATED IN MEZZANINE. CONFIRM EXACT CIRCUIT SIZE WITH MECHANICAL DRAWINGS PRIOR TO ROUGH-IN.
- COORDINATE WITH KITCHEN EQUIPMENT DRAWINGS FOR CONNECTION OF ANSUL

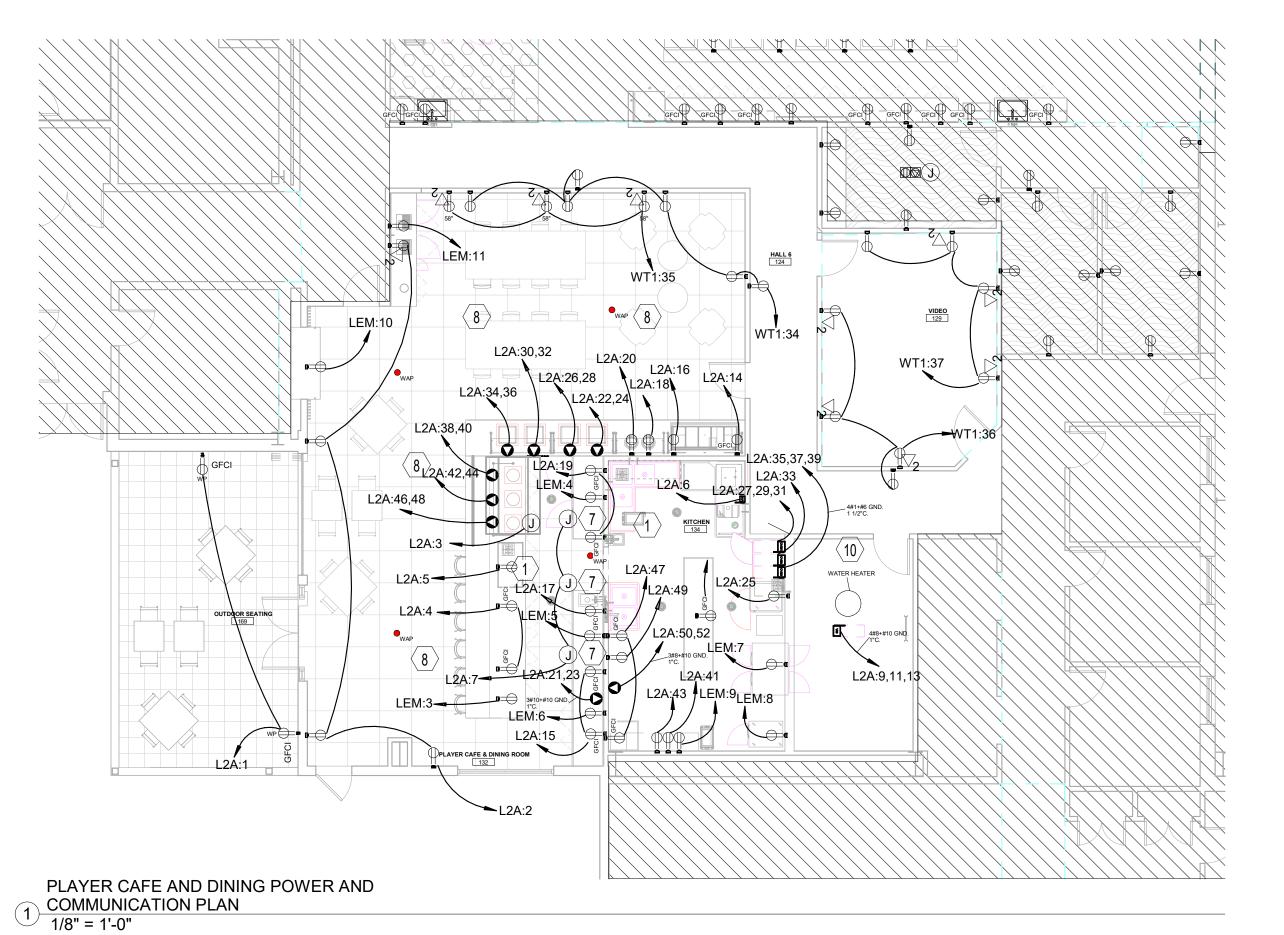

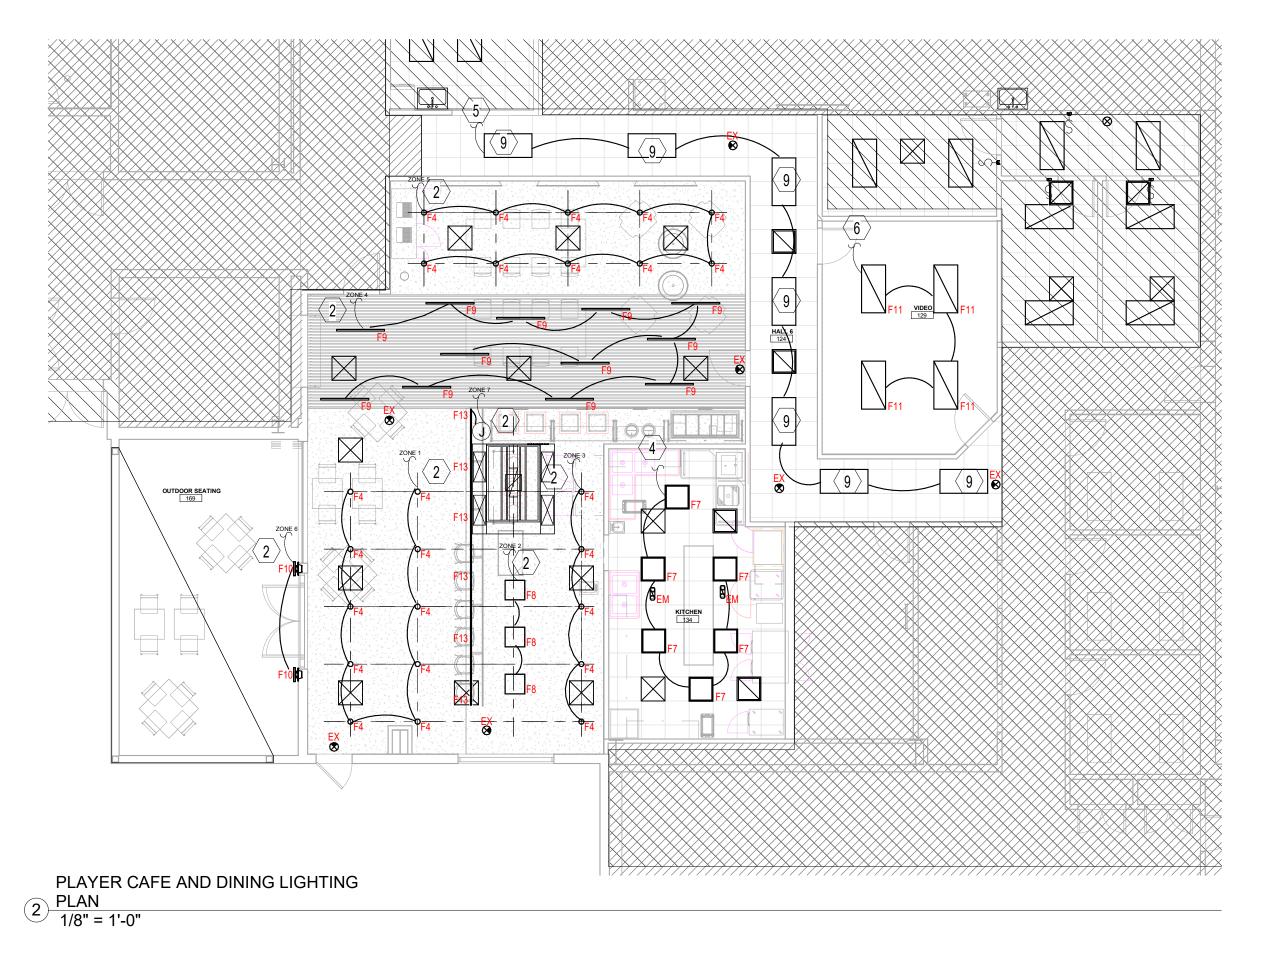

PELICANS CAMPUS IMPROVEMENTS 5800 Airline Drive Metairie, Louisiana

woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443


307 WEST MAPLE RIDGE DR.

METAIRIE, LA 70001

Erik Wismar, AIA

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024



20	descripton	data
no.	descripton	date
_		

ELECTRICAL PLAYER CAFE AND **DINING PLAN**

E1.04 GENERAL NOTES:

- UNLESS OTHERWISE NOTED ALL CONDUCTORS TO BE #12 AWG COPPER.
- ALL "EX" AND "EM" FIXTURES TO BE ELECTRICALLY CONNECTED TO THE NEAREST UNSWITCHED ELECTRICAL CIRCUIT CONDUCTOR.
- RED DASHED LINES DENOTE UNDERGROUND CONDUIT.
- CONFIRM ALL MECHANICAL POWER REQUIRMENTS WITH MECHANICAL/PLUMBING DRAWINGS PRIOR TO ROUGH-IN.

TRAINING POWER AND COMMUNICATION PLAN 1/8" = 1'-0"

 $\langle 1 \rangle$

E1.04 SPECIFIC NOTES:

- CCTV CAMERA LOCATION. PROVIDE RACEWAY TO IT RACK FOR INSALLATION BY OTHERS.
- NEW COMPRESSOR LOCATION. REUSE EXISTING CIRCUIT FROM ELECTRICAL ROOM 176. PROVIDE NEW CONDUIT AND WIRE.
- PROVIDE NEW FLOOR BOX WITH DUPLEX RECPETACLE AND (1) DATA DROP. PROVIDE (1) 1" CONDUIT AND (1) 1.5" CONDUIT TO CLOSEST

WT1:29,31 AIR CURTIAN DISCO


WT1:20

 $\langle 6 \rangle$

WT1:19

- NEW LOCATION FOR EXISTING ICE MACHINE. REUSE EXISTING CIRCUIT FROM ELECTRICAL ROOM 176. PROVIDE NEW CONDUIT AND WIRE.
- TRANSFORMER TO BE SUSPENDED ABOVE CEILING FROM STRUCTURE ABOVE. MOUNT DISCONNECTS TO WALL.
- VERIFY IF ALL EXISTING REMAINED IN THE SAME LOCATION. REUSE EXISITNG CIRCUIT FOR ALL EXISTING EQUIPMENT IF POSSIBLE. IF NOT POSSIBLE, EQUIPMENT TO BE FED FROM SAME EXISTING SOURCE.
- NOT USED
- POWER FLOOR BOX FOR RECOVERY TABLE. ROUTE #10 CONDUCTORS. VERIFY LOCATION PRIOR TO ROUGH-IN.
- PROVIDE NEW FLOOR BOX WITH DUPLEX RECPETACLE AND (2) DATA DROPS. PROVIDE (1) 1" CONDUIT AND (1) 1.5" CONDUIT TO CLOSEST WALL.

CONFIRM EXACT LOCATION OF NUTRITION EQUIPMENT PRIOR TO ROUGH-IN.

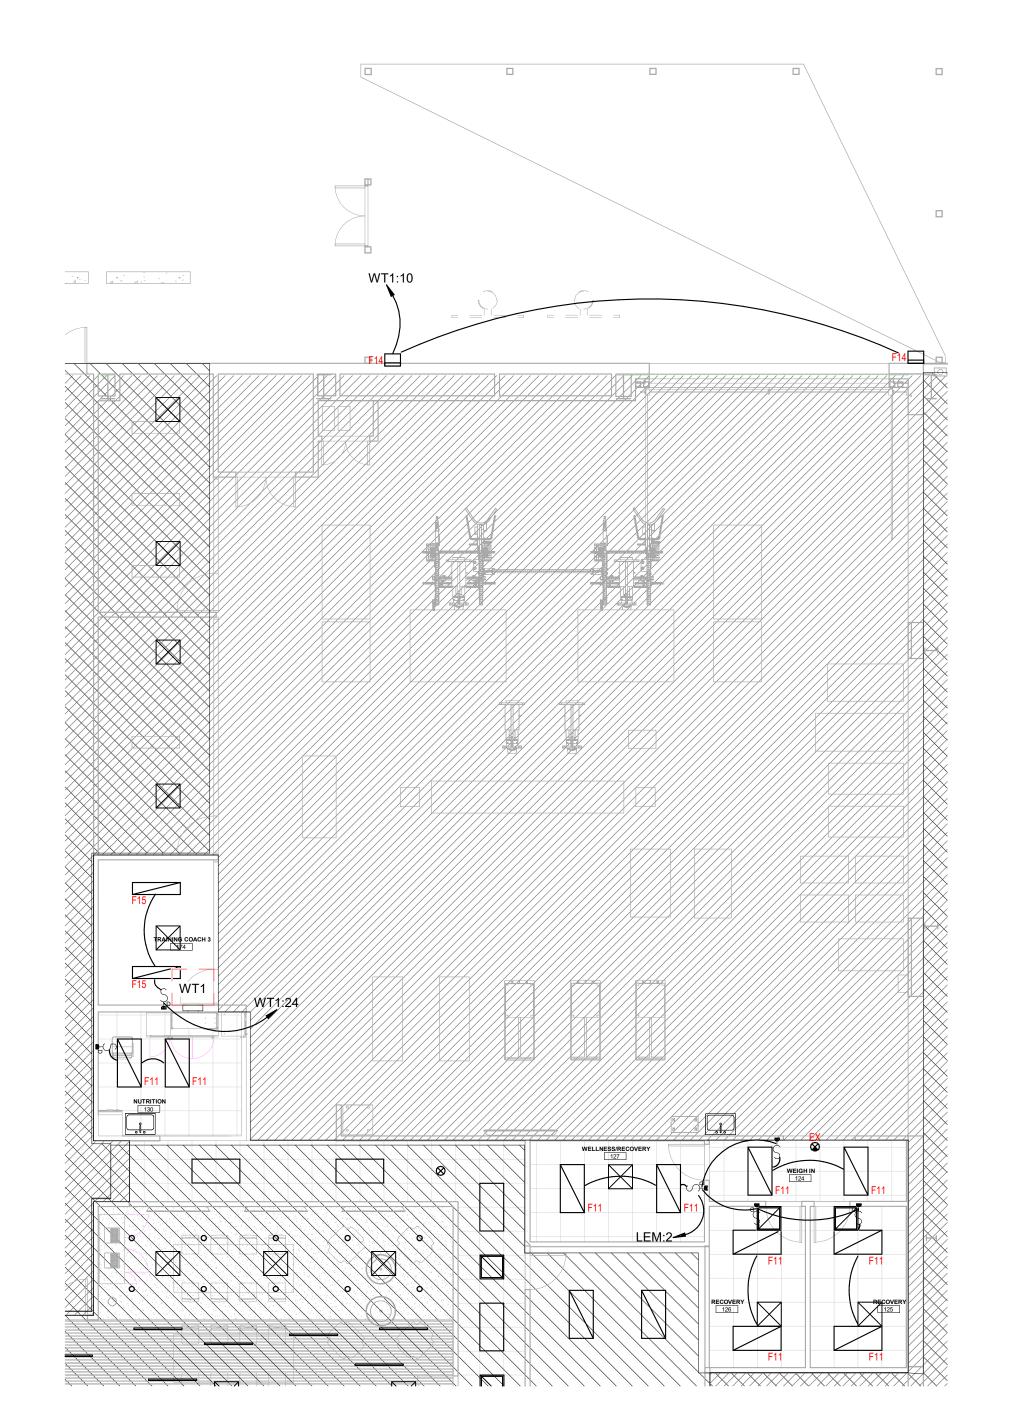

2 TRAINING LIGHTING PLAN 1/8" = 1'-0"




woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443 Erik Wismar, AIA

307 WEST MAPLE RIDGE DR. METAIRIE, LA 70001

PELICANS CAMPUS IMPROVEMENTS 5800 Airline Drive Metairie, Louisiana

WDG PROJECT NO | AR2315 CONSTRUCTION DOCUMENTS 04.15.2024

ELECTRICAL TRAINING PLAN

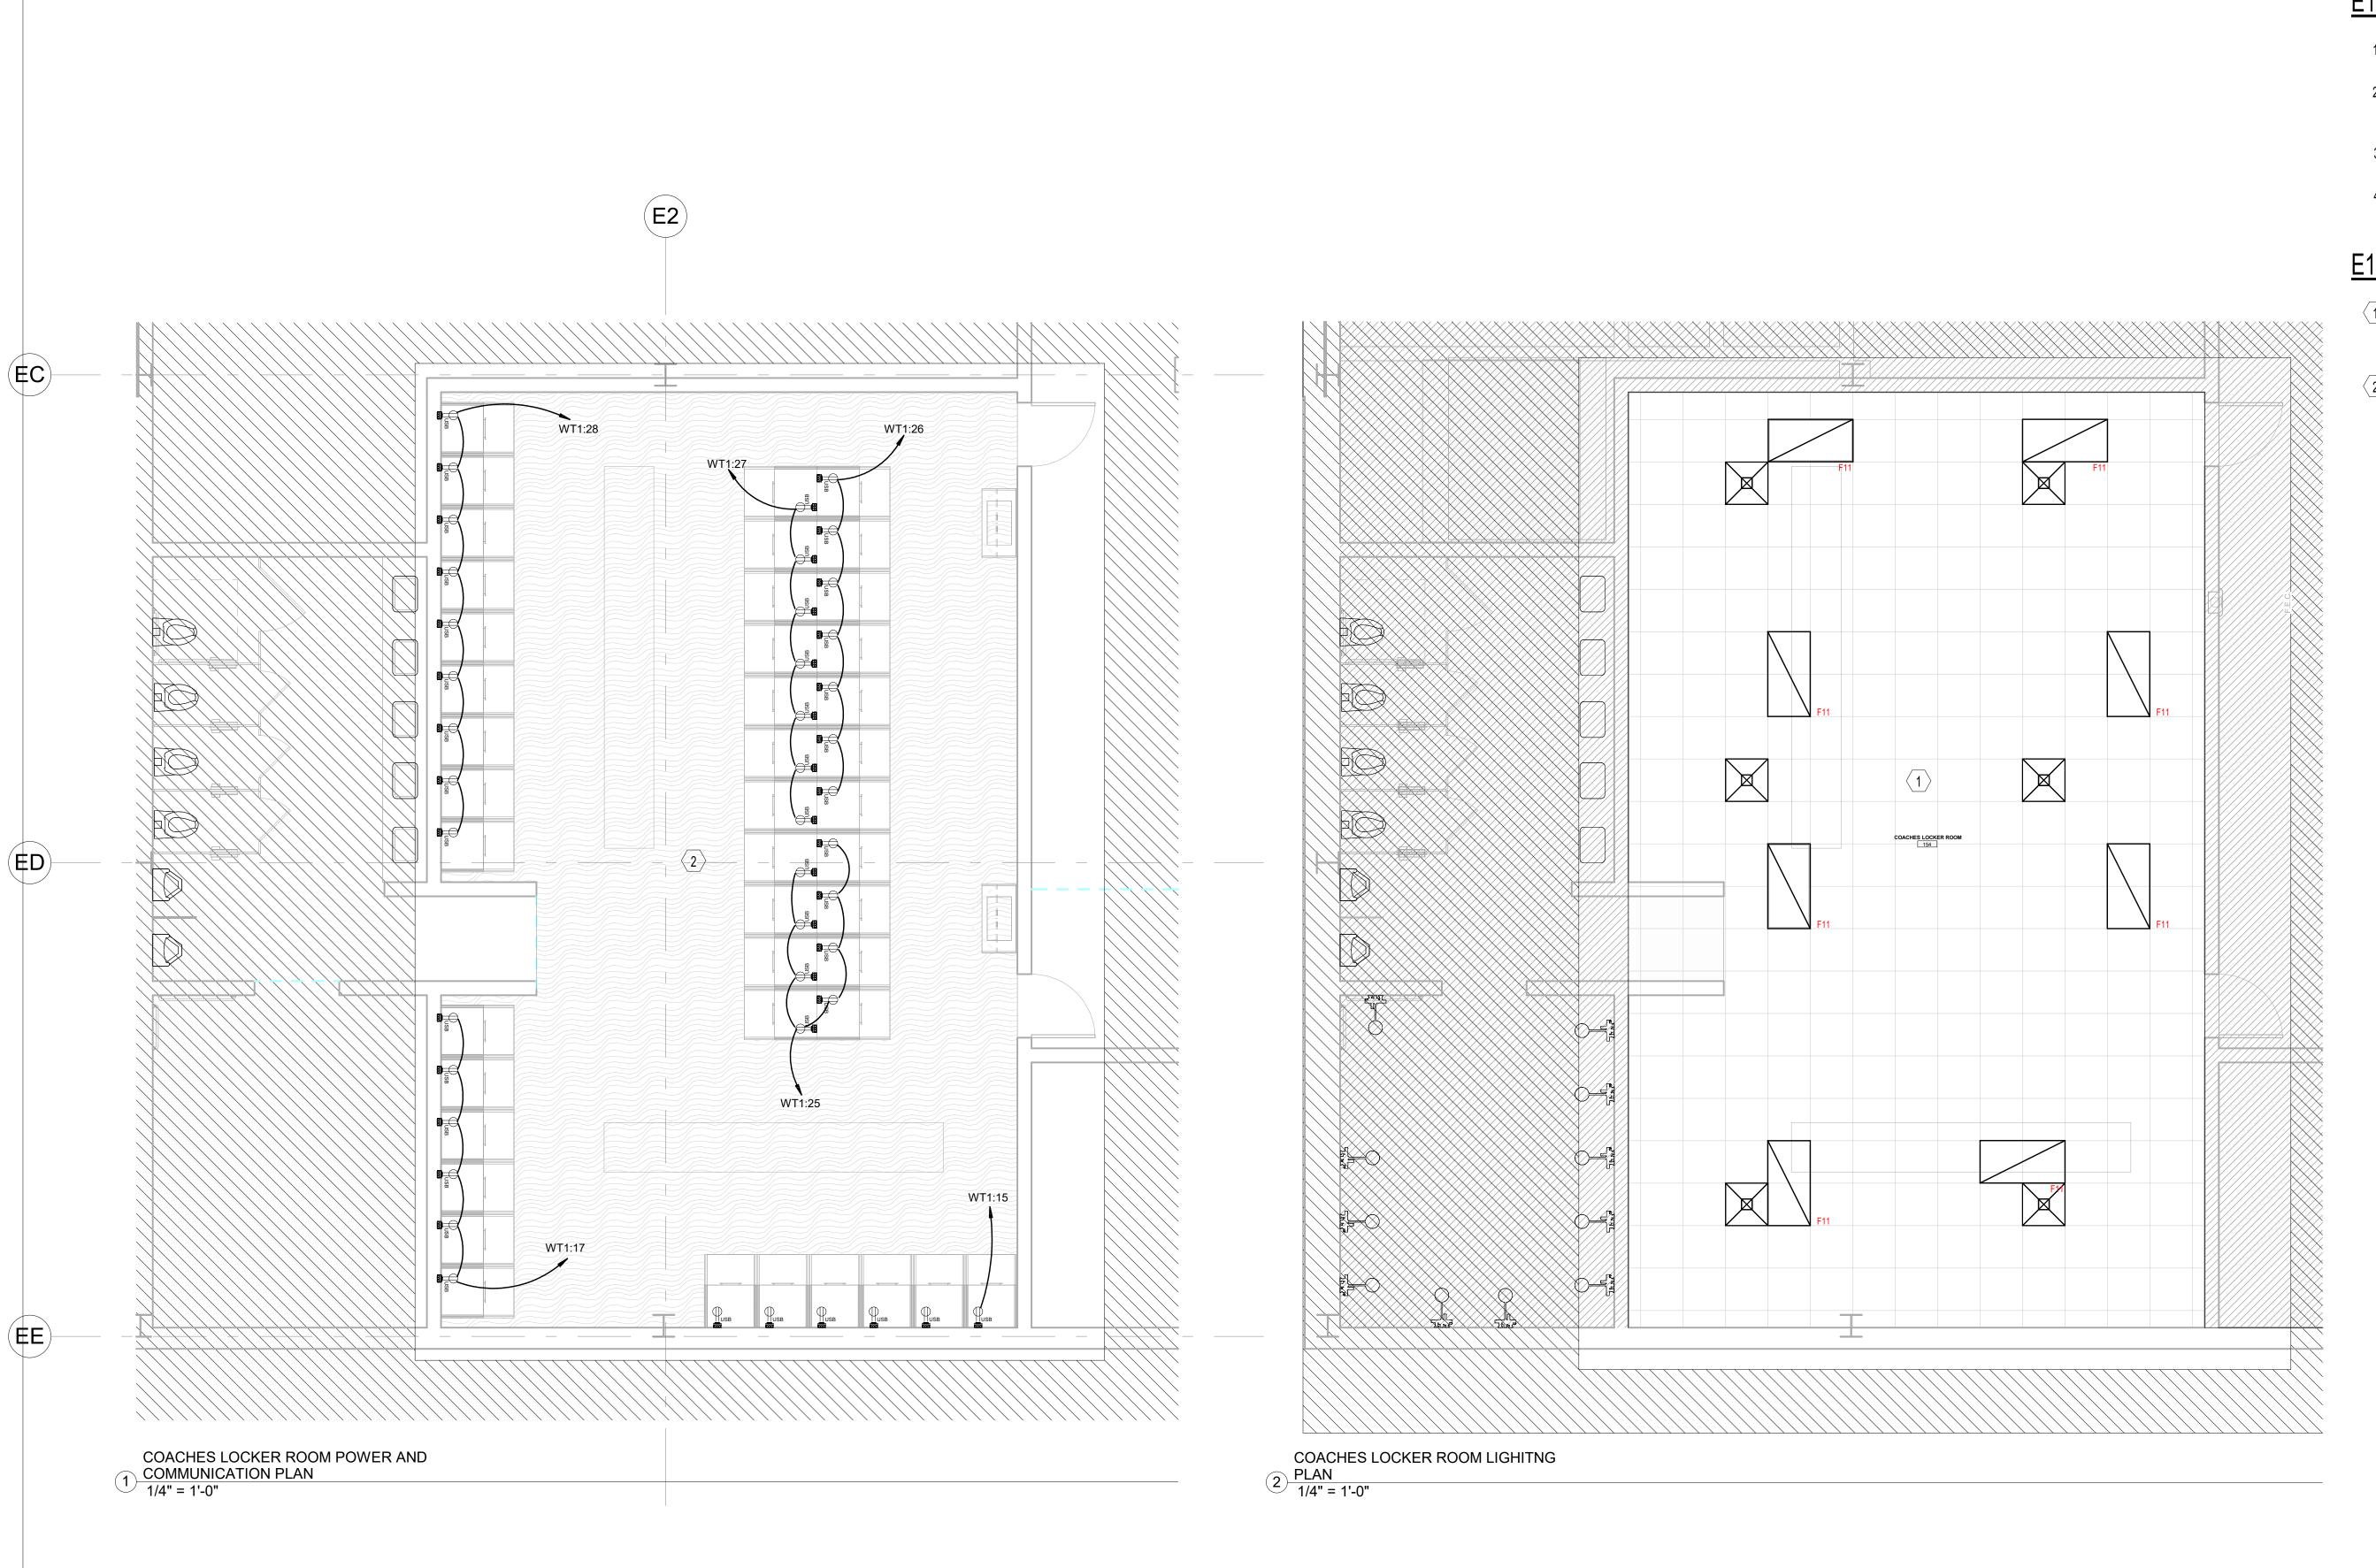

E1.06 GENERAL NOTES:

- 1. UNLESS OTHERWISE NOTED ALL CONDUCTORS TO BE #12 AWG COPPER.
- 2. ALL "EX" AND "EM" FIXTURES TO BE ELECTRICALLY CONNECTED TO THE NEAREST UNSWITCHED ELECTRICAL CIRCUIT CONDUCTOR.
 - RED DASHED LINES DENOTE UNDERGROUND CONDUIT.
- VERIFY HEIGHT OF ALL LOCKER RECEPTACLES WITH OWNER.

E1.06 SPECIFIC NOTES:

- REPLACE ALL EXISTING LIGHTS AND DEVICES WITH NEW. REUSE EXISTING CIRCUITS AND SWITCH LEGS.
- REPLACE ALL EXISTING RECEPTACLES AND PLATES.



woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443 Erik Wismar, AIA

PoNCE, LLC 307 WEST MAPLE RIDGE DR. METAIRIE, LA 70001

PELICANS CAMPUS IMPROVEMENTS 5800 Airline Drive Metairie, Louisiana

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024

COACHES LOCKER ROOM ELECTRICAL PLAN

E1.07 GENERAL NOTES:

E1.07 SPECIFIC NOTES:

UNLESS OTHERWISE NOTED ALL CONDUCTORS TO BE #10 AWG COPPER.


 $\langle 1 \rangle$ xxxx

 $\langle 1 \rangle$

woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443 Erik Wismar, AIA

PoNCE, LLC 307 WEST MAPLE RIDGE DR. METAIRIE, LA 70001

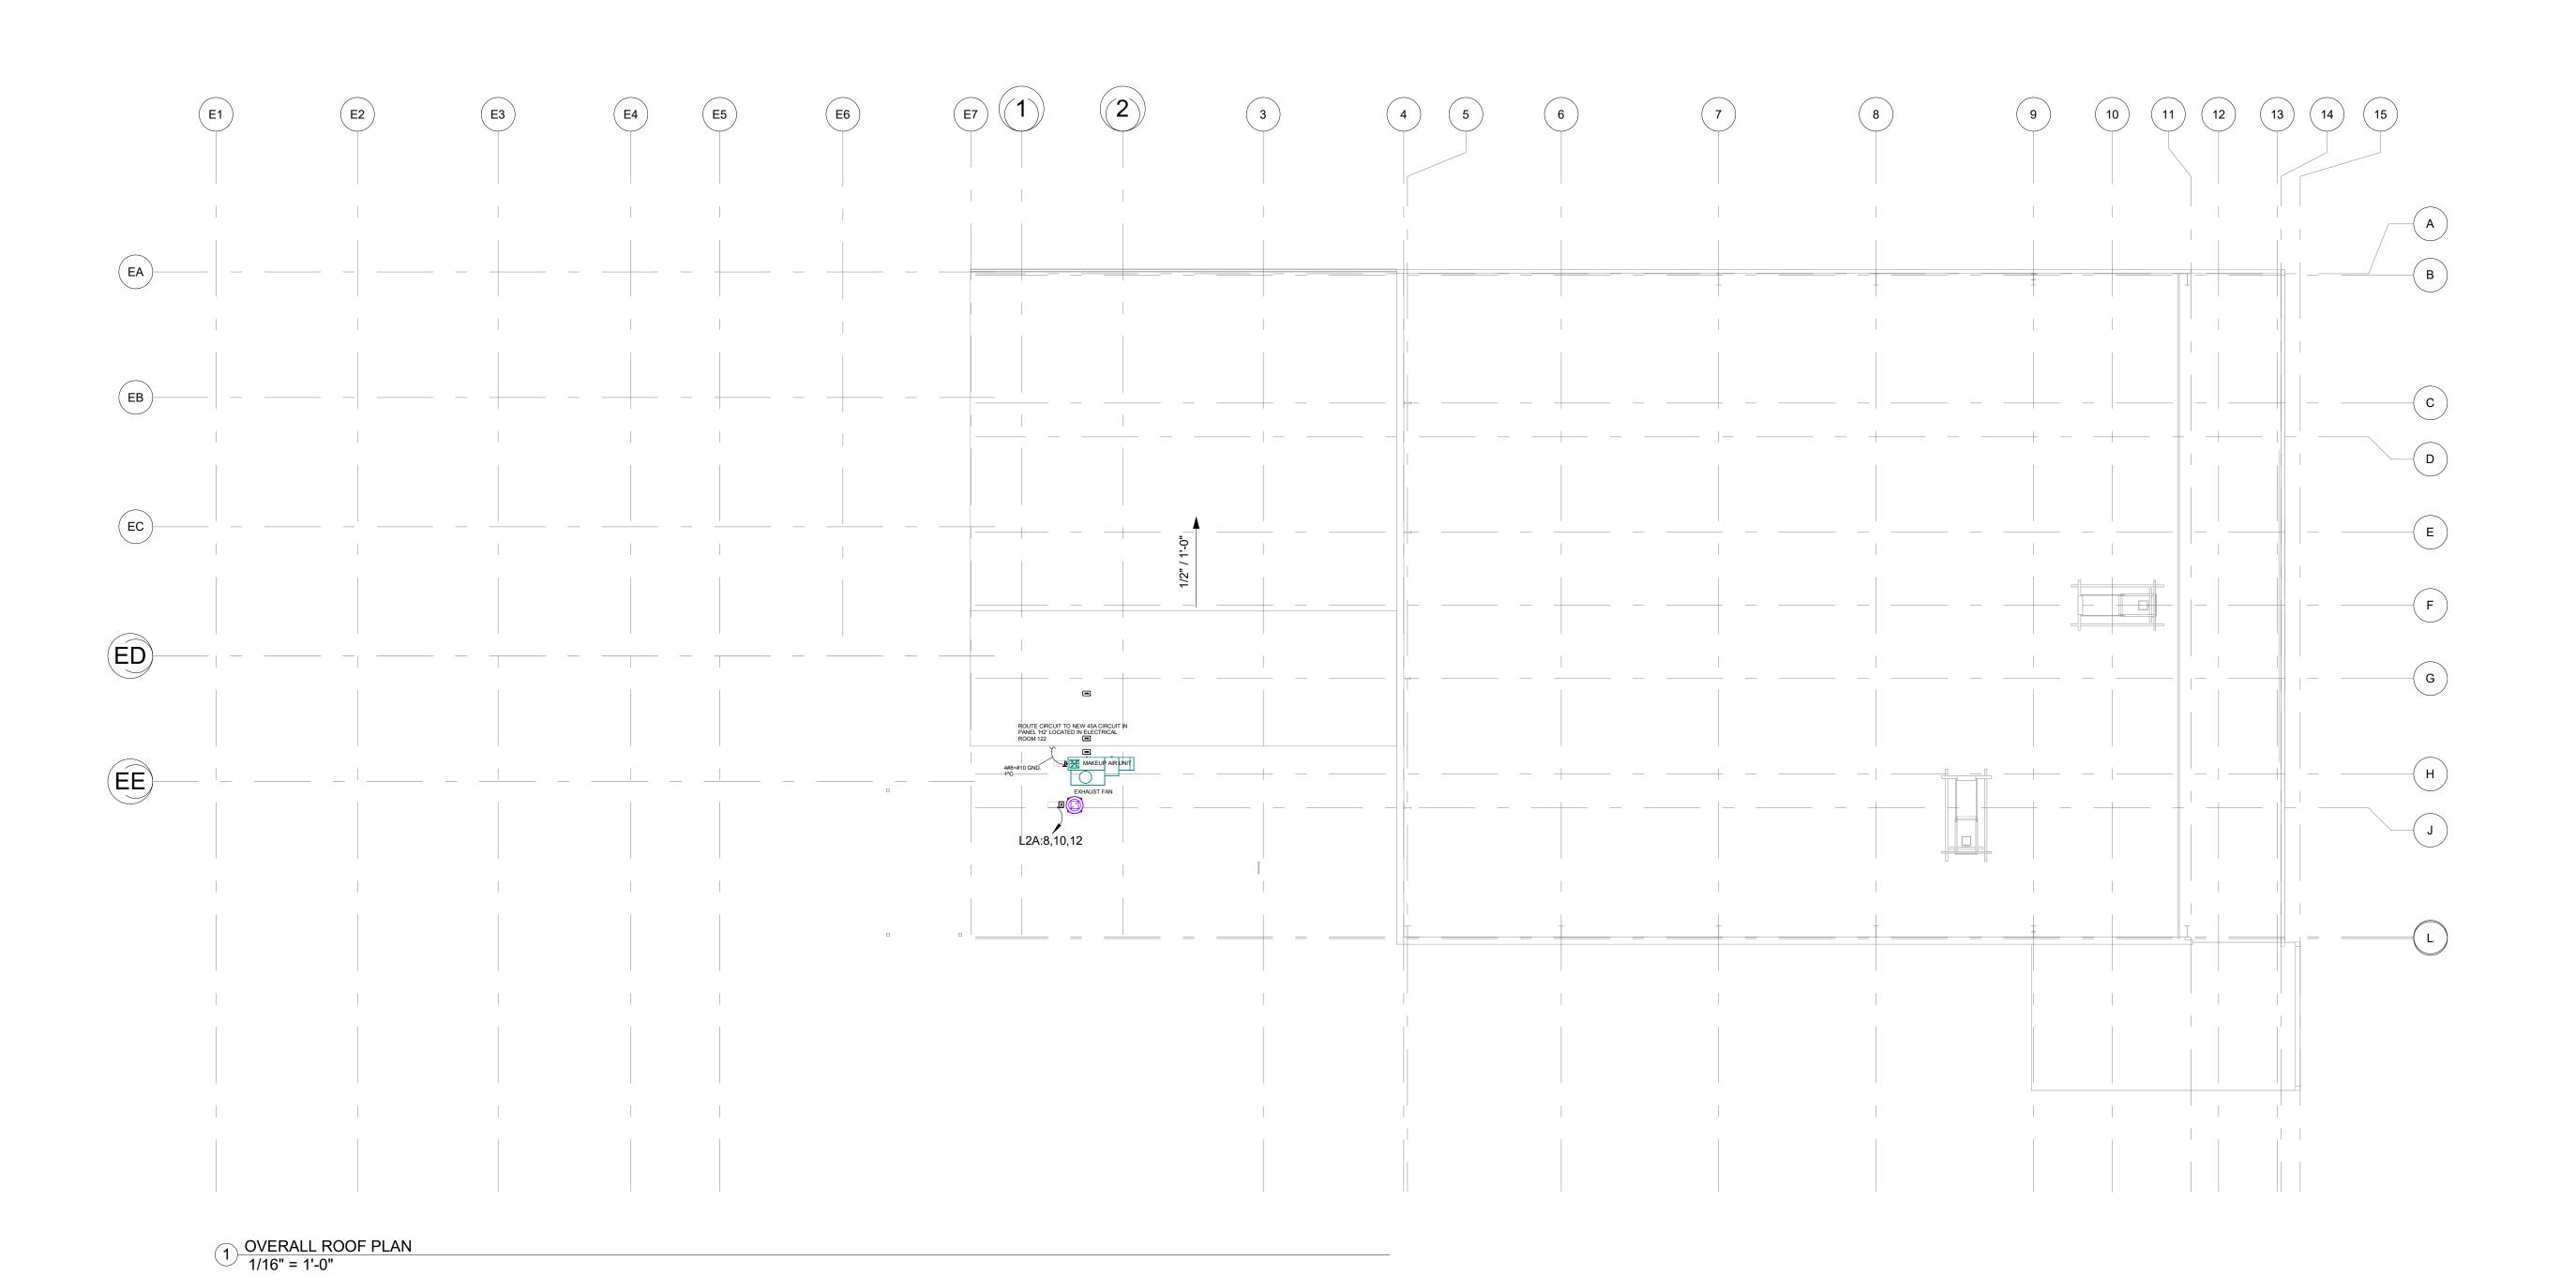

PELICANS CAMPUS IMPROVEMENTS

CONSTRUCTION DOCUMENTS 04.15.2024


5800 Airline Drive Metairie, Louisiana

WDG PROJECT NO | AR2315

ELECTRICAL ROOF PLAN


GENERAL NOTES:

- 1. INTERRUPTING CURRENT RATINGS OF ALL CIRCUIT BREAKERS, FUSES, PANELS, DISCONNECTS, ETC. ARE TO BE EQUAL TO OR HIGHER THAN THE CALCULATED AVAILABLE SHORT CIRCUIT CURRENTS AS PER NEC-2014 ARTICLES 110-9, 110-10, 240-12, 225-53, 230.82(3), 230.205(B), 240.92(C)(1), AND 230.208.

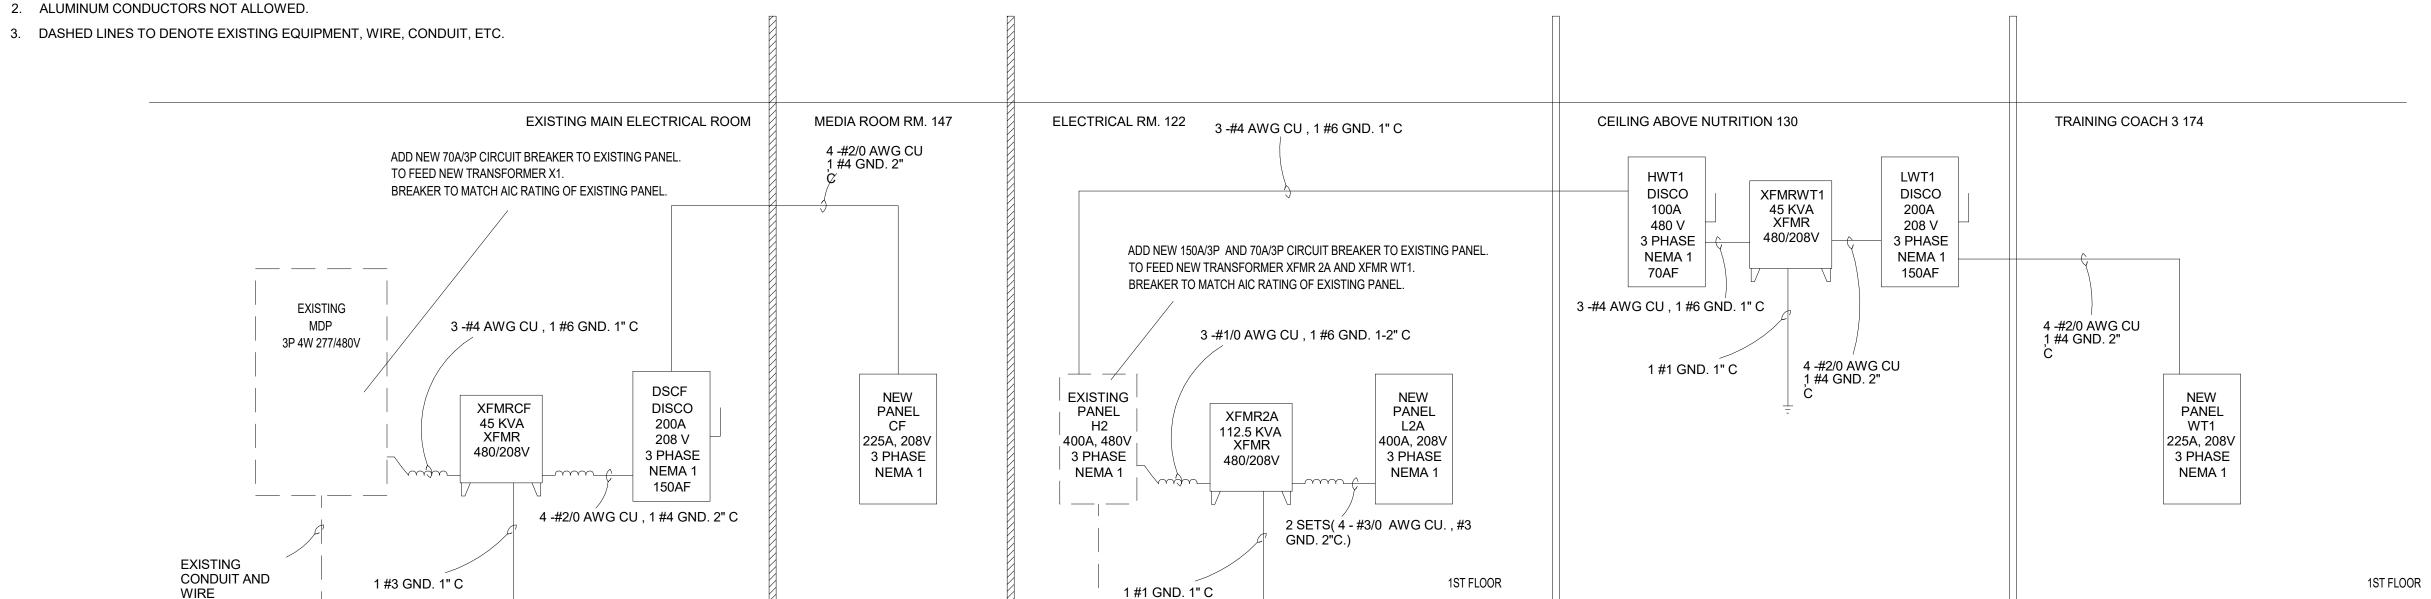

Location: STORAGE 1047 Supply From: Mounting: FLUSH Enclosure: NEMA 1						Volts: Phases: Wires:		3 Wye		A.I.C. Rating: 22kA Mains Type: MLO Mains Rating: 225A MCB Rating:			
Notes:													
CKT	Circuit Description	Trip	Poles		A 	E	3 	C	;	Poles	Trip	Circuit Description	CKT
CF1:1	RECEPTION / LOBBY RECEPTACLE CONV. RECEPTACLE	20 A 20 A	1	720 VA	2500	360 VA	2500			2	30 A	MSCU-2	CF1:2
CF1.5	OFFICE RECEPTACLES	20 A	1			300 VA	2500	900 VA	2500	2	30 A	MSCU-1	CF1:
CF1:7	RESTROOM GFCI	20 A	1	180 VA	2500			900 VA	2000				CF1:
CF1:9	MEDIA ROOM RECEPTACLE	20 A	1	100 VA	2000	720 VA	780 VA			1	20 A	STORAGE / MEDIA / OFFICE LIGHTING	CF1:1
CF1:11	MEDIA ROOM RECEPTACLE	20 A	1			720 771	700 171	720 VA	55 VA	1	20 A	STAIR LIGHTING	CF1:1
CF1:13	STORAGE RECEPTACLE	20 A	1	180 VA	360 VA					1	20 A	COUNTERTOP RECEPTACLES	CF1:1
CF1:15	CONF. ROOM RECEPTACLE	20 A	1			720 VA	0 VA			1	20 A	SCREEN WALL	CF1:1
CF1:17	CONF. ROOM FLOOR BOX	20 A	1					360 VA	0 VA	1	20 A	SCREEN WALL	CF1:1
CF1:19	CONF ROOM FLOOR BOX	20 A	1	1080	0 VA					1	20 A	SCREEN WALL	CF1:2
CF1:21	CONF ROOM RECEPTACLE	20 A	1			720 VA	0 VA			1	20 A	SCREEN WALL	CF1:2
CF1:23	CONF. ROOM RECEPTACLE	20 A	1					540 VA	360 VA	1	20 A	COUNTERTOP RECEPTACLES	CF1:2
CF1:25	REFRIGERATOR	20 A	1	500 VA									CF1:2
CF1:27	UNDERCOUNTER RECEPTACLES	20 A	1			500 VA							CF1:2
CF1:29													CF1:3
CF1:31	VIEWING AREA RECEPTACLE	20 A	1	360 VA									CF1:3
CF1:33	VIEWING AREA RECEPTACLE	20 A	1			360 VA							CF1:3
CF1:35													CF1:3
CF1:37	_												CF1:3
CF1:39													CF1:4
CF1:41													CF1:4
	1	Tota	al Load:	8380) VA	6660) VA	5435	5 VA			-	
		Tota	l Amps:	71	Α	57	' A	45	Α				

Notes:	Location: ELEC. 122 Supply From: Mounting: SURFACE Enclosure: NEMA 1			I	Volts: Phases: Wires:		3 Wye						
votes.													
СКТ	Circuit Description	Trip	Poles		4	E	3		C	Poles	Trip	Circuit Description	скт
L2A:1	EXTERIOR RECEPTACLES	20 A	1	540 VA	720 VA					1	20 A	CAFE RECETPACLES	L2A:2
L2A:3	HOOD CIRCUITS	20 A	1			1200	900 VA			1	20 A	KITCHEN OUTLET	L2A:4
L2A:5	HOT COLD SHELF	20 A	1					456 VA	1920	1	20 A	DISHWASHER *GFCI BREAKER*	L2A:6
L2A:7	DIGITAL ORDER BOARDS	20 A	1	500 VA	792 VA					3	20 A	KITCHEN EXHAUST	L2A:8
L2A:9	HOT WATER HEATER	35 A	3			3333	792 VA				-		L2A:10
L2A:11			I					3333	792 VA	1	I		L2A:12
L2A:13			-	3333	1200					1	20 A	KITCHEN OUTLET	L2A:14
L2A:15	KITCHEN OUTLET	20 A	1			1800	800 VA			1	20 A	COLD FOOD WELL	L2A:16
L2A:17	KITCHEN OUTLET	20 A	1					900 VA	804 VA	1	20 A	INDUCTION RETHERMALIZER	L2A:18
L2A:19	KITCHEN OUTLET	20 A	1	1800	804 VA					1	20 A	INDUCTION RETHERMALIZER	L2A:20
L2A:21	RAPID COOK OVEN	20 A	2			2500	416 VA			2	20 A	INDUCTION RANGE	L2A:22
L2A:23			-					2500	416 VA	-	-		L2A:24
L2A:25	HEAT CABINET	20 A	1	1320	416 VA					2	20 A	INDUCTION RANGE	L2A:26
L2A:27	TOP OVEN	80 A	3			7464	416 VA						L2A:28
L2A:29			-					7464	416 VA	2	20 A	INDUCTION RANGE	L2A:30
L2A:31			-	7464	416 VA								L2A:32
L2A:33	VENTLESS HOOD	20 A	1			192 VA	416 VA			2	20 A	INDUCTION RANGE	L2A:34
L2A:35	OVEN BOTTOM	125 A	3					1237	416 VA				L2A:36
L2A:37			-	1237	416 VA					2	20 A	INDUCTION RANGE	L2A:38
L2A:39	-		-			1237	416 VA						L2A:40
L2A:41	WAFFLE MAKER	20 A	1					1200	416 VA	2	20 A	INDUCTION RANGE	L2A:42
L2A:43	WAFFLE MAKER	20 A	1	1200	416 VA					-	_		L2A:44
L2A:45	KITCHEN OUTLET	20 A	1			900 VA	416 VA			2	20 A	INDUCTION RANGE	L2A:46
L2A:47	KITCHEN OUTLET	20 A	1					1800	416 VA				L2A:48
L2A:49	REFRIGERATED COUNTER	20 A	1	1200	3640					2	50 A	INDUCTION RANGE	L2A:50
L2A:51							3640						L2A:52
L2A:53													L2A:54
	•	Tota	I Load:	3855	0 VA	3797	4 VA	3562	2 VA			•	
		Tota	Amps:	324	4 A	319	9 A	29	7 A	1			

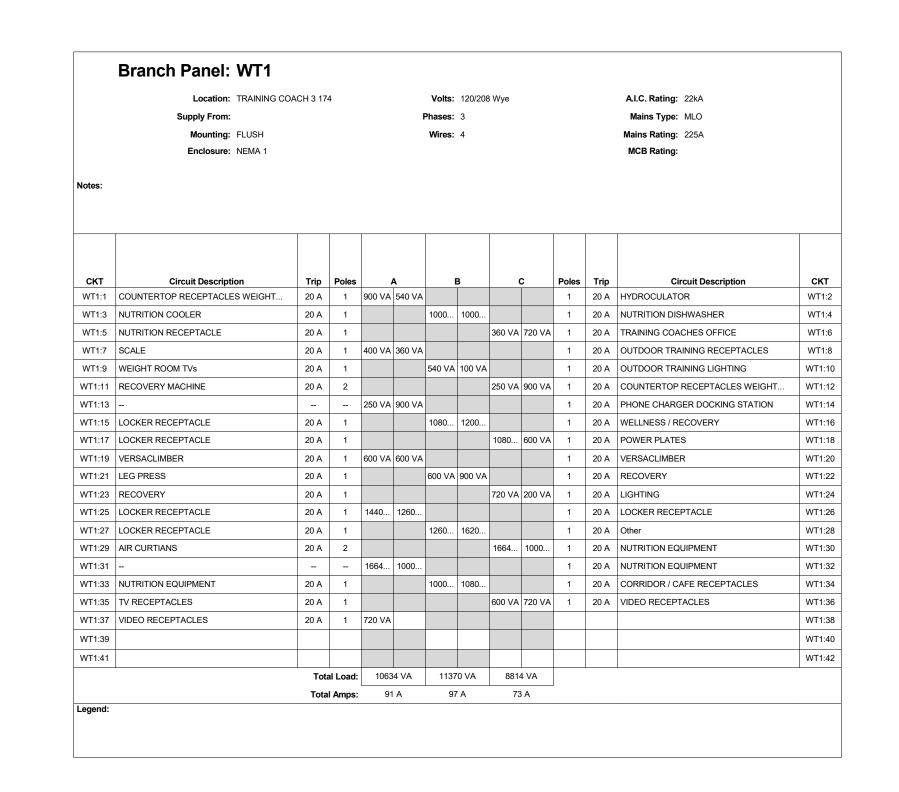

woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443 Erik Wismar, AIA

> 307 WEST MAPLE RIDGE DR. METAIRIE, LA 70001

PELICANS CAMPUS IMPROVEMENTS 5800 Airline Drive Metairie, Louisiana

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024

4/12/2024

no.	descripton	date
110.	descriptori	date


ELECTRICAL ONE LINE AND PANEL SCHEDULE

ED1.01 GENERAL NOTES:

- DEENERGIZE ALL CIRCUITS FEEDING AREA. VERIFY THAT THE CIRCUITS DEENERGIZED DO NOT SUPPLY POWER TO OTHER AREAS.
- DEMO ALL ELECTRICAL DEVICES AND WIRING SERVING THIS AREA.
- FIRE ALARM DEMO SCOPE OF WORK TO INCLUDE: PUT F.A.C.P. INTO TEST MODE PRIOR TO ANY DEMO IN SCOPE OF WORK AREA. DISCONNECT, REMOVE EXISTING DEVICES, AND REQIRE AS NECESSARY. PUT F.A.C.P INTO NORMAL OPERATION.
- REMOVE ALL EXISTING LIGHTING.
- REWORK EXISTING EXPOSED ELECTRICAL CONDUITS AS NEEDED FOR ADDITION OF VIEWING AREA AND CONFERENCE ROOM.

ED1.01 SPECIFIC NOTES:

- SEE GENERAL NOTES FOR DEMO SCOPE OF WORK IN THIS AREA.
- WIRING TO REMAIN IN THIS AREA.



1 G 1

PELICANS CAMPUS IMPROVEMENTS 5800 Airline Drive Metairie, Louisiana

woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443

PoNCE, LLC

307 WEST MAPLE RIDGE DR. METAIRIE, LA 70001

Erik Wismar, AIA

WDG PROJECT NO | AR2315

CONSTRUCTION DOCUMENTS 04.15.2024

ELECTRICAL DEMO PLAN



SECTION 23 00 00 HEATING VENTILATING AND AIR CONDITIONING PART 1 - GENERAL 1.1 · SCOPE WORK IN THIS SECTION INCLUDES COMPLETE AND OPERATING YEAR ROUND AIR CONDITIONING SYSTEMS, PLUS ADDITIONAL VENTILATION REQUIREMENTS FOR AREAS INDICATED. : IT INCLUDES CONDENSING UNITS, AIR HANDLING UNITS, ELECTRIC HEATING COILS, FANS, MOTORS, MOTORS, MOTORS, MOTORS, MOTOR CONTROLLERS, REGISTERS AND DIFFUSERS, DUCTWORK, PIPE AND FITTINGS, INSULATION, TEMPERATURE CONTROLS, AND OTHER WORK INDICATED OR NECESSARY FOR COMPLETE AND OPERATING SYSTEM. 1.2 DESIGN CONDITIONS THIS SECTION OUTLINES THE GENERAL DESIGN CONDITIONS WHICH WERE USED TO DETERMINE BUILDING HVAC LOADS & EQUIPMENT SIZES: OUTDOOR DESIGN CONDITIONS COOLING: 94.4 DB / 77.8 WB (ASHRAE 0.4% COOLING) HEATING: 33.1 DB (ASHRAE 99.6% HEATING) DEHUMIDIFICATION: 84.4 DB / 80.2 WB (ASHRAE 0.4% DEHUMIDIFICATION) INDOOR DESIGN CONDITIONS COOLING: 75 DB / 55% RH HEATING: 70 DB 1.3 DESCRIPTION OF WORK EXTENT: WORK REQUIRED UNDER THIS SECTION CONSISTS OF ALL MECHANICAL WORK AND RELATED ITEMS NECESSARY TO COMPLETE THE WORK INDICATED ON THE DRAWINGS AND/OR DESCRIBED IN THE SPECIFICATIONS. WORK INCLUDED: EXTENT OF WORK PERFORMED UNDER THIS SECTION SHALL INCLUDE, BUT IS NOT LIMITED TO THE FOLLOWING: FURNISH ALL LABOR, EQUIPMENT, TOOLS, TRANSPORTATION, ETC., AND FURNISH AND INSTALL ALL MATERIALS AND EQUIPMENT NECESSARY FOR MECHANICAL WORK HEREINAFTER DESCRIBED, ALL IN ACCORDANCE WITH THE SPECIFICATIONS AND ACCOMPANYING DRAWINGS. SPECIFICATIONS AND ACCOMPANYING DRAWINGS INTENDED TO SHOW AND DESCRIBE A COMPLETE MECHANICAL INSTALLATION IN PROPER OPERATING CONDITION, WITH CONTRACTOR FURNISHING AND INSTALLING EVERYTHING AS SPECIFIED TO COMPLETE THE JOB. FURNISH ALL LABOR, EQUIPMENT, TOOLS, MATERIALS, ACCESSORIES, ETC., FOR ALL ROUGH-INS AND FINAL CONNECTIONS, COMPLETE, FOR ALL EQUIPMENT FURNISHED AS SPECIFIED. RELATED WORK: WITHOUT RESTRICTING REQUIRED WORK, THE FOLLOWING ITEMS OF RELATED WORK ARE SPECIFIED AND INCLUDED IN OTHER SPECIFICATION SECTIONS. PAINT MECHANICAL EQUIPMENT, PIPE, DUCT, ETC. ALL ELECTRICAL POWER WIRING. FURNISH AND INSTALL BASE FLASHINGS AND PITCH POCKETS FURNISH AND INSTALL POURED AND FORMED CONCRETE. FURNISH AND INSTALL STRUCTURAL STEEL. INSTALL ACCESS PANELS AND FRAMES. ALL SOUND CAULKING. THROUGH PENETRATION FIRESTOP SYSTEMS. 1.3 SUBMITTALS A. SUBMIT THE FOLLOWING IN ACCORDANCE WITH REQUIREMENTS DESCRIBED IN DIVISION 1. PRODUCT DATA FOR ALL PURCHASED EQUIPMENT AND MATERIALS INDICATED ON DRAWINGS AN NEEDED FOR COMPLETE INSTALLATION. SHOP DRAWINGS FOR HVAC DUCTWORK AND PIPING. 0&M MANUALS FOR ALL MAJOR EQUIPMENT AND COMPONENTS. 1.6 DRAWINGS ACCOMPANYING DRAWINGS, INCLUDING PLANS, DETAILS, DIAGRAMS, NOTES, ETC., ARE SHOWN TO LIMIT AND EXPLAIN STRUCTURAL CONDITIONS, CONSTRUCTION REQUIREMENTS, SIZES, CAPACITIES AND METHODS OF INSTALLATION AND ERECTION. STRUCTURAL AND OTHER CONDITIONS MAY REQUIRE CERTAIN MODIFICATIONS . ND ADJUSTMENTS FROM CONDITIONS SHOWN. SUCH DEVIATIONS ARE PERMISSIBLE; HOWEVER, SPECIFIED SIZES, CAPACITIES AND REQUIREMENTS AFFECTING SATISFACTORY PERFORMANCE AND OPERATION OF INSTALLATION SHALL REMAIN UNCHANGED. MAKE ALLOWANCE FOR NORMAL JOB CONDITIONS AND INTERFERENCES. WHENEVER IT BECOMES NECESSARY TO SHIFT EQUIPMENT OR PIPES BEYOND REASONABLE TOLERANCES, SUCH CHANGES SHALL BE REFERRED TO ARCHITECT FOR APPROVAL. ASK FOR DETAILS WHENEVER UNCERTAIN ABOUT METHOD OF INSTALLATION. 1.8 PERMITS AND INSPECTIONS SECURE ALL PERMITS AND INSPECTIONS AND PAY ALL FEES, ASSESSMENTS AND TAXES NECESSARY FOR COMPLETION AND ACCEPTANCE OF WORK. NOTIFY ARCHITECT AND PROPER AUTHORITIES IN AMPLE TIME WHEN ANY WORK IS READY TO BE INSPECTED OR TESTED. OBTAIN CERTIFICATES OF INSPECTION AND APPROVAL, AS APPLICABLE TO VARIOUS PORTIONS OF WORK, FROM INSPECTION AGENCY HAVING JURISDICTION. 1.9 CODES INTERNATIONAL MECHANICAL CODE 2021 INTERNATIONAL ENERGY CONSERVATION CODE 2021 INTERNATIONAL PLUMBING CODE 2021 ALL WORK SHALL BE INSTALLED IN STRICT ACCORDANCE WITH ALL EXISTING LOCAL, PARISH AND LA STATE CODES AND ORDINANCES HAVING JURISDICTION, AND WITH RULES AND REGULATIONS OF NATIONAL FIRE PROTECTION ASSOCIATION (NFPA) AND AMERICAN SOCIETY OF MECHANICAL ENGINEERS (ASME) AND NATIONAL BOARD OF BOILER AND PRESSURE VESSEL INSPECTORS (NBBPVI) FOR PRESSURE VESSEL AND BOILERS. ALL PIPING SYSTEMS, INCLUDING MATERIAL AND WORKMANSHIP, SHALL BE IN ACCORDANCE WITH THE LATEST GOVERNING ANSI, ASTM AND ASME CODES AND STANDARDS. IF ANY CONFLICTS ARE FOUND BETWEEN SPECIFICATIONS AND DRAWINGS AND ABOVE AUTHORITIES, NOTIFY ARCHITECT AS SOON AS CONFLICTS ARE DISCOVERED AND ABOVE CODES AND REQUIREMENTS WILL GOVERN. GUARANTEE ALL MECHANICAL INSTALLATIONS AGAINST ALL DEFECTS IN EQUIPMENT, MATERIALS AND WORKMANSHIP FOR A PERIOD OF ONE YEAR FROM DATE OF ACCEPTANCE OR FROM DATE OF BENEFICIAL USE BY OCCUPANCY OF OWNER. DURING GUARANTEE PERIOD, CORRECT ANY DEFECTS IN NEW EQUIPMENT, MATERIALS OR WORKMANSHIP, WITHOUT COST TO OWNER. FURNISH TO OWNER ALL WARRANTIES FOR INSTALLED PLUMBING EQUIPMENT. PART 2 - PRODUCTS ... FURNISH AND INSTALL MINI-SPLIT HEAT PUMPS WITH PERFORMANCE CHARACTERISTICS & ITEMS DICTATED IN EQUIPMENT SCHEDULE. THE UNIT SHALL BE PROPERLY ASSEMBLED AND TESTED AT THE FACTORY INCLUDE FACTORY CONTROLS. NOMINAL UNIT ELECTRICAL CHARACTERISTICS SHALL BE PER PLANS. · UNIT SHALL BE DESIGNED FOR USE WITH R-410A REFRIGERANT AND INCLUDE INVERTER DRIVEN COMPRESSORS. UNIT SHALL HAVE ELECTRIC HEAT PER PLANS. UNIT SHALL BE PROVIDED WITH CONTROL INTEGRATION KIT TO ALLOW REMOTE SCHEDULING AND SETPOINT ADJUSTMENT FROM DDC CONTROL SYSTEM. CASING SHALL BE MANUFACTURER'S STANDARD INSULATED CASING. CASING SHALL MAKE UNIT FULLY WEATHERPROOF FOR OUTDOOR INSTALLATION. INSTALL MINI-SPLIT CONDENSERS ON HURRICANE RATED ALUMINUM SUPPORT STAND ANCHORED INTO CONCRETE HOUSEKEEPING PAD. UNIT EFFICIENCY TO COMPLY WITH IECC 2021 REQUIREMENTS. DUCTWORK SHALL BE G-090 GALVANIZED STEEL, OR FLEXIBLE DUCT PER PLANS. GAUGE AND CONSTRUCTED FOR 4" W.C. ALL MEDIUM PRESSURE DUCTWORK SHALL BE CONSTRUCTED FOR 4" W.C. DUCTWORK SHALL BE G-090 GALVANIZED STEEL, OR FLEXIBLE DUCT PER PLANS. GAUGE AND CUNSTRUCTION STANDARDS SHALL DE IN ACCORDANCE WITH DIMAGNA MIGRADA. ALL DUCTWORK SHALL BE PROPERLY BRACED TO PREVENT RATTLING, BREATHING OR OTHER UNNECESSARY NOISE. CONTRACTOR SHALL TAKE ALL MEASURES NECESSARY TO SECURE, SUPPORT AND REINFORCE DUCTS. ALL TRAVERSE JOINTS & LONGITUDINAL SEAMS SHALL BE SEALED WITH DUCT SEALANT (HARDCAST OR EQUAL). DUCT SIZES INDICATED ON DRAWING ARE CLEAR INSIDE SIZES, UNLESS NOTED OTHERWISE. EXTERIOR DUCTWORK TO BE INTERNALLY LINED WITH 1" FIBERGLASS, 1.5" THERMAX SHEATING EXTERNAL INSULATION AND WRAPPED IN FLEX-CLAD. INCLUDE SHEETMETAL COVER ON TOP OF HORIZONTAL EXTEIROR DUCT SLOPED TO EDGES TO PREVENT PONDING OF WATER. INTERIOR DUCTWORK TO BE WRAPPED WITH 2" FIBERGLASS DUCTWRAP (R-6). DUCT LINER SHALL BE 1" FIBERGLASS DUCT LINING, K-FLEX OR EQUAL. THE LINING SHALL ADHERE TO ALL INTERIOR SIDES OF DUCT WITH A MINIMUM 50% COVERAGE OF FIRE-RETARDANT ADHESIVE. USE MECHANICAL FASTENINGS OF GRAHAM WELDED PINS, TUFF-WELD NYLON HANGERS OR STIC-KLIPS ON MAXIMUM 16 INCH CENTERS. PROVIDE ALL DAMPERS REQUIRED FOR PROPER AIR DISTRIBUTION AND BALANCING OF THE SYSTEM.. APPROVED TYPE FIRE DAMPERS, SMOKE DAMPERS AND/OR COMBINATION FIRE/SMOKE SHALL BE PROVIDED WHERE INDICATED BY THE INTERNATIONAL BUILDING CODE, INTERNATIONAL MECHANICAL CODE, AND NFPA. ALL POWERED LIFE SAFETY DAMPERS TO BE PROVIDED WITH 120V POWERED ACTUATORS. PROVIDE MOTORIZED CONTROL DAMPERS AS SHOWN ON PLANS. ALL MOTORIZED DAMPERS TO BE PROVIDED WITH 24V POWERED ACTUATORS. 2.4 REGISTERS, GRILLES AND DIFFUSERS A. REGISTERS, GRILLES AND DIFFUSERS SHALL BE TITUS, PRICE, KREUGER METAL AIRE PER SCHEDULE ON PLANS. CONTRACTOR SHALL FURNISH AND INSTALL ALL REFRIGERANT PIPING, AND CONDENSATE DRAIN LINES. THE GENERAL ARRANGEMENT OF ALL PIPING. PIPING ARRANGEMENTS WHICH MAY BE REQUIRED TO CHANGE BECAUSE OF BUILDING CONSTRUCTION WILL BE ALLOWED, PROVIDED BASIC ARRANGEMENT IS NOT REFRIGERANT PIPING TO BE ACR SOFT DRAWN COPPER WITH BRAZED FITTINGS. ALL REFRIGERANT PIPING TO BE INSULATED WITH 3/4" ELASTOMERIC INSULATION. EXTERIOR REFRIGERANT PIPING TO BE PROVIDED WITH ALUMINUM JACKET OR NYLON LOOM TO PROTECT INSULATION FROM UV DEGRADATION. CONDENSATE PIPING TO BE SCHEDULE 40 PVC WITH SOLVENT WELD JOINTS. ALL CONDENSATE DRAINAGE PIPING TO BE INSUALTED WITH 3/4" ELASTOMERIC INSULATION. CONNECT CONDENSATE PIPING TO NEAREST WASTE STACK. PIPE SUPPORTS FOR HORIZONTAL LINES SHALL BE SPACED AT INTERVAL IN ACCORDANCE WITH INTERNATIONAL MECHANICAL AND PLUMBING CODES. HANGERS SHALL BE ADJUSTABLE SWIVEL-RING TYPE, SUPPORTED BY STEEL RODS WITH NO PERFORATED OR BAND HANGERS USED. TRAPEZE HANGERS MAY BE USED WHERE TWO OR MORE PIPES RUN PARALLEL AT THE SAME ELEVATION. PIPES MUST BE SO INSTALLED THAT THEY MAY CONTRACT OR EXPAND FREELY WITHOUT DAMAGE TO OTHER WORK OR INJURY TO THEMSELVES. PIPING SHALL BE SO INSTALLED AS TO PERMIT PROPER CIRCULATION AND TO PERMIT DRAINAGE. ALL PIPING SHALL BE RACKED AND HANDLED IN A MANNER TO PREVENT ENTRANCE OF DIRT AND FOREIGN MATTER. OPEN DX PIPE ENDS SHALL BE PLUGGED OR CAPPED DURING ERECTION. INSTALLATION OF ALL PIPING SHALL INCLUDE ALL ACCESSORIES AS HEREIN SPECIFIED, AS SHOWN ON THE PLANS OR AS REQUIRED FOR A PROPER OPERATION OF THE SYSTEM. . POWER WIRING WILL BE PROVIDED UNDER ELECTRICAL SECTION, BUT ALL CONTROL WIRING AND CONTROL DISCONNECTS FURNISHED AND INSTALLED BY THIS CONTRACTOR.

STANDARDS OF MATERIAL AND WORKMANSHIP AS REQUIRED BY NATIONAL ELECTRICAL CODE, SHALL APPLY TO ALL ELECTRICAL WORK REQUIRED AS PART OF THIS SECTION. IN ADDITION, ALL SPLICES IN LOW VOLTAGE CONTROL WIRING SHALL BE MADE AT TERMINAL BLOCKS FURNISHED FOR THE PURPOSE; ANY SPLICES NOT MADE AT TERMINAL

MECHANICAL CONTRACTOR SHALL FURNISH ACCESS PANELS FOR INSTALLATION BY OTHERS FOR PROPER ACCESS TO DAMPERS, VALVES, CLEANOUTS, FIXTURE CONNECTIONS, MOTORS, DRIVES OR OTHER ITEMS INSTALLED UNDER THIS CONTRACT, EXCEPT WHERE SUCH PANELS ARE SHOWN AND/OR SPECIFIED UNDER OTHER SECTIONS OF SPECIFICATIONS.

BLOCKS SHALL BE SOLDERED. COLOR-CODED WIRE SHALL BE USED THROUGHOUT WITH A MINIMUM OF FIVE DIFFERENT COLORS. ALL FIRESTATS, PUSH-BUTTON AND OTHER CONTROL DEVICES SHALL BE FURNISHED AND INSTALLED UNDER THIS SECTION.

FURNISH AND INSTALL ALL THERMOSTATS, SWITCHES, PILOT LIGHTS, INTERLOCKS, RELAYS, ETC. NECESSARY FOR THE SYSTEM TO OPERATE.

ACCESS PANELS IN DUCTWORK SHALL BE GASKETED WITH CAM LOCK.

PANELS KARP TYPE KDW, OR EQUAL, WITH CONTINUOUS PIANO HINGES, KEY LOCK, PRIME COAT STEEL. EXACT SIZE AND LOCATION SUBJECT TO ARCHITECT'S APPROVAL.

```
PART 3 - EXECUTION
3.1 CUTTING AND PATCHING
                      BE RESPONSIBLE FOR THE LAYOUT OF ALL CUTTING, FITTINGS, ETC., AFFECTING MECHANICAL WORK AND COORDINATE WITH TRADES OR OTHER SECTIONS INVOLVED. ALL CUTTING FOR MECHANICAL WORK BY GENERAL CONTRACTOR.
                      INSURE THAT ALL NECESSARY CHASES, OPENINGS FOR PIPES, DUCTS, ETC., ARE PROVIDED TO PROPER TIME AS WORK OF OTHER SECTIONS PROGRESSES.
                     ALL PATCHING FOR MECHANICAL WORK BY GENERAL CONTRACTOR. PROVIDE FIRESTOP SYSTEMS AT ALL MECHANICAL PENETRATIONS THROUGH FIRE-RATED ASSEMBLIES
3.2 THIMBLES, INSERTS AND EXPANSION SHIELDS.
                      SET IN PLACE, AS FORM WORK PROGRESSES, ALL NECESSARY INSERTS AND THIMBLES AS REQUIRED.
                       SIZE THIMBLES TO ALLOW FREEDOM AROUND PIPE OR AROUND PIPE AND INSULATION WHERE PIPE IS INSULATED.
                     CAULK BETWEEN THIMBLE AND PIPING IN CHASES AND EXTERIOR WALLS. WHERE PIPES PASS THROUGH UPPER FLOORS OTHER THAN IN CHASES, SET PIPE THIMBLES ONE INCH ABOVE FINISHED FLOOR TO PREVENT WASH-WATER FROM DRIPPING BELOW.
                    FURNISH AND INSTALL PROPERLY SIZED CHROME PLATED BRASS ESCUTCHEON PLATES TO CONCEAL OPENINGS WHERE PIPING OR HANGERS PASS EXPOSED THROUGH FLOORS, CEILING OR WALLS.
                      INSTALL ALL ITEMS OF MECHANICAL WORK SUCH AS PIPES, DUCTS, ETC., PENETRATING ROOF A SUFFICIENT DISTANCE FROM WALLS, EAVES, ETC., TO PERMIT PROPER APPLICATION OF FLASHINGS. INSTALL ALL MECHANICAL ROOF PENETRATIONS ON REAR OF ROOF RIDGE WHEREVER POSSIBLE.
                       FLASH VENT PIPES THROUGH ROOF AS REQUIRED FOR TYPE OF ROOF CONSTRUCTION WITH FOUR POUND LEAD, WELL TURNED DOWN INTO PIPING AND EXTENDING TWELVE INCHES BEYOND OUTSIDE OF PIPE. MECHANICAL WORK REQUIRING LESS THAN AN EIGHT INCH ROOF OPENING SHALL BE PROVIDED WITH FLASHED PITCH
                       POCKETS OF SUITABLE SIZES.
                      FLASHINGS AND COUNTERFLASHINGS FOR OTHER THAN VENT PIPES AND DRAINS TO BE OF GAUGES AND CONSTRUCTION SPECIFIED IN ROOFING AND SHEET METAL SECTIONS OF SPECIFICATIONS. COORDINATE WITH ROOFER.
                     NO PAINTING SHALL BE DONE UNDER THIS DIVISION OF SPECIFICATIONS. ALL EXPOSED EQUIPMENT, PIPES, GRILLES, LOUVERS, FAN HOUSING, ETC., SHALL BE PAINTED UNDER OTHER DIVISIONS OF SPECIFICATIONS.
                     PROTECT ALL FACTORY FINISHES. WHERE DAMAGED, FINISH TO BE RENEWED AT THIS SECTION'S EXPENSE. THIS SECTION RESPONSIBLE FOR PRESERVATION OF PAINT AND FINISHES ON MECHANICAL EQUIPMENT AND MATERIALS DURING AND AFTER INSTALLATION.
3.8 HANGERS AND SUPPORT WORK
                       HANG ALL PIPING 1 1/4 INCHES AND LARGER ON TEN FOOT MAXIMUM CENTERS; 7'-6" ON CENTERS FOR SIZES ONE INCH AND 3/4 INCH; FOUR FOOT ON CENTERS FOR SIZES 1/2 INCH AND BELOW.
                       SUPPORT VERTICAL RUNS OF PIPING WITH FLAT STEEL BAR CLAMP HANGERS AT EACH FLOOR, OR AS DETAILED ON DRAWINGS.
                       HANGERS IN BUILDING: SOLID OR CLEVIS SUPPORTED BY VERTICAL STEEL RODS FROM MASONRY INSERTS, EXPANSION SHIELDS OR BEAM CLAMPS. WHERE TWO OR MORE PIPING RUNS ARE PARALLEL, AND GRADE TO THE SAME POINT, TRAPEZE-TYPE STRUCTURAL STEEL HANGERS MAY BE USED. BRASS, COPPER OR LEAD
                       INSERT HANGERS FOR INSULATED COPPER PIPING
                      SUPPORT ALL PIPING INDEPENDENTLY OF ALL EQUIPMENT AND ARRANGE HANGERS TO ISOLATE ANY VIBRATION TRANSMISSION FROM PIPING TO STRUCTURE.
                       FURNISH AND INSTALL STEEL SUPPORTS AND FRAMEWORK FOR EACH ITEM OF EQUIPMENT OR FIXTURE IN MEET ALL APPLICABLE REQUIREMENTS SPECIFIED UNDER STRUCTURAL STEEL. ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS OR AS DETAILED ON DRAWINGS. ALL SUCH WORK SHALL MEET ALL
                       APPLICABLE REQUIREMENTS SPECIFIED UNDER STRUCTURAL STEEL.
3.9 INSTALLATION OF PIPING
                      INSTALL ALL PIPING SO THAT IT MAY EXPAND AND CONTRACT FREELY WITHOUT DAMAGE TO EQUIPMENT, OTHER WORK OR INJURY TO PIPING SYSTEM. SUPPORT PIPING INDEPENDENTLY OF ALL EQUIPMENT.
                       INSTALL NECESSARY SWING JOINTS, EXPANSION JOINTS OR OFFSETS TO PROTECT PIPING SYSTEMS, EQUIPMENT OR OTHER WORK FROM DAMAGE WHETHER INDICATED ON DRAWINGS OR NOT.
                       INSTALL UNIONS ADJACENT TO ALL SCREWED COCKS, CONTROL VALVES, DISCHARGE FROM RELIEF VALVES. FLANGED FITTINGS ARE CONSIDERED EQUIVALENT TO UNION CONNECTIONS.
                      INSTALL PIPING PARALLEL AND/OR PERPENDICULAR TO BUILDING FLOOR, WALL OR CEILING PLANES, UNLESS OTHERWISE SHOWN ON DRAWINGS.
                      INSTALL ALL PIPING CONCEALED UNLESS SPECIFICALLY NOTED OTHERWISE, MAKING ALL NECESSARY OFFSETS, TURNS, ETC., NECESSARY TO CONCEAL PIPING FROM VIEW.
                     NO PIPING OF DISSIMILAR METALS SHALL BE PLACED IN CONTACT WITH EACH OTHER. PROVIDE INSULATING UNIONS WHENEVER PIPING OF DISSIMILAR METALS IS JOINED.
                      SEE SCHEDULES AND ELECTRICAL PLANS FOR MOTOR VOLTAGES.
                      ALL MOTORS FOR MECHANICAL EQUIPMENT FURNISHED UNDER MECHANICAL SECTIONS. WORK SHALL INCLUDE SETTING AND ALIGNING INTEGRAL DRIVE MOTORS IN OPERATING POSITION. MOTORS ELECTRICALLY CONNECTED UNDER DIVISION 26, ELECTRICAL.
                      ALL POWER WIRING AND ALL DISCONNECT SWITCHES FURNISHED AND INSTALLED UNDER DIVISION 26, ELECTRICAL.
                     ALL LOW VOLTAGE ELECTRICAL CONTROL WORK IN CONNECTION WITH AIR CONDITIONING, HEATING AND VENTILATING EQUIPMENT DONE BY HVAC SUBCONTRACTOR, INCLUDING ALL 24 VOLT CONTROL WIRING.
3.11 CLEANING UP
                    AFTER FINAL TESTING, REMOVE ALL DEBRIS, SURPLUS AND WASTE MATERIALS COMPLETELY FROM THE JOB SITE. \cdots
```

PROPERLY OIL, GREASE AND LUBRICATE ALL MOTORS, PUMPS, COMPRESSORS, ETC., BEFORE STARTING AND UNTIL FINAL ACCEPTANCE OF WORK. CONTRACTOR WILL NOT BE RESPONSIBLE FOR THIS TYPE OF MAINTENANCE DURING WARRANTY PERIOD. IT IS THE OWNER'S RESPONSIBILITY AFTER ACCEPTANCE OF WORK.

TO PROVIDE PROPER MAINTENANCE WORK AS INDICATED IN MAINTENANCE INSTRUCTIONS SUBMITTED TO OWNER AT ACCEPTANCE OF PROJECT.

END OF SECTION 23 00 00 ·

PELICANS CAMPUS IMPROVEMENTS

woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125

WOODWARDDESIGNBUILD.COM | 504-822-6443

307 W MAPLE RIDGE DR

METAIRIE, LA 70001

Erik Wismar, AIA

WDG PROJECT NO IAR2315

Construction Documents



no.	descripton	date
	1. Table 1.	
	·	

	· ·	
- 1		
	1000	

	MECHANICAL SYMBOLS							
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION					
	SUPPLY DUCT UP OR DOWN	•	POINT BETWEEN DEMO & EXISTING TO REMAIN					
	RETURN DUCT UP OR DOWN	0	POINT BETWEEN NEW & EXISTING WORK					
	EXHAUST DUCT UP OR DOWN	— RS —	REFRIGERANT SUCTION LINE					
\sim	INSULATED FLEXIBLE DUCT		REFRIGERANT LIQUID LINE					
	LINED DUCTWORK	—— D ——	DRAIN LINE					
	SQUARE-ROUND TRANSITION	O+	PIPE ELBOW TURNED UP					
	ELBOW WITH TURNING VANES.	C+	PIPE ELBOW TURNED DOWN					
	RADIUS ELBOW	-101-	TEE OFF BOTTOM					
	SPLITTER DAMPER IN DUCT		TEE OFF TOP					
	FLEXIBLE DUCT CONNECTION	OA	OUTSIDE AIR					
X	CEILING DIFFUSER	EA	EXHAUST AIR					
	RETURN AIR GRILLE	SA	SUPPLY AIR					
	EXHAUST AIR GRILLE WITH SQUARE OR ROUND NECK	RA ·	RETURN AIR					
	SLOT DIFFUSER	∮ (CFM)	CUBIC FEET PER MINUTE					
	MANUAL DAMPER	AP	ACCESS PANEL					
	AUTOMATIC DAMPER	AHU	AIR HANDLING UNIT					
	SMOKE DAMPER	FCU	FAN COIL UNIT					
	FIRE DAMPER (VERTICAL)	Ø 👄	DIAMETER AND FLAT OVAL					
	FIRE DAMPER (HORIZONTAL)	U	UNDERCUT IN DOOR					
	COMBINATION FIRE/SMOKE DAMPER (VERTICAL)	T	TEMPERATURE SENSOR					
FS	COMBINATION FIRE/SMOKE DAMPER (HORIZONTAL)							
THIS IS A	TYPICAL SCHEDULE. NOT ALL SYMBOLS ARE	NECESSARILY USE	ED ON THIS PROJECT.					

				238128 - MINI-SPLIT SYSTEM SCHEDULE																
			INDOO	R UNIT						OUTDOOR UNIT	Γ									
	WEIGHT			ELECTRIC/	AL DATA	COND.	MODEL#		WEIGHT	ELECTRICAL DA	ATA	MODEL#	RATED CAP. COOLING	RATED CAP. HEATING	EFF.	HSPF	REFRIG.	LINESET	QTY	REMARKS
MARK	(LBS)	TYPE	CFM	VOLTS/PH.	MCA	PUMP LIFT	(CARRIER)	MARK	(LBS)	VOLTS/PH. MCA	MOCP	(CARRIER)	(BTU/H)	(BTU/H)	(SEER)	11011	INCITATO.	LINCOLI	QTI	TALIMI WATE
MSFCU-1	44	HORIZONTAL DUCTED	176/282/353	208/1	1.11	29.5"	40MBDQ123	MSCU-1	82	208/1 9	15	38MAQB12A3	13000	13500	19	10.2	R410A	1/4-1/2 (82' MAX)	1	1,2,3
MSFCU-2	120	HORIZONTAL DUCTED	720/1030/1230	208/1	3.2	29.5"	40MBDQ363	MSCU-2	137	208/1 30	50	38MBRQ36A3	36000	40000	16.5	11.5	R410A	3/8-5/8 (213' MAX)	1	1,2,3

- 1 COOLING CAPACITY IS AT AHRI RATED CONDITIONS OF 80/67 ENTERING COIL WITH 95/78 AMBIENT CONDITION.
- 2. HEATING CAPACITY IS AT AHRI RATED CONDITIONS OF 70/60 ENTERING COIL WITH 47/43 AMBIENT CONDITION.
- 3. INDOOR UNIT IS POWERED FROM OUTDOOR UNIT.


			AIR	DISTRIE	BUTION SC	CHEDULE		
MARK	TYPE	CFM RANGE	CONN. SIZE	NECK SIZE	FACE SIZE	FINISH	BASIS OF DESIGN	REMARKS
S-1	PLAQUE FACE CEILING DIFFUSER	SEE DWGS	SEE DWGS	SEE DWGS	23.75x23.75	WHITE	PRICE SPD	(1)(2)
S-2	LINEAR BAR GRILLE	SEE DWGS	SEE DWGS	SEE DWGS	SIZE+1.4375	WHITE	PRICE LBP-15A	(3)(4)(5)
R-1	PERF. FACE FILTER RETURN	0-1000	SEE DWGS	22x22	23.75x23.75	WHITE	PRICE AFF	LAY-IN (3)
R-2	LINEAR BAR GRILLE	0-1230	SEE DWGS	SEE DWGS	SIZE+1.4375	WHITE	PRICE LBP-15A	(3)(4)(6)
E-1	PERF. FACE	SEE DWGS	SEE DWGS	22x22	23.75x23.75	WHITE	PRICE 10A	(3)

NOTES:

- 1. PROVIDE WITH INSULATED BACK.
- 2. PROVIDE WITH PLASTER FRAME IN GYP CEILINGS.
- 3. SURFACE MOUNT BORDER WITH COUNTERSUNK SCREWHOLES IN FACE OF GRILLE.
- 4. FRONT BLADES PARALLEL WITH SHORT DIMENSION.
- 5. PROVIDE WITH MULTI-SHUTTER DAMPER.
- 6. FRONT BLADES PARALLEL WITH WIDE DIMENSION.

		230000 - MISC. EQUIPMENT SCHEDULE
:	MARK	DESCRIPTION
· .		


AIR CURTAIN: MARS AIR MODEL QP10120-3UD-OB; 185 LBS, 4200 CFM, (3) 1/2 HP MOTORS, AC-1 (2) 1750 RPM, 208/1, 7.5 FLA. PROVIDE TOP MOUNT BRACKET. PROVIDE MCPA-6UD (MOTOR CONTROL PANEL. PROVIDE 99014 (DOOR SWITCH, ROLLER/PLUNGER COMBO).

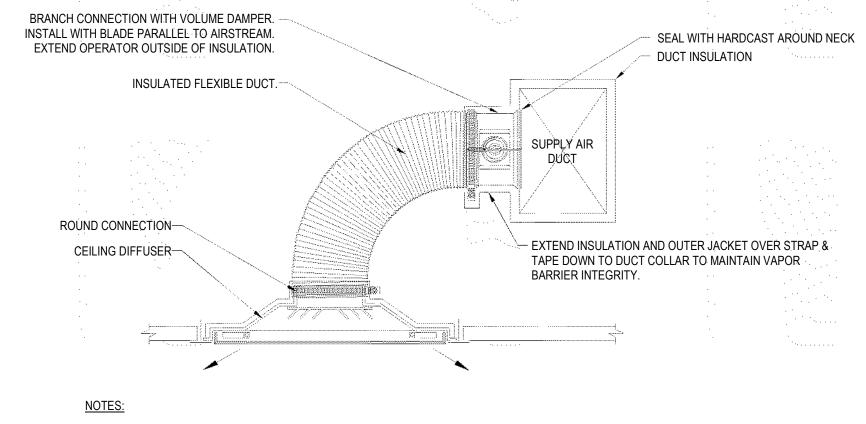

1. SUPPORT FLEXIBLE DUCT FROM STRUCTURE AS SPECIFIED. DUCT SHALL NOT KINK, SAG OR REST ON LIGHT FIXTURES, CEILING SUPPORT TEES OR TILE.

2. IN UNCONDITIONED CEILING PLENUMS, INSULATE BACK OF DIFFUSER WITH DUCT WRAP AND SEAL WITH VAPOR BARRIER

1 DETAIL - CEILING DIFFUSER 1/8" = 1'-0"

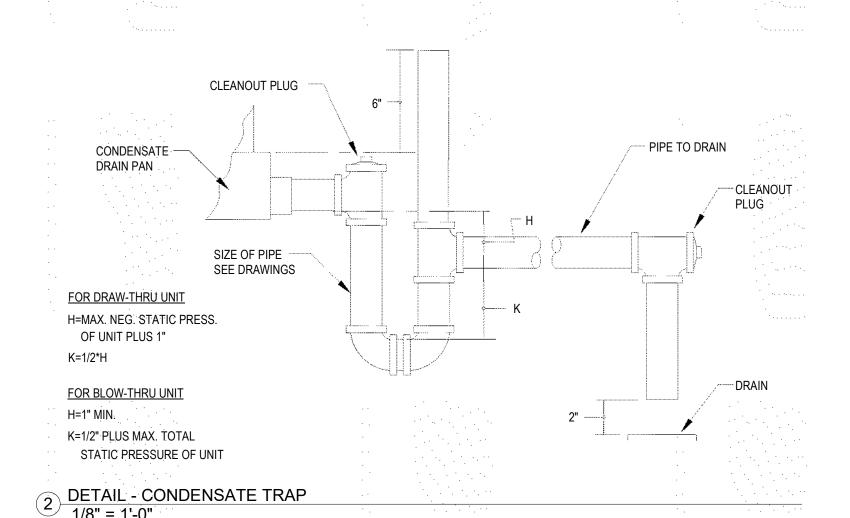

GENERAL NOTES: SA & RA PLENUMS TO REMAIL ON AHU 1.10 & AHU 1.11. REUSE STORED (FROM DEMO.) APPLICABLE AIR DEVICES. COORDINATE ALL LOCATIONS OF DEVICES IN CEILING WITH ARCHITECTURAL RCP PRIOR TO INSTALLATION. AREAS ABOVE CEILINGS ARE TO BE USED AS A RETURN AIR PLENUM UNLESS NOTED OTHERWISE. ALL DUCTWORK TO BE SHEETMETAL. ALL SUPPLY & OUTSIDE AIR DUCTWORK TO BE INSULATED . WITH R-6, 2" DUCTWRAP. DUCT DIMENSIONS ARE SHEETMETAL SIZES UNLESS NOTED

ALL SA CFM QUANTITIES TO BE SET VIA MANUAL DAMPER IN TAKEOFF ON MAIN TRUNK.

HVAC SYMBOLOGY, SCHEDULES, **NOTES & DETAILS**

DRAWN BY | Author

WDG PROJECT NO |AR2315 04.15.2024

Construction Documents WENDELL P, HUMPHRES

PELICANS CAMPUS IMPROVEMENTS


woodward design group


Erik Wismar, AIA


1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443


. 307 W MAPLE RIDGE DR


METAIRIE, LA 70001

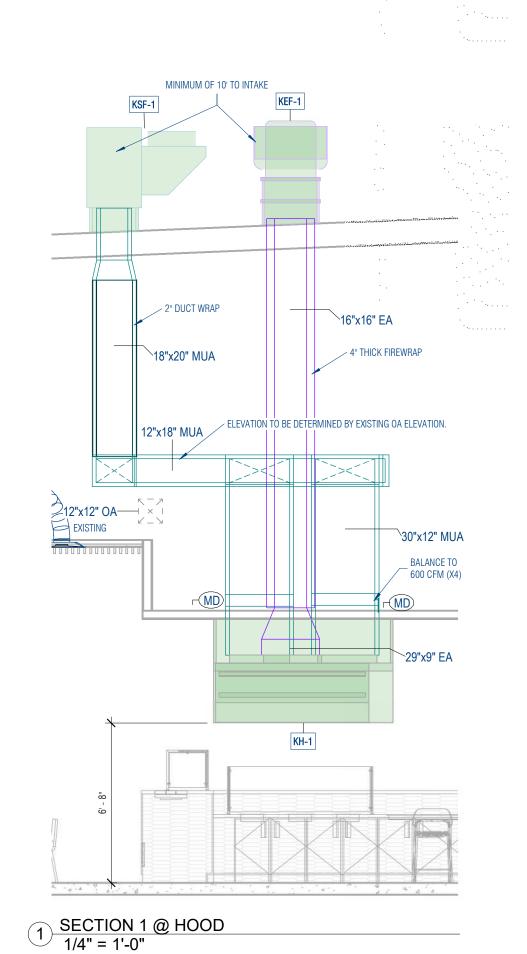

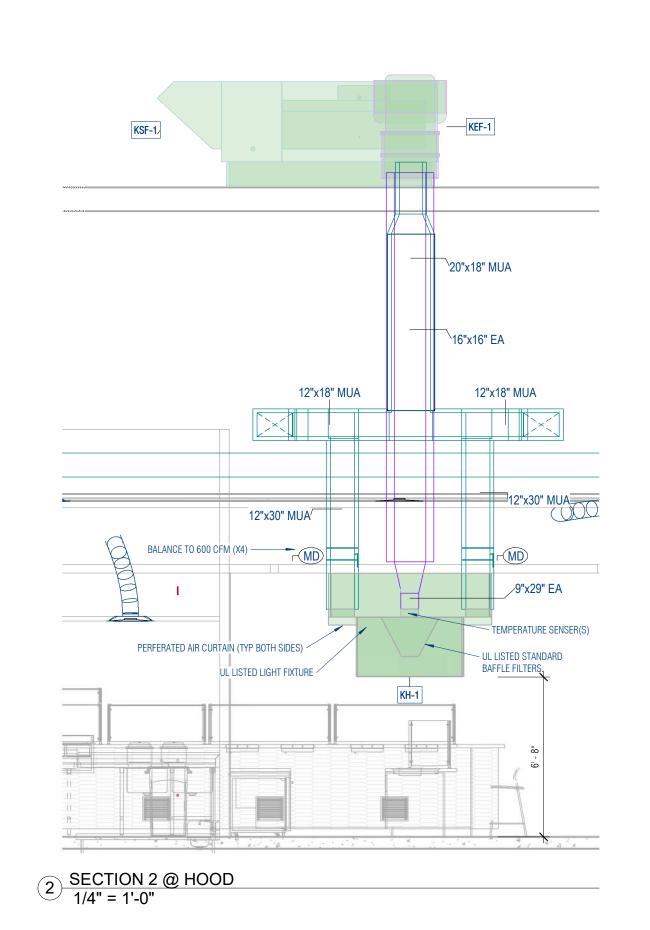

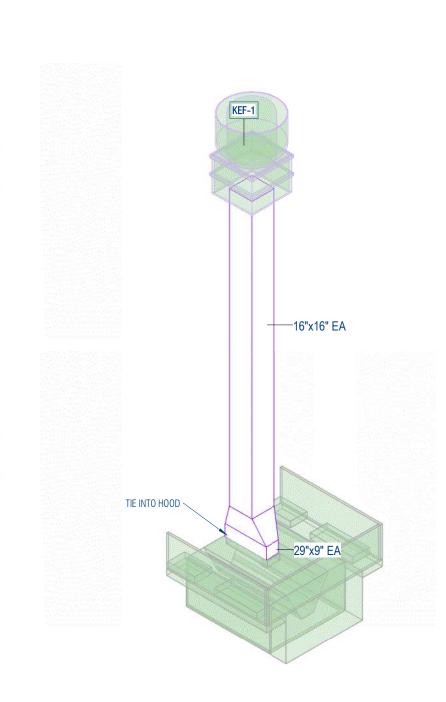



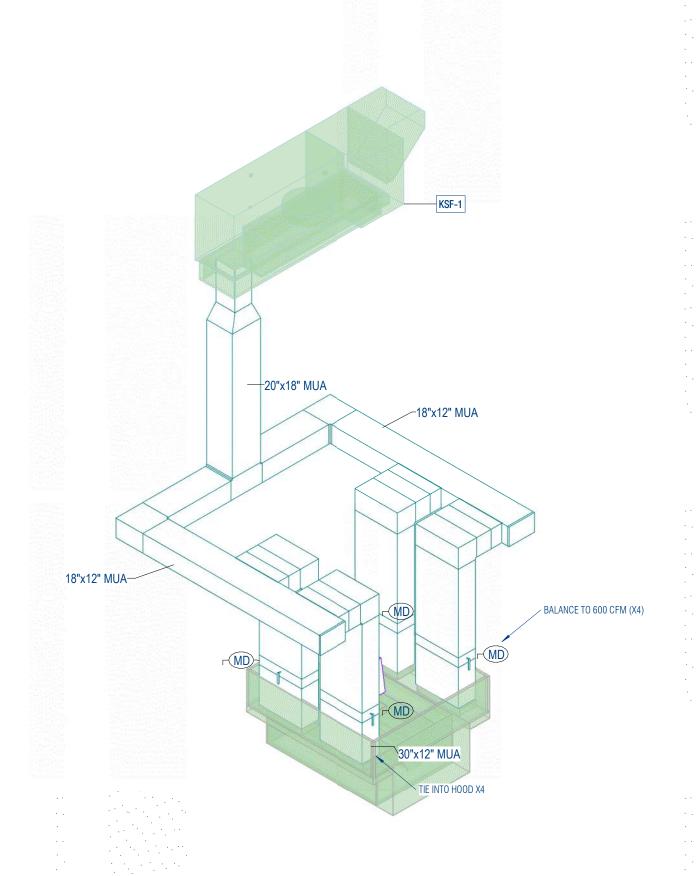

4 HVAC- HOOD MUA ISO

woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA

PoNCE, LLC .307 W MAPLE RIDGE DR METAIRIE, LA 70001




PELICANS CAMPUS IMPROVEMENTS

WDG PROJECT NO |AR2315

Construction Documents WENDELL P, HUMPHRES

no. descripton

HVAC - HOOD SECTIONS, DETAILS & IOS's

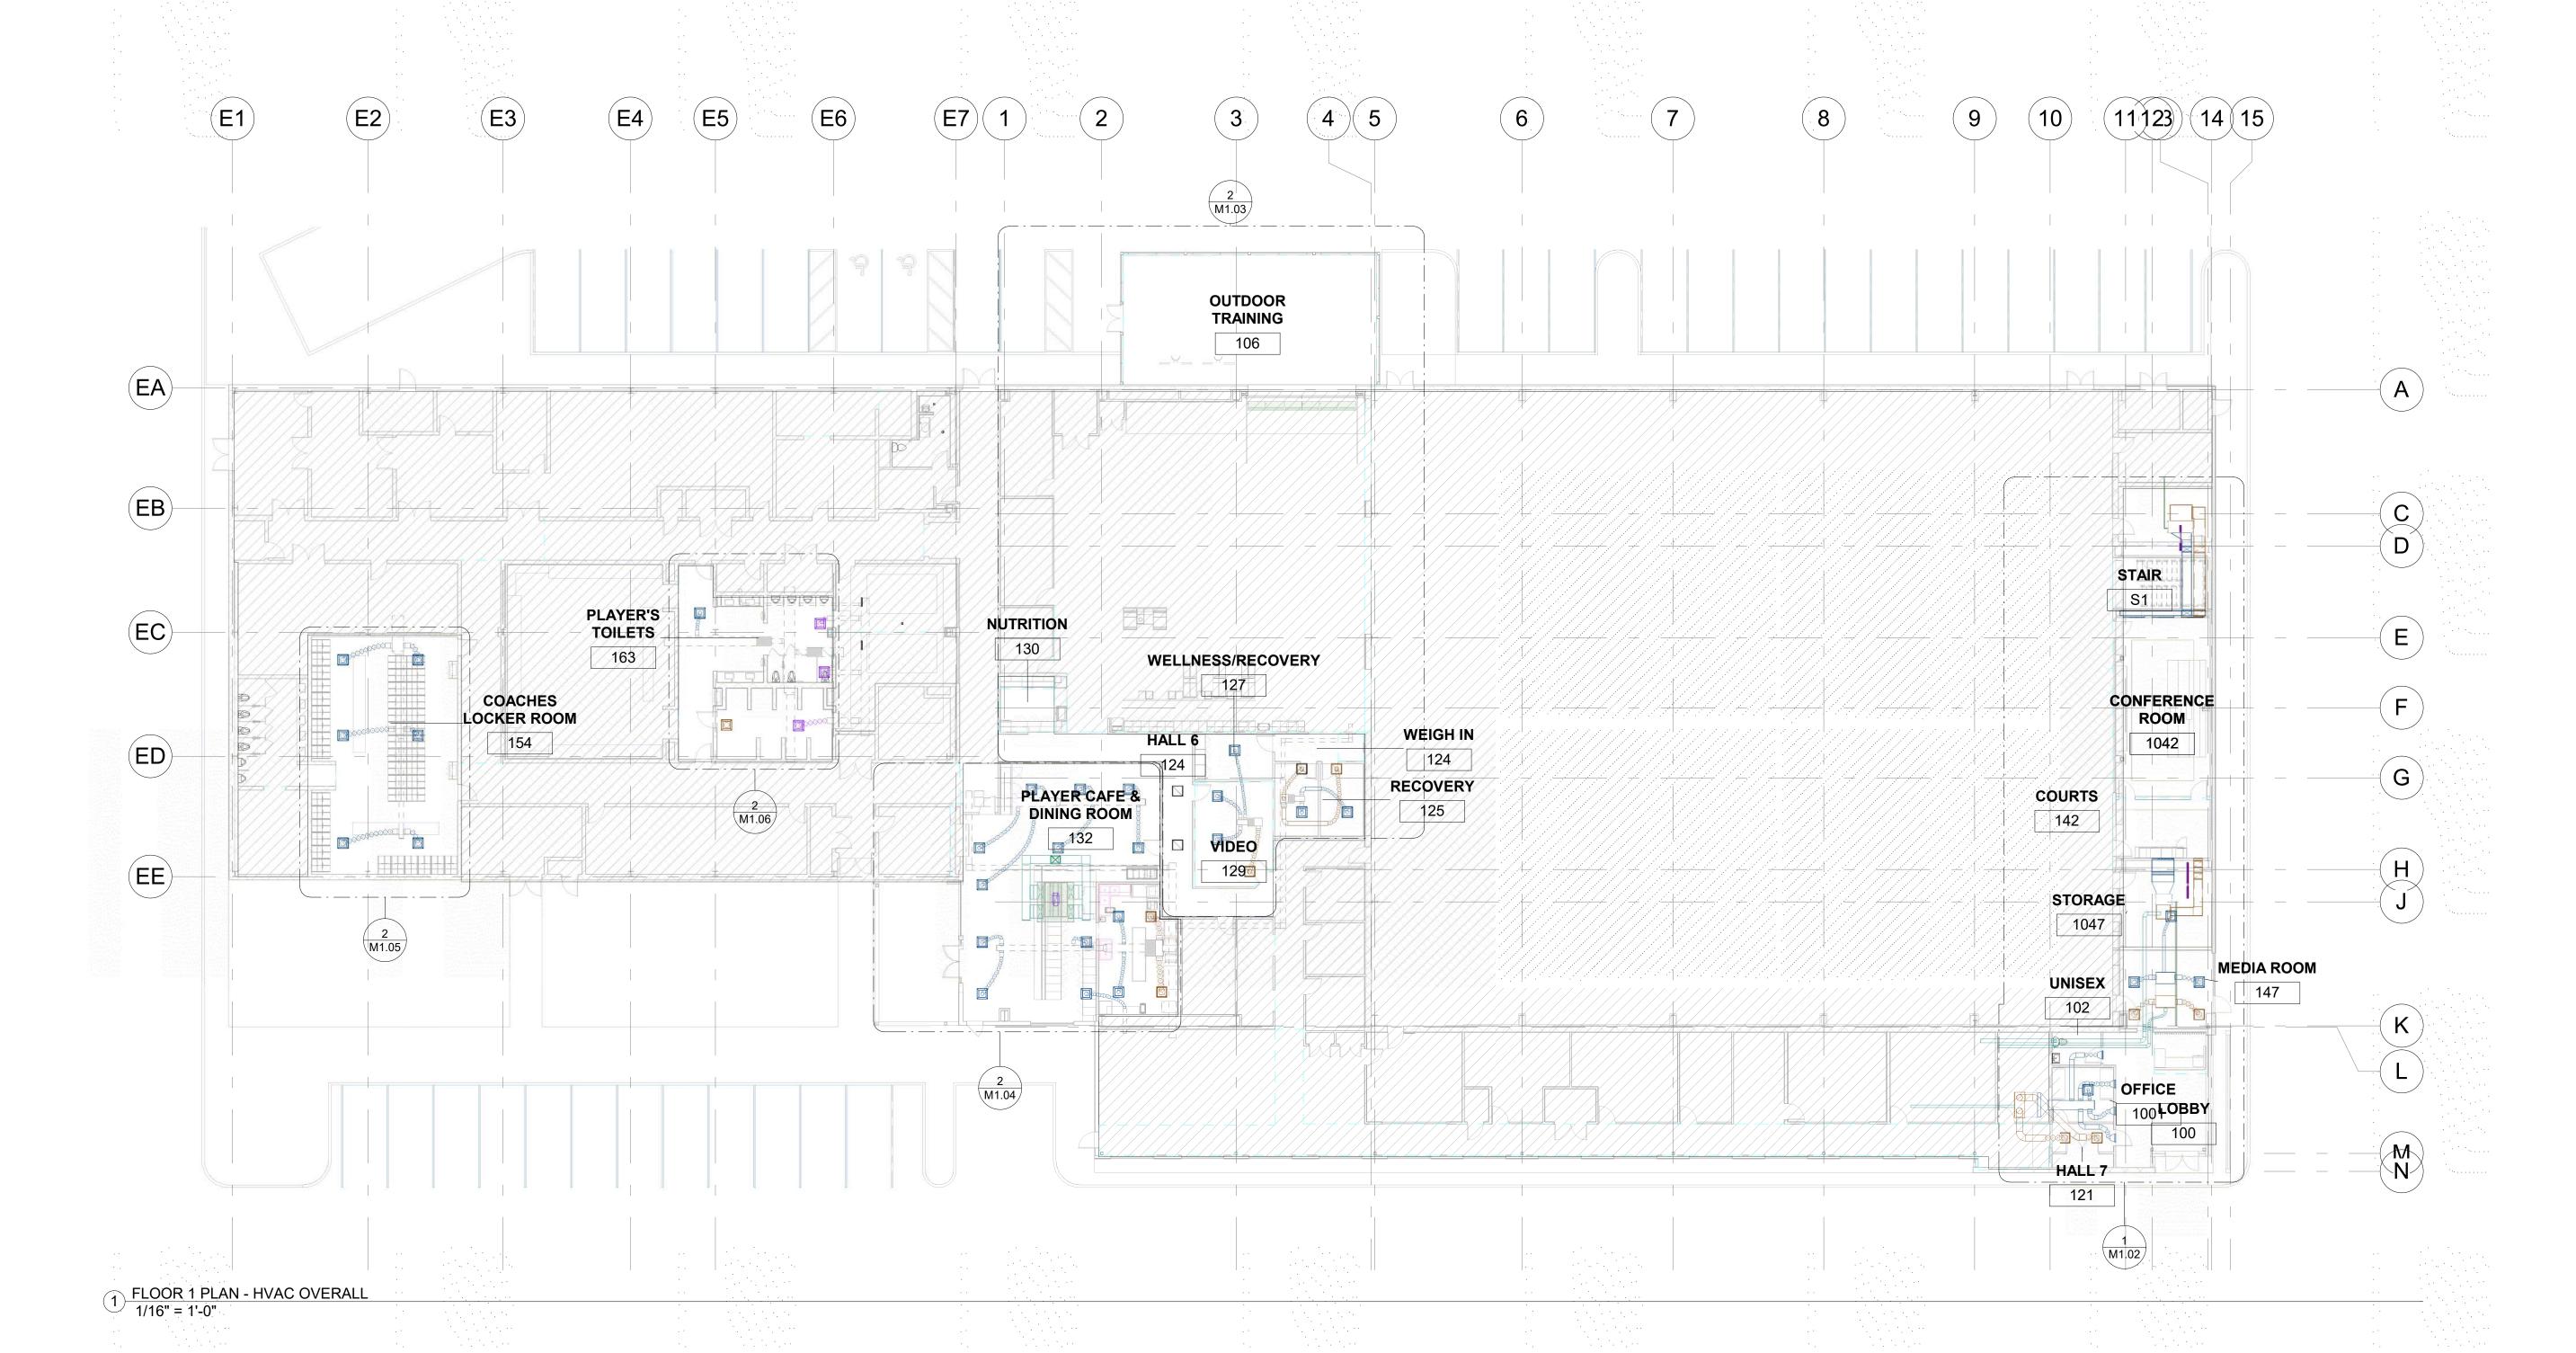

woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY
NEW ORLEANS, LA 70125
WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA

PONCE, LLC
307 W MAPLE RIDGE DR
METAIRIE, LA 70001

PONTCHARTRAIN MECHANICAL


716 Little Farms Ave. Metarisc, LA 70003 504-736-3064 www.gontnoch.com

PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana


WDG PROJECT NO JAR2315

Construction Documents 04.15.202



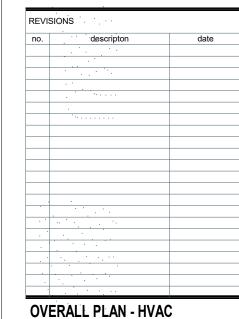

DRAWN BY |Author M1.00

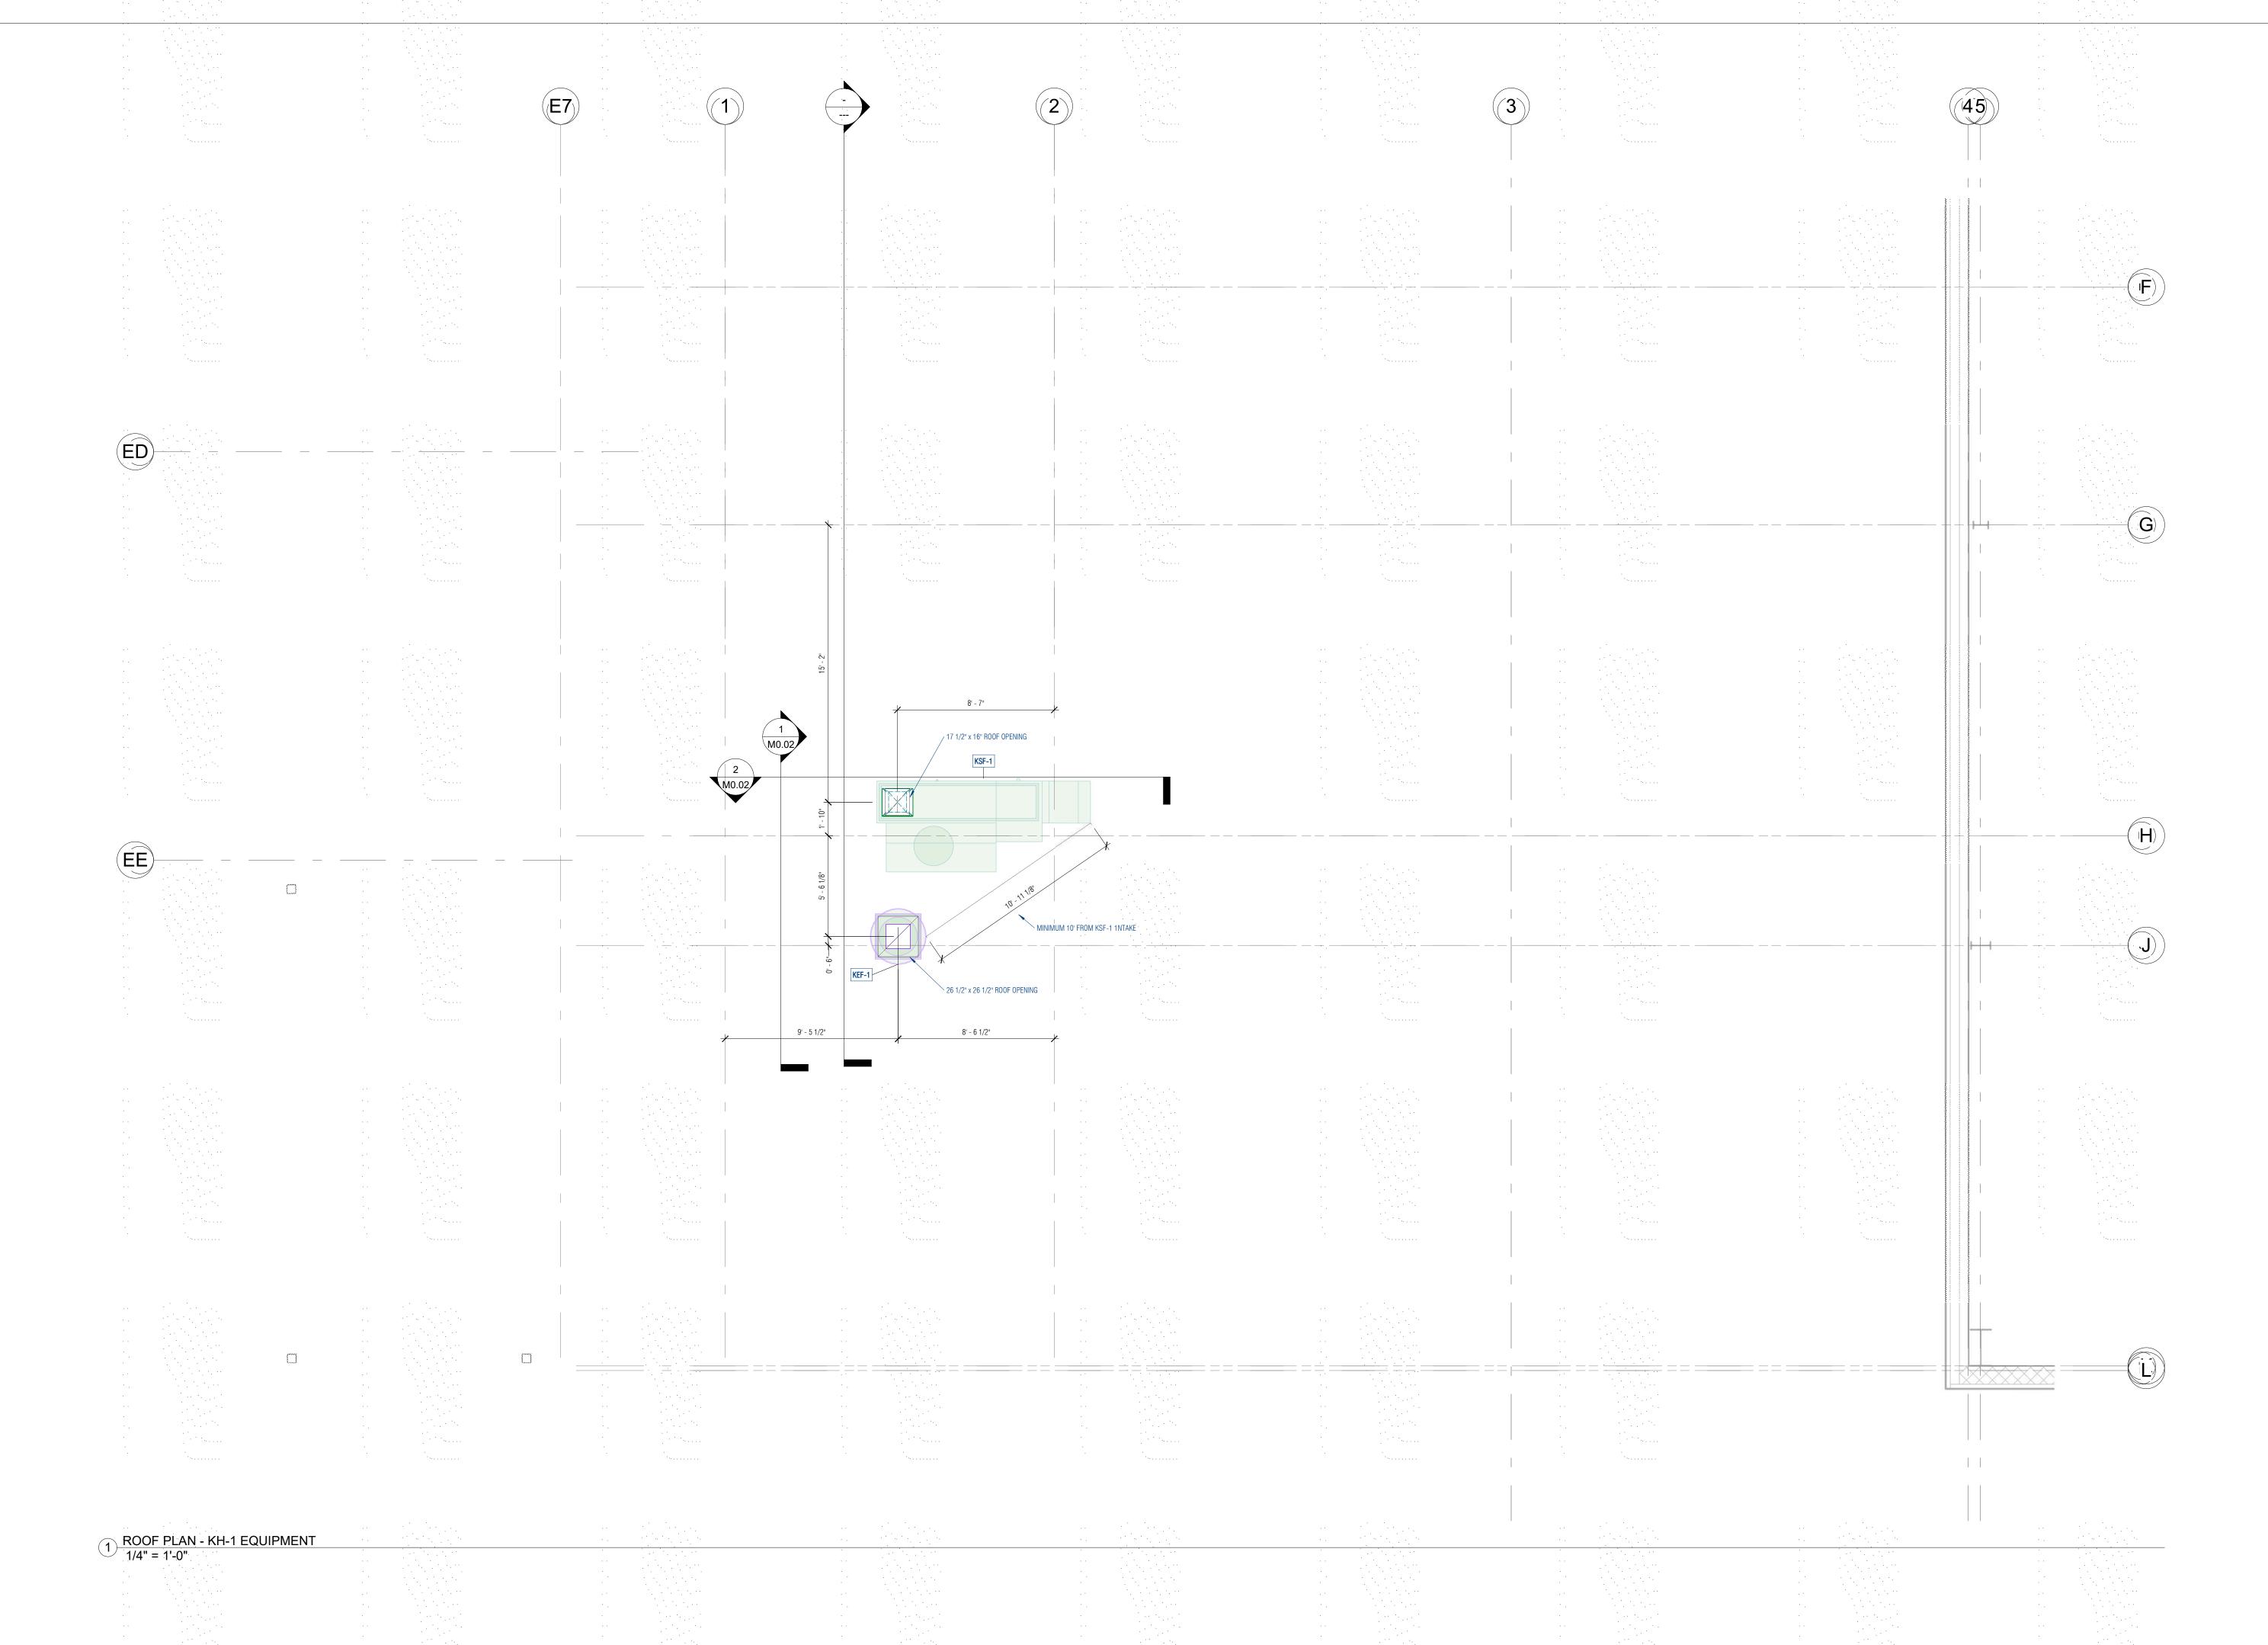



woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY
NEW ORLEANS, LA 70125
WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA

PONCE, LLC
307 W MAPLE RIDGE DR
METAIRIE, LA 70001



PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana

WDG PROJECT NO |AR2315


Construction Documents



REVISIONS								
no.	descripton	date						
	1							
1								
	<u> </u>							
	<u>,</u>							
	<u> </u>							
	<u> </u>							

ROOF PLAN - HVAC EQUIPMENT

DRAWN BY |Author

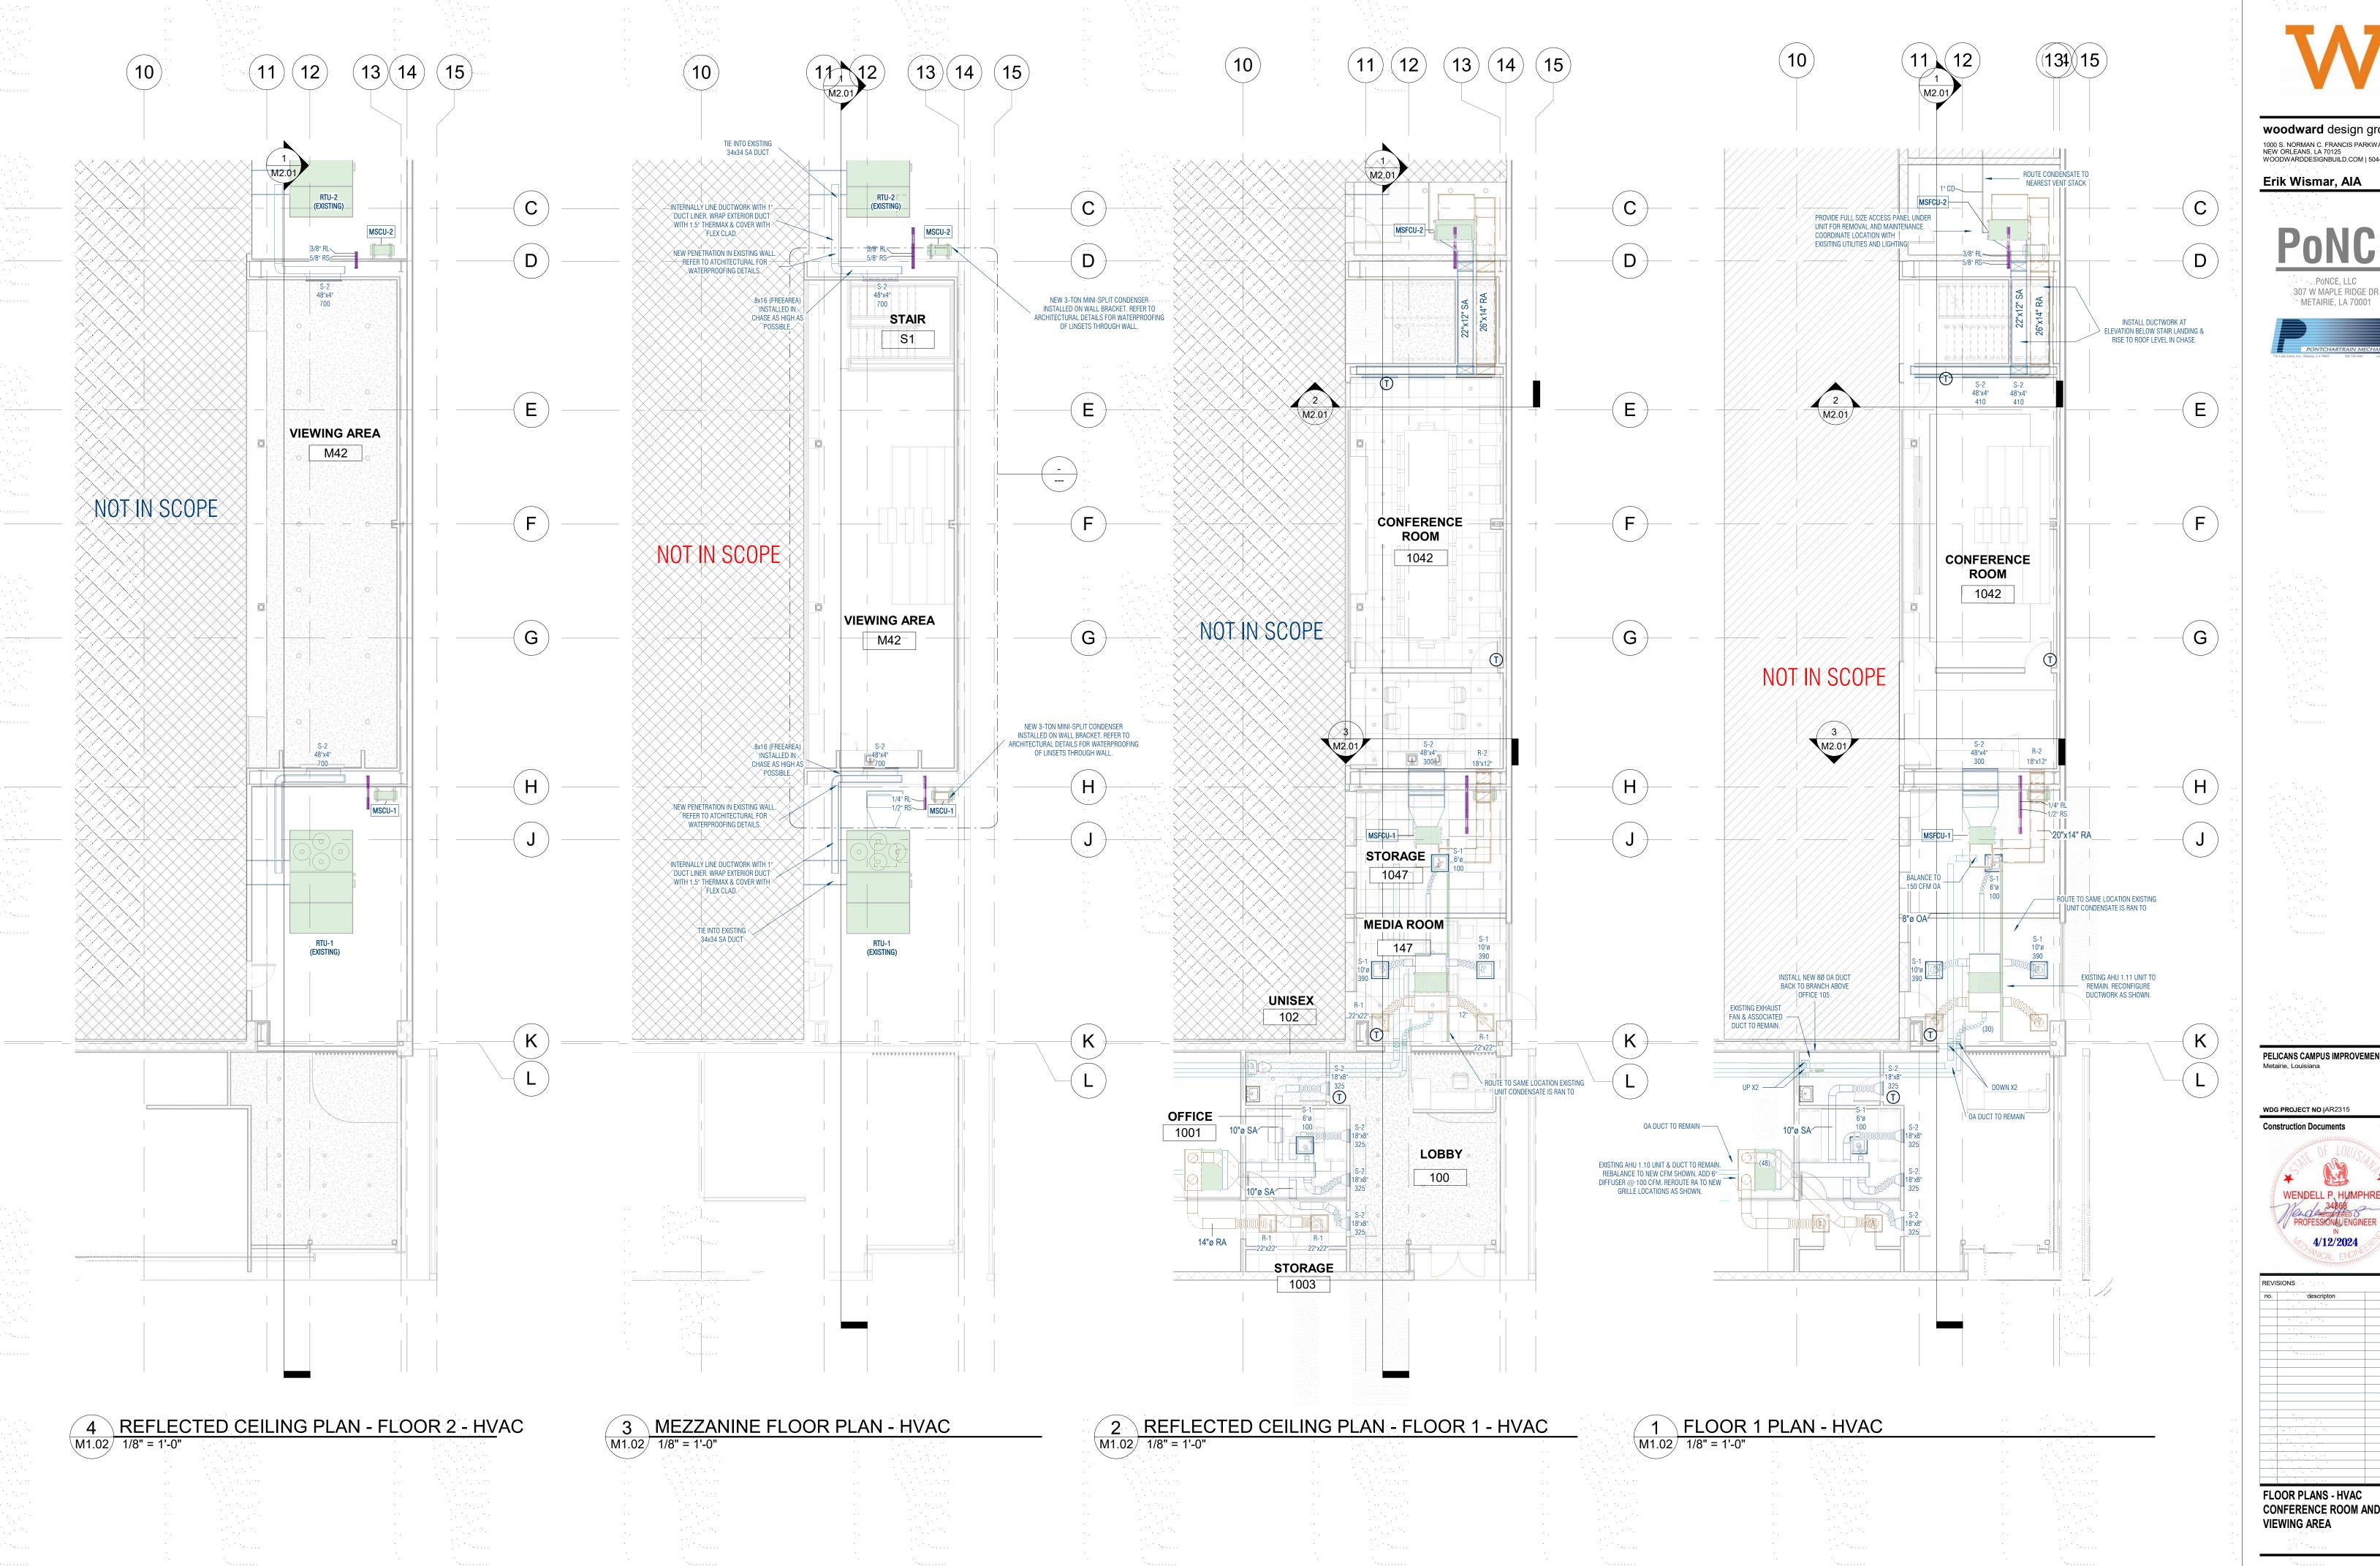


woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443

PoNCE, LLC 307 W MAPLE RIDGE DR




PELICANS CAMPUS IMPROVEMENTS




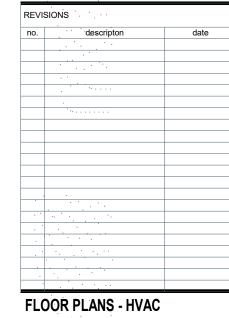

CONFERENCE ROOM AND

DRAWN BY |Author M1.02

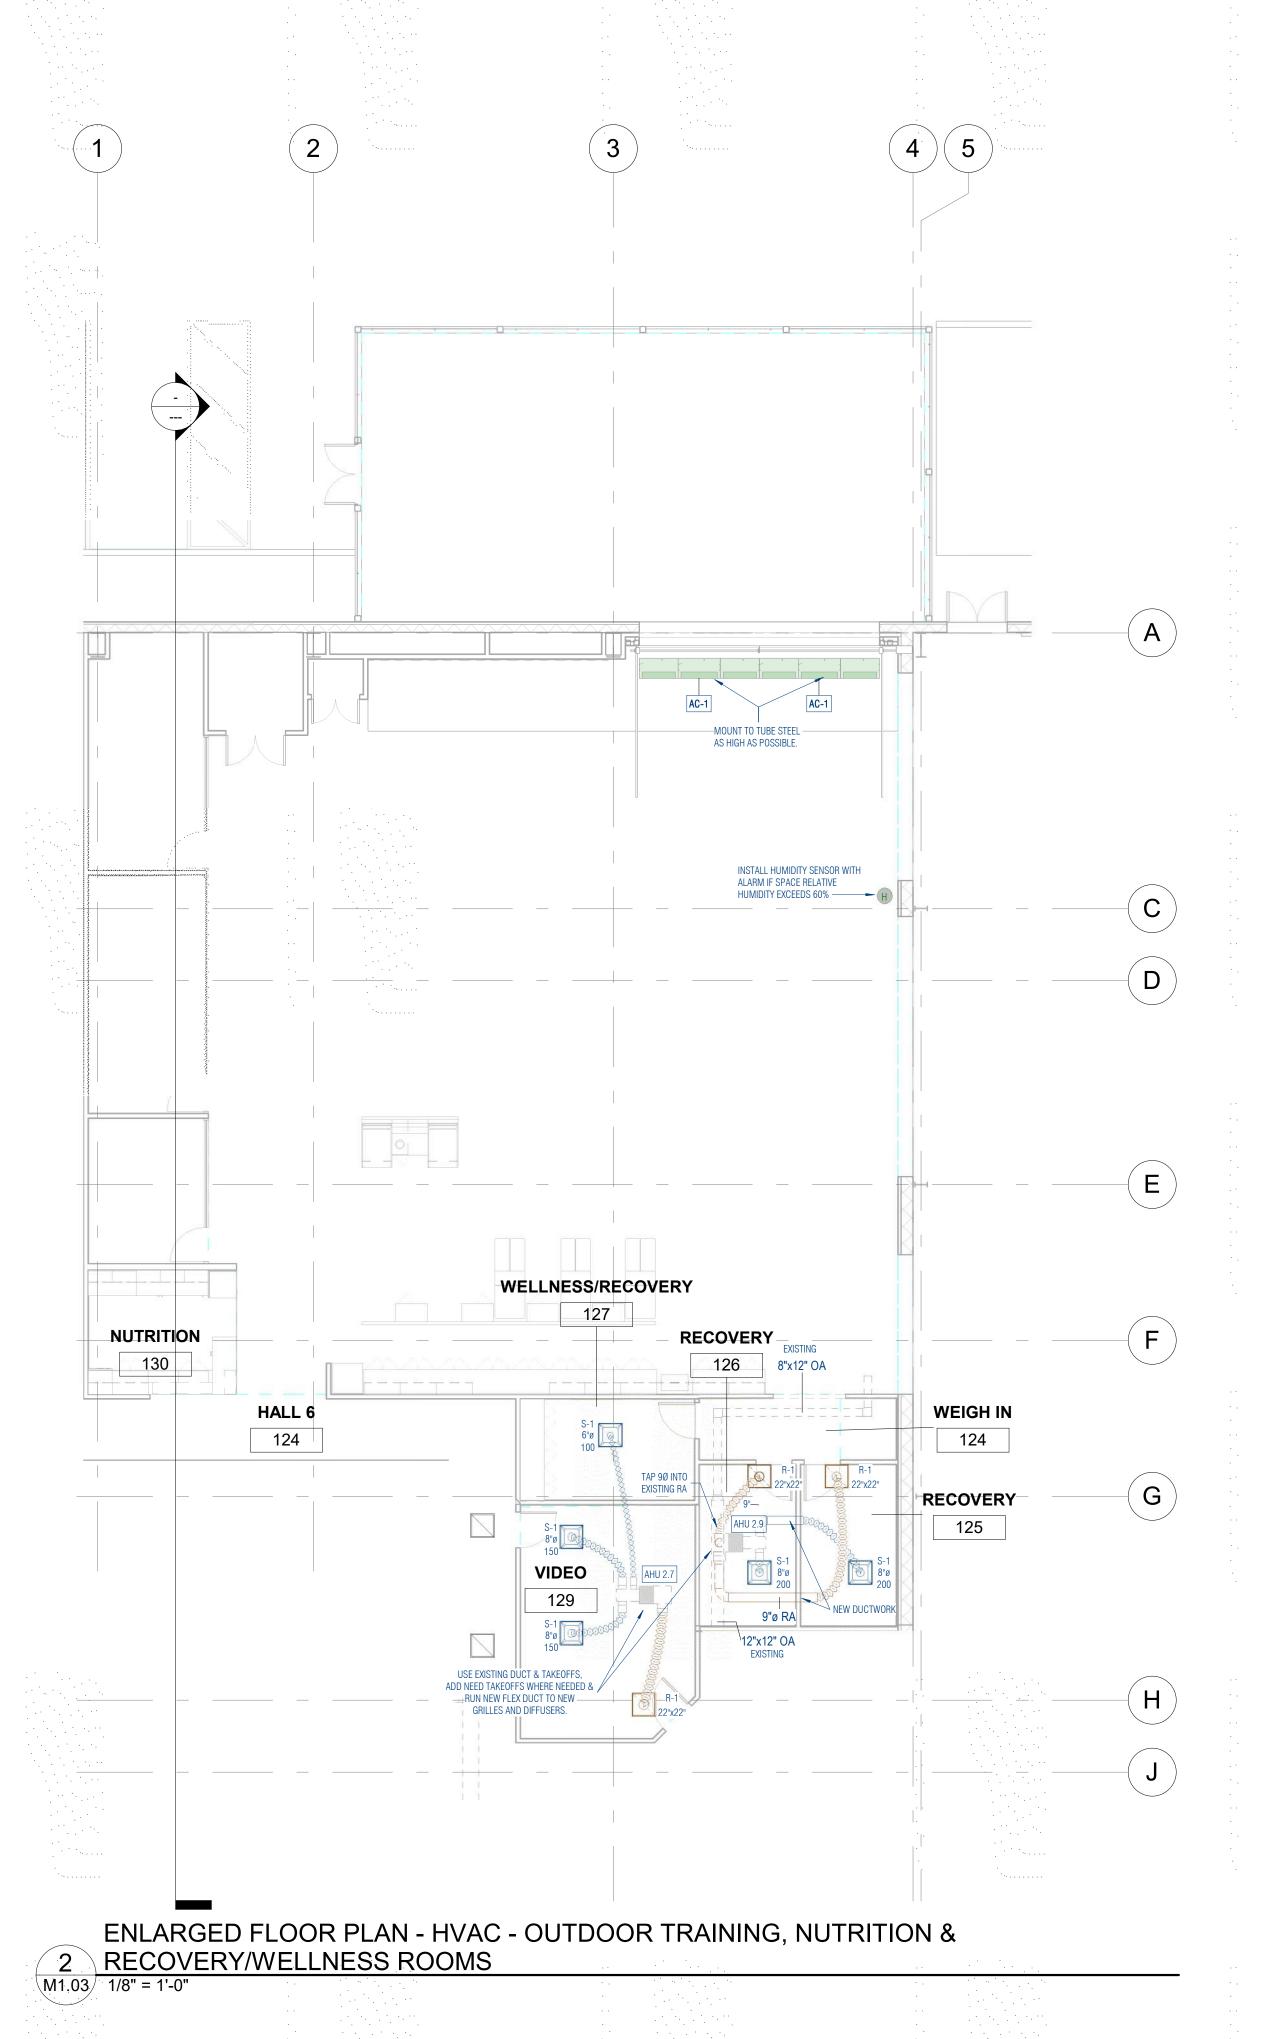

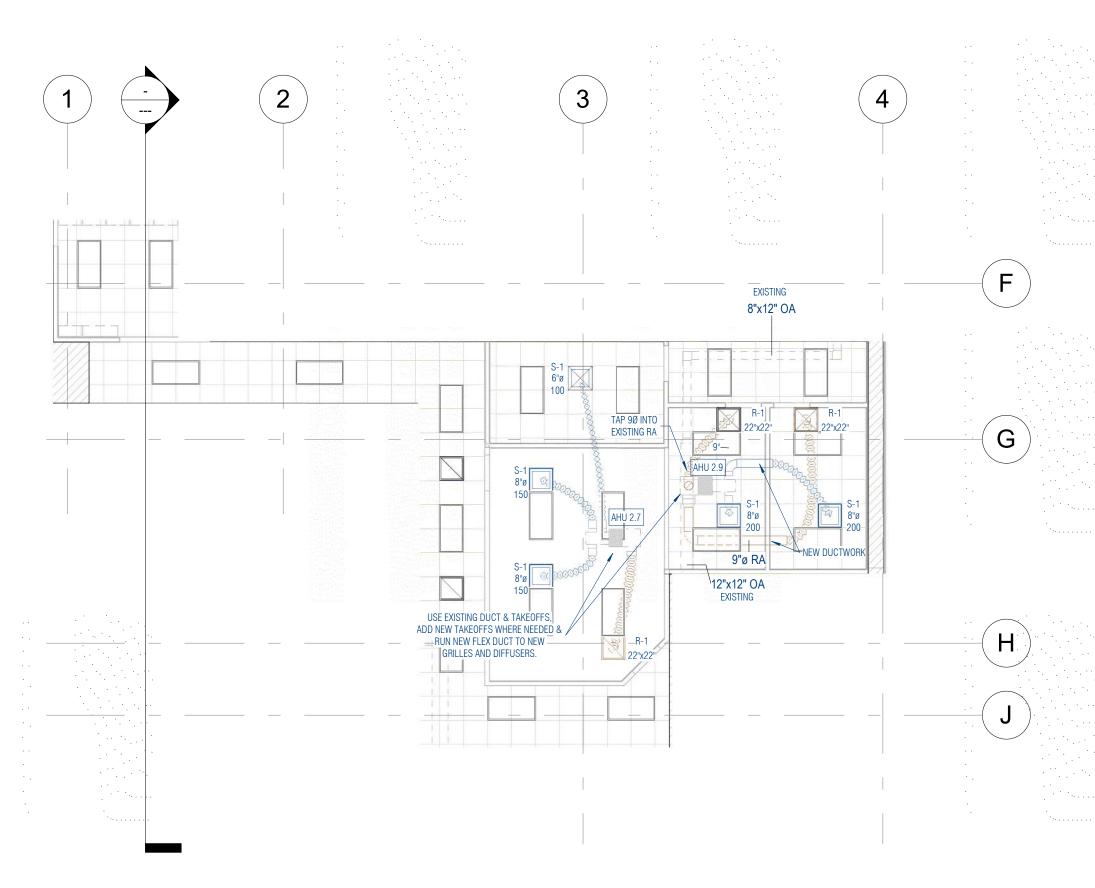

RCP - HVAC - NUTRITION & RECOVERY/WELLNESS ROOMS M1.03 1/8" = 1'-0"

woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA

Ponce, LLC 307 W MAPLE RIDGE DR



PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana

WDG PROJECT NO |AR2315 **Construction Documents**




no.	descripton	da


	Teach and a second	
'		

AND RECOVERY

DRAWN BY | Author M1.03

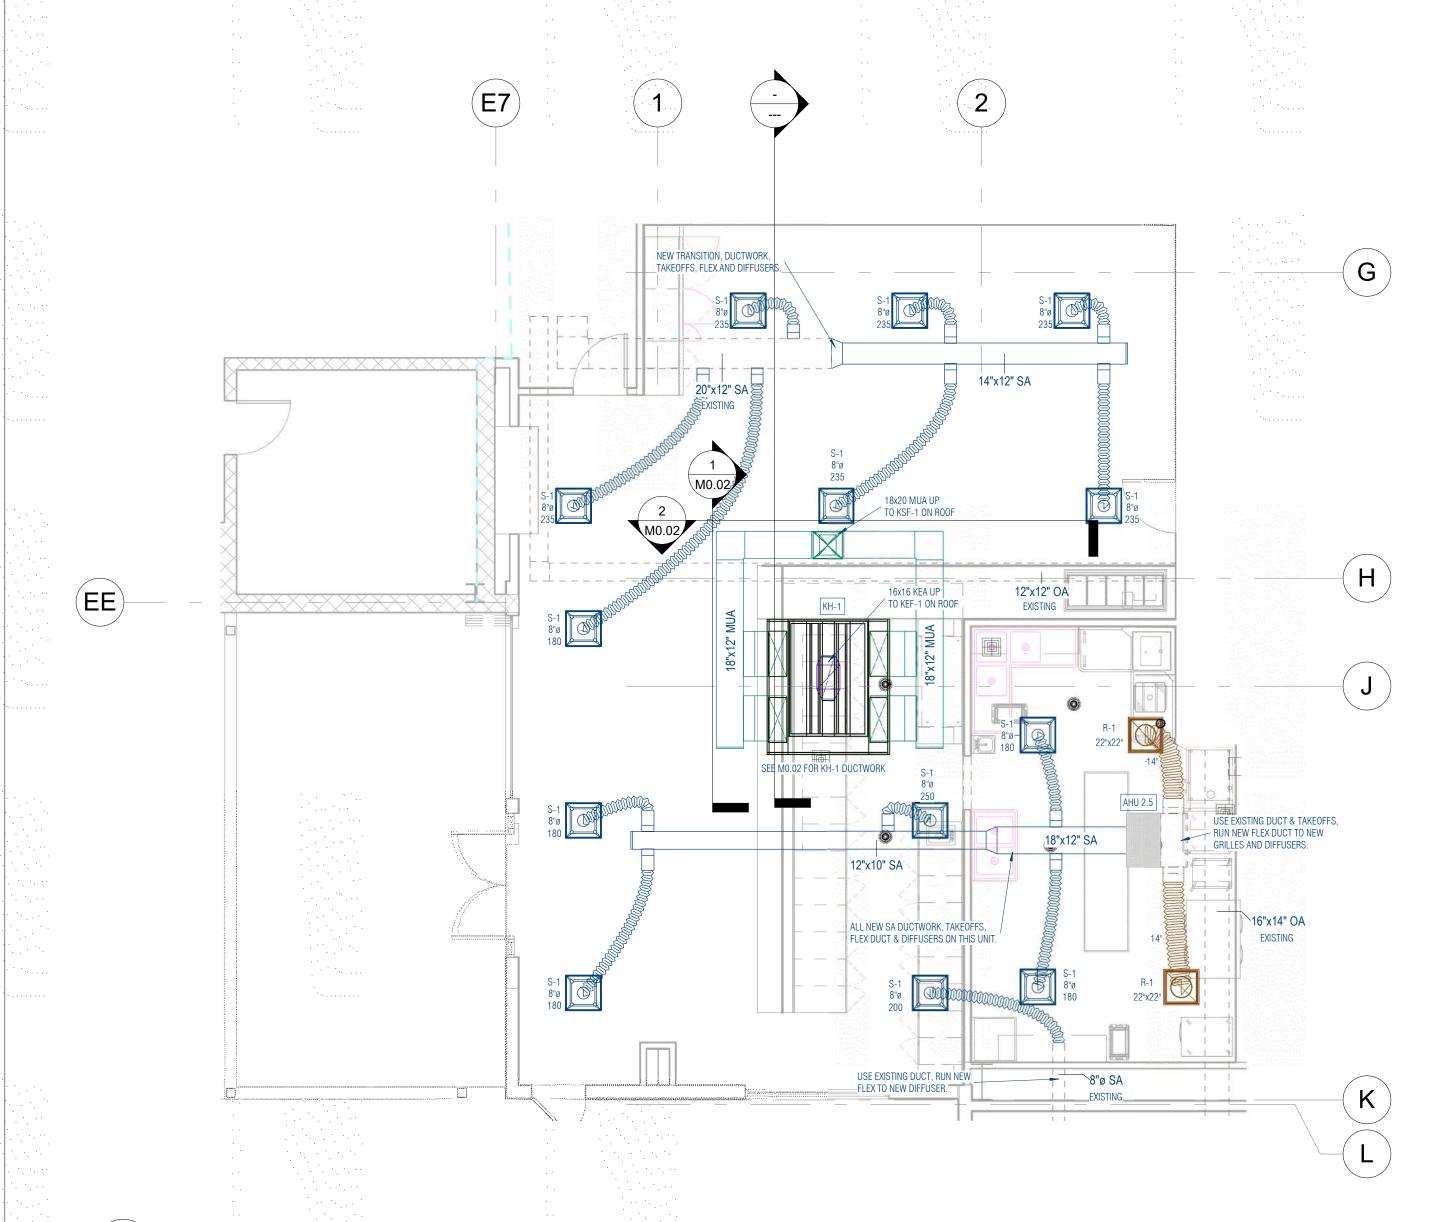

2 ENLARGED FLOOR PLAN - HVAC - PLAYERS' CAFE & DINING AREA

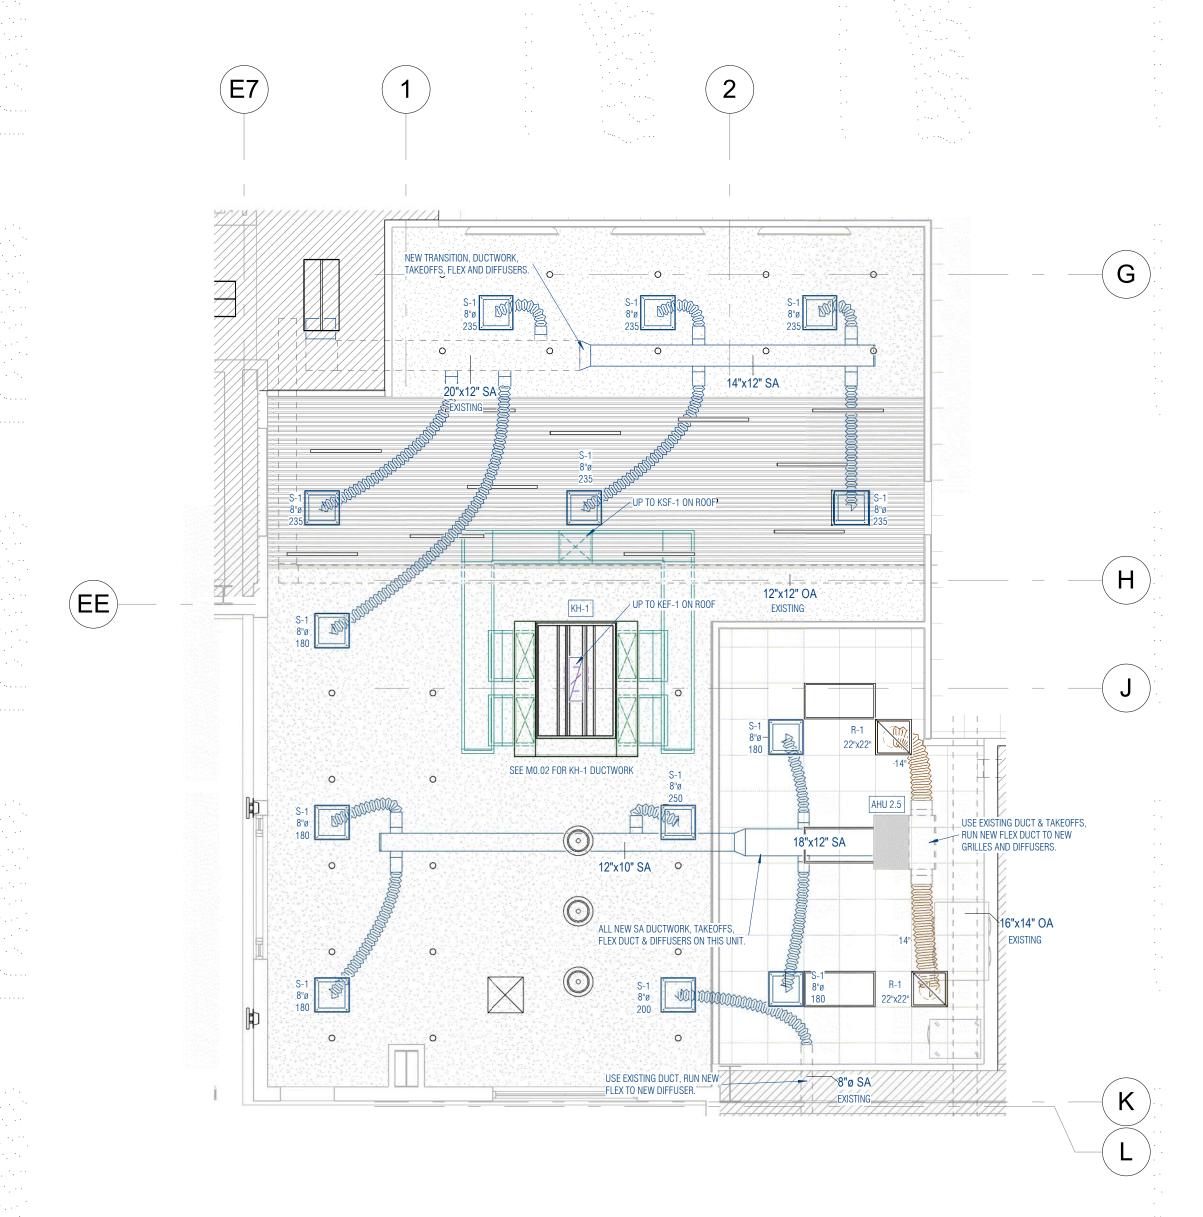

RCP - HVAC - PLAYERS' CAFE & DINING AREA



Erik Wismar, AIA


Ponce, LLC 307 W Maple RIDGE DR




PELICANS CAMPUS IMPROVEMENTS


WDG PROJECT NO |AR2315 **Construction Documents**



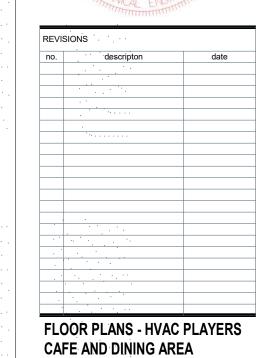

DRAWN BY |Author M1.04

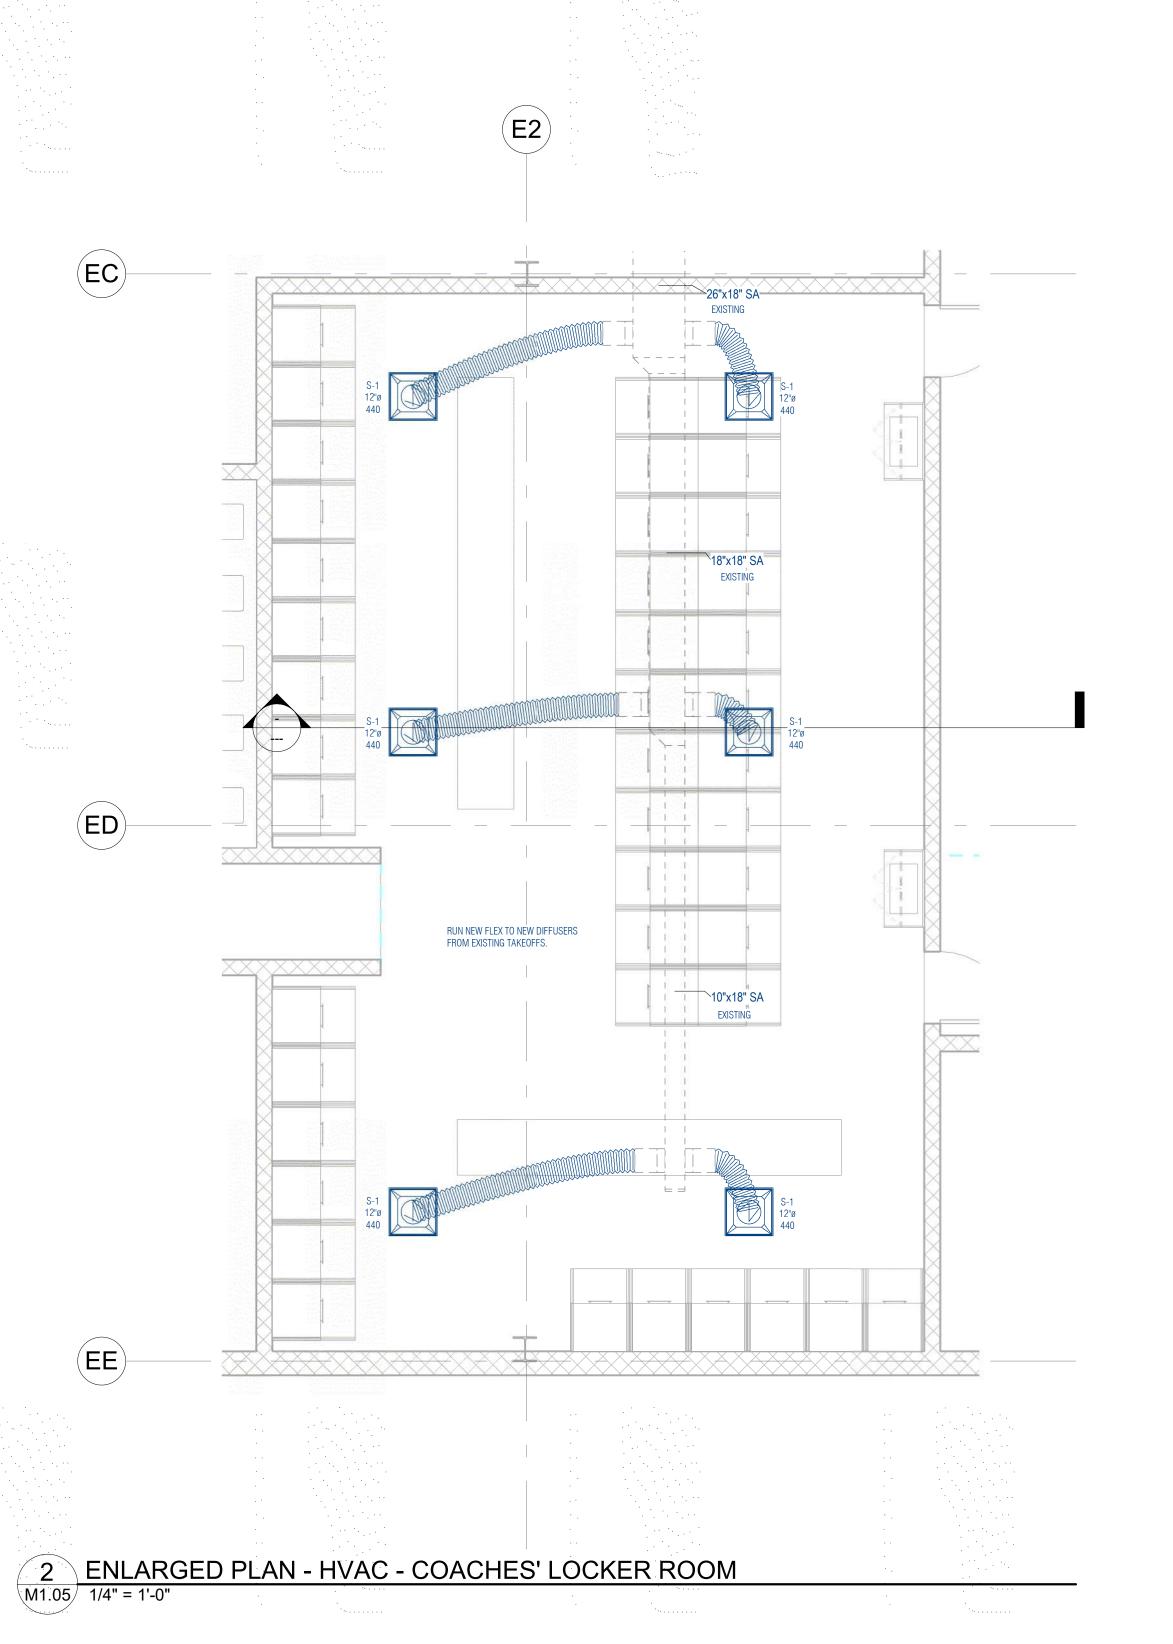

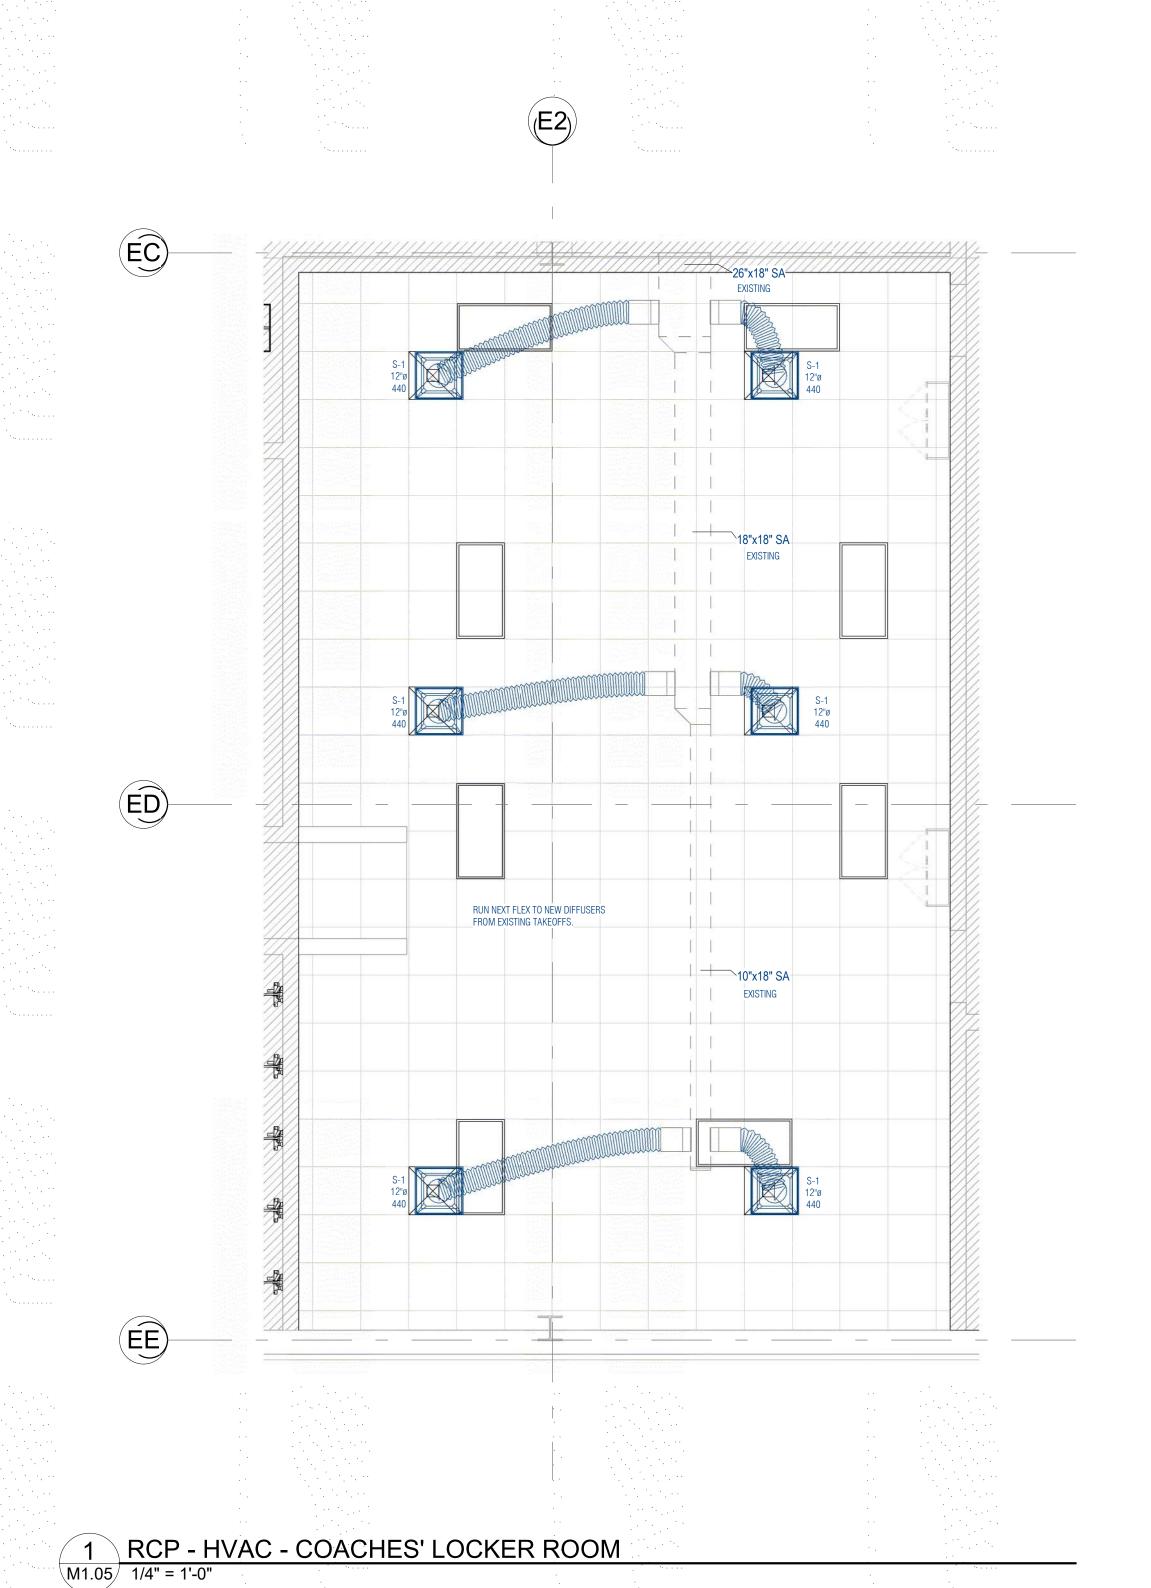

woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY
NEW ORLEANS, LA 70125
WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA

PONCE, LLC
307 W MAPLE RIDGE DR
METAIRIE, LA 70001



PELICANS CAMPUS IMPROVEMENTS
Metairie, Louisiana


WDG PROJECT NO |AR2315



no. descripton	date

LOCKER ROOM

DRAWN BY |Author M1.05

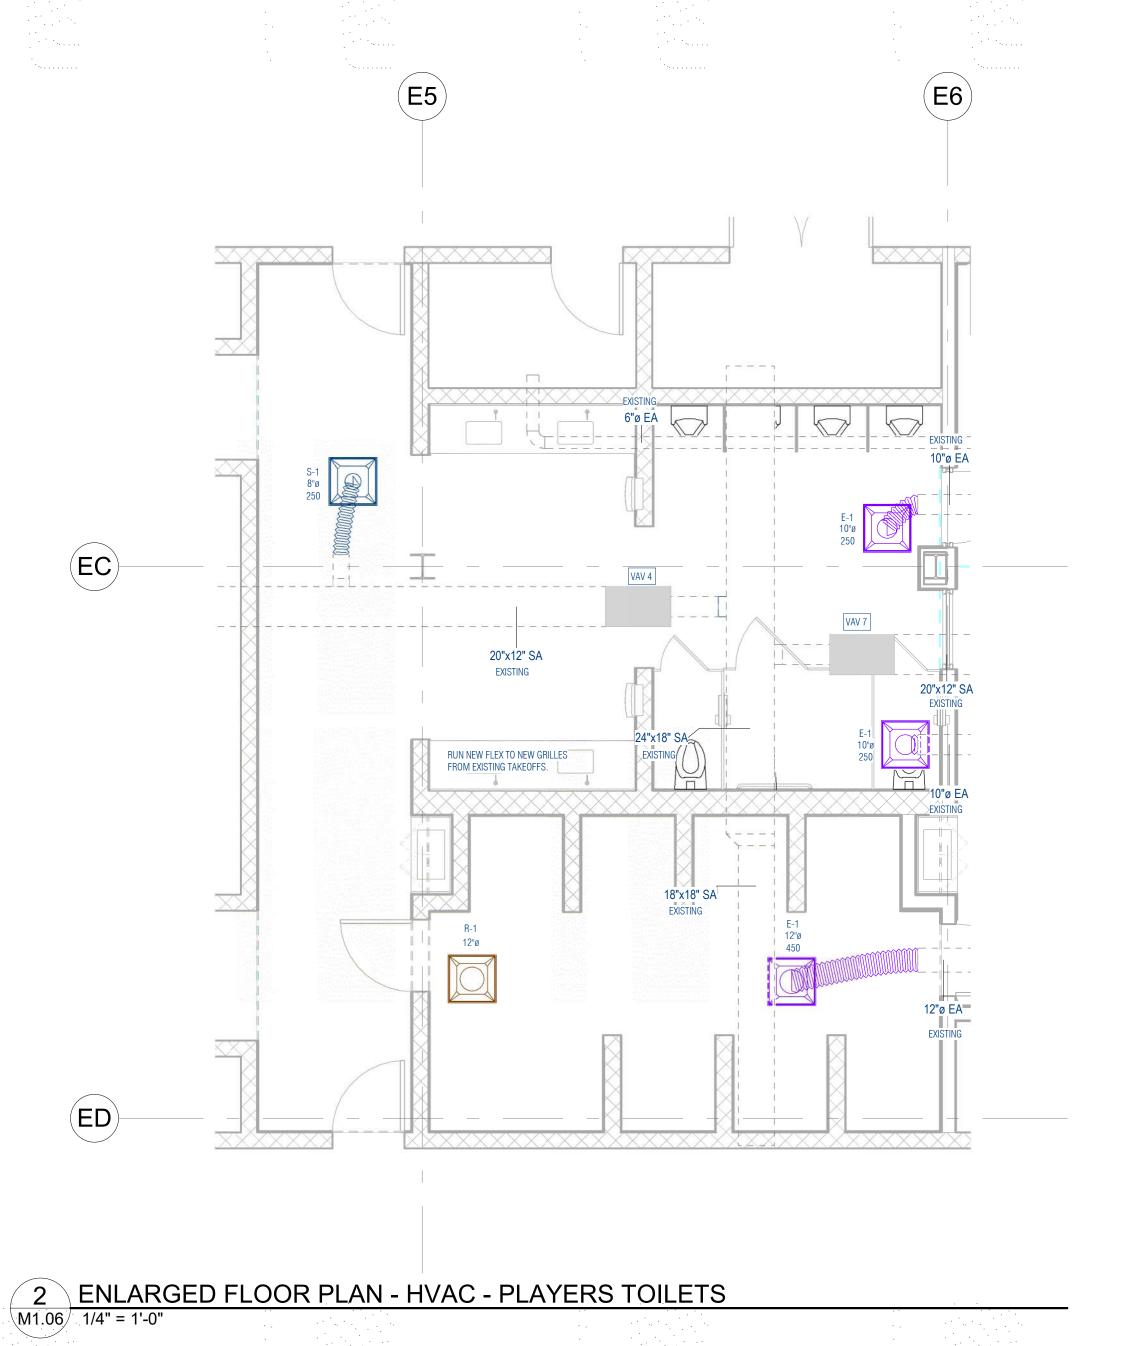



woodward design group


Erik Wismar, AIA

1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443


PoNCE, LLC 307 W MAPLE RIDGE DR METAIRIE, LA 70001


WDG PROJECT NO |AR2315 **Construction Documents**




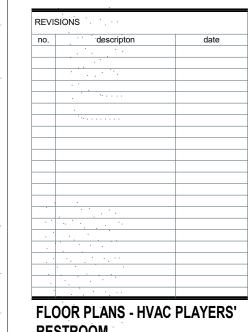

DRAWN BY |Author M1.06

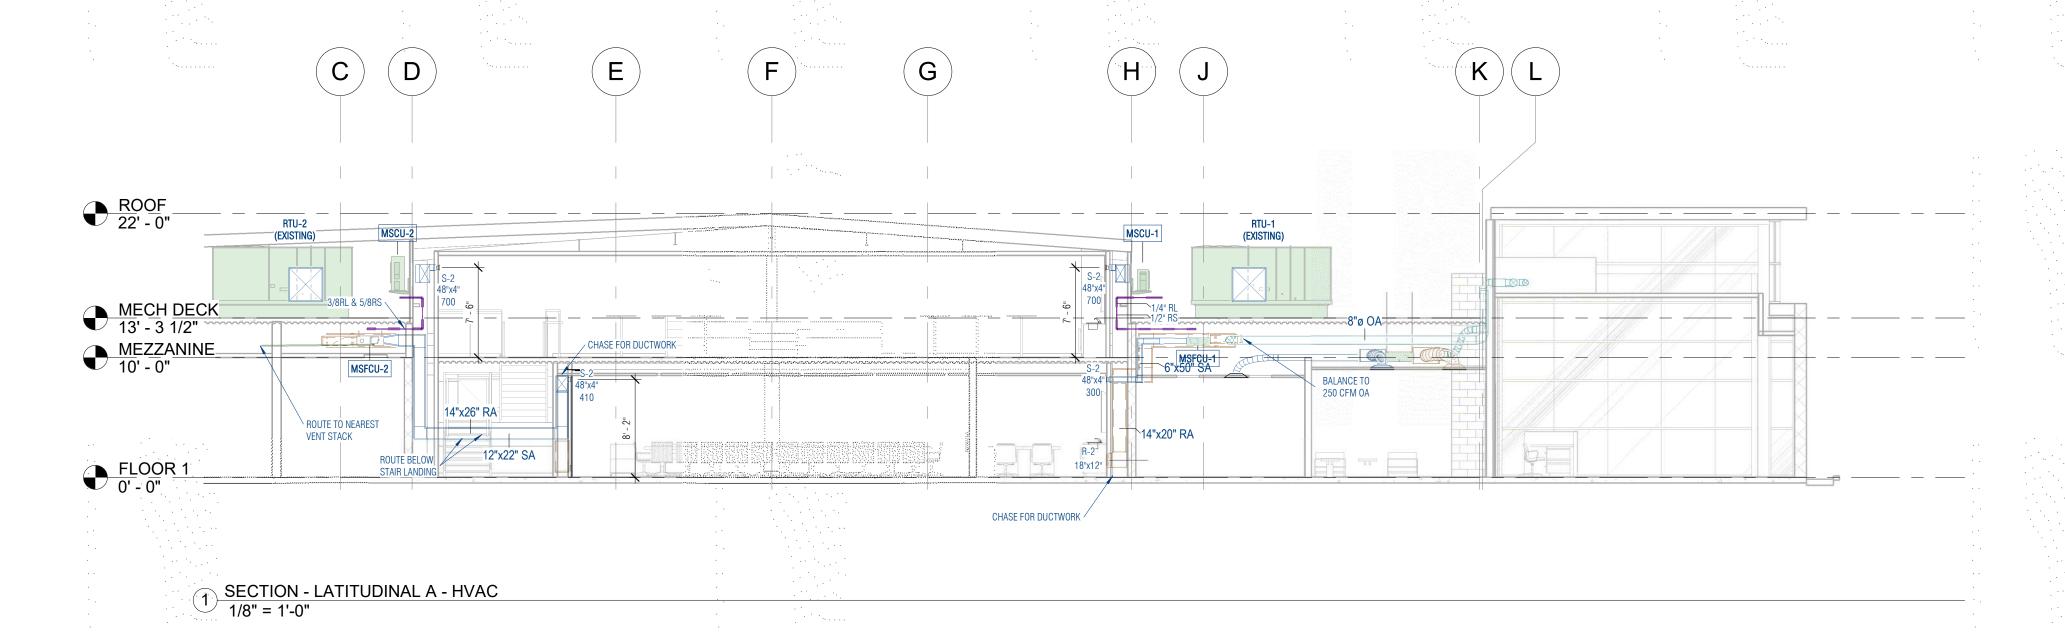

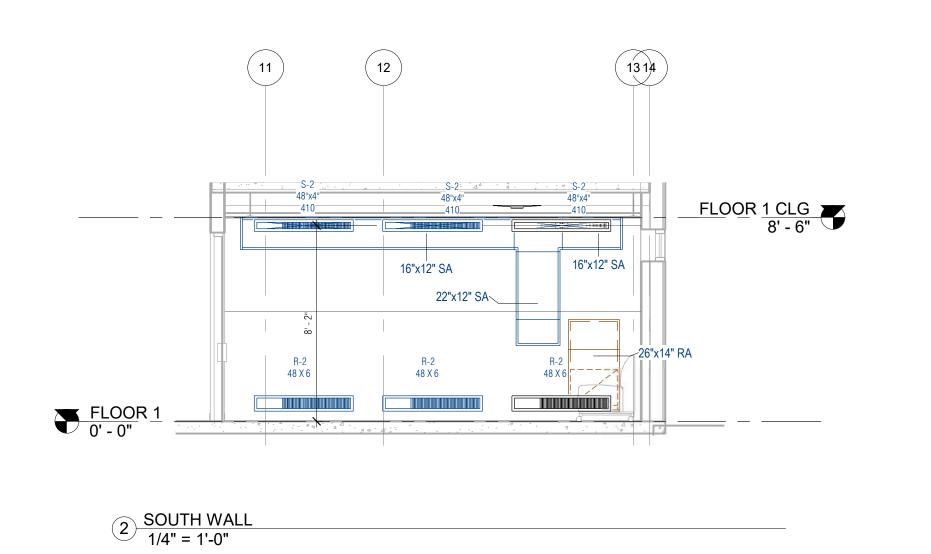

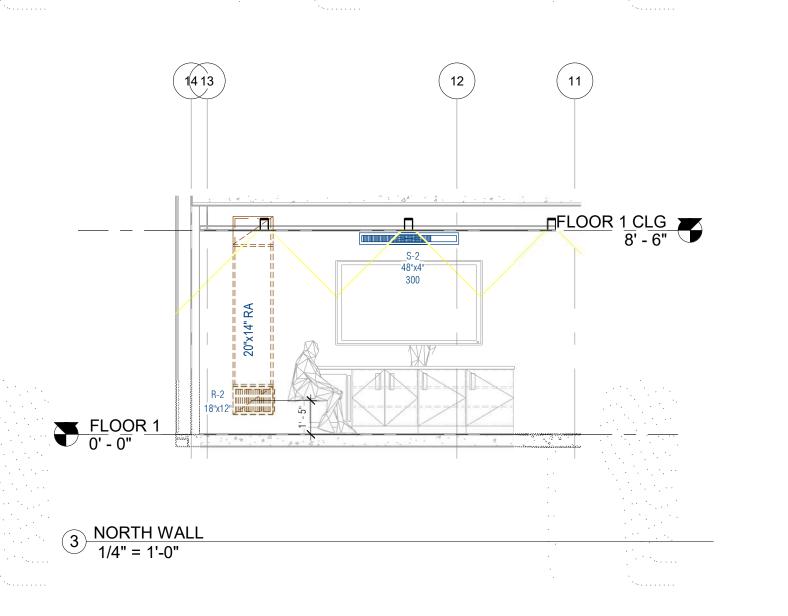

woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA

PoNCE, LLC . 307 W MAPLE RIDGE DR METAIRIE, LA 70001



PELICANS CAMPUS IMPROVEMENTS

WDG PROJECT NO |AR2315 **Construction Documents**



REVIS	SIONS	
no.	descripton	date
	· · · · ·	
	94444	

-	* *	
-	· · · · · · · · · · · · · · · · · · ·	
	 	

BUILDING SECTIONS -CONFERENCE ROOM AND VIEWING AREA

SECTION 22 00 00 PLUMBING WORK IN THIS SECTION INCLUDES COMPLETE DOMESTIC COLD WATER, DOMESTIC HOT WATER, SANITARY DRAINAGE SYSTEM, STORM DRAINAGE SYSTEM, AND NATURAL GAS SYSTEM INSTALLED IN ACCORDANCE WITH LOCAL CODES AND SPECIFIED HEREIN. EXTENT: WORK REQUIRED UNDER THIS SECTION CONSISTS OF ALL PLUMBING WORK AND RELATED ITEMS NECESSARY TO COMPLETE THE WORK INDICATED ON THE DRAWINGS AND/OR DESCRIBED IN THE SPECIFICATIONS. WORK INCLUDED: EXTENT OF WORK PERFORMED UNDER THIS SECTION SHALL INCLUDE, BUT IS NOT LIMITED TO THE FOLLOWING: FURNISH ALL LABOR, EQUIPMENT, TOOLS, TRANSPORTATION, ETC., AND FURNISH AND INSTALL ALL MATERIALS AND EQUIPMENT NECESSARY FOR PLUMBING WORK HEREINAFTER DESCRIBED, ALL IN ACCORDANCE WITH THE SPECIFICATIONS AND ACCOMPANYING DRAWINGS. SPECIFICATIONS AND ACCOMPANYING DRAWINGS ARE INTENDED TO SHOW AND DESCRIBE A COMPLETE THE JOB. FURNISH ALL LABOR, EQUIPMENT, TOOLS, MATERIALS, ACCESSORIES, ETC., FOR ALL ROUGH-INS AND FINAL CONNECTIONS, COMPLETE, FOR ALL EQUIPMENT FURNISHED AS SPECIFIED. C. RELATED WORK: WITHOUT RESTRICTING REQUIRED WORK, THE FOLLOWING ITEMS OF RELATED WORK ARE SPECIFIED AND INCLUDED IN OTHER SPECIFICATION SECTIONS. PAINT MECHANICAL EQUIPMENT, PIPE, DUCT, ETC. ALL ELECTRICAL POWER WIRING. FURNISH AND INSTALL BASE FLASHINGS AND PITCH POCKETS. FURNISH AND INSTALL POURED AND FORMED CONCRETE. FURNISH AND INSTALL STRUCTURAL STEEL. INSTALL ACCESS PANELS AND FRAMES. ALL SOUND CAULKING. THROUGH PENETRATION FIRESTOP SYSTEMS. SUBMIT THE FOLLOWING IN ACCORDANCE WITH REQUIREMENTS DESCRIBED IN DIVISION 1. PRODUCT DATA FOR ALL PURCHASED EQUIPMENT AND FIXTURES INDICATED ALL NEEDS FOR COMPLETE INSTALLATION. SHOP DRAWINGS FOR DRAINAGE, WATER, AND GAS PIPING. 0&M MANUALS FOR ALL MAJOR EQUIPMENT AND FIXTURES. ACCOMPANYING DRAWINGS, INCLUDING PLANS, DETAILS, DIAGRAMS, NOTES, ETC., ARE SHOWN TO LIMIT AND EXPLAIN STRUCTURAL CONDITIONS, CONSTRUCTION REQUIREMENTS, SIZES, CAPACITIES AND METHODS OF INSTALLATION AND ERECTION. STRUCTURAL AND OTHER CONDITIONS MAY REQUIRE CERTAIN MODIFICATIONS AND ADJUSTMENTS FROM CONDITIONS SHOWN. SUCH DEVIATIONS ARE PERMISSIBLE; HOWEVER, SPECIFIED SIZES, CAPACITIES AND REQUIREMENTS AFFECTING SATISFACTORY PERFORMANCE AND OPERATION OF INSTALLATION SHALL REMAIN UNCHANGED. MAKE ALLOWANCE FOR NORMAL JOB CONDITIONS AND INTERFERENCES. WHENEVER IT BECOMES NECESSARY TO SHIFT EQUIPMENT OR PIPES BEYOND REASONABLE TOLERANCES, SUCH CHANGES SHALL BE REFERRED TO ARCHITECT FOR APPROVAL. ASK FOR DETAILS WHENEVER UNCERTAIN ABOUT METHOD OF INSTALLATION. SECURE ALL PERMITS AND INSPECTIONS AND PAY ALL FEES, ASSESSMENTS AND TAXES NECESSARY FOR COMPLETION AND ACCEPTANCE OF WORK. NOTIFY ARCHITECT AND PROPER AUTHORITIES IN AMPLE TIME WHEN ANY WORK IS READY TO BE INSPECTED OR TESTED. NOTE: WATER METER, GAS METER AND SEWER CONNECTION FEES ARE BY OWNER. OBTAIN CERTIFICATES OF INSPECTION AND APPROVAL, AS APPLICABLE TO VARIOUS PORTIONS OF WORK, FROM INSPECTION AGENCY HAVING JURISDICTION. ALL WORK SHALL BE INSTALLED IN STRICT ACCORDANCE WITH ALL EXISTING LOCAL, PARISH AND LA STATE CODES AND ORDINANCES HAVING JURISDICTION, AND WITH RULES AND REGULATIONS OF NATIONAL FIRE PROTECTION ASSOCIATION(NFPA), INTERNATIONAL BUILDING CODE (IBC), INTERNATIONAL MECHANICAL CODE (IMC), INTERNATIONAL PLUMBING CODE (IPC), AND INTERNATIONAL FUEL GAS CODE (IFGC). IF ANY CONFLICTS ARE FOUND BETWEEN SPECIFICATIONS AND DRAWINGS AND ABOVE AUTHORITIES, NOTIFY ARCHITECT AS SOON AS CONFLICTS ARE DISCOVERED AND ABOVE CODES AND REQUIREMENTS WILL GOVERN. GUARANTEE ALL MECHANICAL INSTALLATIONS AGAINST ALL DEFECTS IN EQUIPMENT, MATERIALS AND WORKMANSHIP FOR A PERIOD OF ONE YEAR FROM DATE OF ACCEPTANCE OR FROM DATE OF BENEFICIAL USE BY OCCUPANCY OF OWNER. DURING GUARANTEE PERIOD, CORRECT ANY DEFECTS IN NEW EQUIPMENT, MATERIALS OR WORKMANSHIP, WITHOUT COST TO OWNER. FURNISH TO OWNER ALL WARRANTIES FOR INSTALLED PLUMBING EQUIPMENT PART 2 - PRODUCTS ALL WASTE & VENT PIPING ABOVE & BELOW GRADE TO BE SOLID WALL, SCHEDULE 40 PVC WITH SOLVENT WELD FITTINGS. CLEANOUTS SHALL BE INSTALLED IN EACH CHANGE OF DIRECTION OF SEWER LINES WHERE MORE THAN A 45 DEGREE ANGLE TURN IS MADE OR AS OUTLINED IN THE INTERNATIONAL PLUMBING CODE. SIZE AND DISTANCE BETWEEN CLEANOUTS SHALL BE REQUIRED BY LOCAL AUTHORITIES AND/OR AS INDICATED ON DRAWINGS. INSULATE ALL P-TRAPS ASSOCIATED WITH FLOOR DRAINS/HUB DRAINS LOCATED ABOVE GRADE RECEIVING CONDENSATE OR DISCHARGE FROM AN ICE MACHINE WITH ELASTOMERIC INSULATION. DOMESTIC WATER DOMESETIC WATER PIPING BELOW GRADE TO BE TYPE K TUBING INSTALLED WITHOUT JOINTS. SLEEVE ALL UNDERGROUND PIPING. DOMESTIC WATER PIPING ABOVE GRADE TO BE EITHER FUSED POLYPROPYLENE, OR TYPE "A" PEX WITH EXPANSION FITTINGS. TYPE L, HARD DRAWN SEAMLESS COPPER TUBING TO BE USED AT CONTRACTOR'S OPTION. ALL HEATING WATER RECIRCULATING MAINS THAT OPERATE AT TEMPERATURES ABOVE 140 DEGREES TO BE FUSED POLYPROPYLENE. PROVIDE AN INSULATING FITTING DIELECTRIC UNION AT ALL CONNECTIONS BETWEEN DISSIMILAR METALS. BALL VALVES SHALL BE PROVIDED WHERE INDICATED ON DRAWINGS AND SHALL BE DESIGNED FOR A MINIMUM WATER WORKING PRESSURE OF NOT LESS THAN ONE HUNDRED FIFTY (150) POUNDS PER SQUARE INCH. ALL PIPING FITTINGS SOLDER AND FLUX USED IN CONJUNCTION WITH THE POTABLE WATER SYSTEMS SHALL BE LEAD FREE DOMESTIC HOT-WATER RECIRCULATING MAINS SHALL BE INSULTED WITH 1" FIBERGLASS WITH ASJ. ALL DOMESTIC COLD-WATER MAINS SHALL BE INSULATED WITH ½" FIBERGLASS WITH ASJ. BRANCH PIPING TO FIXTURES SHALL NOT BE INSULATED. 2.8 VALVES, STRAINERS, UNIONS AND FITTINGS THIS CONTRACTOR SHALL FURNISH AND INSTALL ALL VALVES REQUIRED UNDER THESE SPECIFICATIONS. ALL VALVES SHALL BE INSTALLED SO AS TO BE EASILY ACCESSIBLE FOR CLEANING, INSPECTION AND MAINTENANCE. VALVE ALL FIXTURE GROUPS AND IN ADDITION EACH INDIVIDUAL BRANCH LINE TO EVERY PIECE OF EQUIPMENT AND TO EVERY PLUMBING FIXTURE SHALL BE PROVIDED WITH ISOLATION VALVES ON ALL SERVICES, INCLUDING COLD WATER, GAS, ETC. STOPS BELOW FIXTURES SHALL MEET INDIVIDUAL VALVE REQUIREMENTS. ALL VALVES SHALL BE LOCATED IN THE MOST ACCESSIBLE LOCATIONS. MOTORS 2.9 MOTORS SHALL BE AS DESCRIBED HEREIN UNLESS OTHERWISE SPECIFIED. MOTORS SHALL BE CONSTANT SPEED, NORMAL OR HIGH STARTING CURRENT) AS REQUIRED FOR THE APPLICATION, WITH ELECTRICAL CHARACTERISTICS INDICATED ON NAMEPLATE CONFORMING WITH ELECTRICAL SUPPLY AT THE MOTOR LOCATIONS AS INDICATED ON THE ELECTRICAL DRAWINGS. THREE PHASE MOTORS SHALL BE SQUIRREL CAGE INDUCTION TYPE. SINGLE PHASE MOTORS SHALL BE SPLIT PHASE OR CAPACITOR START TYPE. IF SPECIFICALLY NOTED UNDER ANY PARTICULAR ITEM OF EQUIPMENT, PERMANENTLY SPLIT CAPACITOR TYPE MOTORS ARE REQUIRED. ALL MOTORS SHALL HAVE EITHER SLEEVE OR PRE-LUBRICATED BALL BEARINGS AS REQUIRED FOR THE PARTICULAR APPLICATION. MOTORS SHALL BE GUARANTEED TO OPERATE CONTINUOUSLY AT FULL LOAD WITH 10% VOLTAGE VARIATION ABOVE OR BELOW THE PARTICULAR VOLTAGE SPECIFIED. WITH A TEMPERATURE RISE NOT TO EXCEED 40 DEGREES C. ENCLOSURES SHALL BE DRIP-PROOF TYPE, EXCEPT FOR MOTORS IN OUTDOOR LOCATIONS OR SUBJECT TO EXCESSIVE MOISTURE, WHICH SHALL BE TOTALLY ENCLOSED OR TOTALLY ENCLOSED FAN COOLED. BELT DRIVE MOTORS SHALL HAVE BASES WITH SLIDE RAIL.

THE GENERAL CONTRACTOR, UNLESS OTHERWISE SPECIFIED, SHALL PROVIDE ALL FOUNDATIONS, SUPPORTS, ETC. NECESSARY FOR PROPERLY SUPPORTING THE PLUMBING CONTRACTOR SHALL FURNISH AND INSTALL ALL ISOLATION MATERIALS TO PREVENT TRANSMISSION OF VIBRATION TO THE BUILDING STRUCTURE.

PANELS KARP TYPE KDW, OR EQUAL, WITH CONTINUOUS PIANO HINGES, KEY LOCK, PRIME COAT STEEL. EXACT SIZE AND LOCATION SUBJECT TO ARCHITECT'S APPROVAL.

MECHANICAL CONTRACTOR SHALL FURNISH ACCESS PANELS FOR INSTALLATION BY OTHERS FOR PROPER ACCESS TO DAMPERS, VALVES, CLEANOUTS, FIXTURE CONNECTIONS, MOTORS, DRIVES OR OTHER ITEMS INSTALLED UNDER THIS CONTRACT, EXCEPT WHERE SUCH PANELS ARE SHOWN AND/OR SPECIFICATIONS OF SPECIFICATIONS.

ACCESS PANELS

ACCESS PANELS IN DUCTWORK SHALL BE GASKETED WITH CAM LOCK.

BE RESPONSIBLE FOR THE LAYOUT OF ALL CUTTING, FITTINGS, ETC., AFFECTING PLUMBING WORK AND COORDINATE WITH TRADES OR OTHER SECTIONS INVOLVED. ALL CUTTING FOR PLUMBING WORK BY GENERAL CONTRACTOR. INSURE THAT ALL NECESSARY CHASES, OPENINGS FOR PIPES, DUCTS, ETC., ARE PROVIDED TO PROPER TIME AS WORK OF OTHER SECTIONS PROGRESSES. ALL PATCHING FOR PLUMBING WORK BY GENERAL CONTRACTOR. PROVIDE FIRESTOP SYSTEMS AT ALL PLUMBING PENETRATIONS THROUGH FIRE-RATED ASSEMBLIES. FLOOR AND CEILING PLATES FURNISH AND INSTALL PROPERLY SIZED CHROME PLATED BRASS ESCUTCHEON PLATES TO CONCEAL OPENINGS WHERE PIPING OR HANGERS PASS EXPOSED THROUGH FLOORS, CEILING OR WALLS. BUCKS, GROUNDS, CHASES, LINTELS, BLOCKOUTS AND GROUTING PROVIDE BY GENERAL CONTRACTOR. MECHANICAL CONTRACTOR IS RESPONSIBLE FOR PROPERLY INFORMING CONTRACTOR OF PROPER LOCATIONS AND SIZES AND FOR ANY ERRORS OR OMISSIONS IN PLACING SAME. 3.6 FLASHING AND COUNTERFLASHING INSTALL ALL ITEMS OF PLUMBING WORK SUCH AS PIPES, DUCTS, ETC., PENETRATING ROOF A SUFFICIENT DISTANCE FROM WALLS, EAVES, ETC., TO PERMIT PROPER APPLICATION OF FLASHINGS AND COUNTERFLASHINGS. ALL FLASHING, COUNTER FLASHING, & MEMBRANE WATERPROOFING TO BE PROVIDED BY GENERAL CONTRACTOR. COORDINATION OF DETAILS FOR PROPER WATERPROOFING OF PENETRATIONS TO BE PROVIDED BY APPROPRIATE SUBCONTRACTOR. 3.7 PAINTING A. NO PAINTING SHALL BE DONE UNDER THIS DIVISION OF SPECIFICATIONS. ALL EXPOSED EQUIPMENT, PIPES, GRILLES, LOUVERS, FAN HOUSING, ETC., SHALL BE PAINTED UNDER OTHER DIVISIONS OF SPECIFICATIONS. B. PROTECT ALL FACTORY FINISHES. WHERE DAMAGED, FINISH TO BE RENEWED WITH TOUCH UP PAINT. 3.8 HANGERS AND SUPPORT WORK HANG ALL PIPING WITH SUPPORT SPACING AS OUTLINED IN THE INTERNATIONAL PLUMBING CODE, LOCAL JURISDICTION, OR AS RECOMMENDED BY MANUFACTURER. SUPPORT VERTICAL RUNS OF PIPING WITH FLAT STEEL BAR CLAMP HANGERS AT EACH FLOOR, OR AS DETAILED ON DRAWINGS. HANGERS IN BUILDING: SOLID OR CLEVIS SUPPORTED BY VERTICAL STEEL RODS FROM MASONRY INSERTS, EXPANSION SHIELDS OR BEAM CLAMPS. WHERE TWO OR MORE PIPING RUNS ARE PARALLEL, AND GRADE TO THE SAME POINT, TRAPEZE-TYPE STRUCTURAL STEEL HANGERS MAY BE USED. BRASS, COPPER OR LEAD INSERT HANGERS FOR INSULATED COPPER PIPING. PIPING HANGERS BELOW GRADE SHALL BE 1/4 INCH ROUND STAINLESS STEEL. PVC SANITARY SEWER AND VENT PIPING HUNG AT 4' MAX. INTERVALS. SUPPORT ALL PIPING INDEPENDENTLY OF ALL EQUIPMENT AND ARRANGE HANGERS TO ISOLATE ANY VIBRATION TRANSMISSION FROM PIPING TO STRUCTURE. FURNISH AND INSTALL STEEL SUPPORTS AND FRAMEWORK FOR EACH ITEM OF EQUIPMENT OR FIXTURE IN MEET ALL APPLICABLE REQUIREMENTS SPECIFIED UNDER STRUCTURAL STEEL. ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS OR AS DETAILED ON DRAWINGS. ALL SUCH WORK SHALL MEET ALL APPLICABLE REQUIREMENTS SPECIFIED UNDER STRUCTURAL STEEL. INSTALL ALL PIPING SO THAT IT MAY EXPAND AND CONTRACT FREELY WITHOUT DAMAGE TO EQUIPMENT, OTHER WORK OR INJURY TO PIPING SYSTEM. SUPPORT PIPING INDEPENDENTLY OF ALL EQUIPMENT. INSTALL NECESSARY SWING JOINTS, EXPANSION JOINTS OR OFFSETS TO PROTECT PIPING SYSTEMS, EQUIPMENT OR OTHER WORK FROM DAMAGE WHETHER INDICATED ON DRAWINGS OR NOT. INSTALL UNIONS ADJACENT TO ALL SCREWED COCKS, CONTROL VALVES, DISCHARGE FROM RELIEF VALVES. FLANGED FITTINGS ARE CONSIDERED EQUIVALENT TO UNION CONNECTIONS. INSTALL PIPING PARALLEL AND/OR PERPENDICULAR TO BUILDING FLOOR, WALL OR CEILING PLANES, UNLESS OTHERWISE SHOWN ON DRAWINGS. INSTALL ALL PIPING CONCEALED UNLESS SPECIFICALLY NOTED OTHERWISE, MAKING ALL NECESSARY OFFSETS, TURNS, ETC., NECESSARY TO CONCEAL PIPING FROM VIEW. NO PIPING OF DISSIMILAR METALS SHALL BE PLACED IN CONTACT WITH EACH OTHER. PROVIDE INSULATING UNIONS WHENEVER PIPING OF DISSIMILAR METALS IS JOINED. 3.10 ELECTRICAL WORK SEE SCHEDULES AND ELECTRICAL PLANS FOR MOTOR VOLTAGES. ALL MOTORS FOR MECHANICAL EQUIPMENT FURNISHED UNDER MECHANICAL SECTIONS. WORK SHALL INCLUDE SETTING AND ALIGNING INTEGRAL DRIVE MOTORS IN OPERATING POSITION. MOTORS ELECTRICALLY CONNECTED UNDER DIVISION 26, ELECTRICAL. ALL POWER WIRING AND ALL DISCONNECT SWITCHES FURNISHED AND INSTALLED UNDER DIVISION 26, ELECTRICAL. ALL LOW VOLTAGE ELECTRICAL CONTROL WORK IN CONNECTION WITH AIR CONDITIONING, HEATING AND VENTILATING EQUIPMENT DONE BY HVAC SUBCONTRACTOR, INCLUDING ALL 24 VOLT CONTROL WIRING. AFTER FINAL TESTING, REMOVE ALL DEBRIS, SURPLUS AND WASTE MATERIALS COMPLETELY FROM THE JOB SITE.

PROPERLY OIL, GREASE AND LUBRICATE ALL MOTORS, PUMPS, COMPRESSORS, ETC., BEFORE STARTING AND UNTIL FINAL ACCEPTANCE OF WORK. CONTRACTOR WILL NOT BE RESPONSIBLE FOR THIS TYPE OF MAINTENANCE DURING WARRANTY PERIOD. IT IS THE OWNER'S RESPONSIBILITY AFTER ACCEPTANCE OF WORK TO PROVIDE

PROPER MAINTENANCE WORK AS INDICATED IN MAINTENANCE INSTRUCTIONS SUBMITTED TO OWNER AT ACCEPTANCE OF PROJECT.

PART 3 - EXECUTION .

END OF SECTION 22 00 00

PELICANS CAMPUS IMPROVEMENTS

woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY WOODWARDDESIGNBUILD.COM | 504-822-6443

> 307 W MAPLE RIDGE DR METAIRIE, LA 70001


Erik Wismar, AIA

WDG PROJECT NO IAR2315

Construction Documents

descripton

DRAWN BY | Author

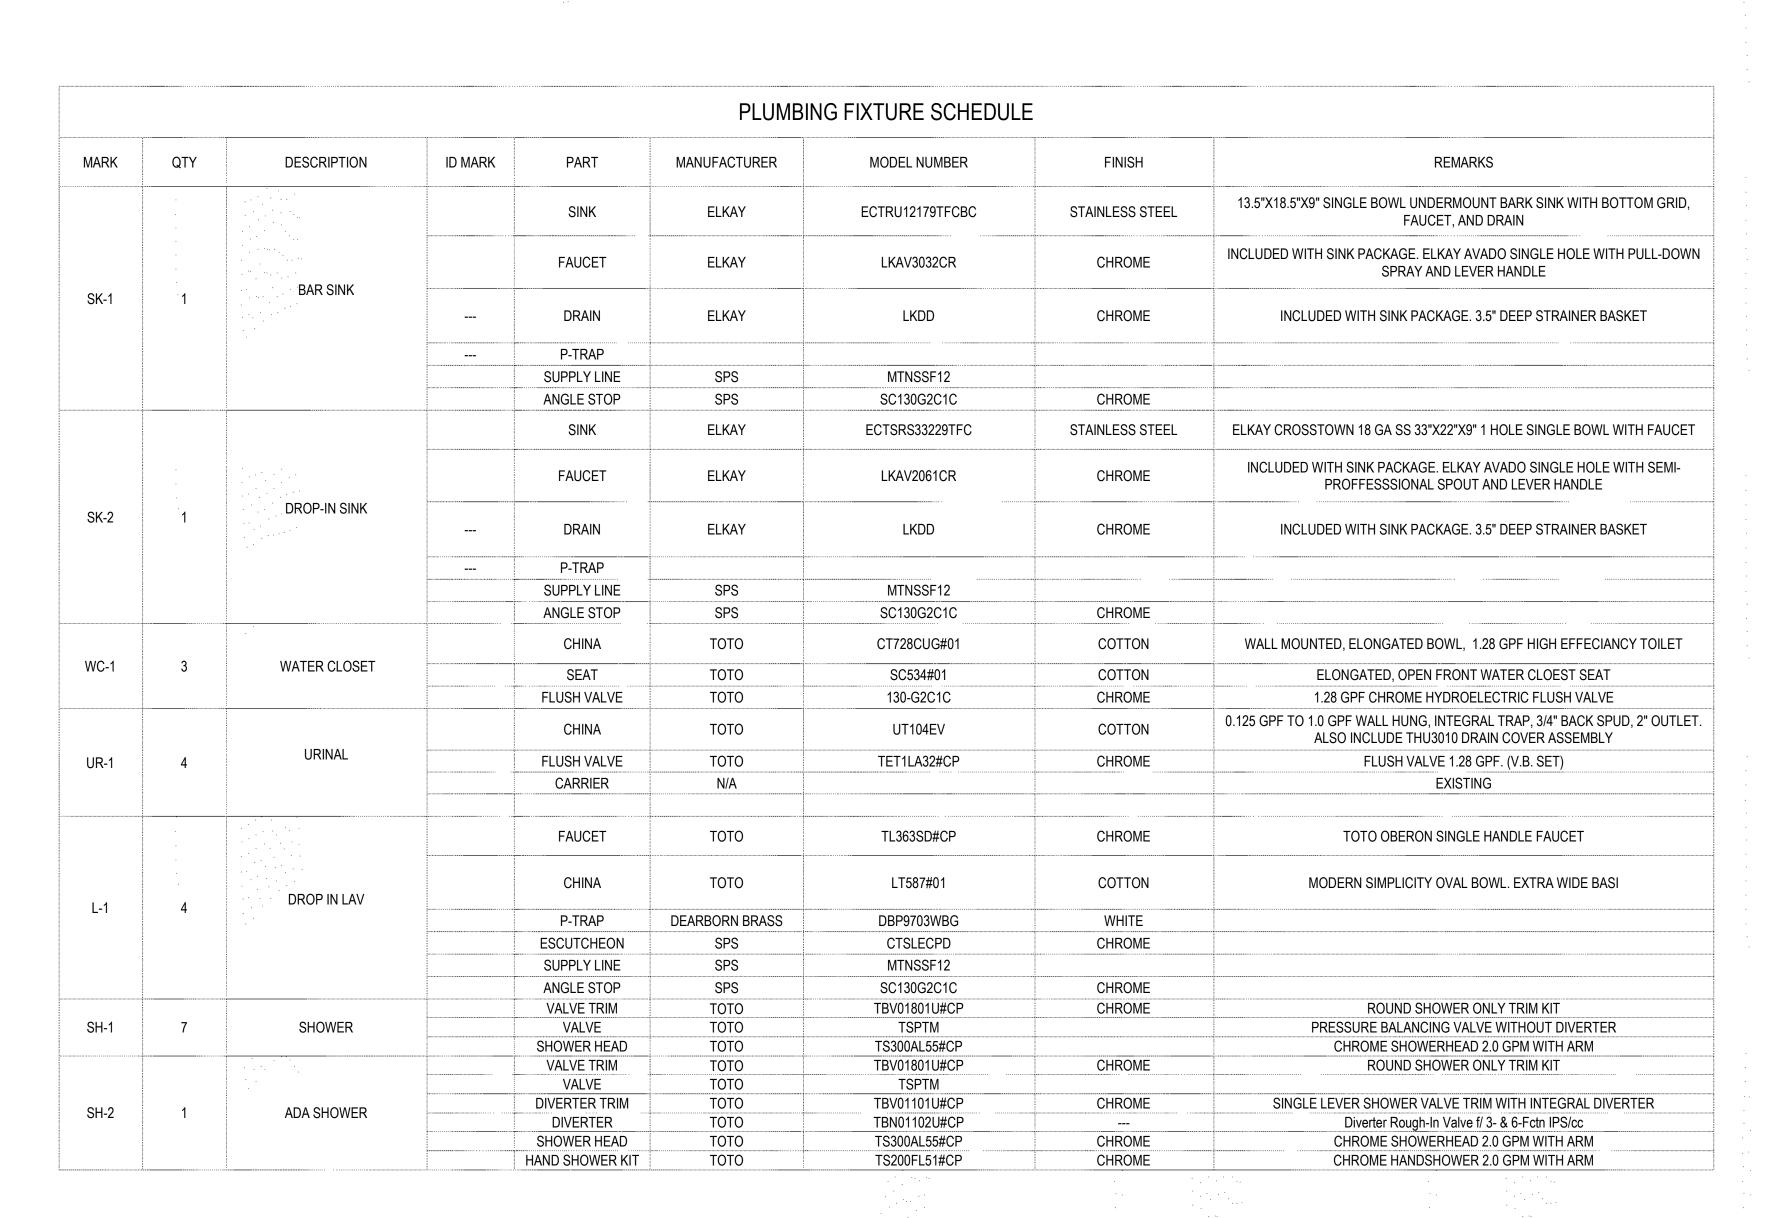

				22112	3 - RECII	RCULATIO	ON PUM	P SCHE	DULE		
		WEIGHT					MOTOR	DATA			
MARK	QTY	LBS.	TYPE	GPM	FT. HEAD	VOLTS/PH	RPM	HP	VFD	BASIS OF DESIGN	REMARKS
RP-1	1		RECIRCULATION PUMP	4	8	120/1	3250	1/8	NO	TACO 007	
NOTES:							Anna Anna			A STATE OF THE STA	· .

1. PROVIDE WITH AQUSTAT & TIME OF DAY SCHEDULE CONTROLLER

				WATER	RHEATER	SCHEDUL	E			
				OTODAOE	OAO INDUT	OUTDUT	ELECTR	ICAL		
MARK	QTY	LOCATION	FUEL	STORAGE (GAL.)	GAS INPUT (MBH)	OUTPUT (MBH)	VOLTS/PH	KW	BASIS OF DESIGN	REMARKS
WH-A	1	MECH PLATFORM	ELECTRIC	55			208	6	PROLINE MASTER 55 GALTALL	

221319 - SANITARY WASTE PIPING SPECIALITIES SCHEDULE QTY DESCRIPTION MANUFACTURER & MODEL REMARKS ENAMEL COATED CAST IRON, ADJUSTABLE HEIGHT FLOOR DRAIN WITH PUSH-ON FD-1 JR SMITH 2005 2" FLOOR DRAIN DRAIN CONNECTION, TRAP PRIMER CONNECTION, FLASHING RING & 6" ROUND NICKEL BRONZE STRAINER. 3-3" 1-2" FS-1 FLOOR SINK JR SMITH 305 PVC FLOOR SINK WITH DOME BOTTOM STRAINER. FCO-1 FLOOR CLEAN OUT JR SMITH 4031 ADJUSTABLE FLOOR CLEAN OUT WITH 5" BRASS TOP WCO WALL CLEAN OUT JR SMITH 4020 TAPER THREAD CLEAN OUT PLUG WITH ROUND COVER. TS TRAP SEAL RECTORSEAL SURESEAL TRAP SEAL INSET INTO FLOOR DRAIN TO REPLACE NEED FOR TRAP PRIMER VALVE TD-1 TRENCH DRAIN WATTS PP-AB-N24 (P24-CO-PP-FS) WATTS DEAD LEVEL TRENCH DRAIN

woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY
NEW ORLEANS, LA 70125
WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA





PELICANS CAMPUS IMPROVEMENTS
Metairie, Louisiana


WDG PROJECT NO |AR2315


Construction Documents 0





no i ide	scripton	date
no. de	scriptori	uale
	· .	
79		
		+
	٠.	
	. 1	
	-	
	. * *	
	··	
		-

PLUMBING SCHEDULES

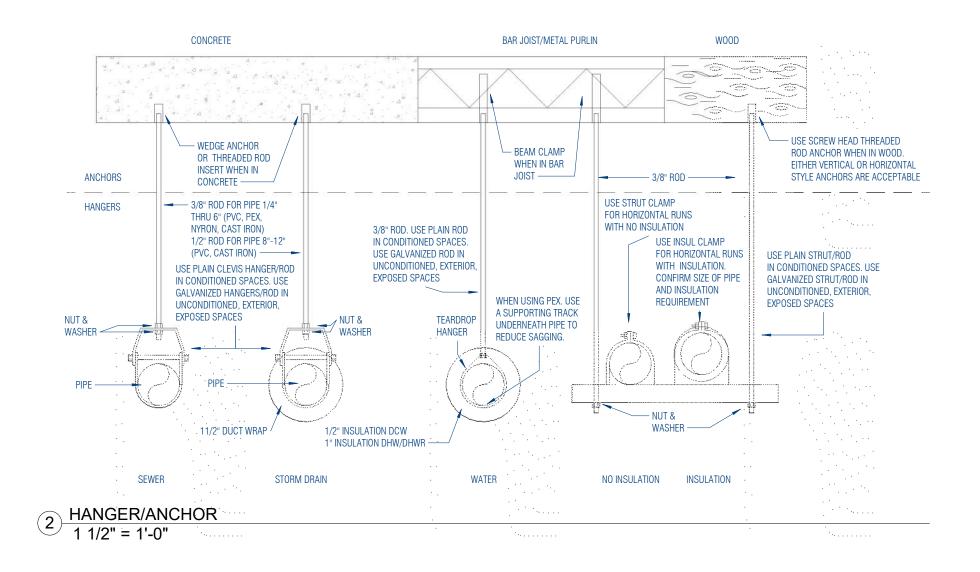

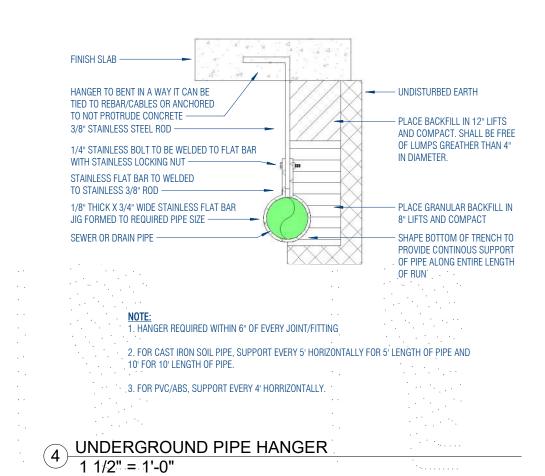

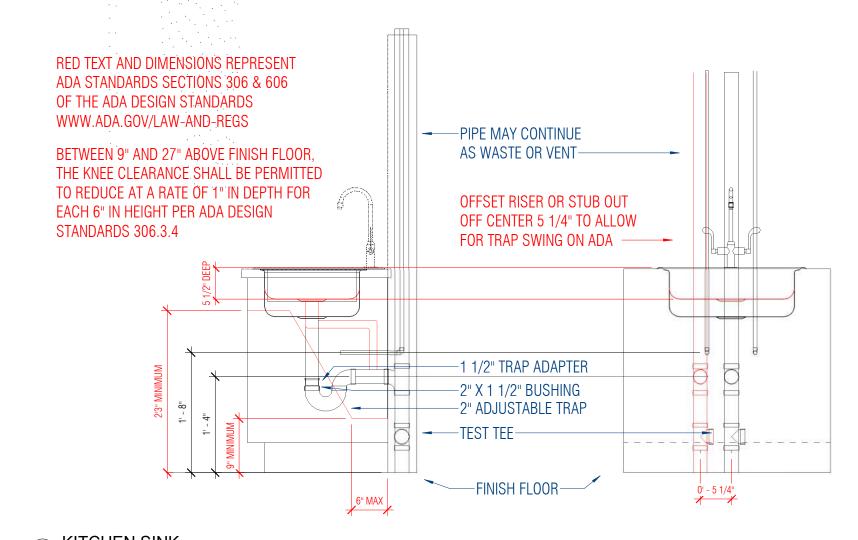

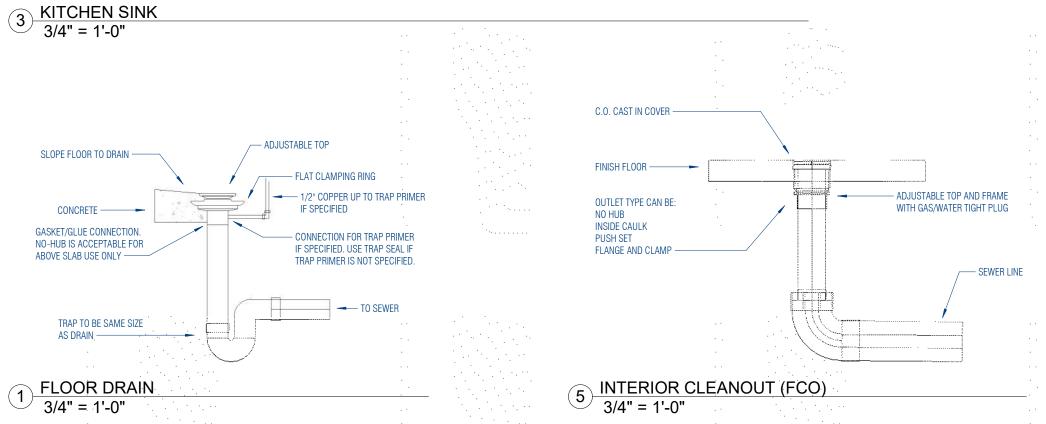

PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana


woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY WOODWARDDESIGNBUILD.COM | 504-822-6443

> PoNCE, LLC . 307 W MAPLE RIDGE DR METAIRIE, LA 70001

Erik Wismar, AIA


WDG PROJECT NO |AR2315





PLUMBING DETAILS

P0.02 DRAWN BY | Author

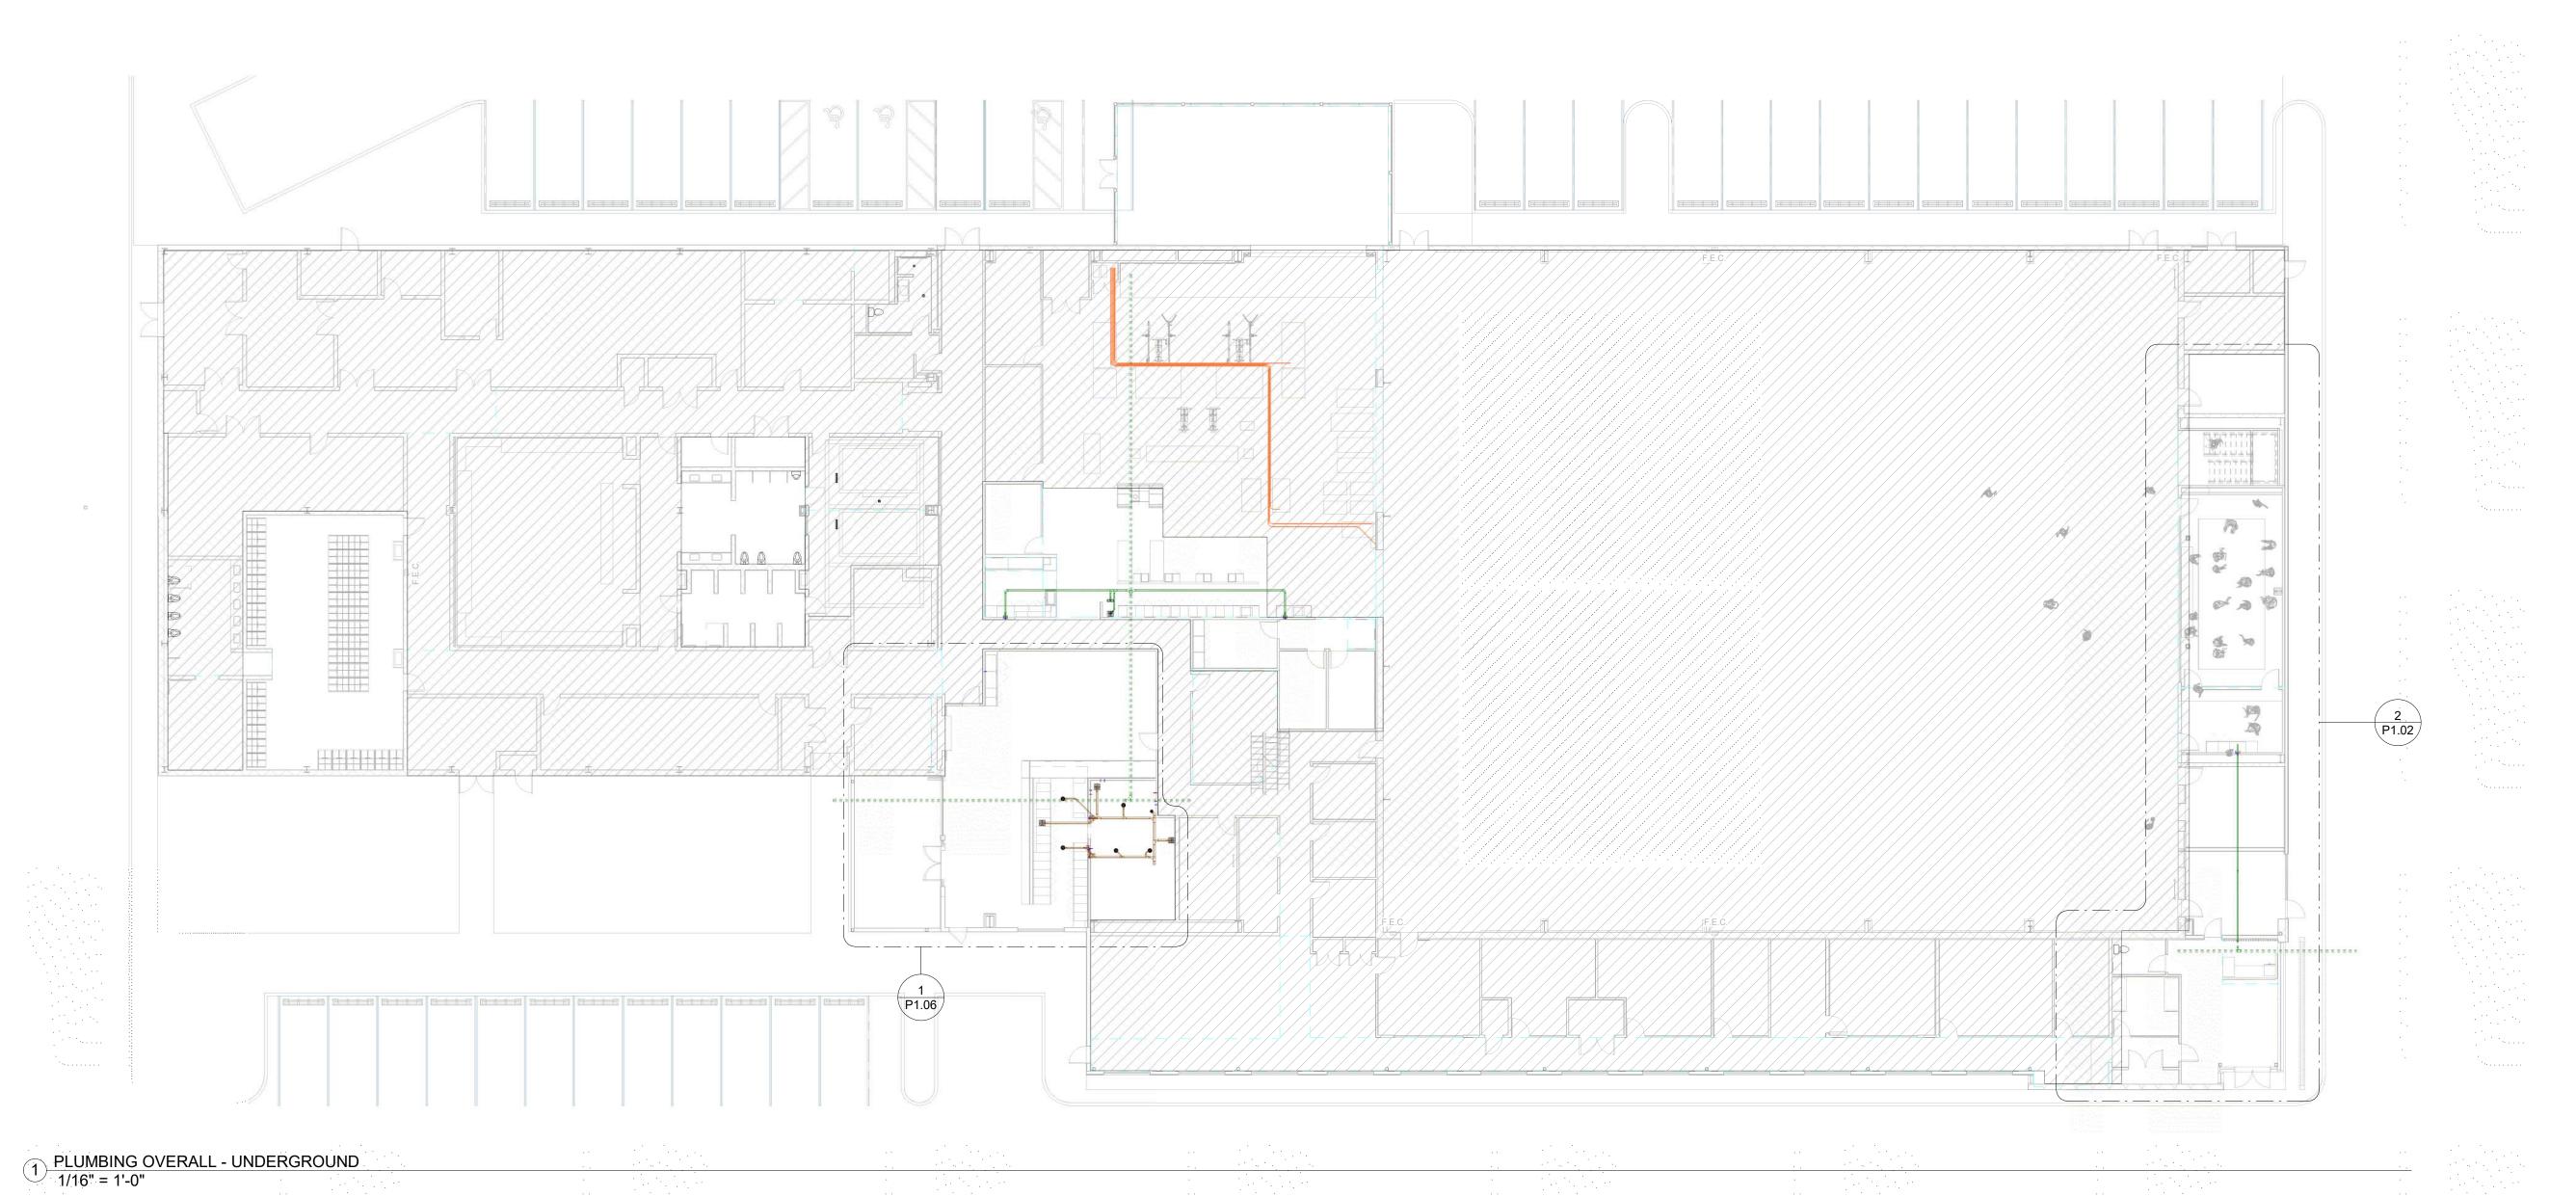

The second design group

woodward design group
1000 S. NORMAN C. FRANCIS PARKWAY
NEW ORLEANS, LA 70125
WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA

PONCE, LLC
307 W MAPLE RIDGE DR
METAIRIE, LA 70001



PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana


WDG PROJECT NO |AR2315

Construction Documents



no. descripton	date
78	

PLUMBING

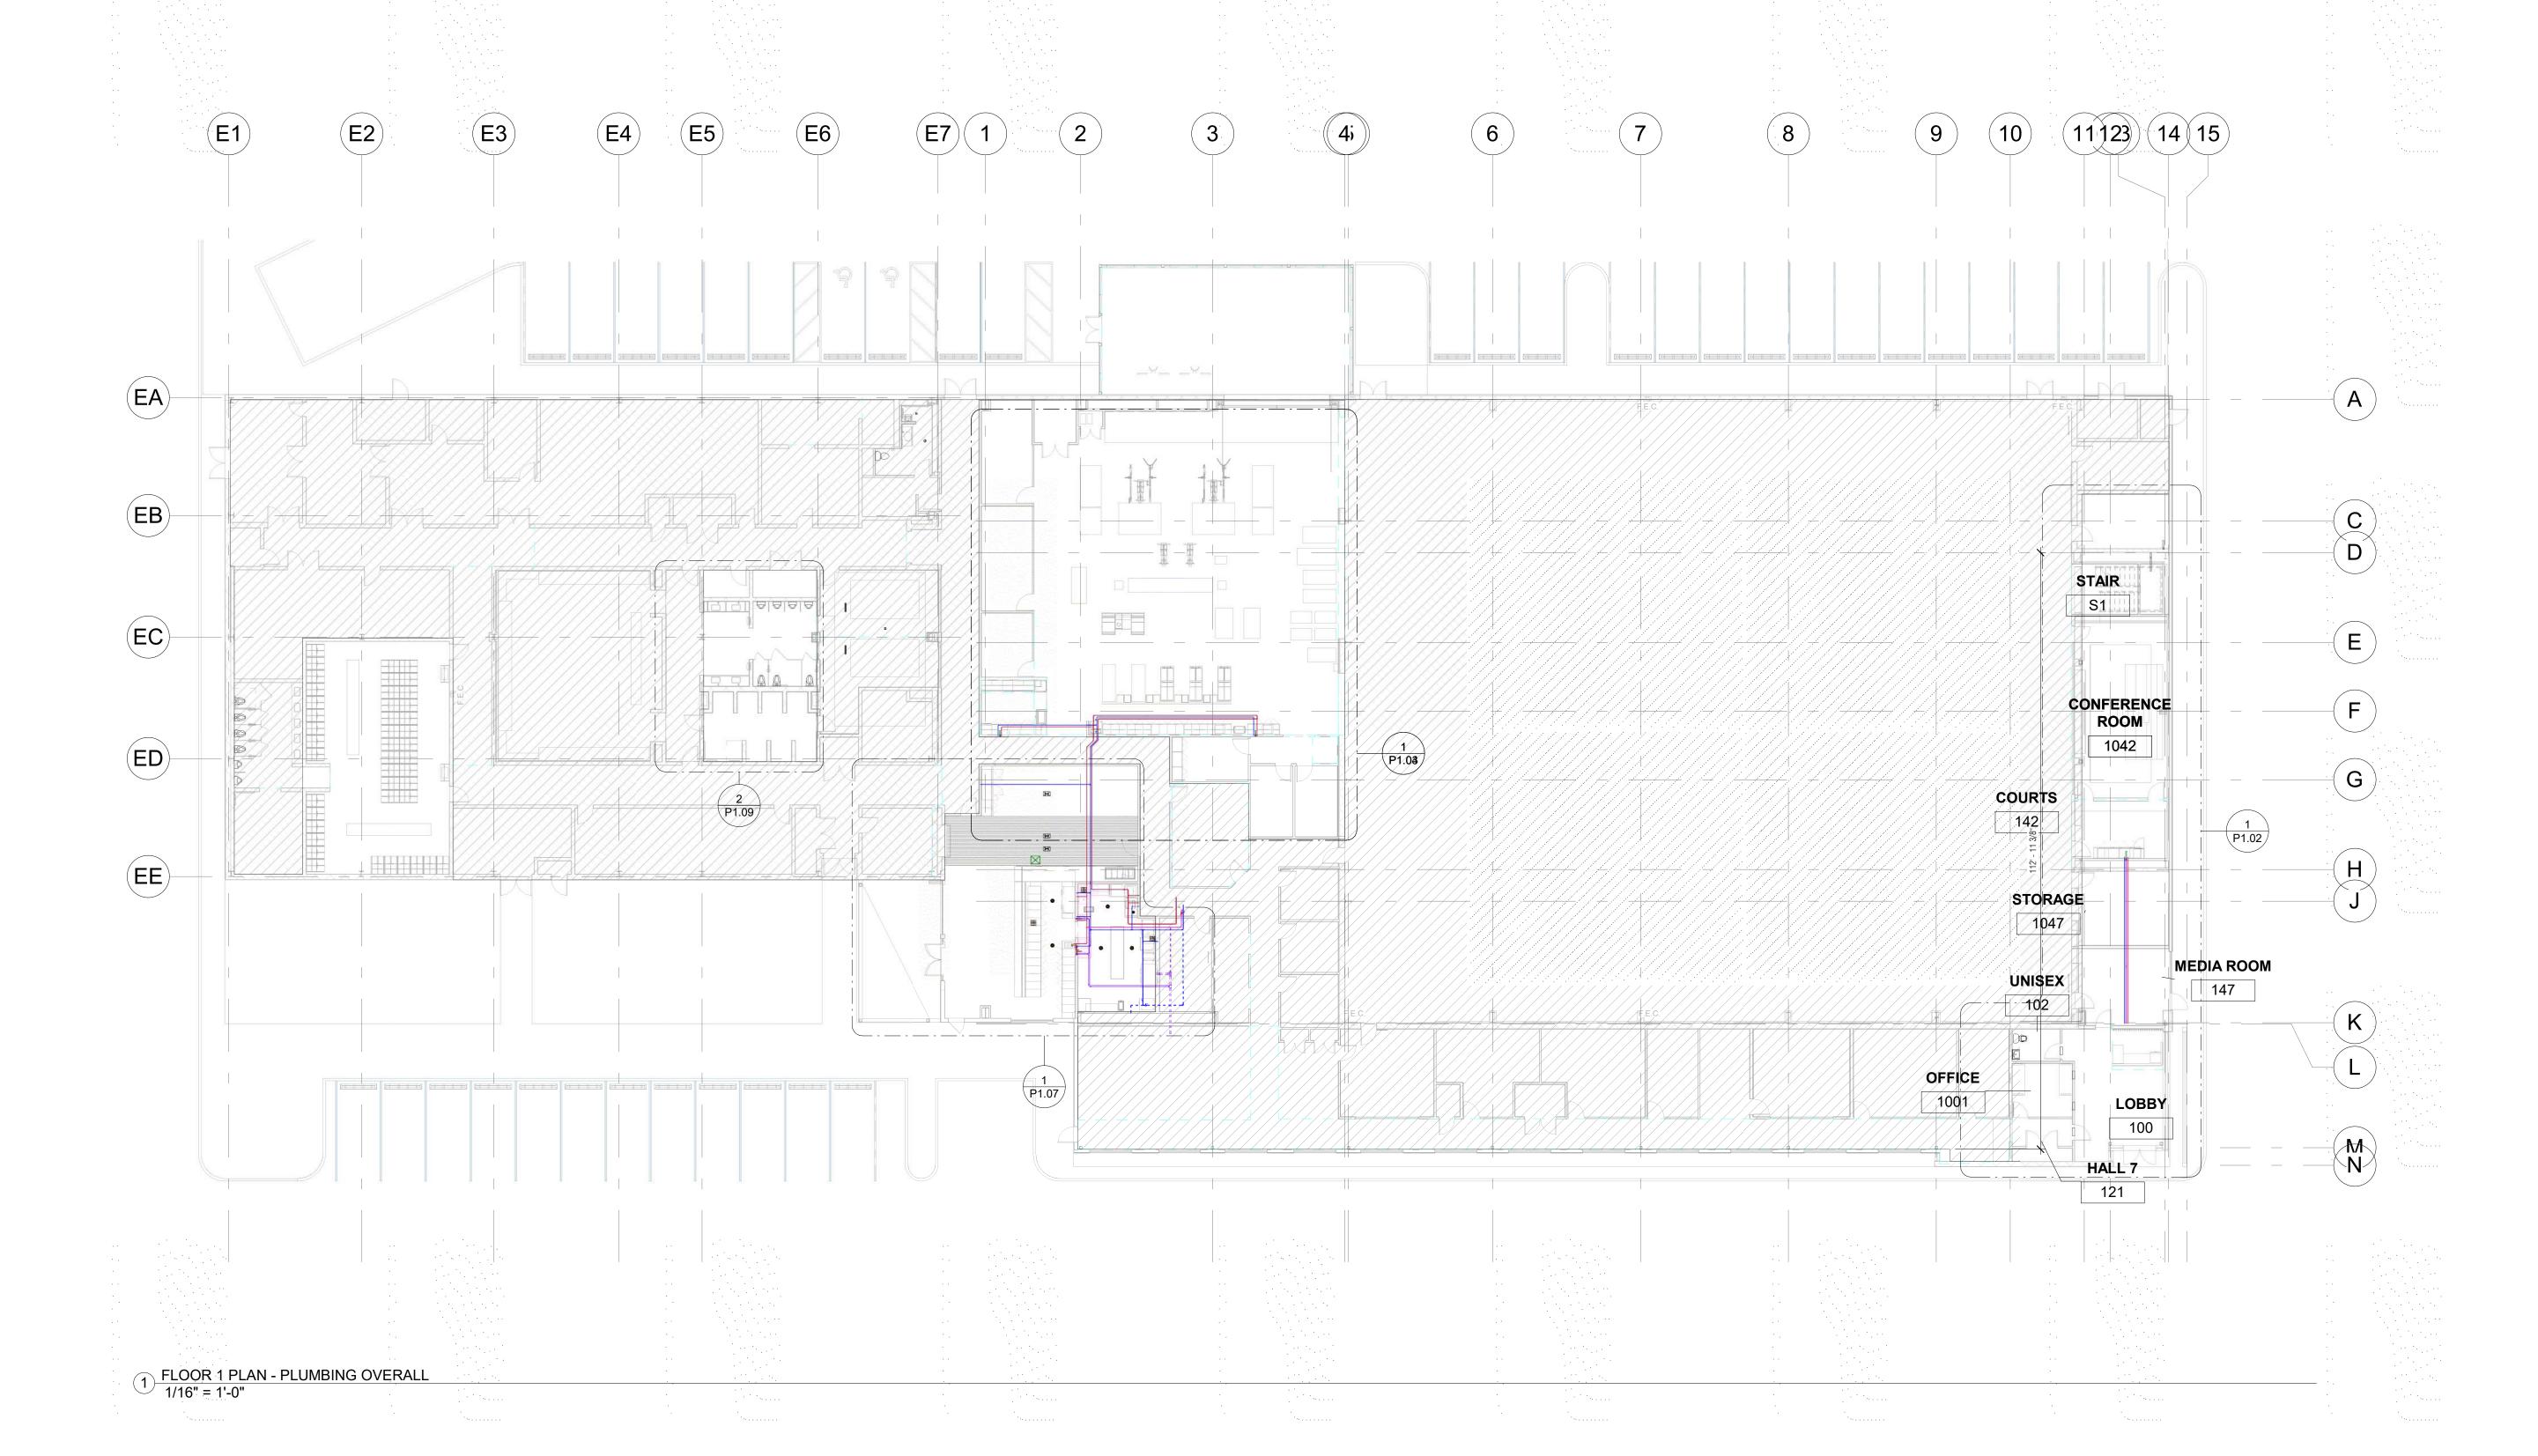



1000 S. NORMAN C. FRANCIS PARKWAY
NEW ORLEANS, LA 70125
WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA

PONCE, LLC
307 W MAPLE RIDGE DR
METAIRIE, LA 70001




PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana

WDG PROJECT NO JAR2315


Construction Documents 04.15.2




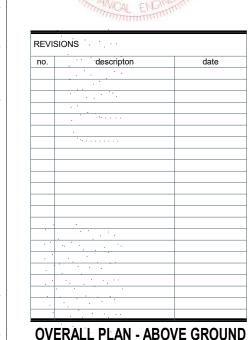


OVERALL PLAN - ABOVE GROUND PLUMBING

DRAWN BY |Author

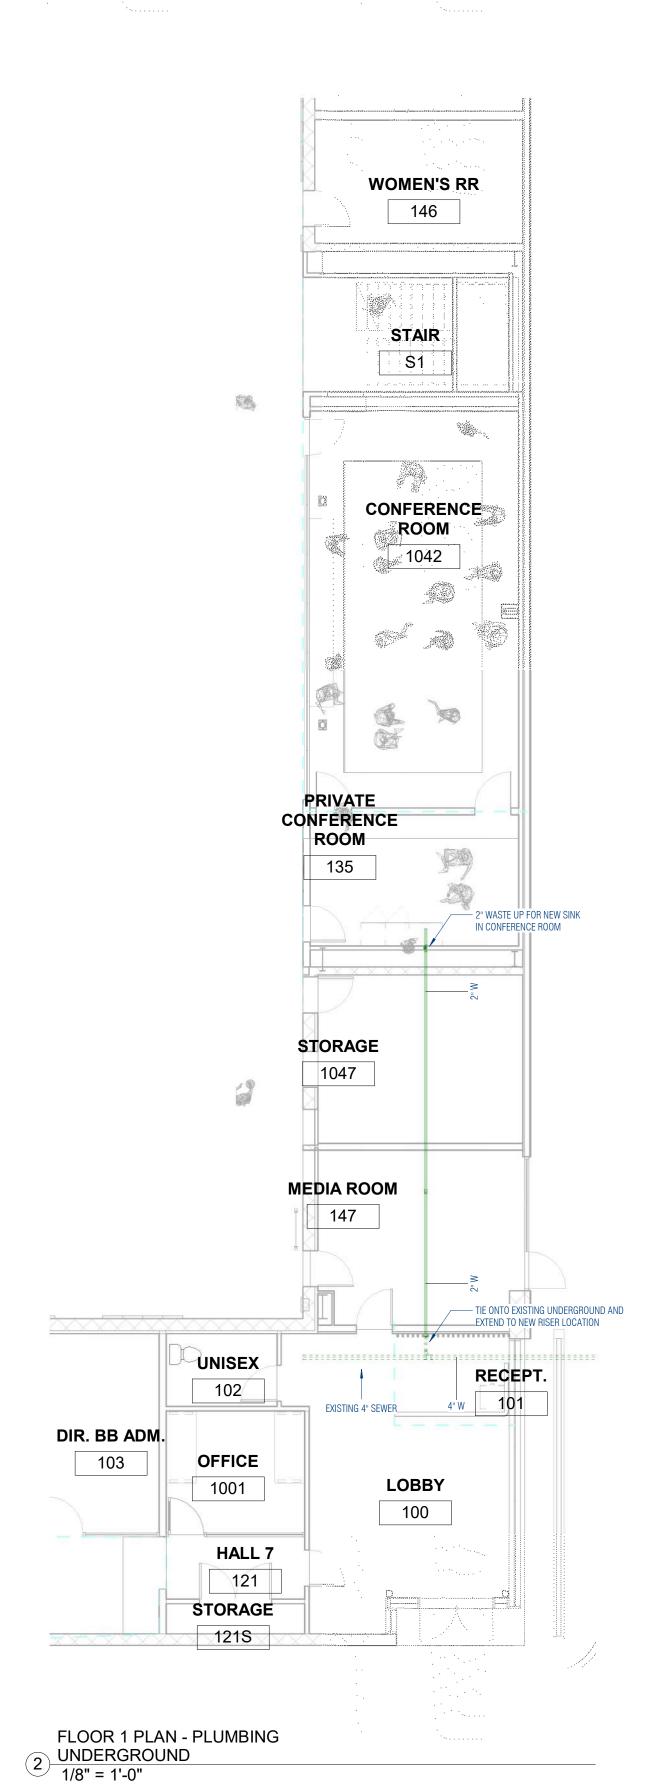

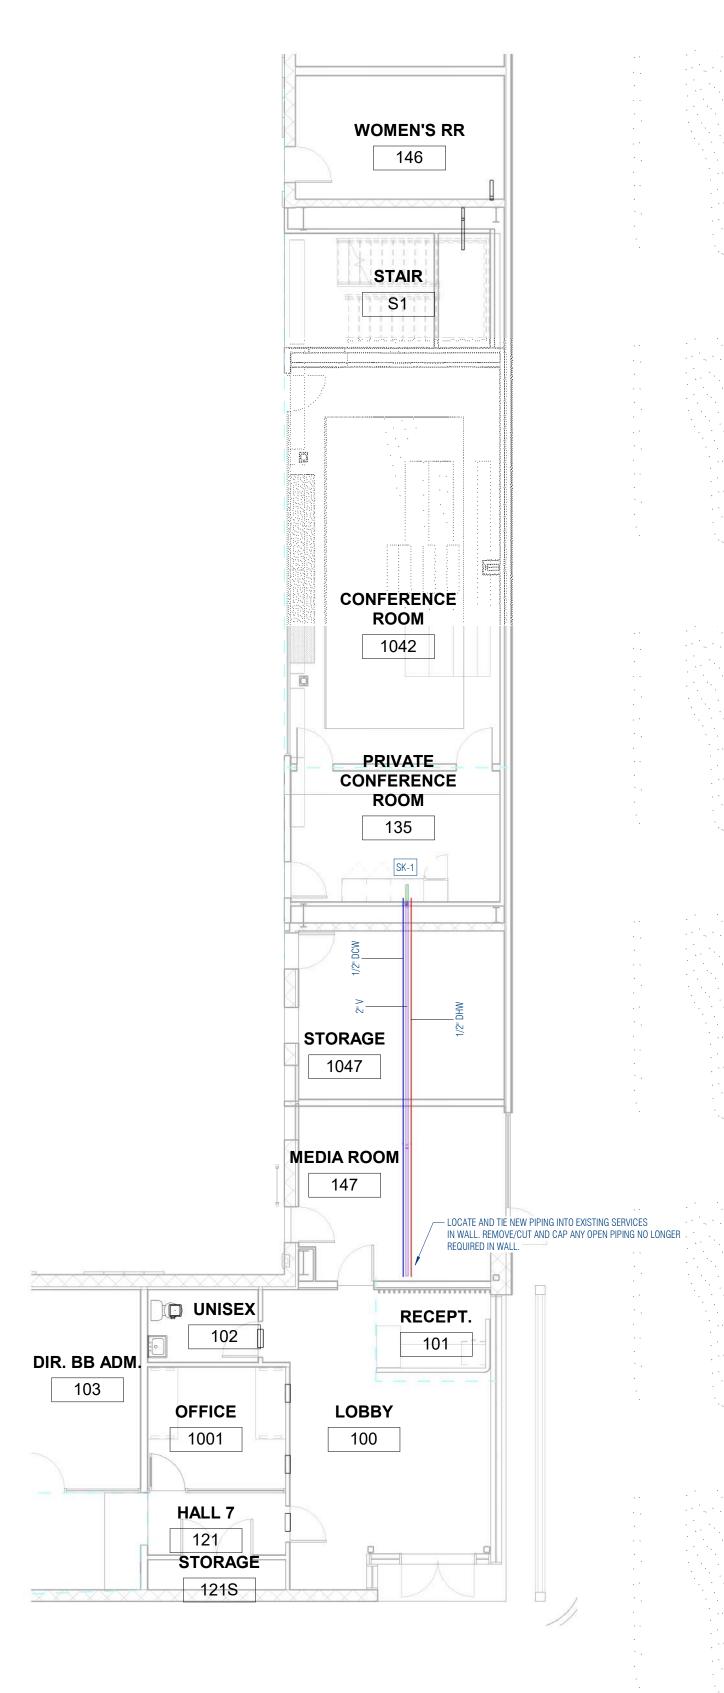

1) FLOOR 1 PLAN - PLUMBING 1/8" = 1'-0"

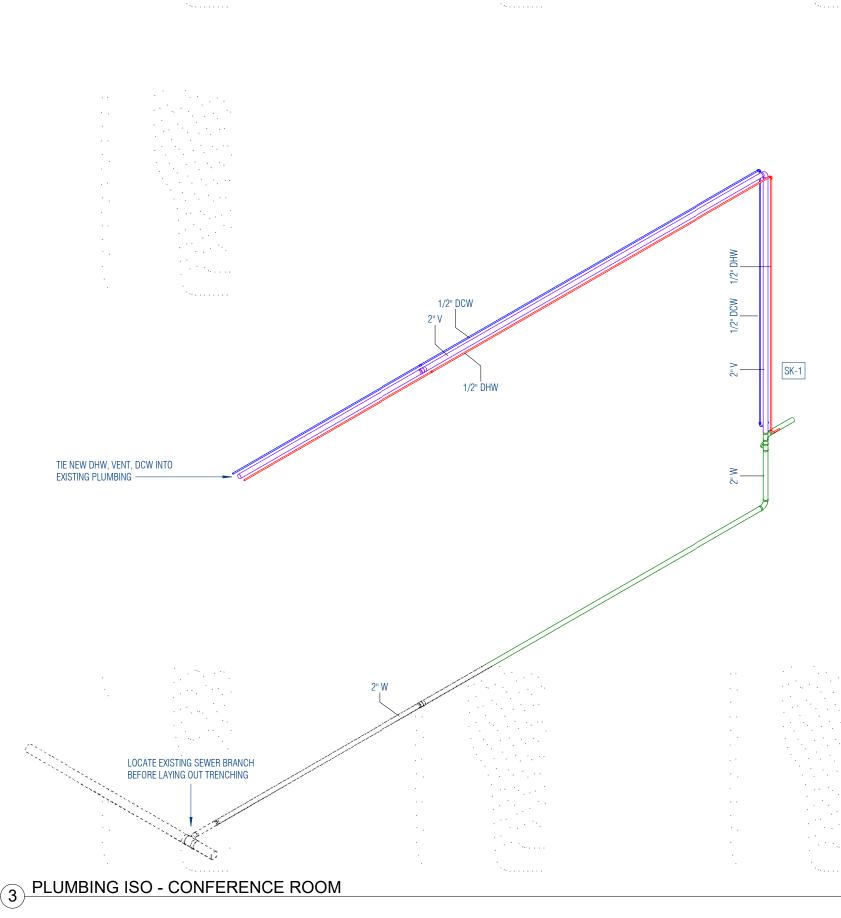

3 PLUMBING ISO - CONFERENCE ROOM

woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443 Erik Wismar, AIA


Ponce, LLC . 307 W MAPLE RIDGE DR METAIRIE, LA 70001

PELICANS CAMPUS IMPROVEMENTS

WDG PROJECT NO |AR2315

Construction Documents WENDELL P, HUMPHRES

FLOOR PLANS - PLUMBING CONFERENCE ROOM

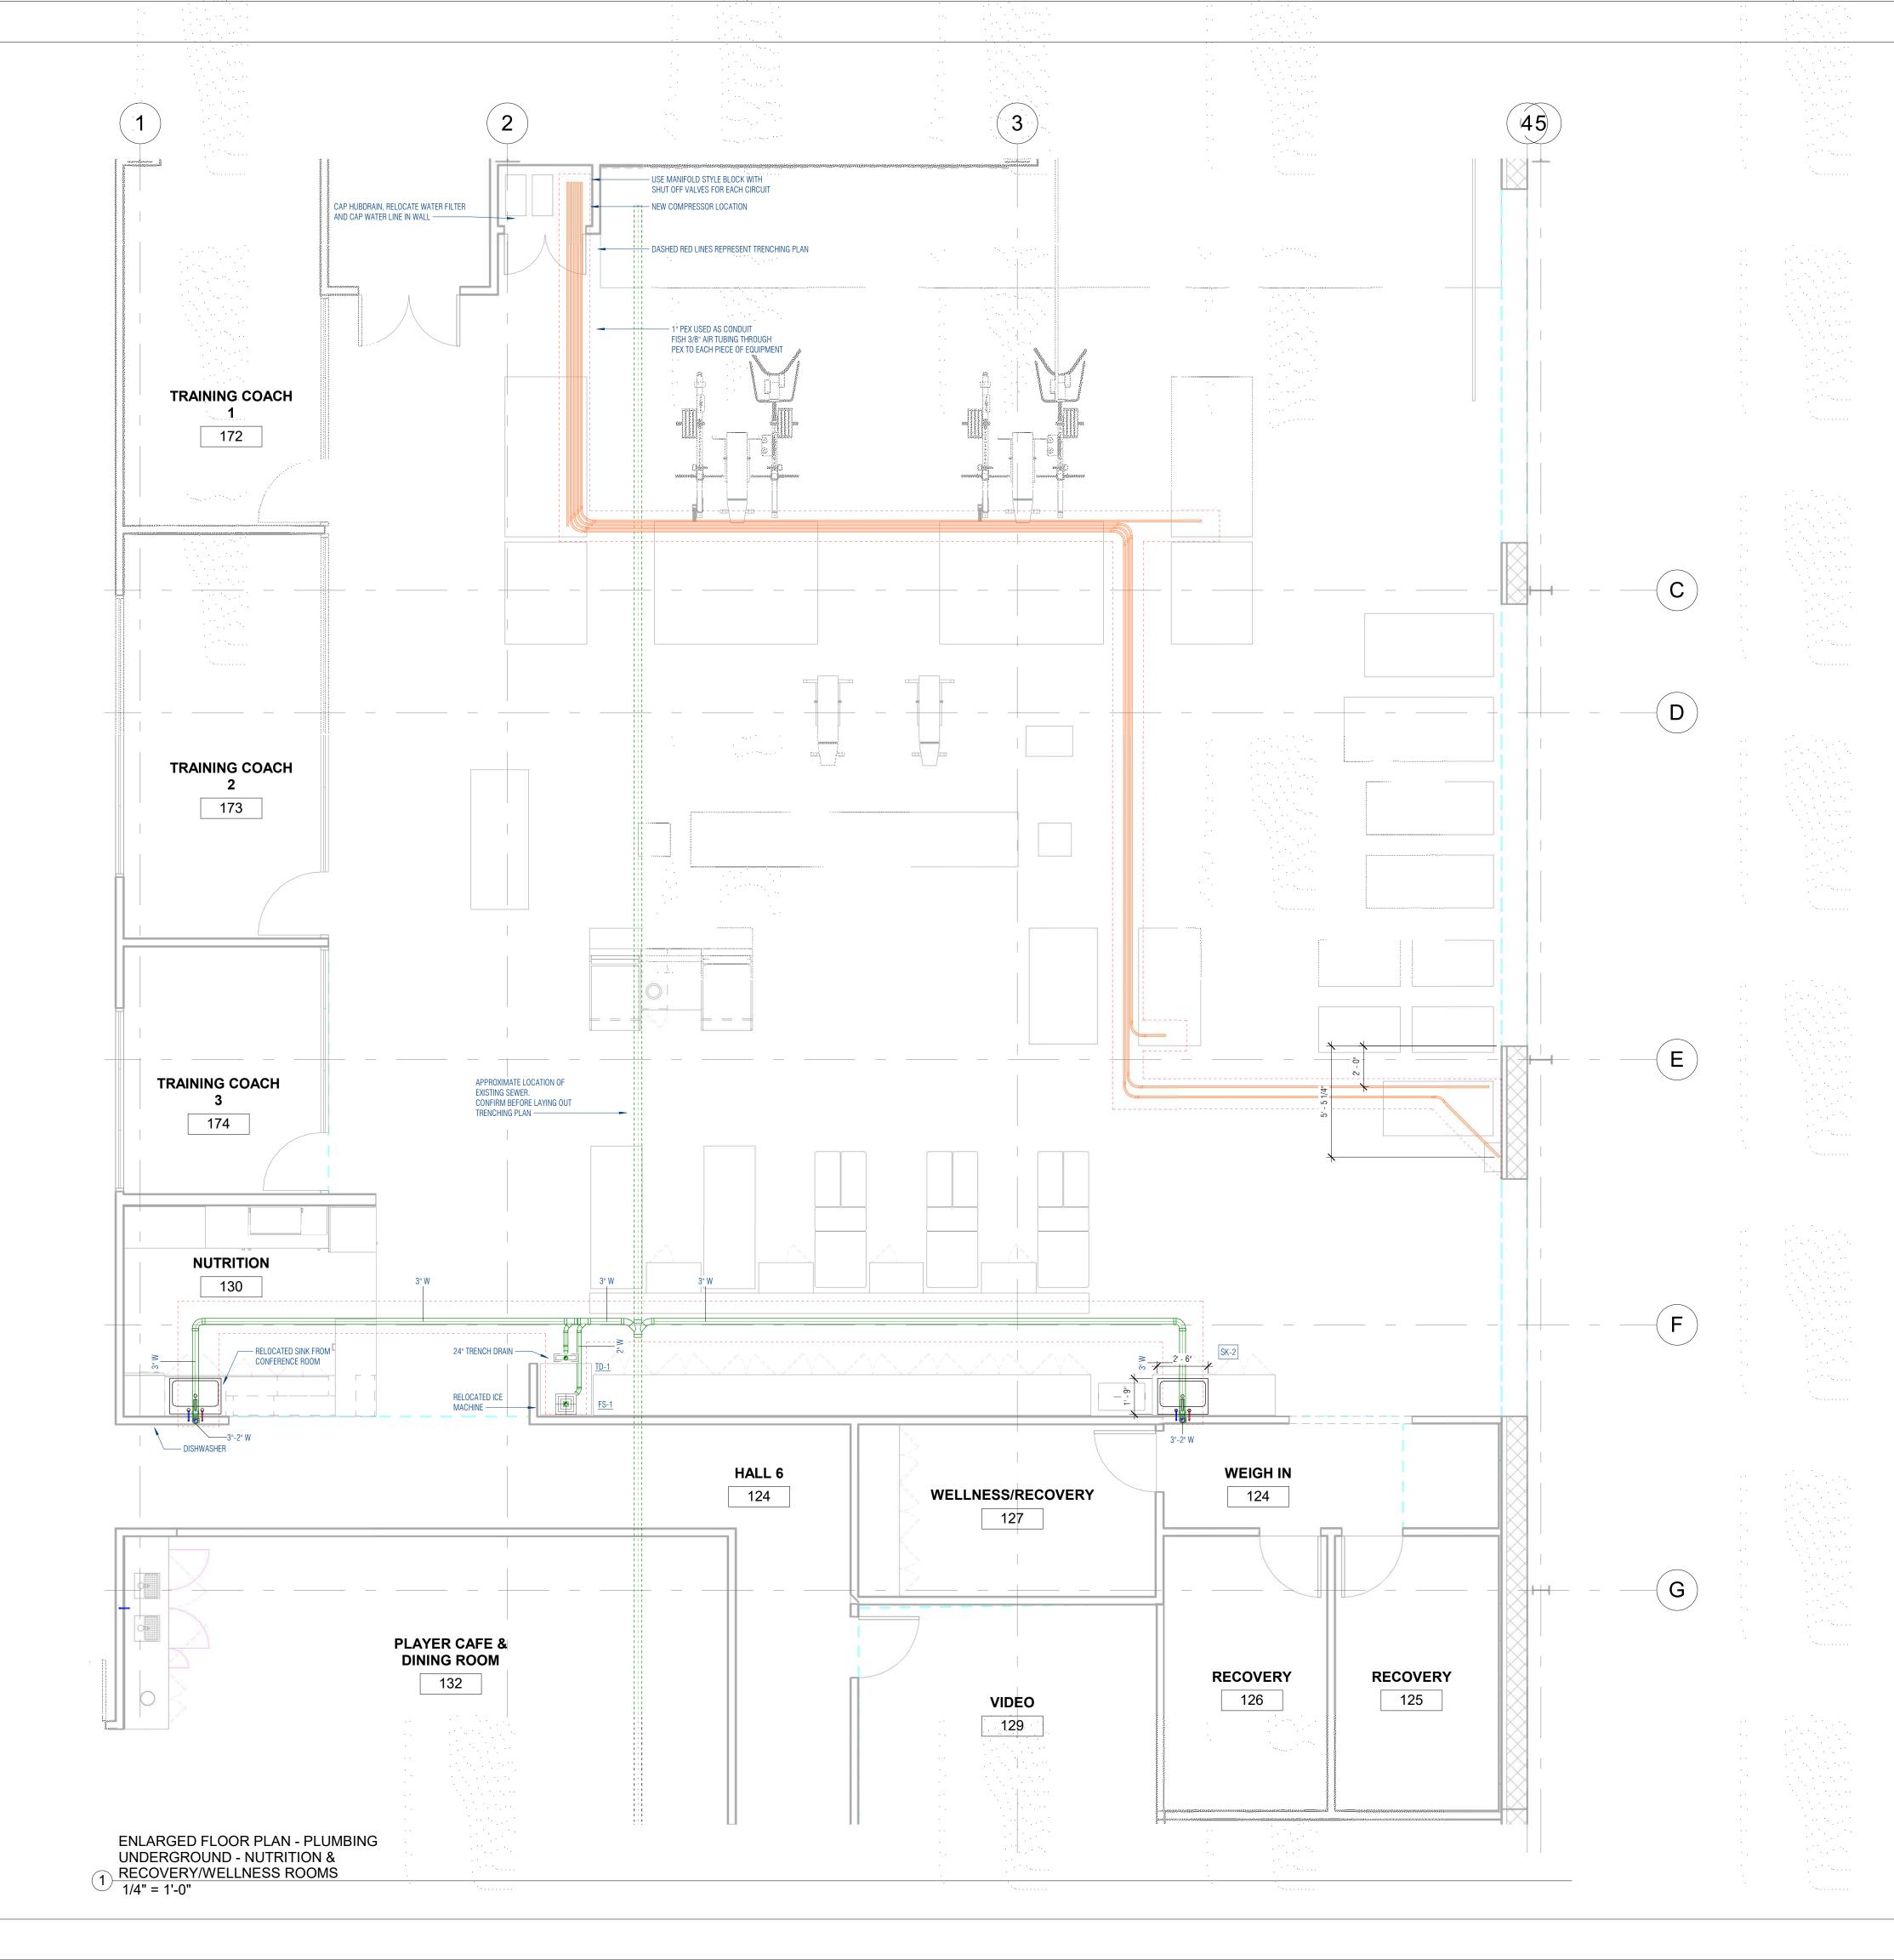



Woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY
NEW ORLEANS, LA 70125
WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA






PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana

WDG PROJECT NO |AR2315

Construction Documents




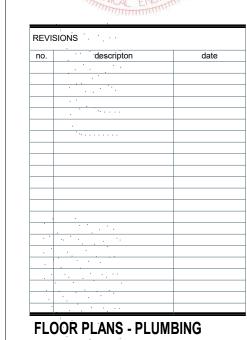

NUTRITION AND RECOVERY -UNDERGROUND

DRAWN BY |Author

P1.03

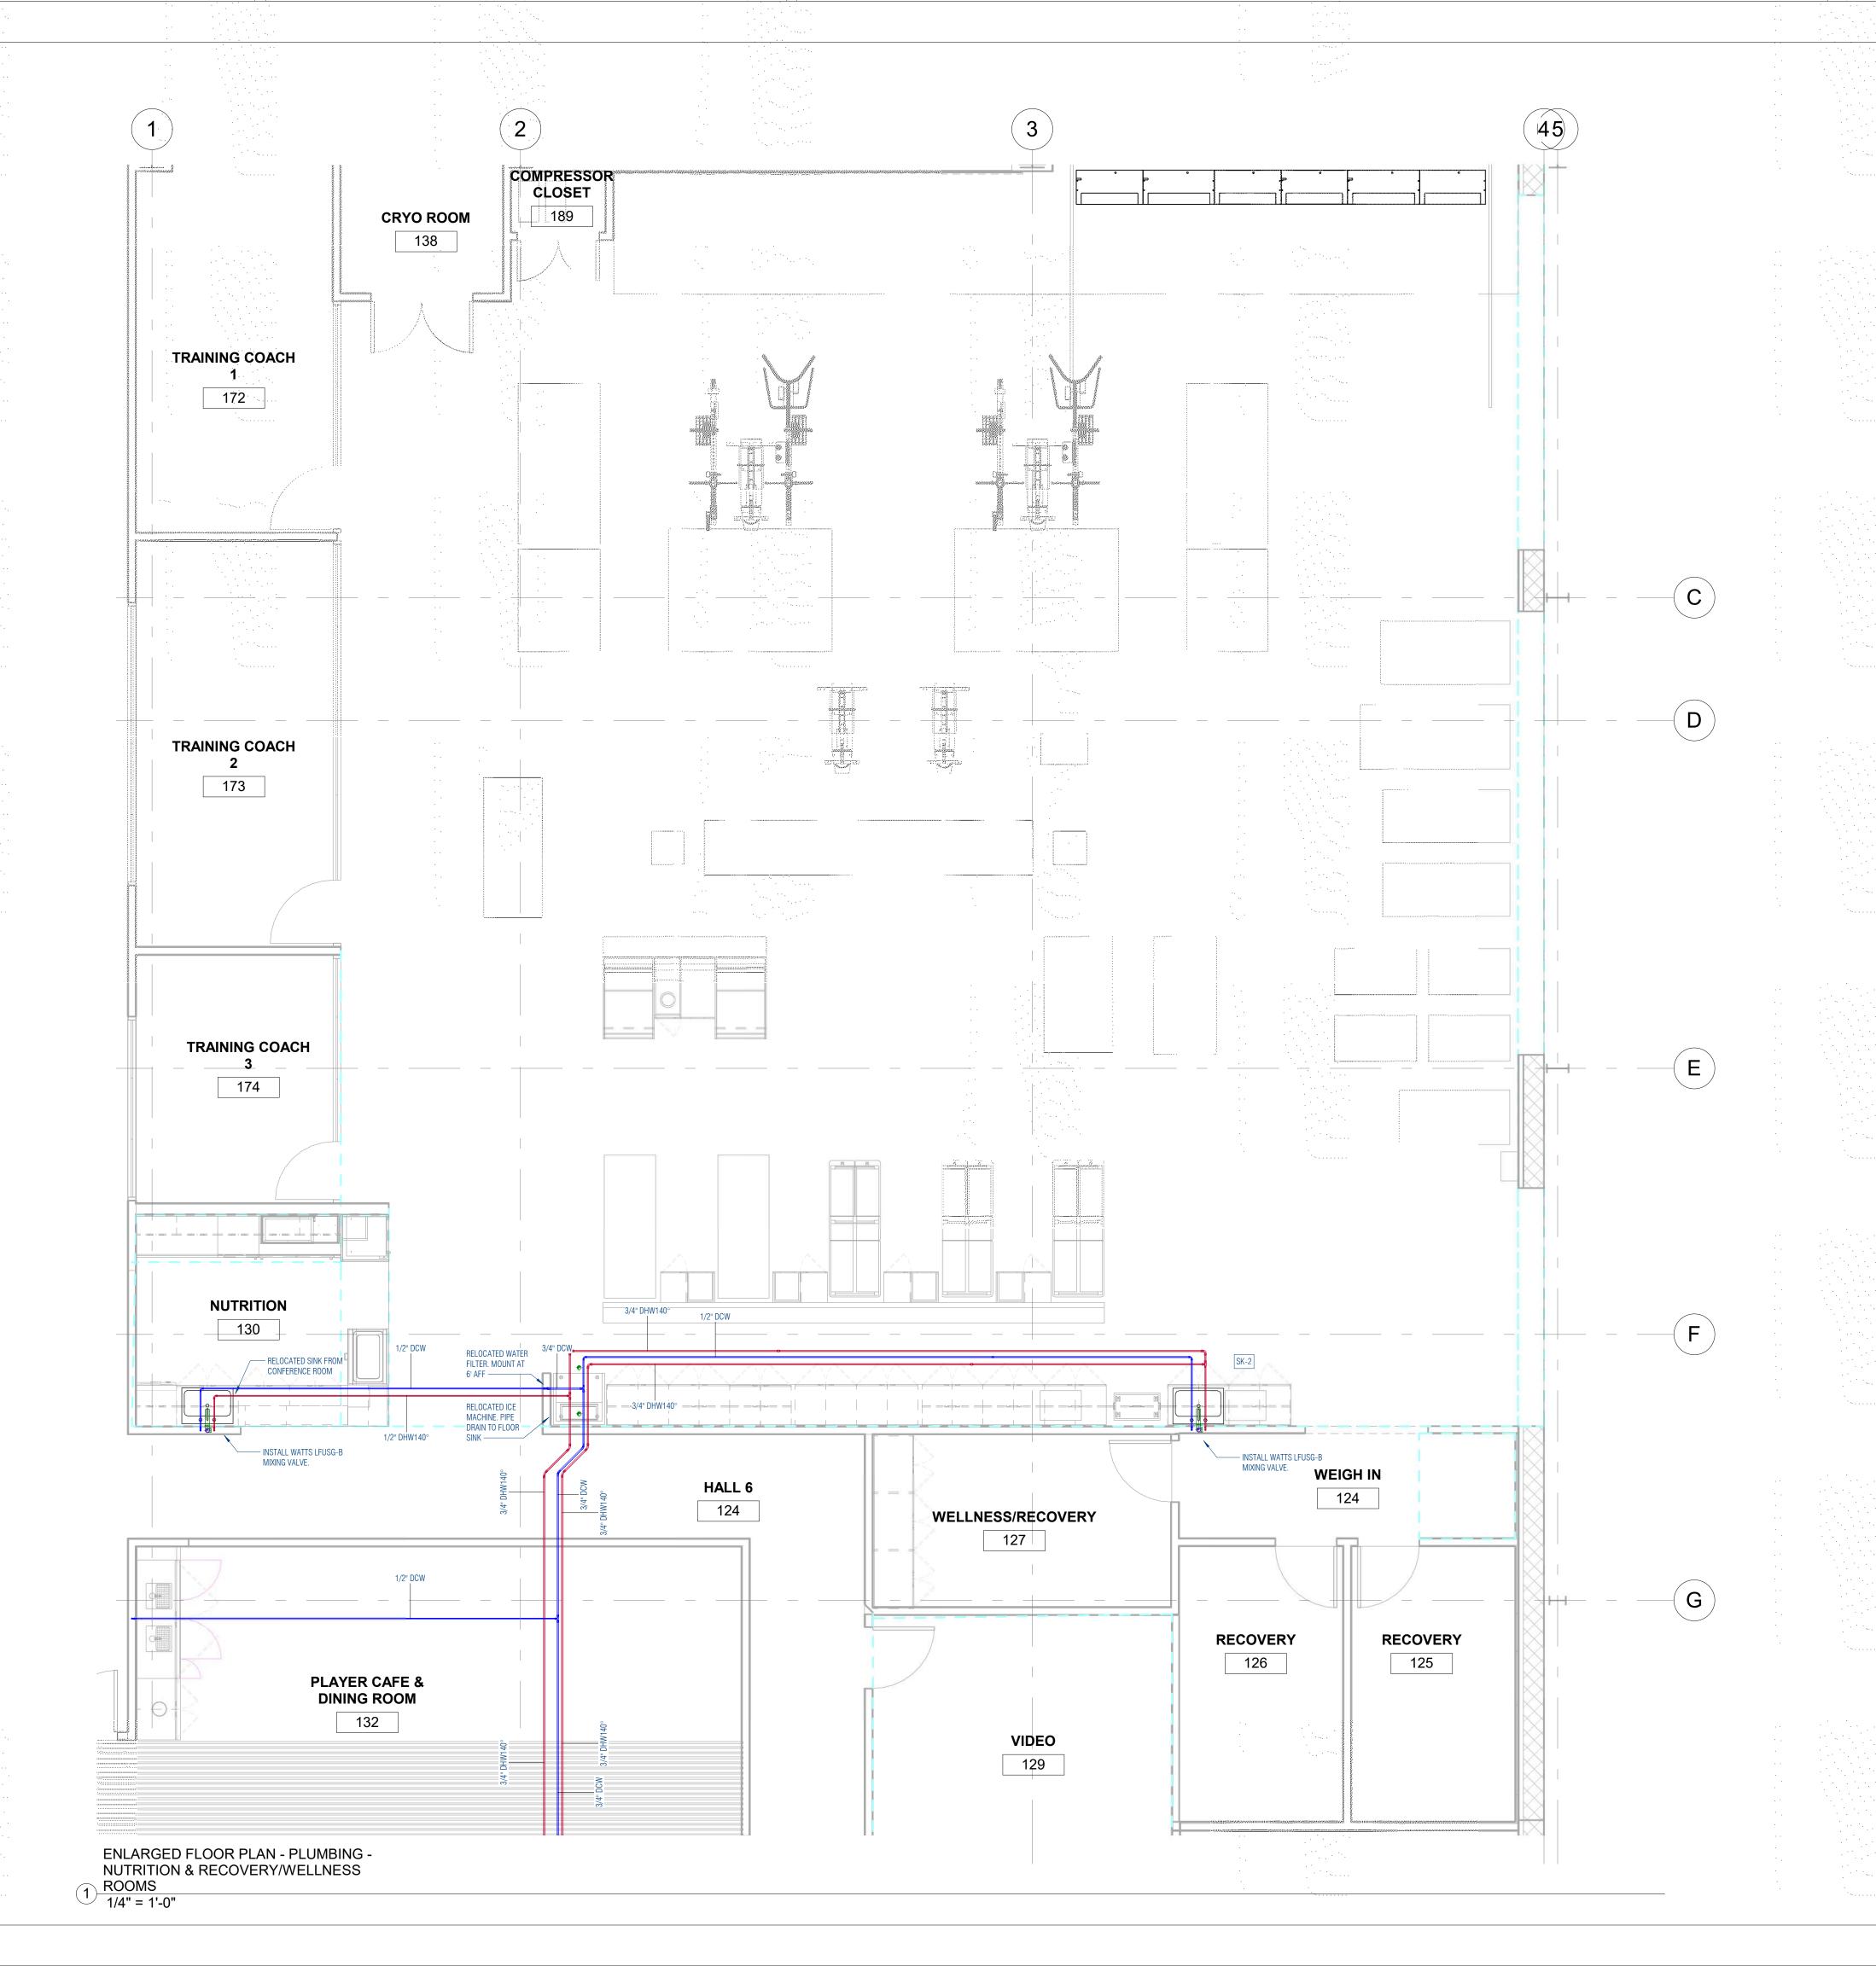



woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY
NEW ORLEANS, LA 70125
WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA






PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana

WDG PROJECT NO |AR2315


Construction Documents



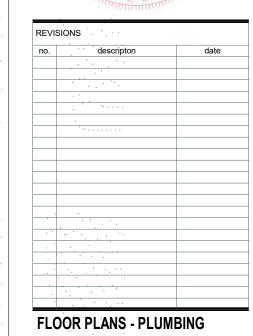

FLOOR PLANS - PLUMBING NUTRITION AND RECOVERY -ABOVEGROUND

DRAWN BY JAuthor P1.04

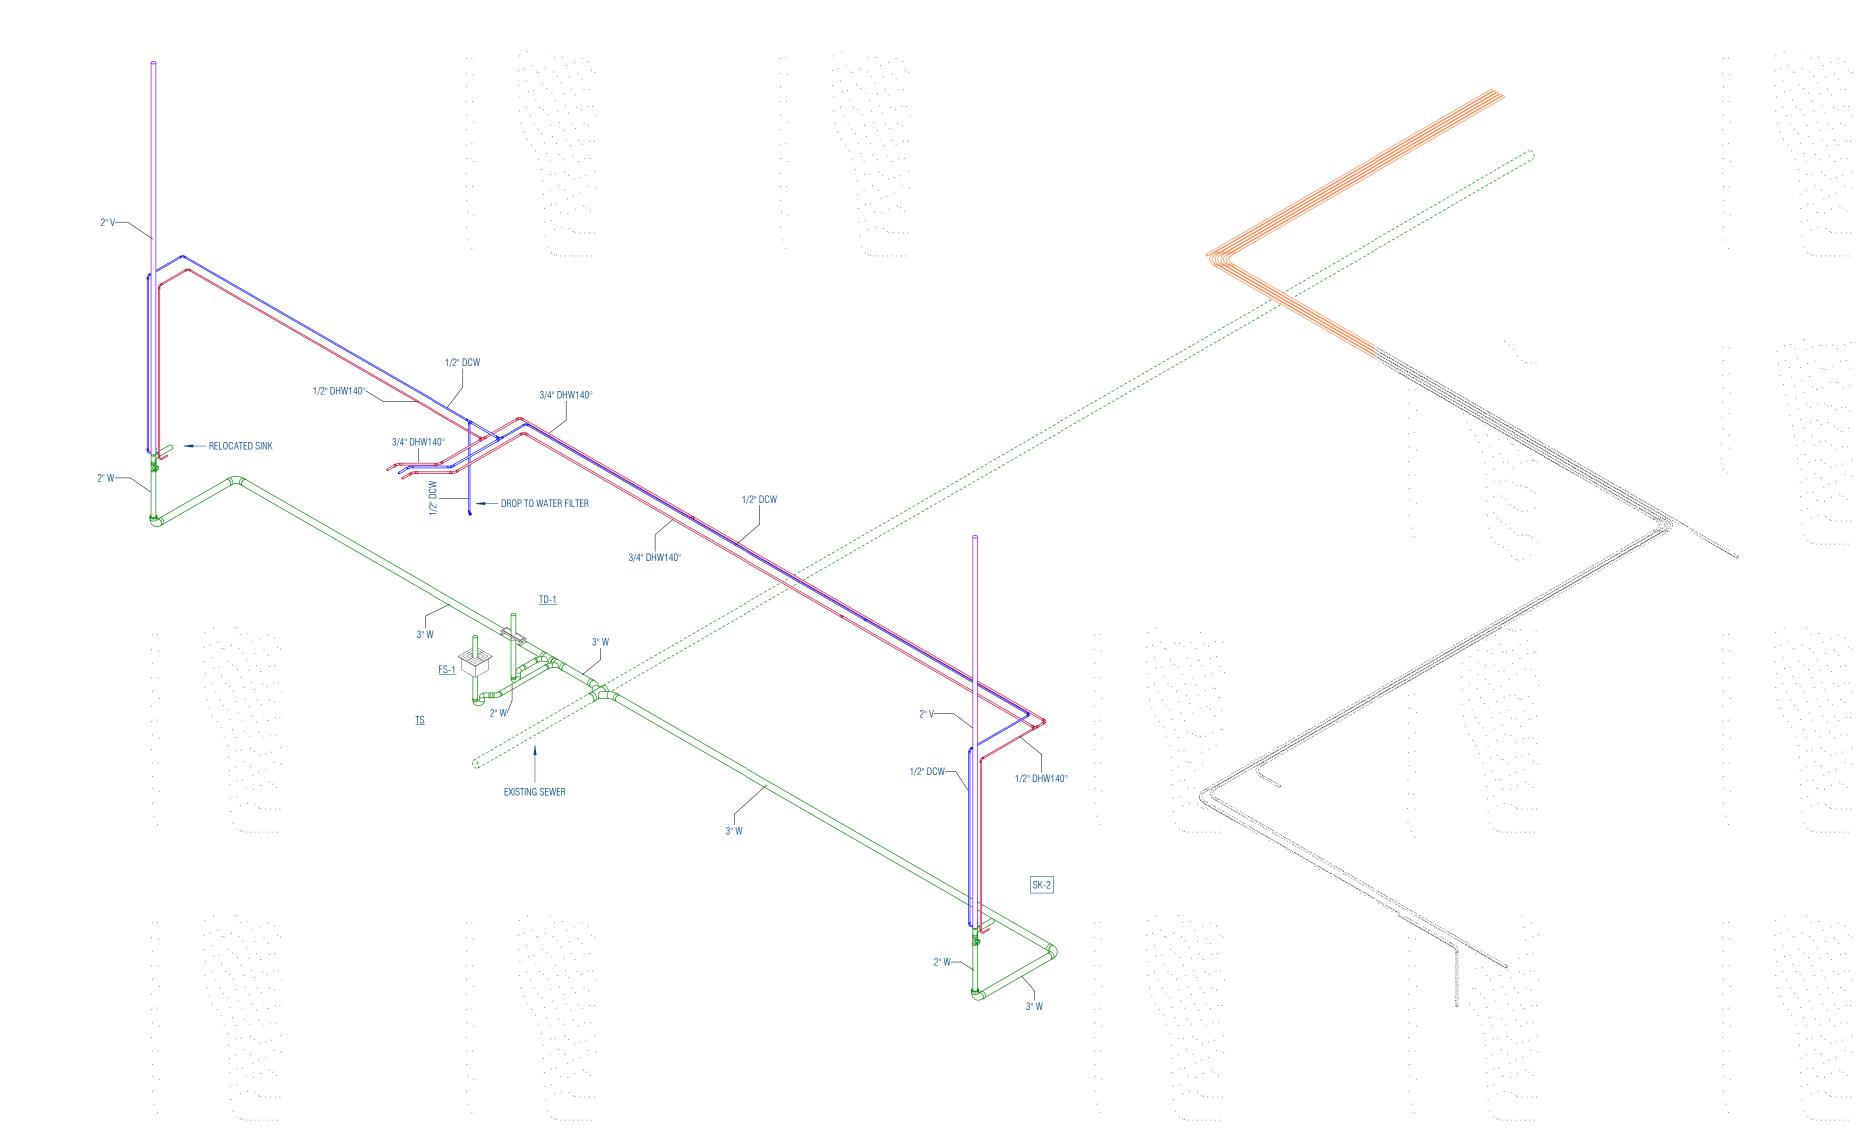

PLUMBING ISO - NUTRITION AND

1 RECOVERY

woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY
NEW ORLEANS, LA 70125
WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA

PONCE, LLC
307 W MAPLE RIDGE DR
METAIRIE, LA 70001



PELICANS CAMPUS IMPROVEMENTS
Metairie, Louisiana

WDG PROJECT NO |AR2315




	dat

18	
1	
1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1	

PLUMBING ISO - NUTRITION AI RECOVERY

DRAWN BY |Author P1.05

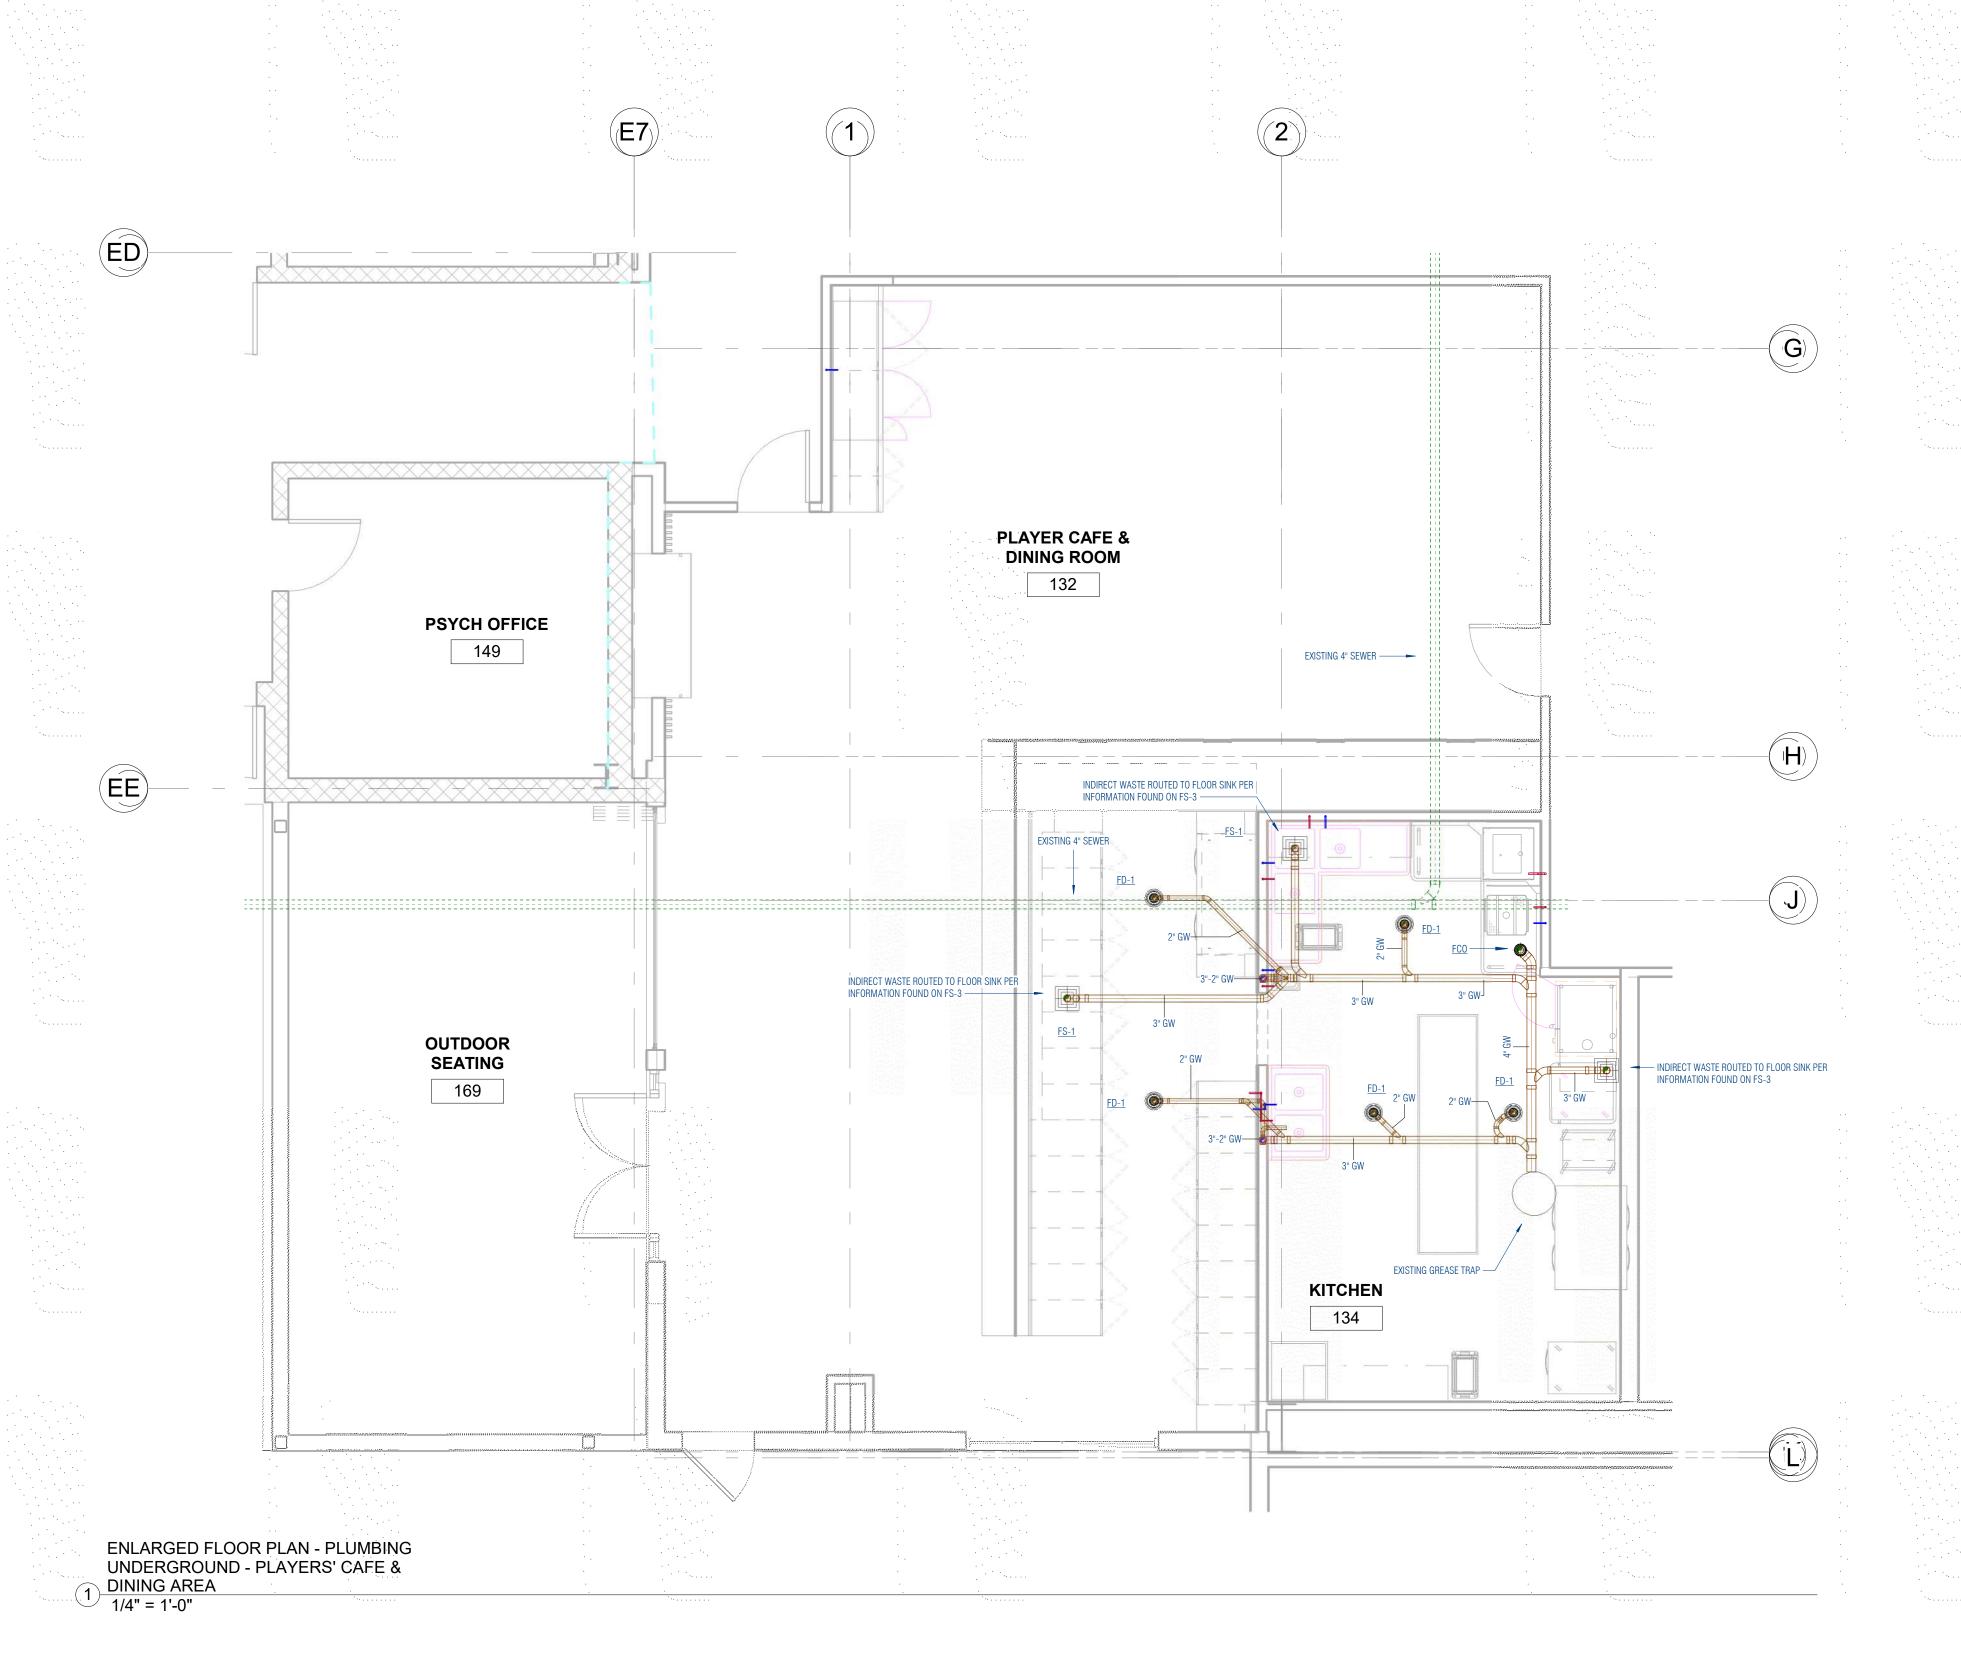



Erik Wismar, AIA

PONCE, LLC
307 W MAPLE RIDGE DR



PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana

WDG PROJECT NO |AR2315

Construction Documents




no.	descripton	date
	+ * .	

· .		
	A Company of the Company	
	The state of the s	
-	The second second	

FLOOR PLANS - PLUMBING
PLAYERS CAFE UNDERGROUND

DRAWN BY |Author P1.06

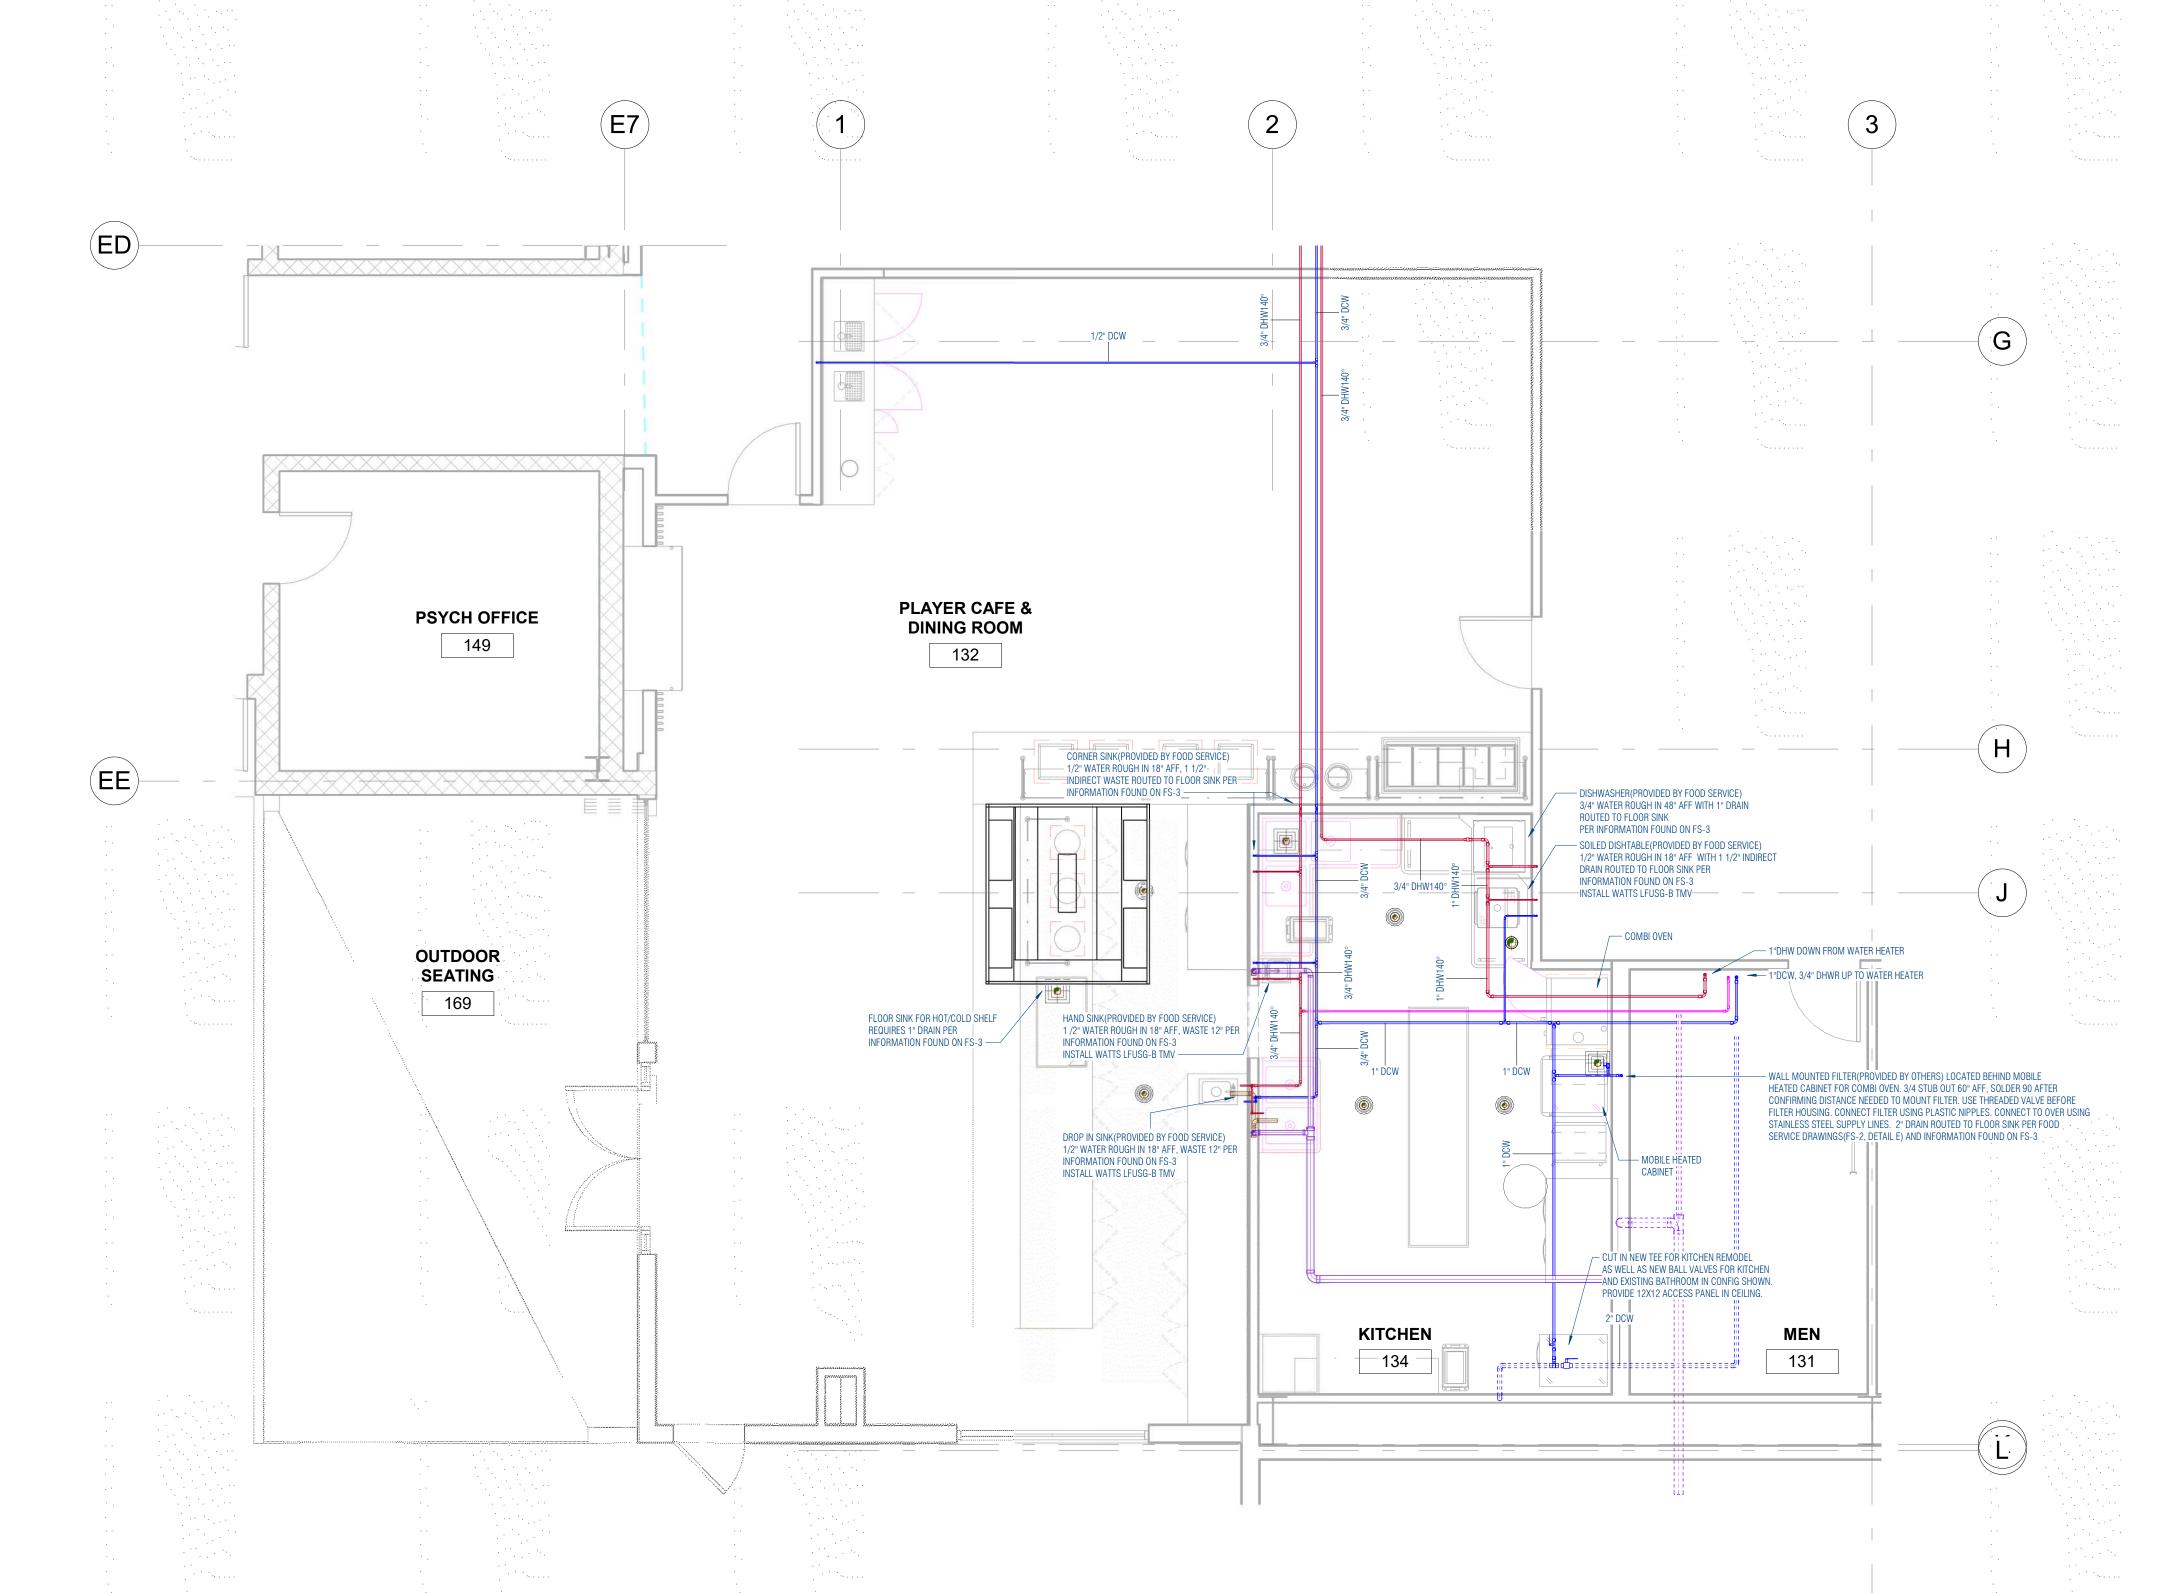

1 ENLARGED FLOOR PLAN - PLUMBING - PLAYERS' CAFE & DINING AREA P1.07 1/4" = 1'-0"



1000 S. NORMAN C. FRANCIS PARKWAY
NEW ORLEANS, LA 70125
WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA

PONCE, LLC
307 W MAPLE RIDGE DR
METAIRIE LA 70001



PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana

WDG PROJECT NO |AR2315

Construction Documents




The state of the s						
REVISIONS						
REVISIONS						
no. descripton	date					

190000000						
· · · · · · · · · · · · · · · · · · ·						
<u> </u>						
FLOOD DLANC DI	LIMBINIO					

FLOOR PLANS - PLUMBING
PLAYERS CAFE ABOVEGROUND

DRAWN BY |Author P1.07

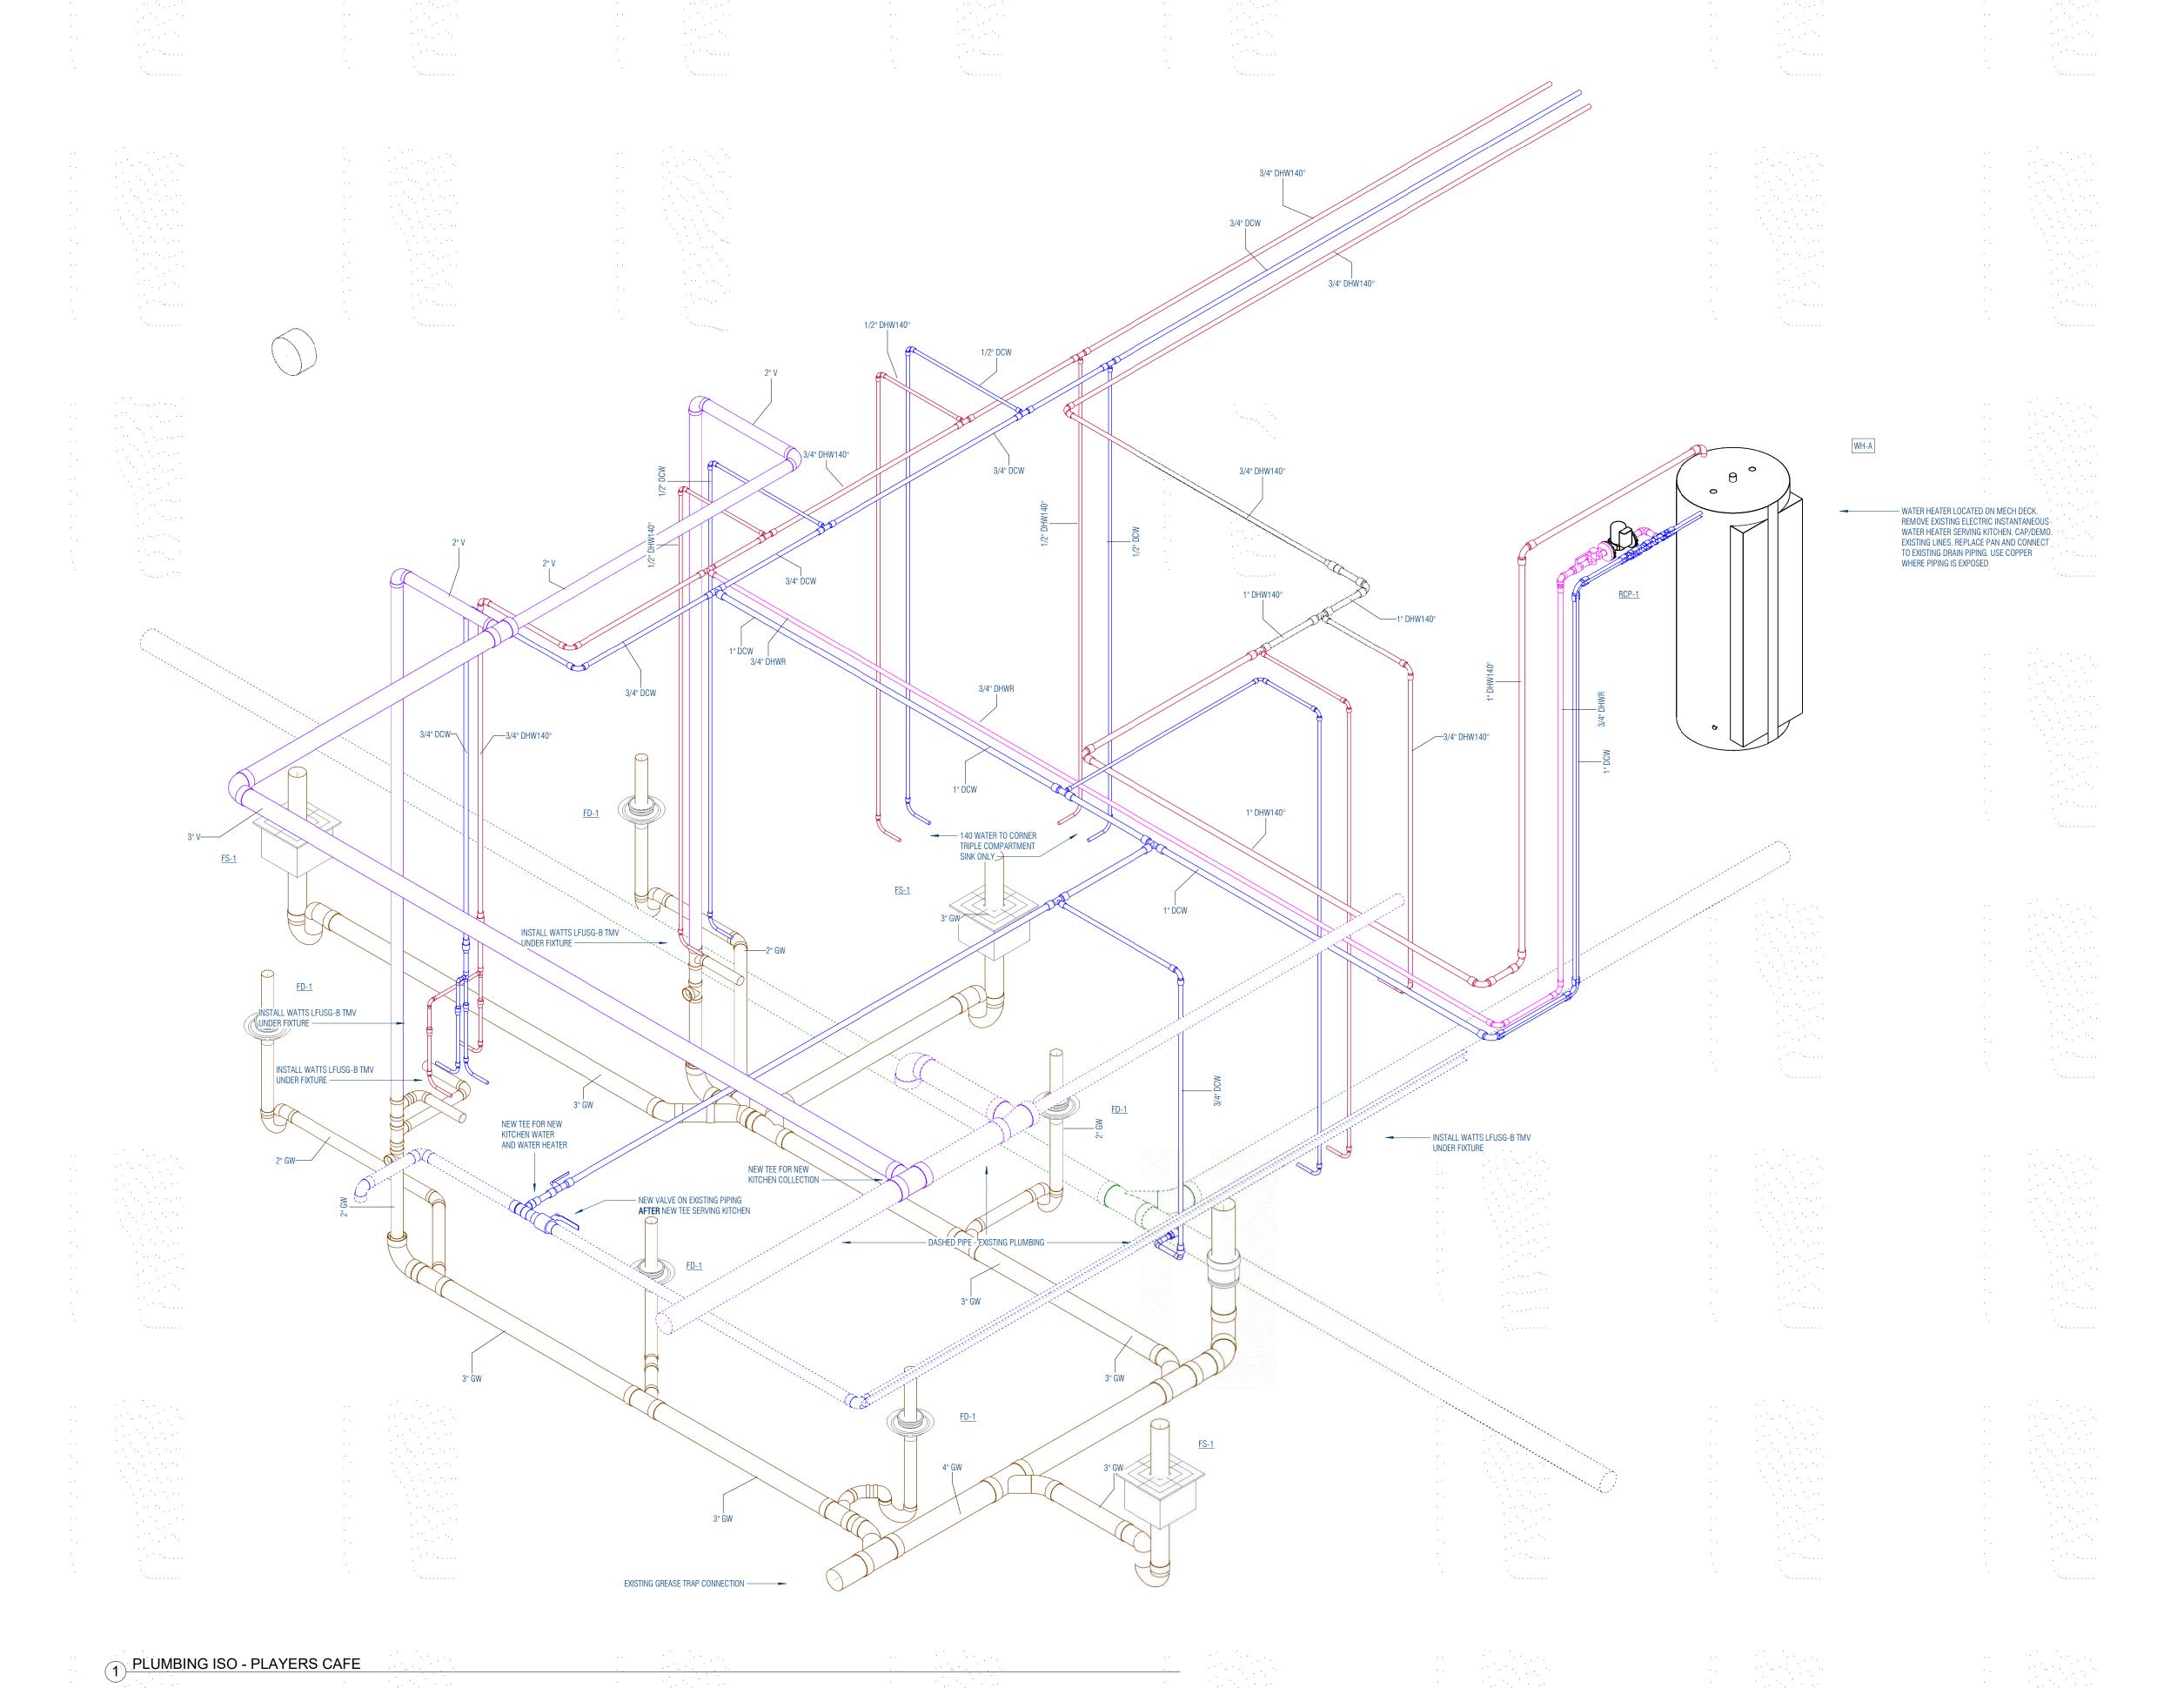

woodward design group 1000 S. NORMAN C. FRANCIS PARKWAY NEW ORLEANS, LA 70125 WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA



PELICANS CAMPUS IMPROVEMENTS


WDG PROJECT NO |AR2315 **Construction Documents**



no.	descripton	date
·		

-	- 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1	
- 1 L	· . · . · . · . · . · · . · · · · · · ·	
		
	The second second	
	· · · · · · · · · · · · · · · · · · ·	
		
	* * * * * * * * * * * * * * * * * * * *	

PLUMBING ISO - PLAYERS CAFE

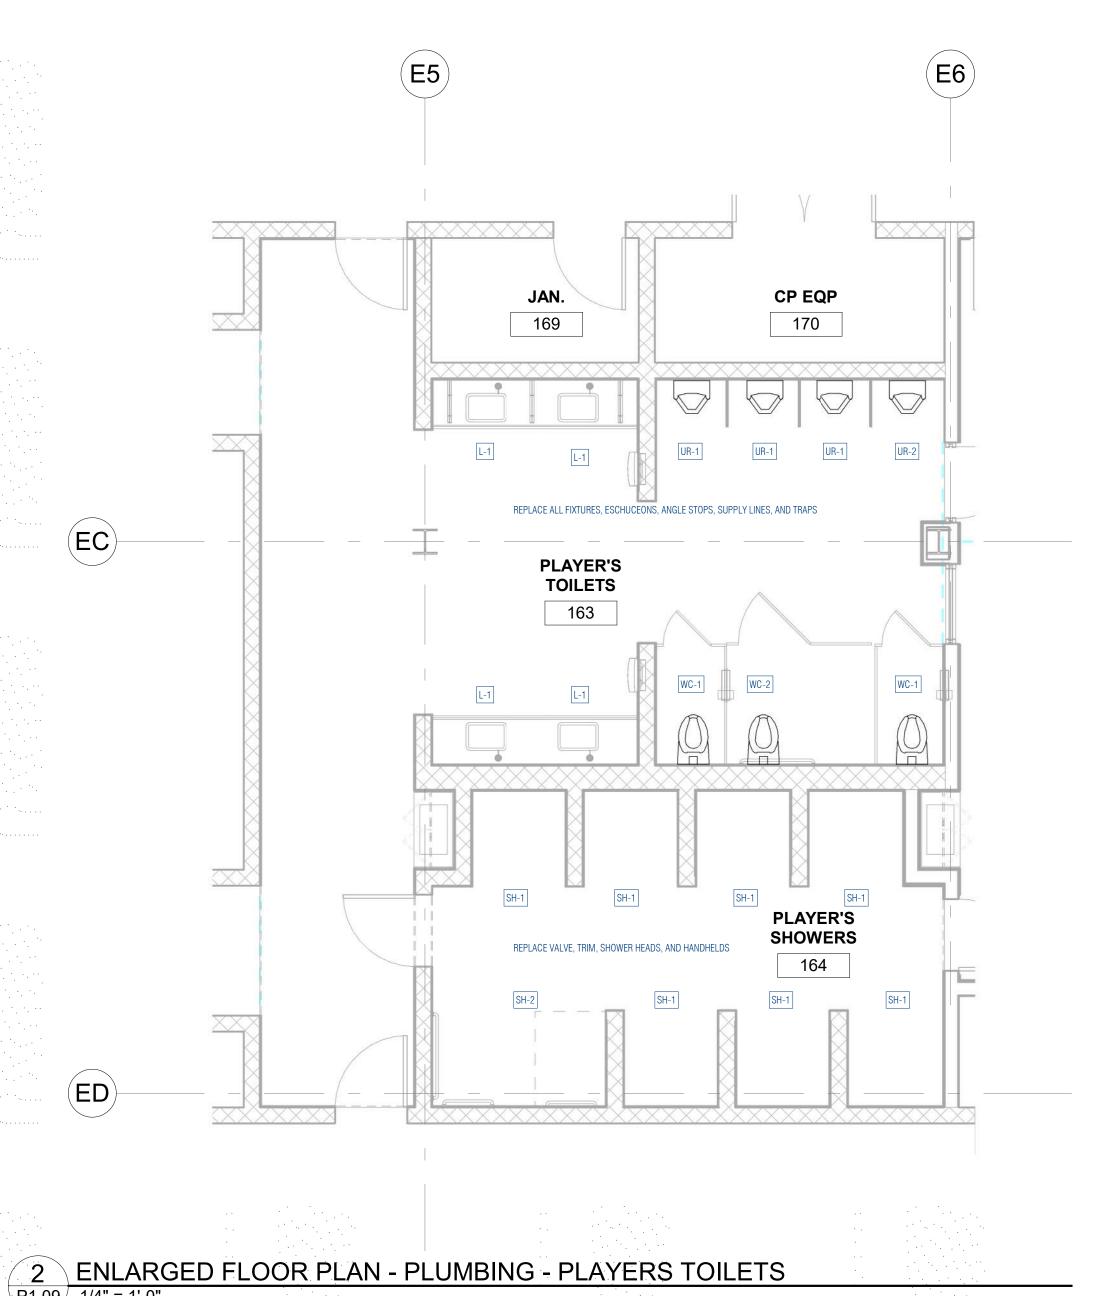

woodward design group

1000 S. NORMAN C. FRANCIS PARKWAY
NEW ORLEANS, LA 70125
WOODWARDDESIGNBUILD.COM | 504-822-6443

Erik Wismar, AIA

PONCE, LLC
307 W MAPLE RIDGE DR
METAIRIE, LA 70001



PELICANS CAMPUS IMPROVEMENTS Metairie, Louisiana

WDG PROJECT NO |AR2315

Construction Documents




no.	descripton	date

	* * . * . * . * . * . * . * . * . * . *	
1	Tarifa in the second	
. 1		
1	· · · · · · · · · · · · · · · · · · ·	
	Tage to a great	
	- ` · · · · · · · · · · · · · · · · · · 	

DRAWN BY |Author P1.09

PLAYERS TOILETS

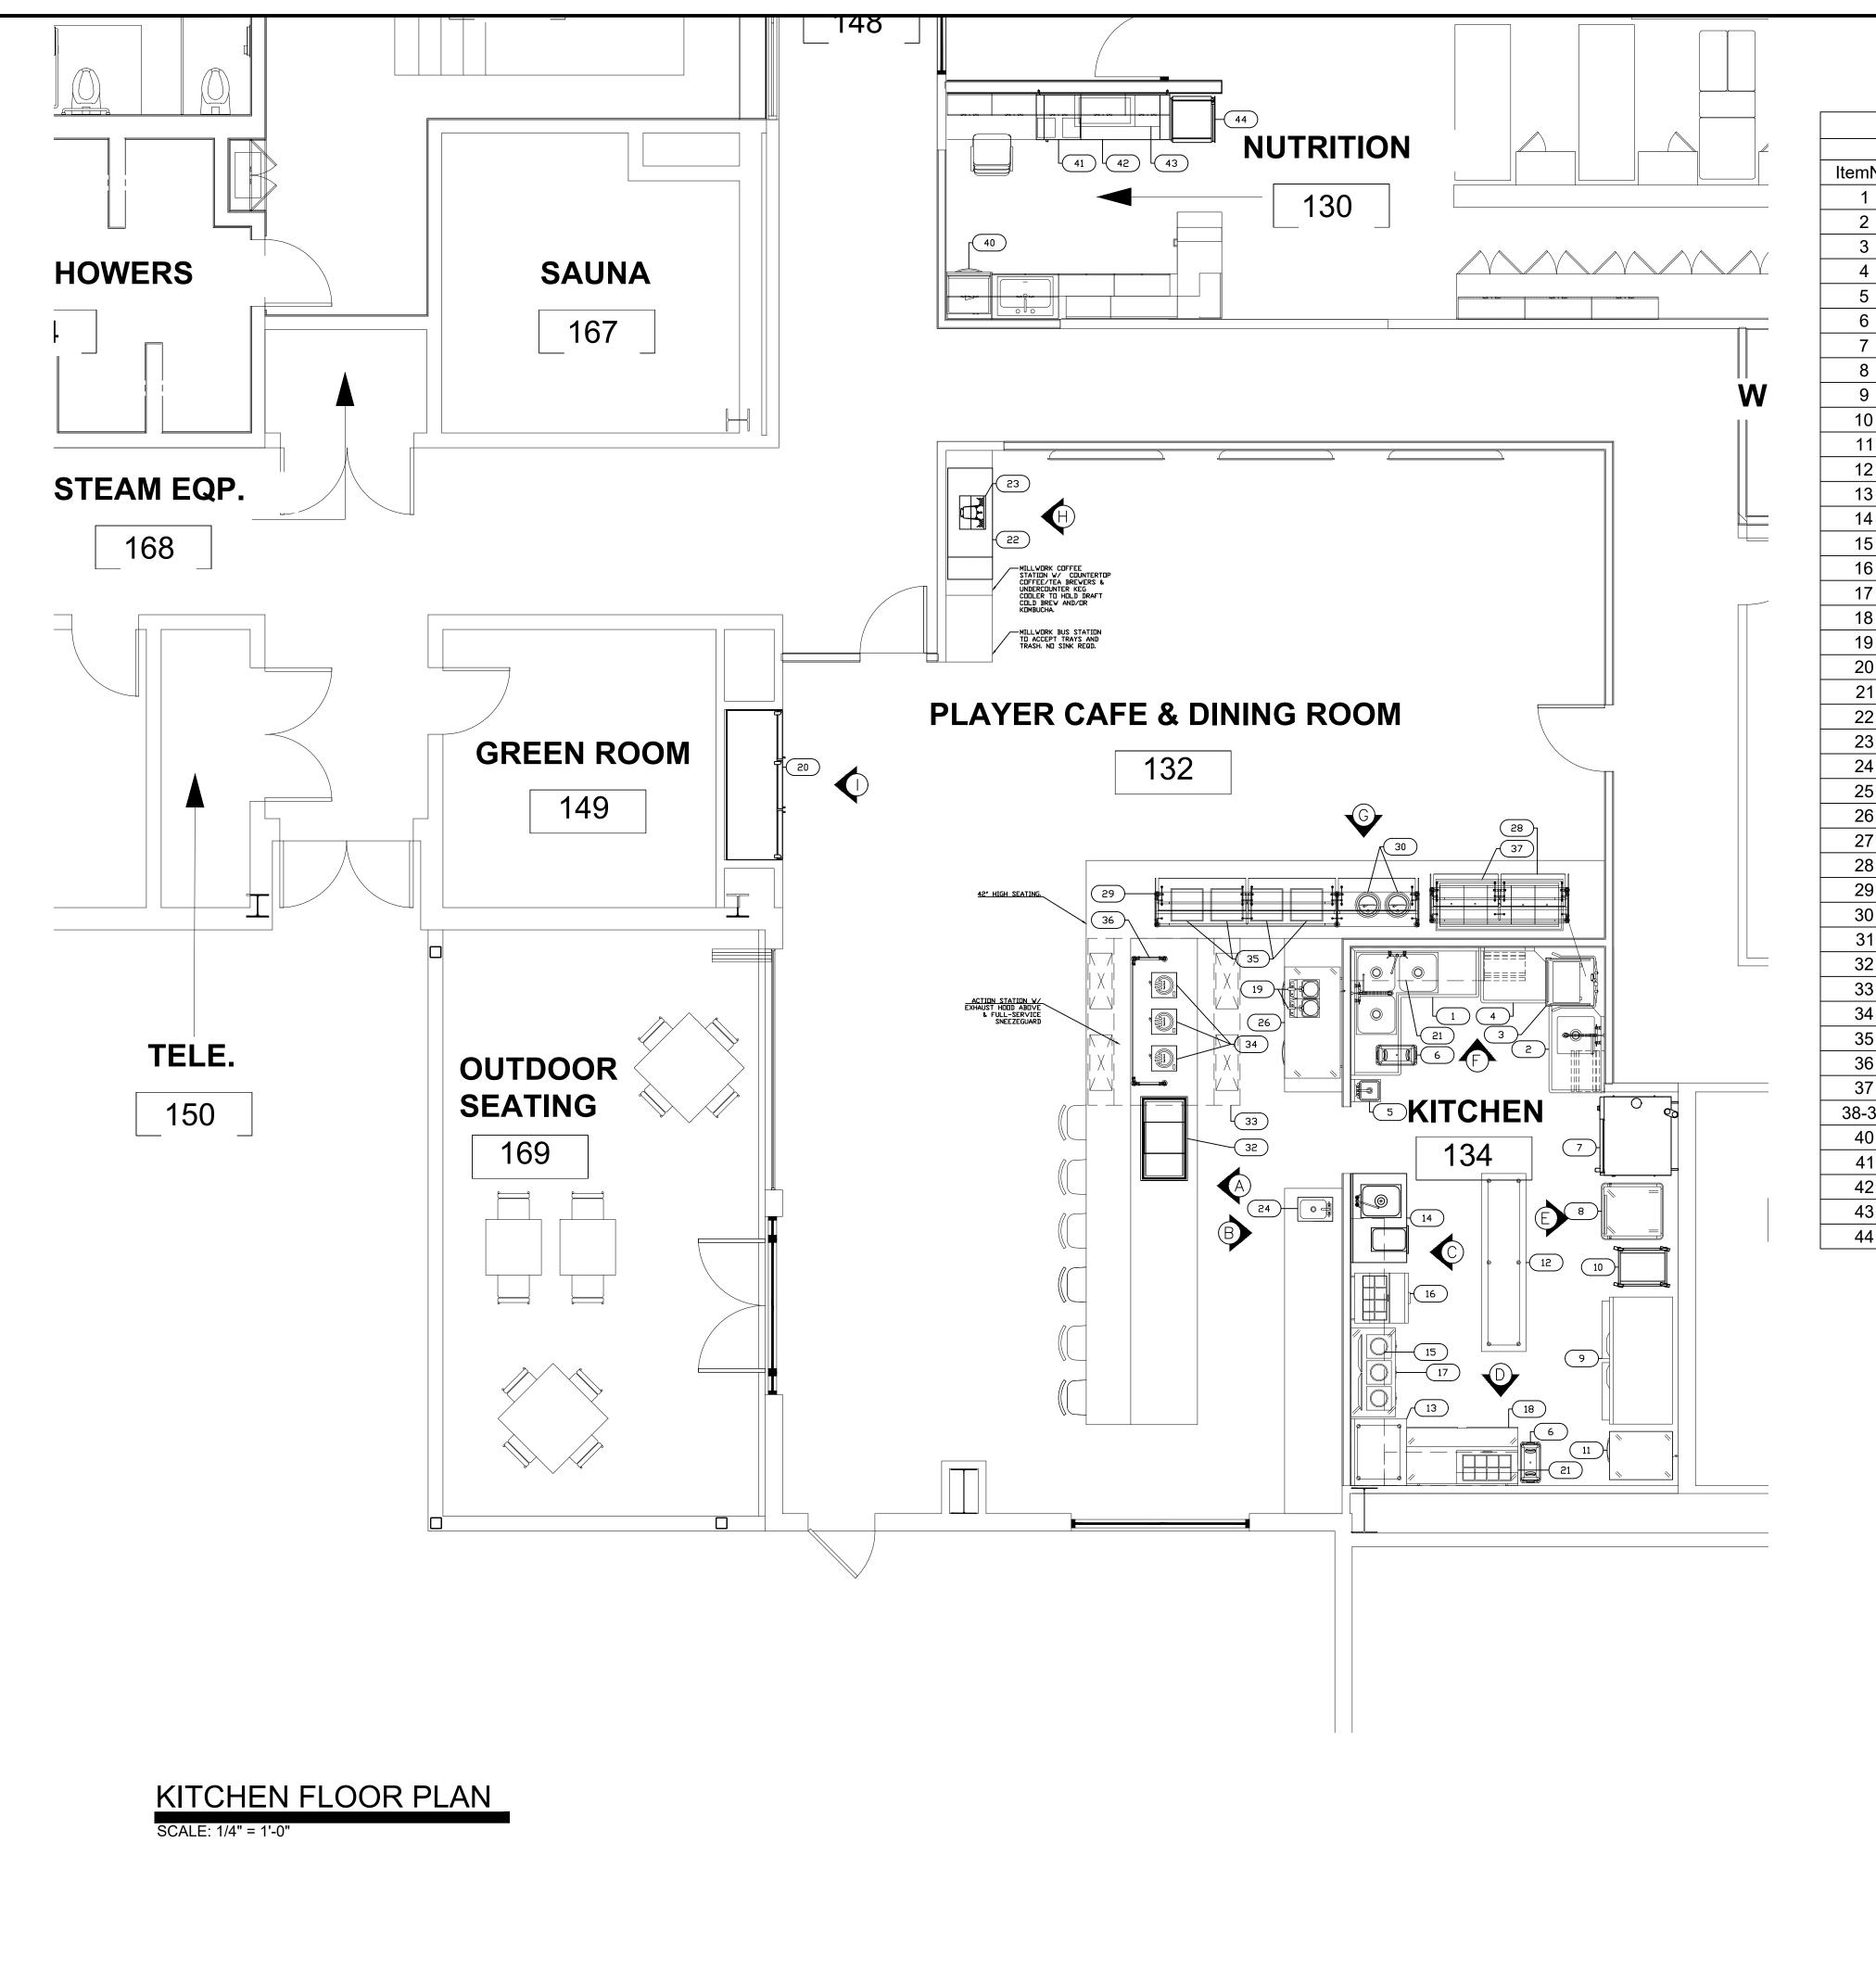

		EQUIT WENT SOFIEDO	·
ItemNo	Quantity	Category	Equipment Remarks
1	1	Corner Sink	W/ Pre-Rinse & Faucet
2	1	Soiled Dishtable	W/ Pre-Rinse & Rack Shelf
3	1	Dishwasher, Door Type	
4	1	Clean Dishtable	W/ Rack Shelf
5	1	Hand Sink	
6	2	Trash Receptacle, Indoor	
7	1	Combi Oven, Electric	Left-Hinged, Door Opens 135 Degrees
8	1	Mobile Heated Cabinet	Existing
9	1	Roll-in Refrigerator	
10	1	Bun Pan Rack	
11	1	Reach-In Freezer	
12	1	Work Table, Stainless Steel Top	
13	1	Work Table, Stainless Steel Top	
14	1	Work Table, with Prep Sink(s)	W/ Drawer
15	1	Shelving, Wall Mounted	Existing
16	1	Refrigerated Counter, Sandwich / Salad Unit	Existing
17	1	Induction Range, Floor Model	Existing
18	1	Refrigerated Counter, Sandwich / Salad Unit	Existing
19	2	Waffle Maker	-
20	1	Refrigerated Merchandiser	
21	2	Shelving, Wall Mounted	
22	1	Back Bar Cabinet, Refrigerated	
23	1	Draft Coffee/ Kombucha Dispensing Tower	
24	1	Drop-In Sink	
25		Spare Number	
26	1	Undercounter Refrigerator	
27		Spare Number	
28	1	Sneeze Guard, Stationary	
29	1	Sneeze Guard, Stationary	
30	2	Induction Rethermalizer, Built-In / Drop-In	
31		Spare Number	
32	1	Hot / Cold Shelf	
33	1	Exhaust Hood	
34	3	Induction Range, Built-In / Drop-In	
35	4	Induction Range, Built-In / Drop-In	
36	1	Sneeze Guard, Stationary	
37	1	Cold Food Well Unit, Drop-In, Refrigerated	
38-39	-	Spare Number	
40	1	Undercounter Dishwasher	Existing
41	1	Glass Froster	<u> </u>
42	1	Back Bar Cabinet, Refrigerated	
43	1	Refrigerated Rail	
44	1	Refrigerated Merchandiser	


EQUIPMENT SCHEDULE

General Foodservice Notes

- Condensing Unit Locations and Exhaust Fan Locations TBD.
 Any Equipment to be Roof—Mounted will be Placed by G/C.
- 2. Required Roof/Wall Penetrations and Sealing of Same by G/C
- 3. Final Connections by Appropriate Trades
- 4. Exhaust Hoods Provided by Owner & Hung by Mechanical Contractor. M/C to Test and Balance Exhaust System in Conjunction with HVAC System.
- 5. Refrigeration System for Walk—in Cooler, Walk—in Freezer, & Ice Maker to be Provided and Installed by FSEC. All Reqd. Electrical, Including Control Wiring, by Electrical Contractor.

			3
RE۱	/ISIONS:		3
0.	DATE	REMARKS	
1	2.09.24	PRELIMINARY LAYOUT	
2\	2.27.24	REVISED LAYOUT	
3\	3.04.24	REVISED LAYOUT	
4	3.08.24	ROUGH IN DRAWINGS	
5	3.15.24	REV. ROUGH IN DRAWINGS	
6	4.17.24	EQUIPMENT ADDED	
$\overline{}$			
\triangle			
$\overline{\ }$			3
$\overline{\ }$			
			F 1







DRAWING TITLE:


FOOD SERVICE

FQUIPMENT

FLOOR PLAN

DRAWING NO.



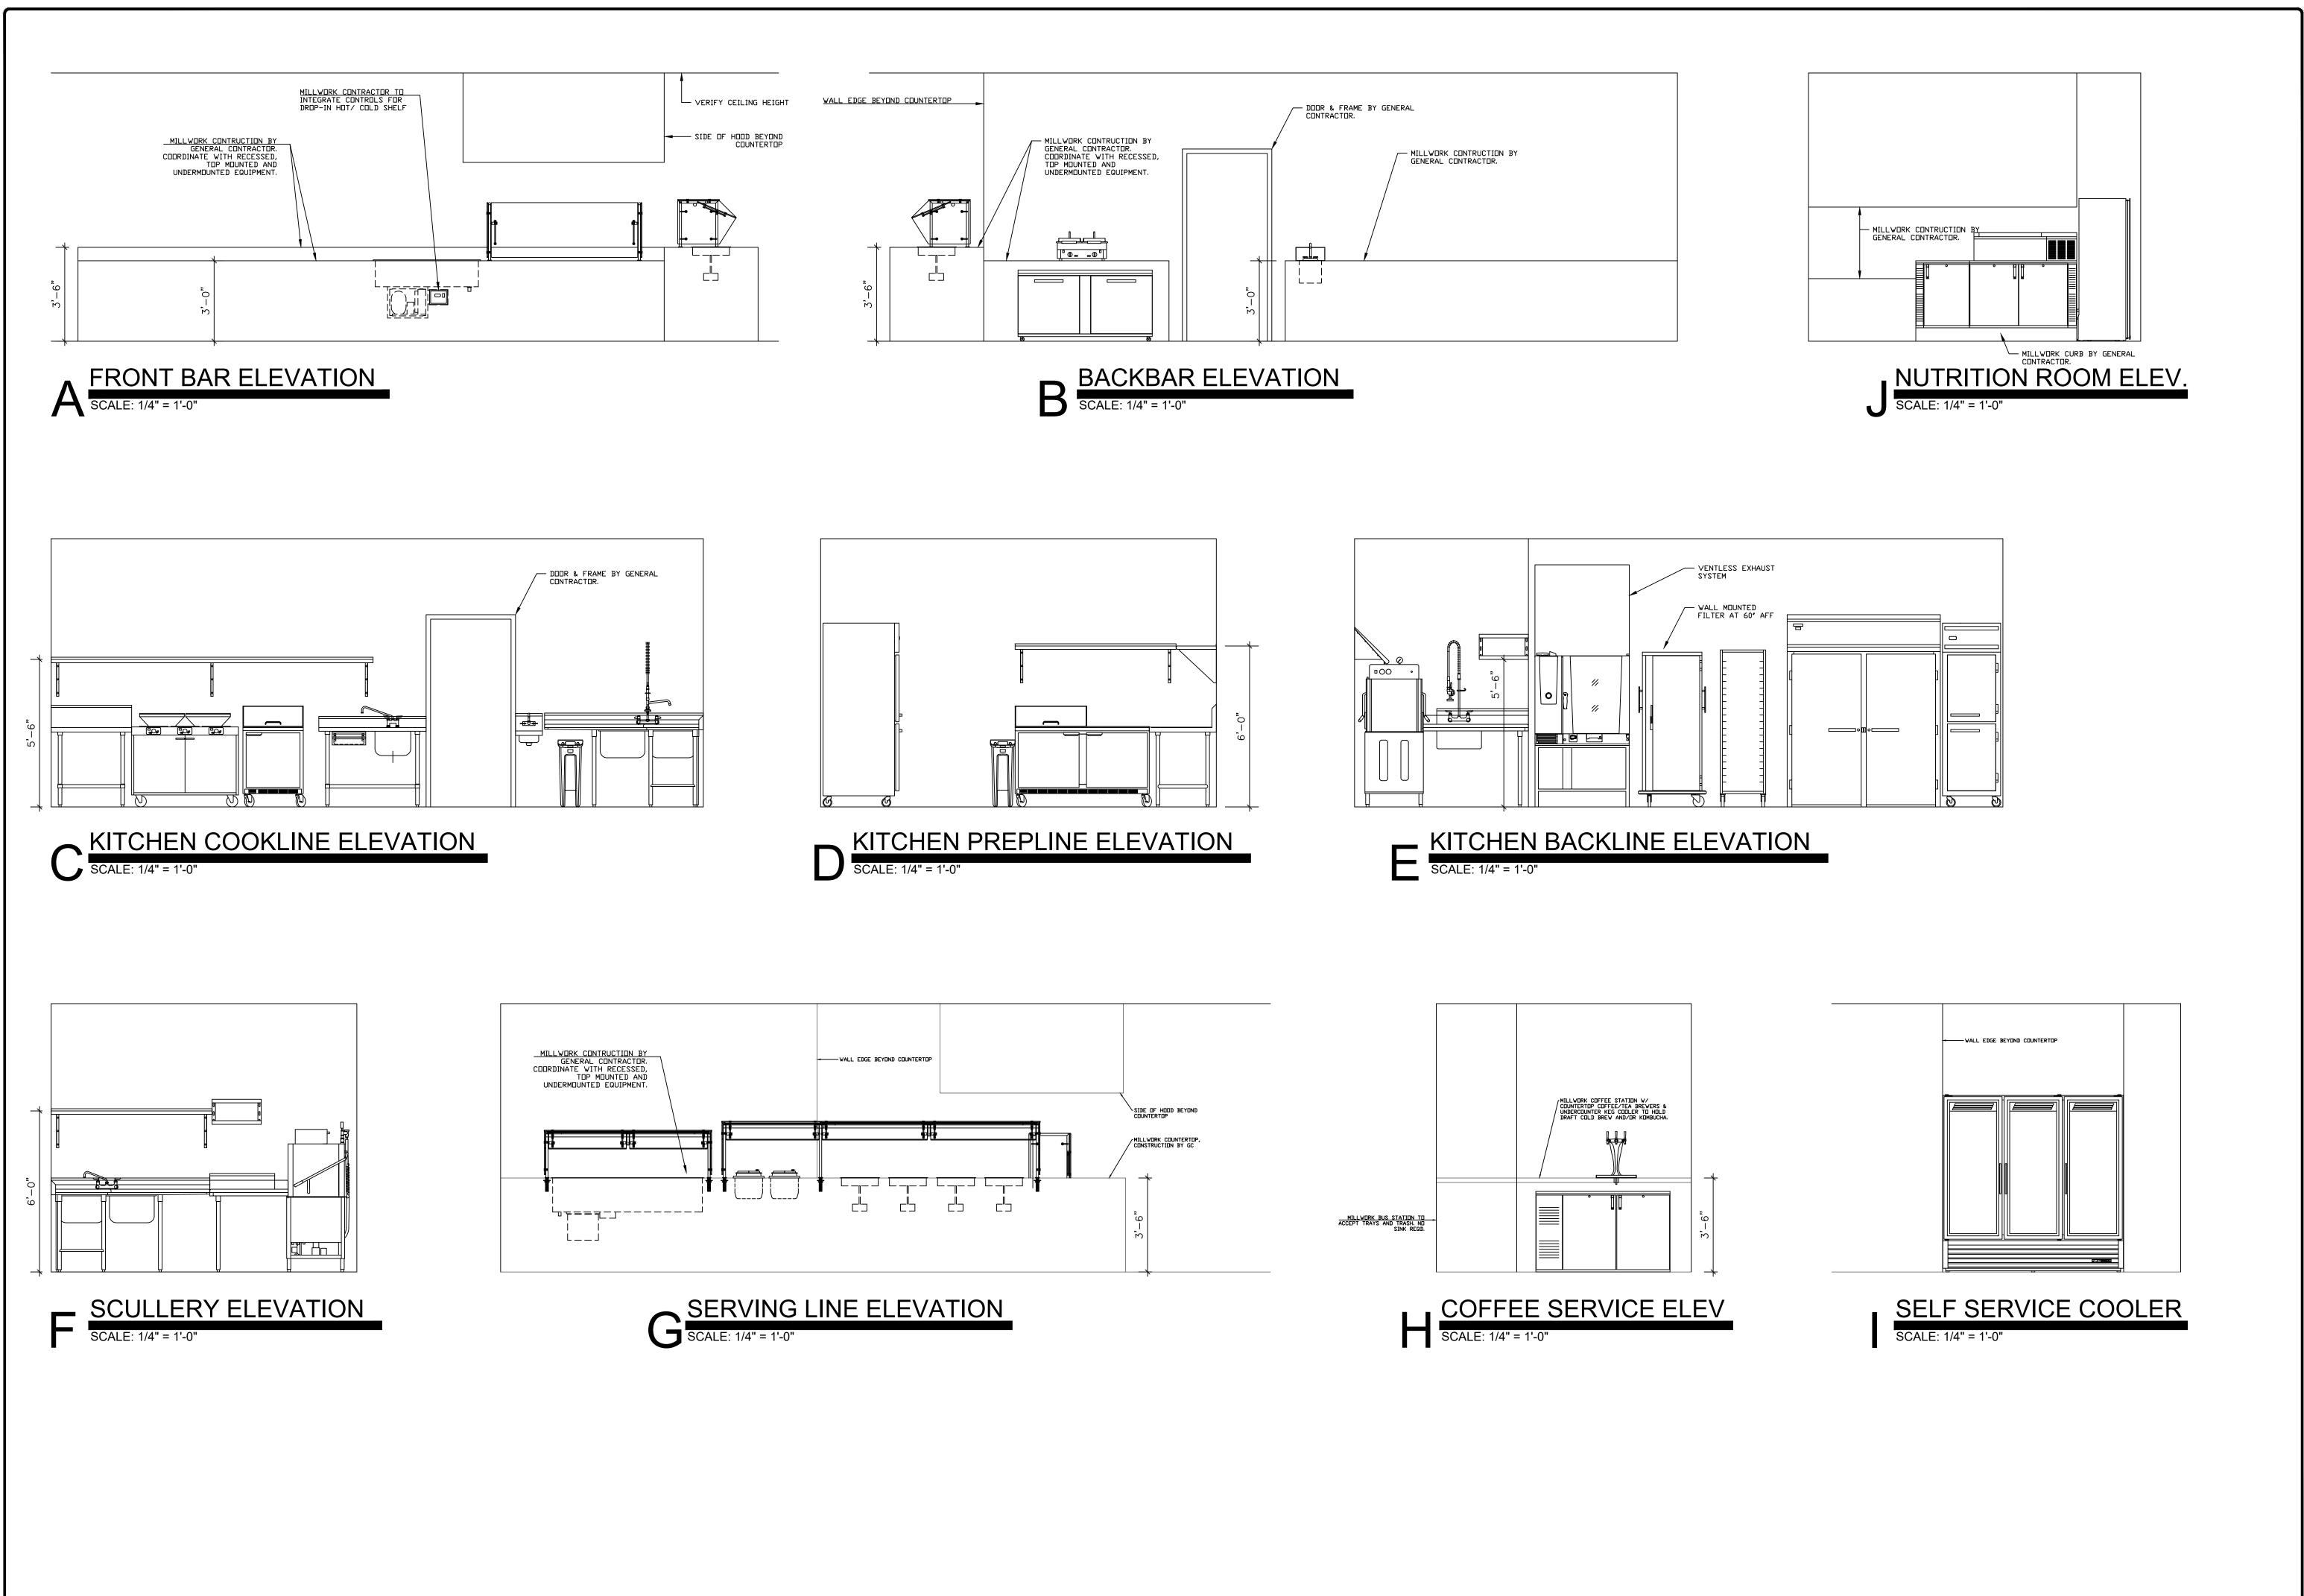




FOOD SERVICE EQUIPMENT ELEVATIONS

DRAWING NO.

SHEET 2 OF 5

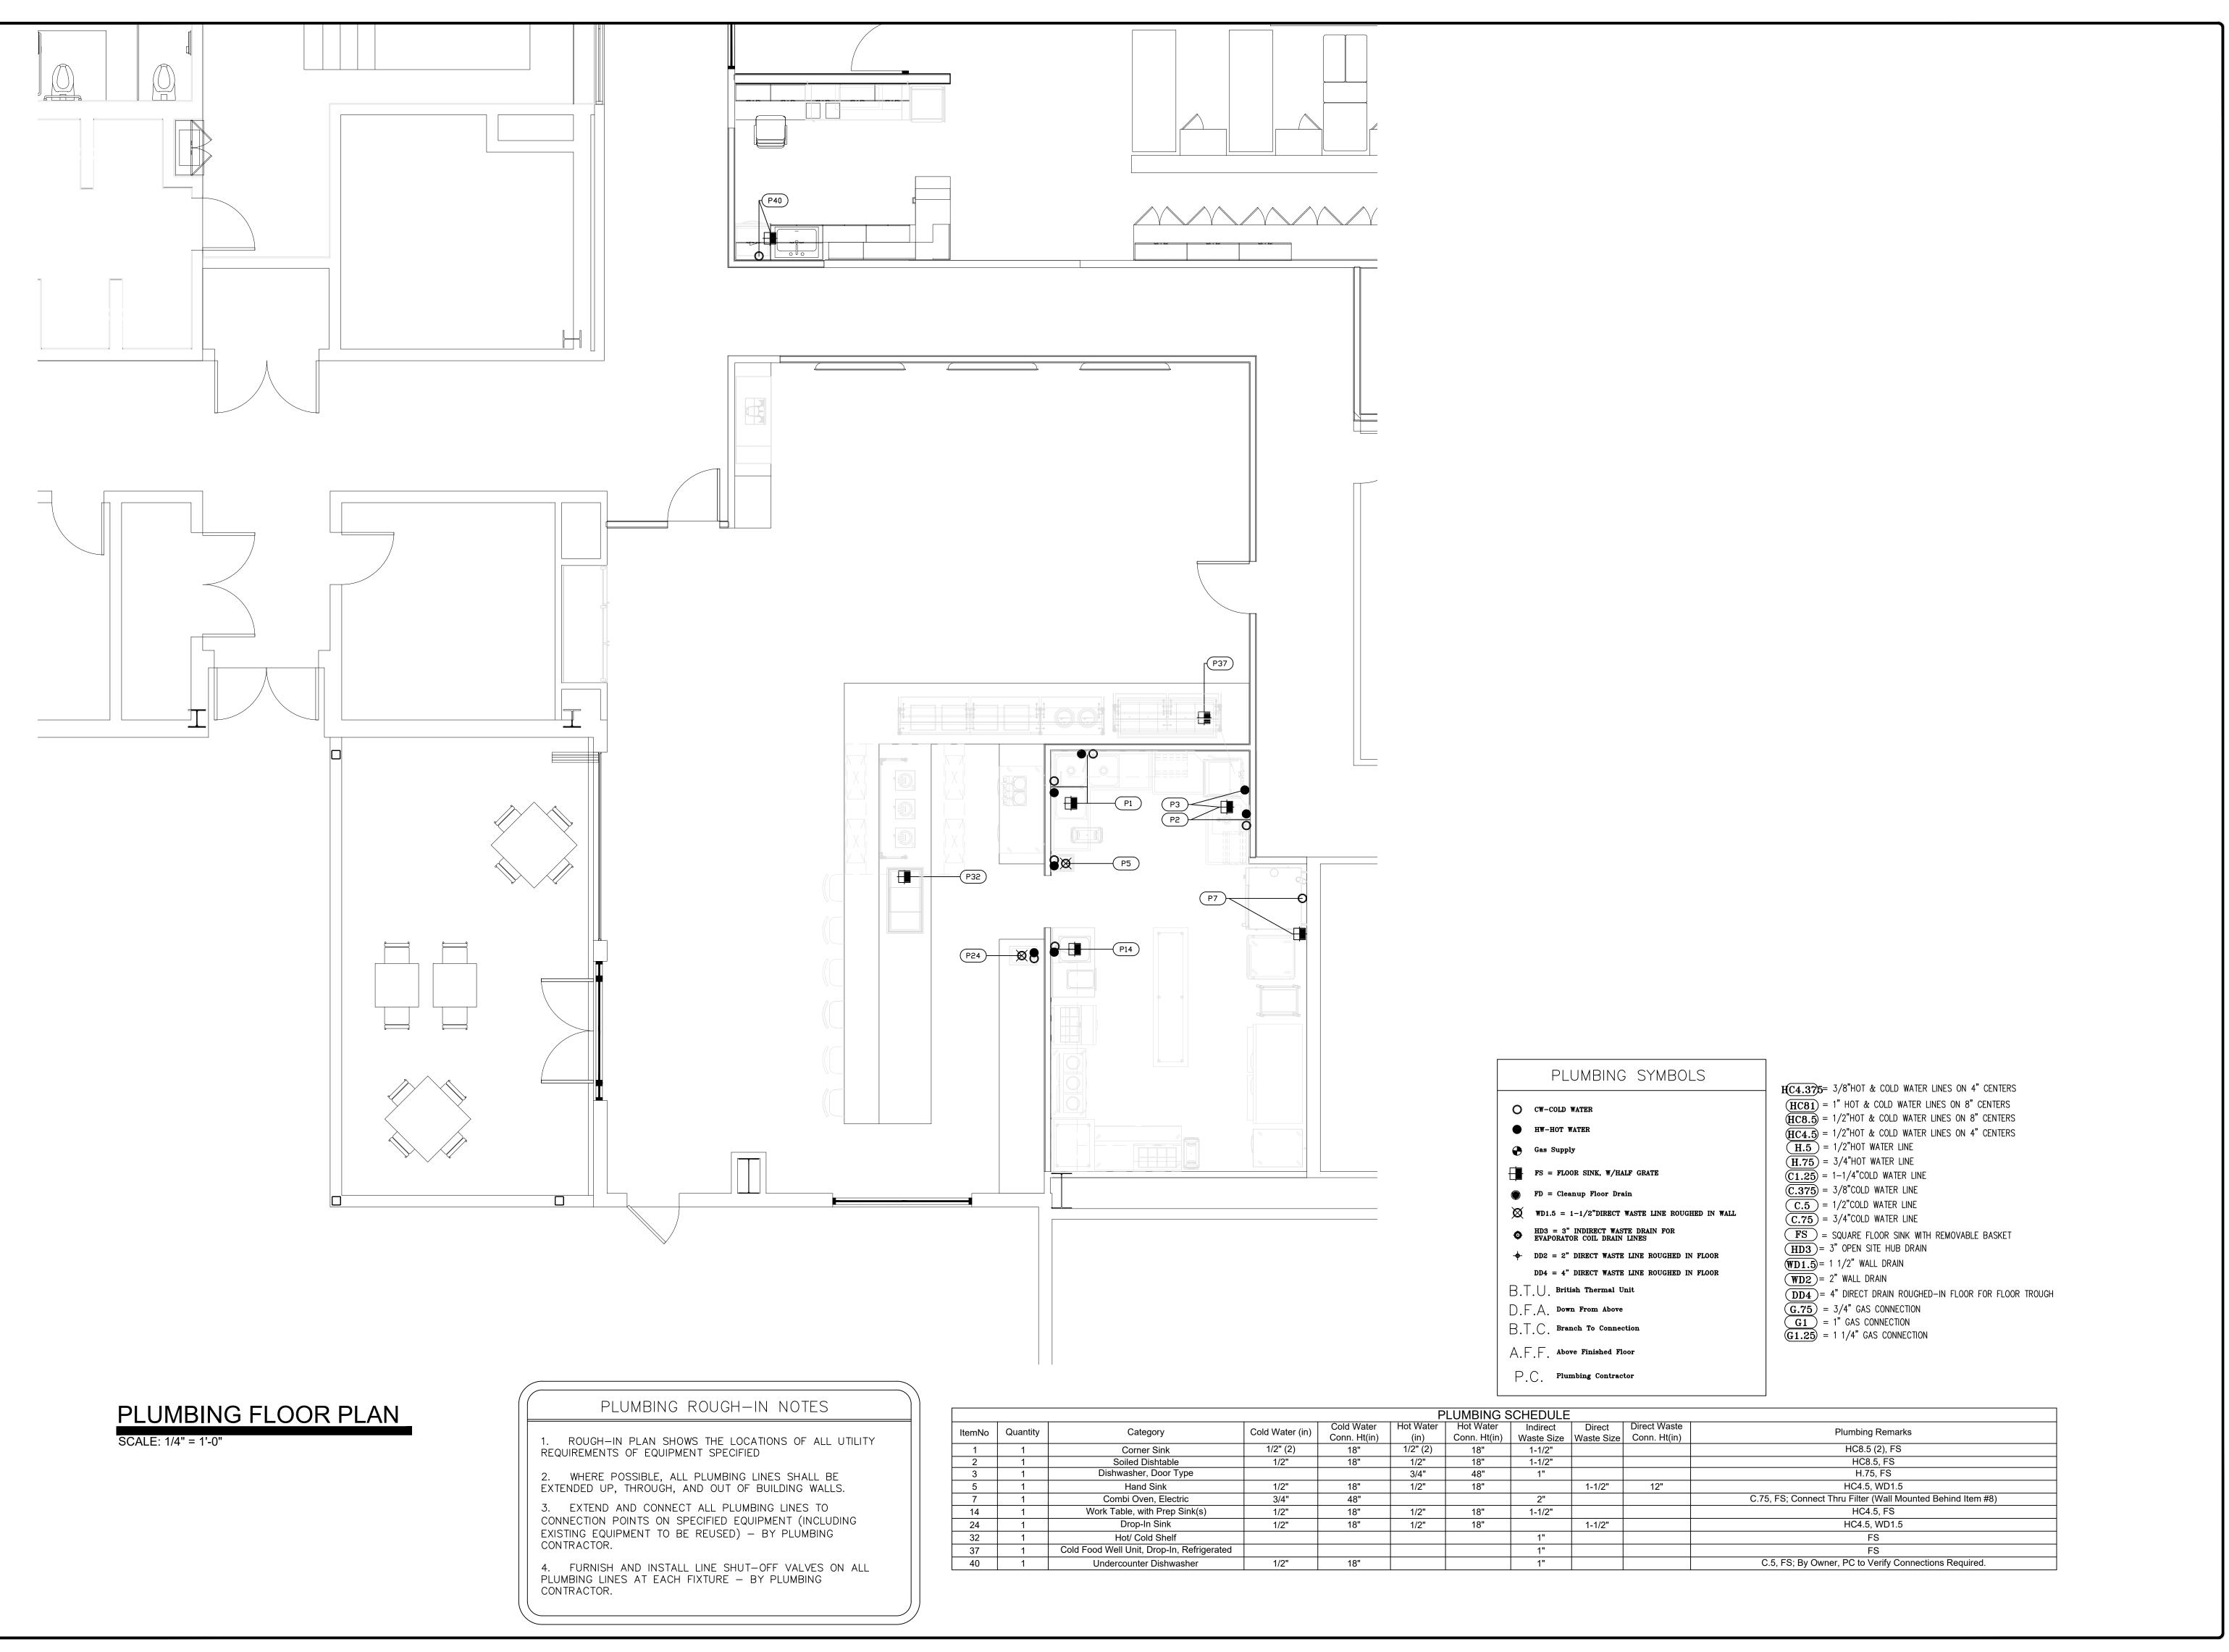

UNILEANS

LICANIS

NEW ORLE




Associated Food Equipment & Supplies

FOOD SERVICE
PLUMBING
FLOOR PLAN

R. BY: J.M.
K. BY M.W.
ATE: APR 17, 2024

DRAWING NO.

SHEET 3 OF 5

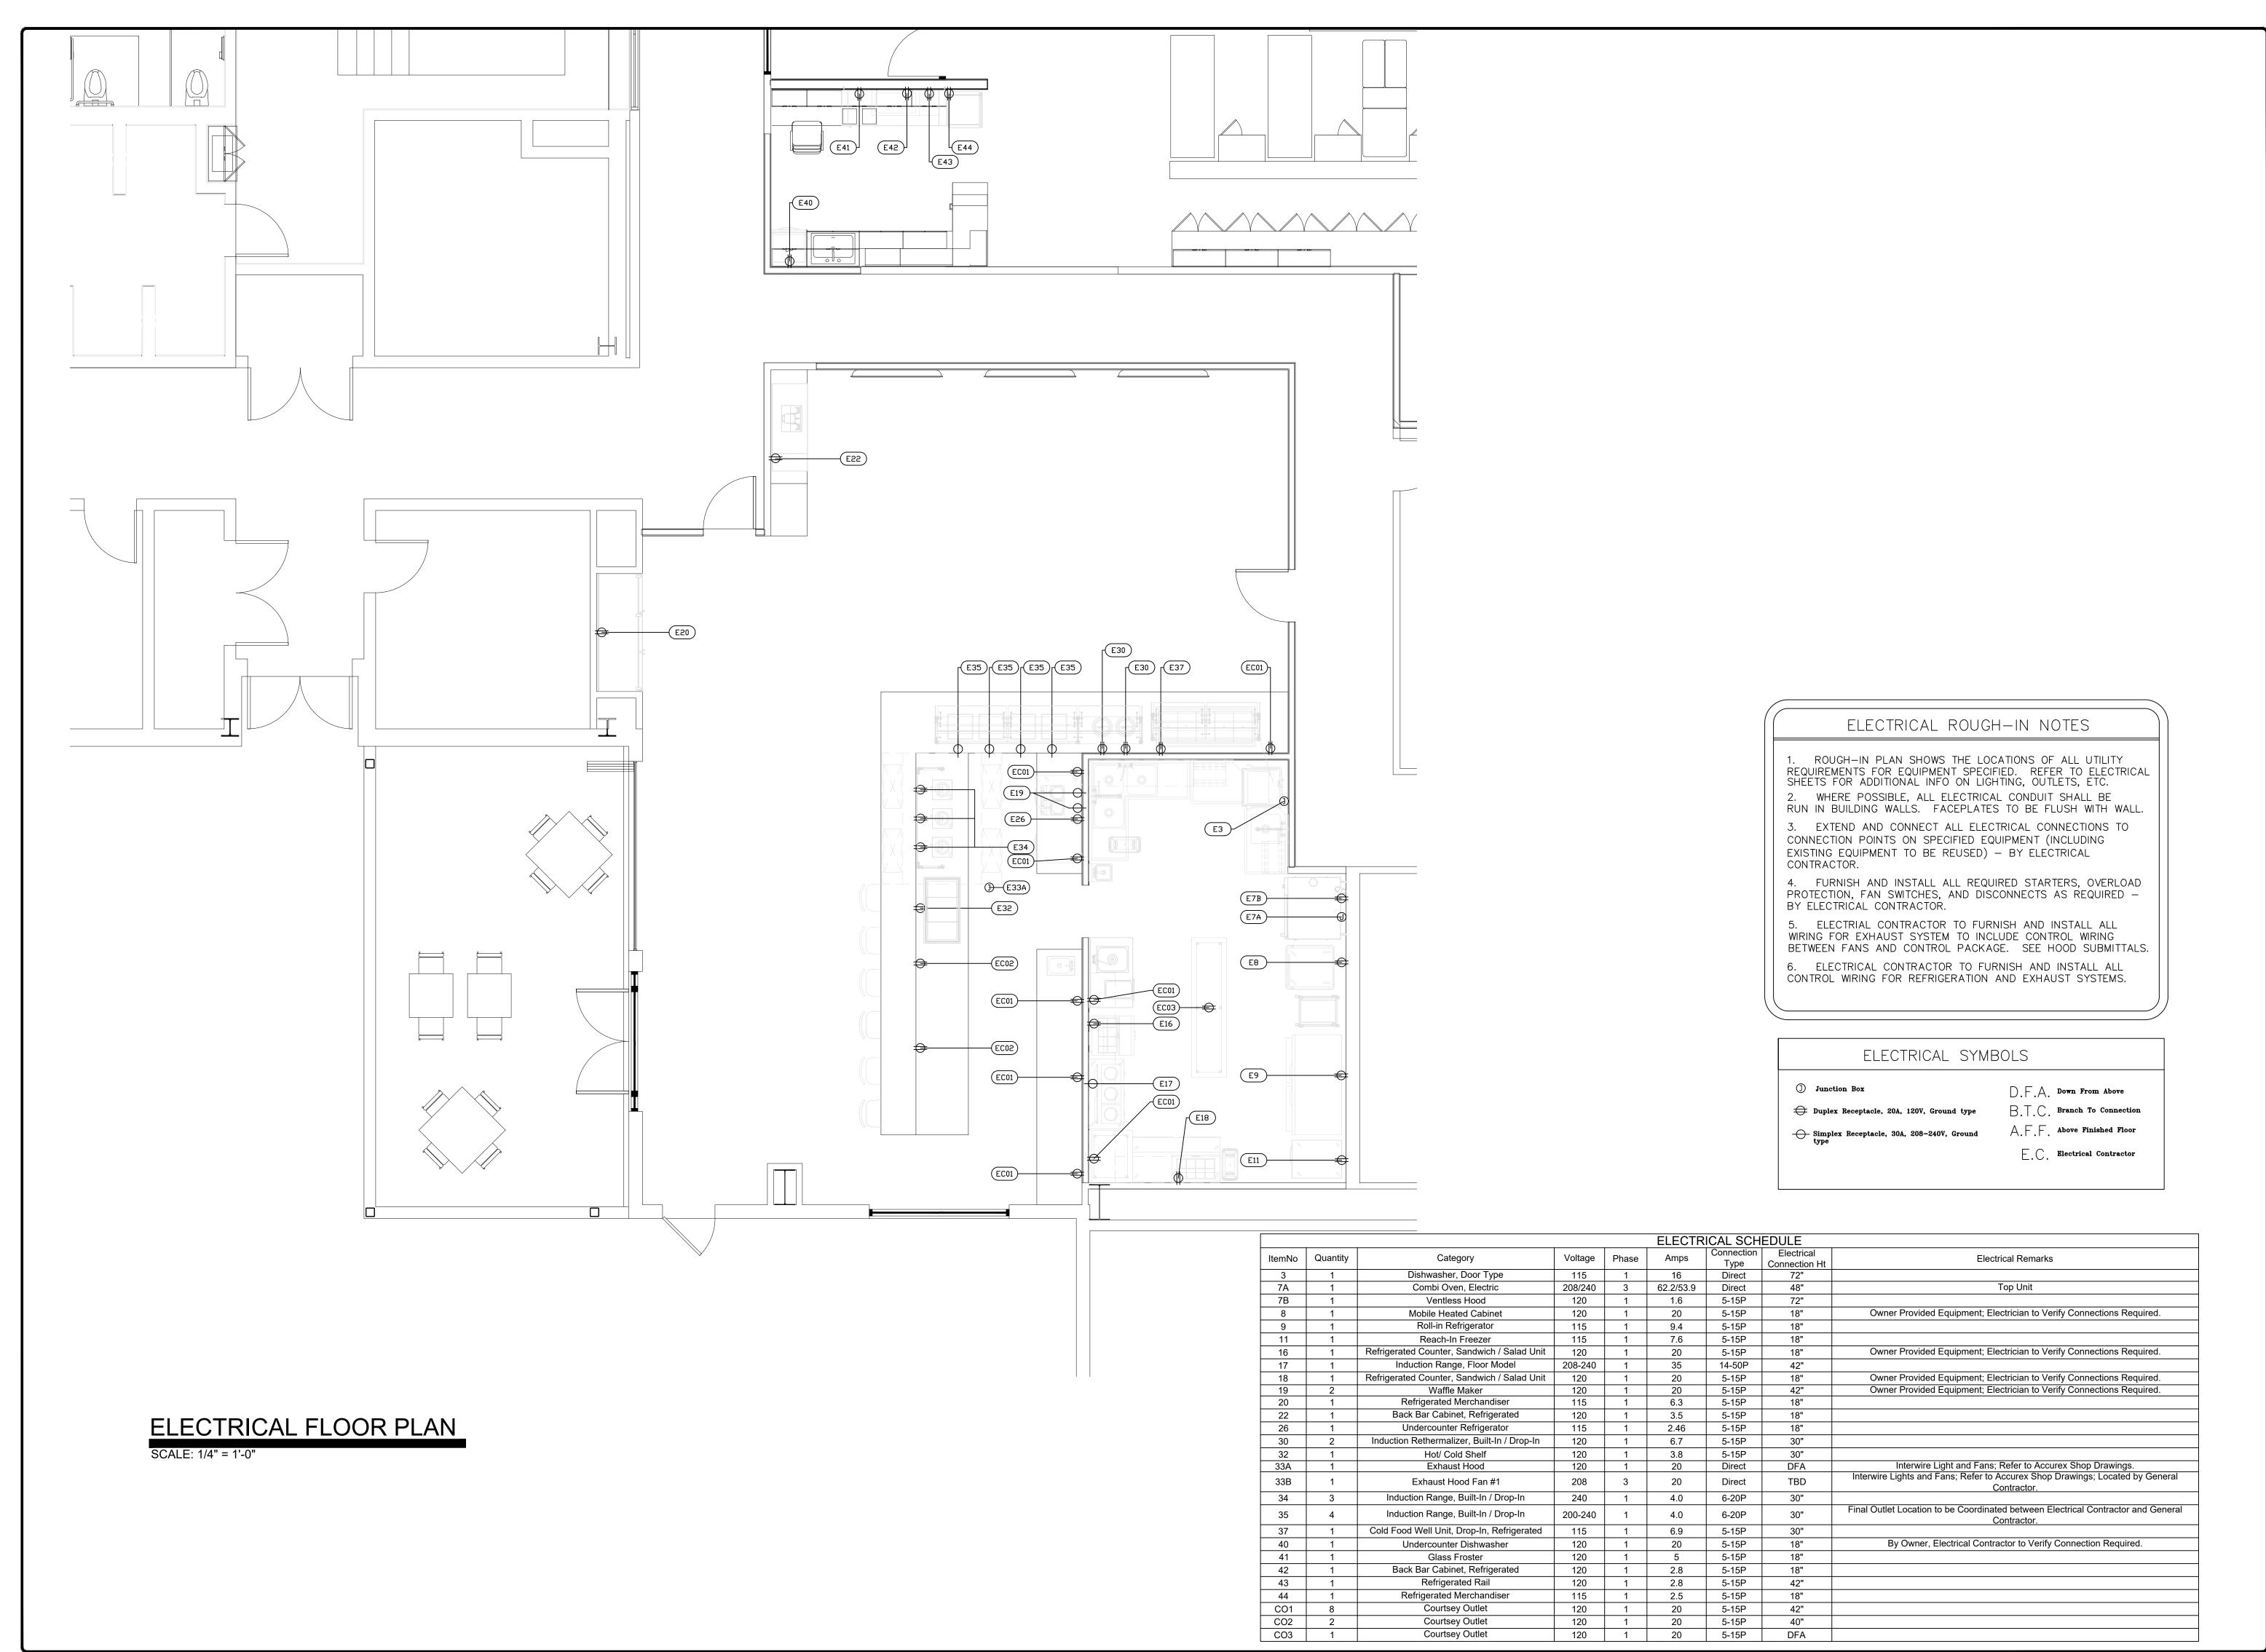








FOOD SERVICE
ELECTRICAL
FLOOR PLAN

DR. BY: J.M.
CK. BY M.W.
DATE: APR 17 2024

DRAWING NO.

FS-4

SHEET 4 OF 5

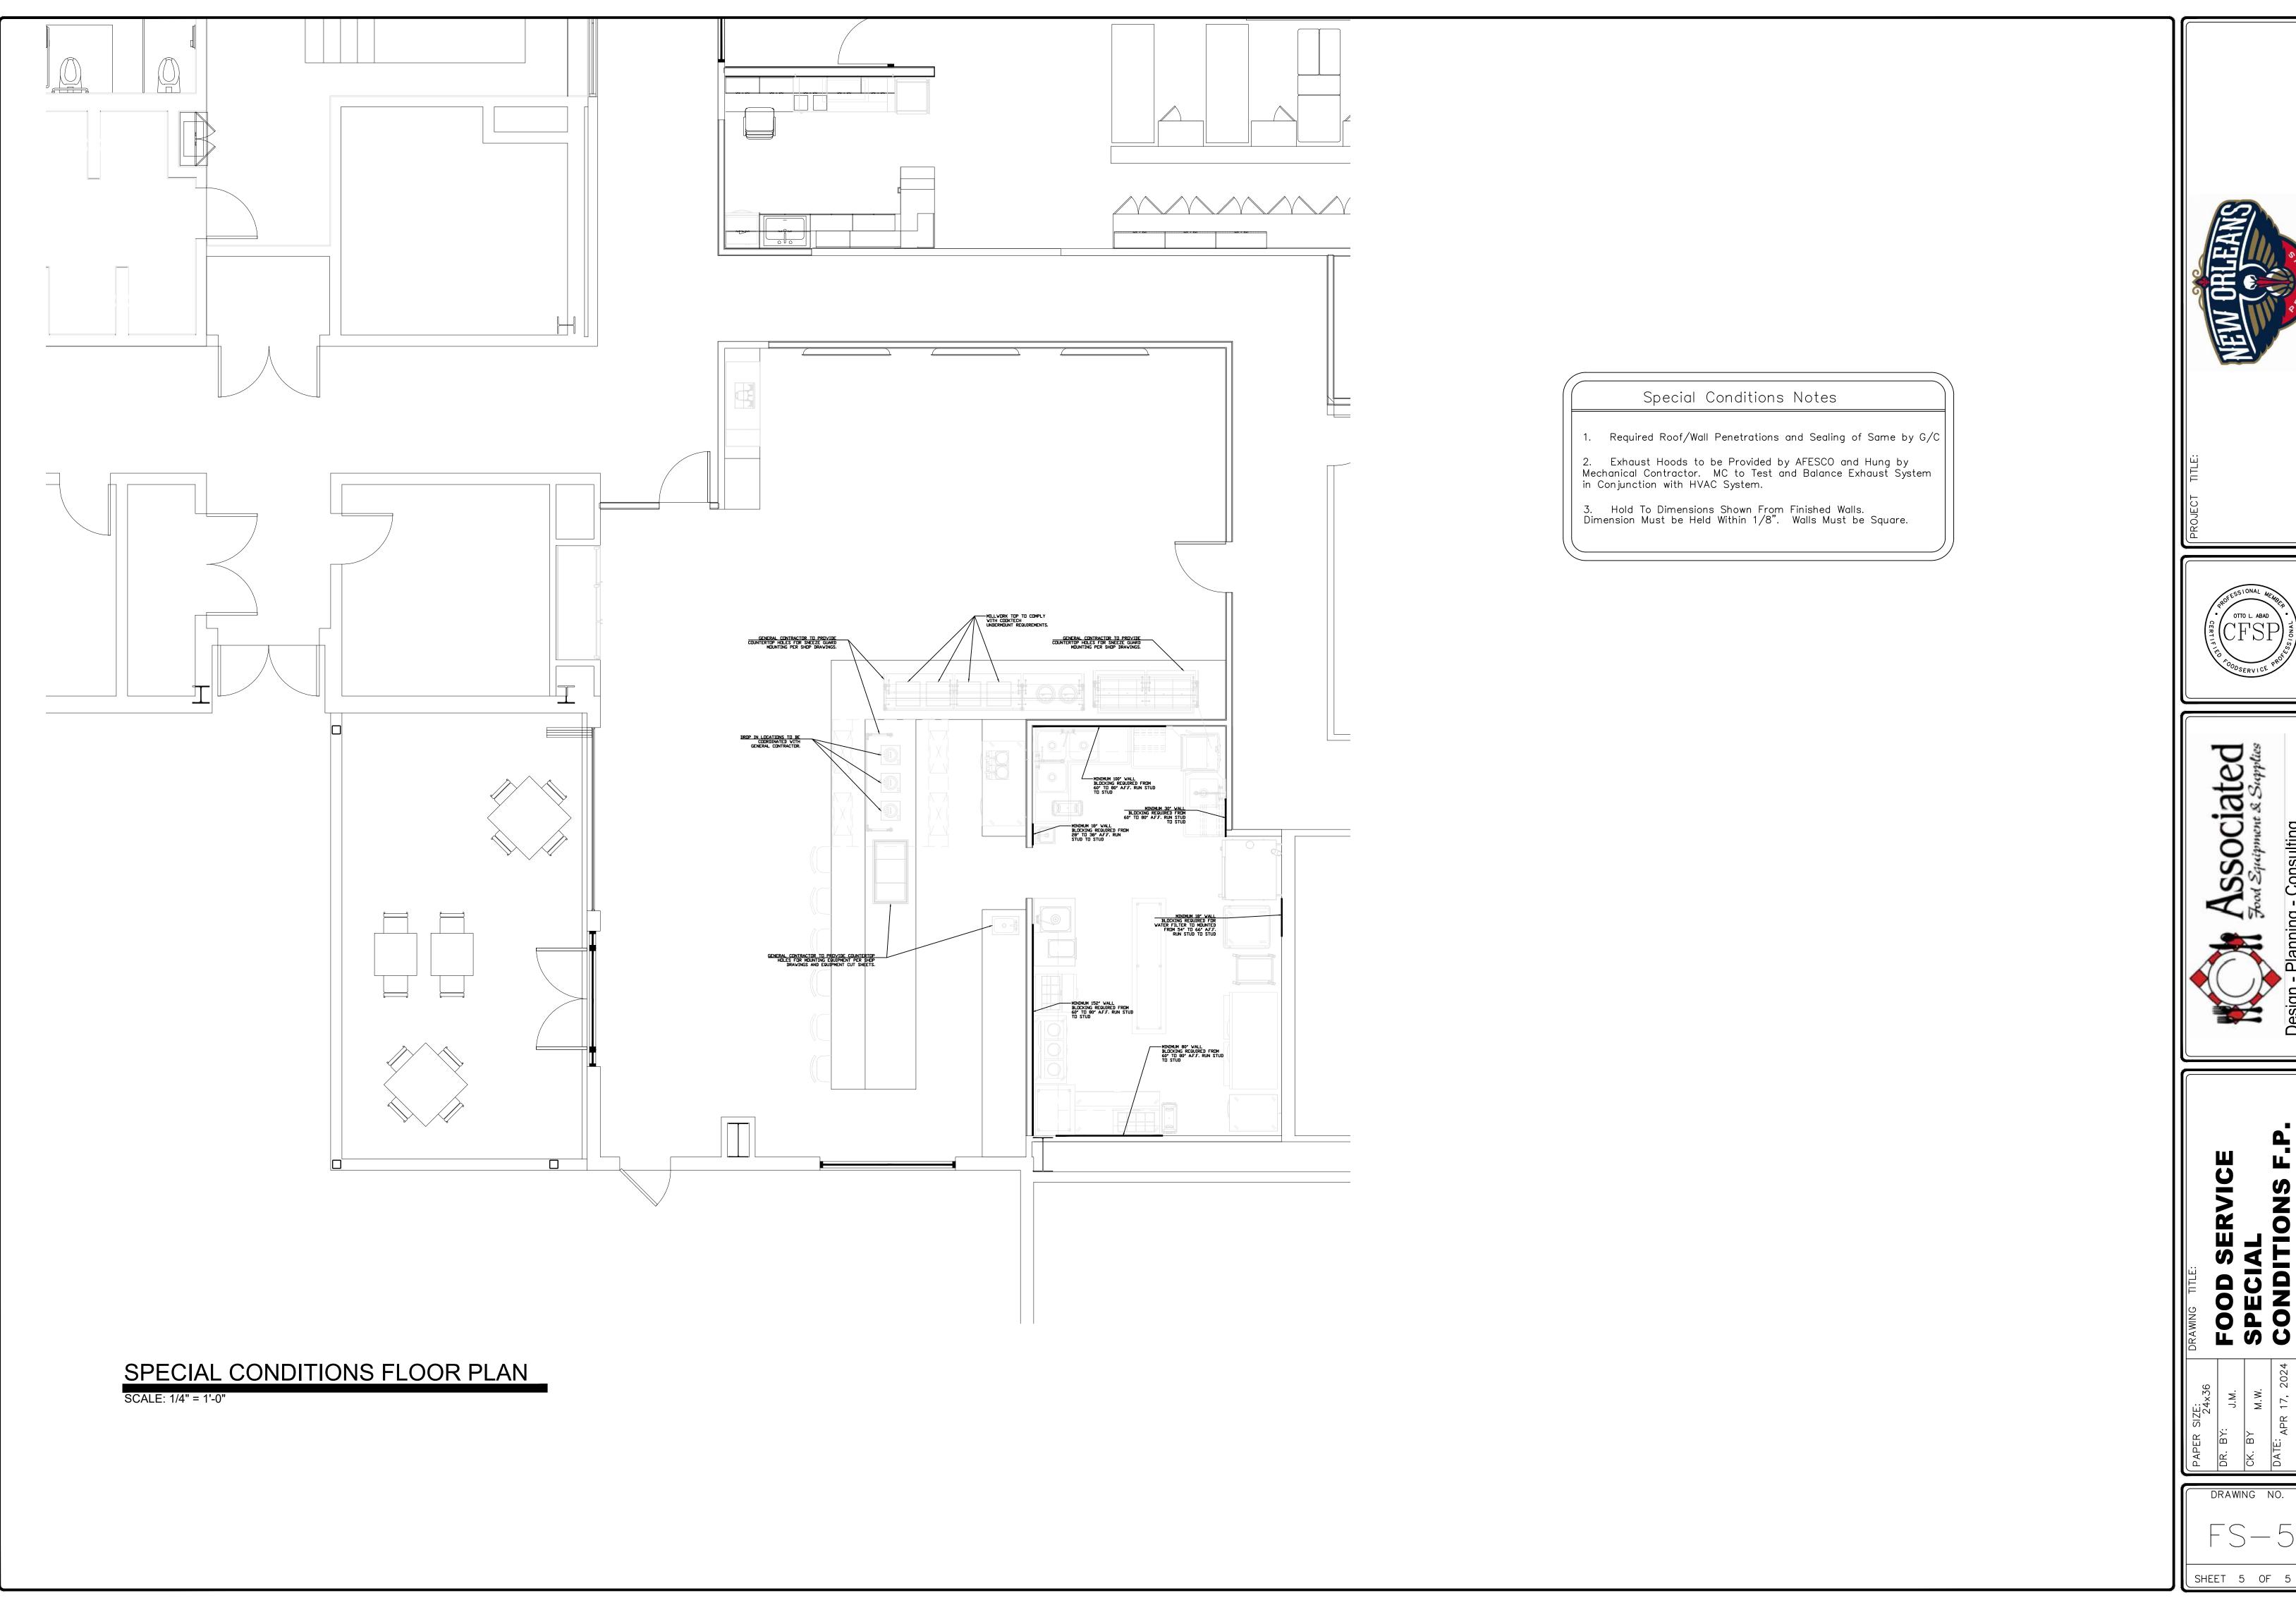







FOOD SERVICE SPECIAL CONDITIONS F.F

DRAWING NO.

Submittal Drawings Cover Page

All of Premier Metal & Glass' (PMG) projects are custom manufactured. A customer signature is required on these drawings in order to release this project into production.

This checklist is intended to provide the contractor a guide to ensure proper fit and finish. PMG will manufacture this custom project based on this set of signed drawings. If CAD files of the counters and layout are available, it is always best for the contractor to provide the files to PMG in order to expedite accuracy of the submittal drawings.

It is imperative that the contractor verify the following:

- All dimensions have been verified for proper fit.
- The mounting hardware depicted in this set of submittal drawings is appropriate for the install site field conditions.
- The finish for the metal hardware and tubing is correct.
- If heat strips and/or light fixtures are present on this project, the components' electrical requirements and wire chase locations have been verified.
- Contractor understands that projects involving electrical components will be shipped assembled where possible and all others will be shipped knocked down. The contractor needs to convey to PMG which option will work best for this particular installation.


PMG's default design for food shields complies with **NSF/ANSI 2-2014** unless otherwise directed by the contractor. Local codes, which are determined by the local Authority Having Jurisdiction where the food shield is to be installed, will have the final determination of code compliance. It is the contractor's responsibility to ensure compliance to the codes set by the local Authority Having Jurisdiction and PMG assumes contractor has performed due diligence to ensure local code compliance of the food shield.




ITEM #30A - (1 REQD.) ENTIRE UNIT TO HAVE BRUSHED STAINLESS FINISH UNIT TO BE SHIPPED ASSEMBLED 3/8" CLEAR TEMP GLASS 3/8" CLEAR TEMP END PANELS

MODEL REMOTE CONTROL 134-144" | 120-277 | 43.17 0.36 UNIVERSAL

LIGHT - LED w/ DRIVER

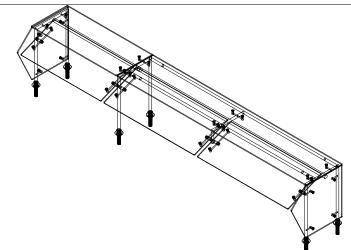


140"

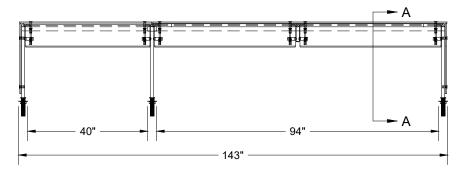

ELEVATION VIEW

SCALE 3/8" = 1'

DAISY CHAIN: WIRE CHASE LIGHT - 43" + 97"

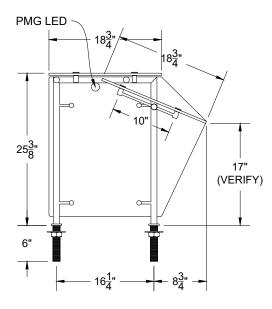

SECTION A-A SCALE 3/4" = 1'-0"

WWW.PMG-INC.COM 800-251-5800 | 800-251-2515 1835 MacArthur Blvd. N.W. Atlanta, GA 30318

© 2023 PMG Ventures, Inc.



SAINT PELICANS **KITCHEN**

ASSOCIATED FOOD **EQUIPMENT & SUPPLIES**

TM2N-A-EXT

PLAN, ELEVATION, ISO

FINISH: **BRUSHED STAINLESS**


DATE	3/6/2024	TOL:	± 1/16"
SHEET	2 OF 7	DWR	CASEY

PR	OJ#	F	ASFOE	QSU.	5249	91
DATE	-	contained	ding ection		Date	ntial and not to
ВУ	-	information	eon, superce ensuring insp	Resubmit As Noted	_	Inc. It is confide
SNO		ed prior to fabrication. The information contained	original appearation. They will pecifications contained hereon, superceding aning oode approval and ensuring inspection ibilities of the purchaser.	d As Noted		tual property of PMG Ventures, Inc. It is confidential and not to rty not listed herein.


ITEM #37A - (1 REQD.) ENTIRE UNIT TO HAVE BRUSHED STAINLESS FINISH UNIT TO BE SHIPPED ASSEMBLED 3/8" CLEAR TEMP GLASS 3/8" CLEAR TEMP END PANELS


QTY	MODEL	V	W	Α	REMOTE CONTROL
1	62-74"	120-277	21 58	0.18	LINIVERSAL


LIGHT - LED w/ DRIVER

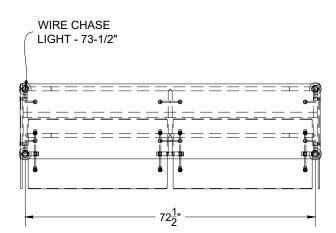

PLAN VIEW SCALE 1/2" = 1'

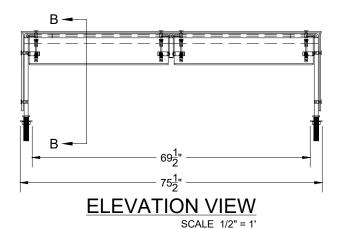





SECTION B-B SCALE 3/4" = 1'-0"

WWW.PMG-INC.COM 800-251-5800 | 800-251-2515 1835 MacArthur Blvd. N.W. Atlanta, GA 30318

© 2023 PMG Ventures, Inc.





SAINT PELICANS **KITCHEN**

ASSOCIATED FOOD **EQUIPMENT &** SUPPLIES

TM2N-A-EXT

PLAN, ELEVATION, ISO


FINISH: **BRUSHED STAINLESS**


- I				
	SHEET	3 OF 7	DWR	CASEY
	DATE	3/6/2024	TOL:	± 1/16"

2491


PR	OJ#	F	۱S	=OI	EQ	SU.	5
DATE	•	contained	ding	ection			
ВУ		rication. The information contained	ontained hereon, superceding	oproval and ensuring inspection		Resubmit As Noted	
		rication. The inform	ontained her	oproval and	urchaser.	Resn	

ITEM #34A - (1 REQD.) ENTIRE UNIT TO HAVE BRUSHED STAINLESS FINISH UNIT TO BE SHIPPED KNOCKED DOWN 3/8" CLEAR TEMP GLASS 3/8" CLEAR TEMP END PANELS




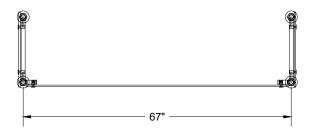

PLAN VIEW SCALE 1/2" = 1'

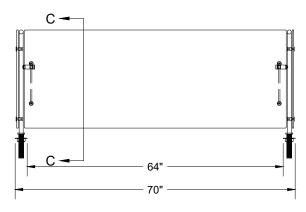

ELEVATION VIEW SCALE 1/2" = 1'



SECTION C-C SCALE 3/4" = 1'-0"

WWW.PMG-INC.COM 800-251-5800 | 800-251-2515 1835 MacArthur Blvd. N.W. Atlanta, GA 30318

© 2023 PMG Ventures, Inc.



SAINT PELICANS **KITCHEN**

ASSOCIATED FOOD **EQUIPMENT & SUPPLIES**

FM1V-A

PLAN, ELEVATION, ISO

FINISH: **BRUSHED STAINLESS**

DA	TE	3/6	6/2024	1	TOL:	± ½	16"
SHE	EET	4 (OF 7		DWR	CAS	SEY
PR	OJ#	,	ASF	OE	QSU.	5249	91
DATE		contained	ding			Date	ntial and not to
ВУ	-	information	reon, superce	ensum g msbe	Resubmit As Noted	_	Inc. It is confider
SNC		ed prior to fabrication. The information contained	original specification. PMG Will becifications contained hereon, superceding initial and opening increasing	allillig code apploval and ensuming inspection bilities of the purchaser	As Noted Resu		ual property of PMG Ventures, Inc. It is confidential and not to ty not listed herein.


Approved

THIS DRAWING WAS LAST MODIFIED ON: 3/6/2024 3:47 PM

THIS DRAWING WAS PRINTED ON: 3/6/2024 3:47 PM

CONSIDERATIONS FOR MOUNTING LOCATIONS AND INSTALLATION

- VERTICAL PARTITIONS MUST EXTEND TO 60" ABOVE THE FINISHED FLOOR.
- 2. SELF-SERVE GUARDS MUST BE MOUNTED SUCH THAT THE LEADING EDGE WILL BE IN FRONT OF FOOD A DISTANCE EQUAL TO 3/4 OF THE SERVICE OPENING. I.E. A 13" OPENING NEEDS TO BE 9-3/4" IN FRONT OF FOOD.
- 3. GUARDS WITHOUT END PANELS MUST BE MOUNTED WITHIN 3" OF A WALL.

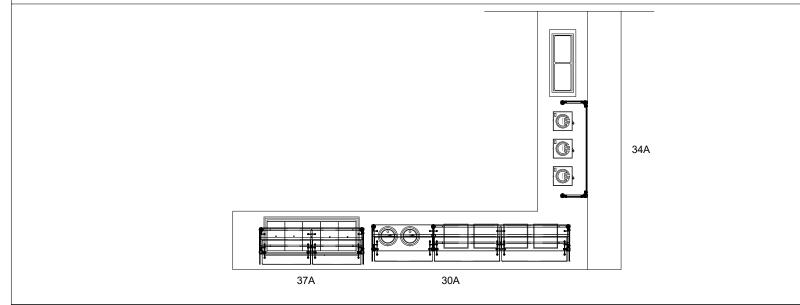



WWW.PMG-INC.COM 800-251-5800 | 800-251-2515 1835 MacArthur Blvd. N.W. Atlanta, GA 30318

© 2023 PMG Ventures, Inc.

**

FOR NSF/UL COMPLIANCE SEE EACH UNIT'S RESPECTIVE DRAWING PAGE

**

SAINT PELICANS KITCHEN

ASSOCIATED FOOD EQUIPMENT & SUPPLIES

COUNTER LAYOUT

FINISH:


BRUSHED STAINLESS

DATE 3/6/2024 TOL: ±½6"

_	SHEET	5 OF 7	DWR	CASEY
	PROJ#	ASEC	FOSU	52491

Servicons of the part of the p

THIS DRAWING WAS LAST MODIFIED ON: 3/6/2024 3:47 PM THIS DRAWING WAS PRINTED ON: 3/6/2024 3:48 PM

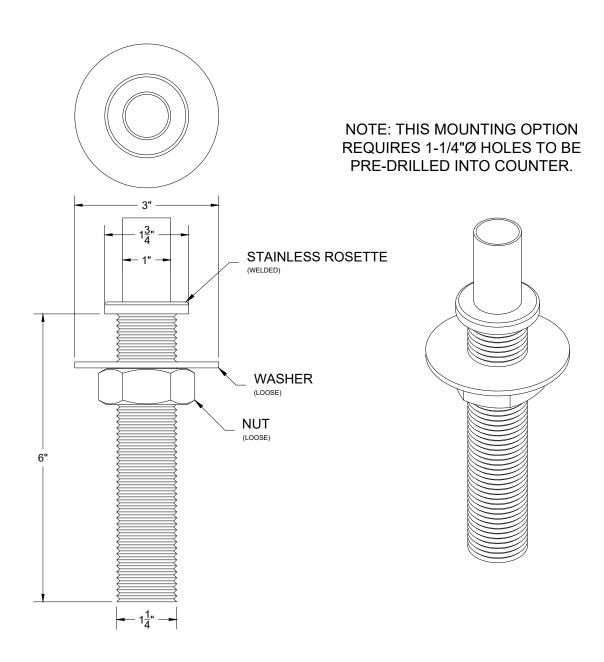

WWW.PMG-INC.COM 800-251-5800 | 800-251-2515 1835 MacArthur Blvd. N.W. Atlanta, GA 30318

© 2023 PMG Ventures, Inc.

FOR NSF/UL COMPLIANCE SEE EACH UNIT'S RESPECTIVE DRAWING PAGE

SAINT PELICANS **KITCHEN**

ASSOCIATED FOOD **EQUIPMENT & SUPPLIES**

223: 1" UNDER **COUNTER MOUNT**

INFO

FINISH: **BRUSHED STAINLESS**


DA	TE	3/6/	2024	ТО	L:	±½	/ 16
SHEET		6 OF 7		DW	R	CASE	
PR	OJ#	Α	SFC	EQS	U.	5249	1
DATE		contained	ding ection			Date	ntial and not to
ВУ	-	ne information or MG will	ereon, superced l ensuring inspe		ubmit As Noted	ū	s, Inc. It is confidential and not to
	DATE 3 19	PROJ#	DATE DATE LOST LOST LOST LOST LOST LOST LOST LOST	SHEET 6 OF 7 PROJ# ASFC	SHEET 6 OF 7 DW PROJ# ASFOEQS	SHEET 6 OF 7 DWR PROJ# ASFOEQSU.	SHEET 6 OF 7 DWR CAS PROJ# ASFOEQSU.5249


onte	ing	cţio	Ш
o uc	ced	sbe	oted
natic	nbe	Ϊ	ž
Jorr	ĭ, ∝	suri	Resubmit As Noted
je E	MG 8	en	uqn
F	- 호	anc šer.	Res
ation	atior	oval	
rior to fabrication. The information conta	ginal specification. PMG will fications contained hereon, superceding	ng code approval and ensuring inspection ies of the purchaser.	
o fa	spe	de s	В
iort	inal cati	g cc	s Noted
1 =	ᅈᄪ	~ w	10

223: TYPICALLY FOR WOOD / METAL COUNTERS WHERE COMPRESSION IS ACCEPTABLE. SIMPLY DROP INTO PRE-DRILLED HOLES AND SECURE FROM BELOW. USE A BASIN WRENCH UP TO 1-3/4" TO SECURE NUT WHEN SPACE IS LIMITED.

THIS DRAWING WAS LAST MODIFIED ON: 3/6/2024 3:47 PM

THIS DRAWING WAS PRINTED ON: 3/6/2024 3:48 PM

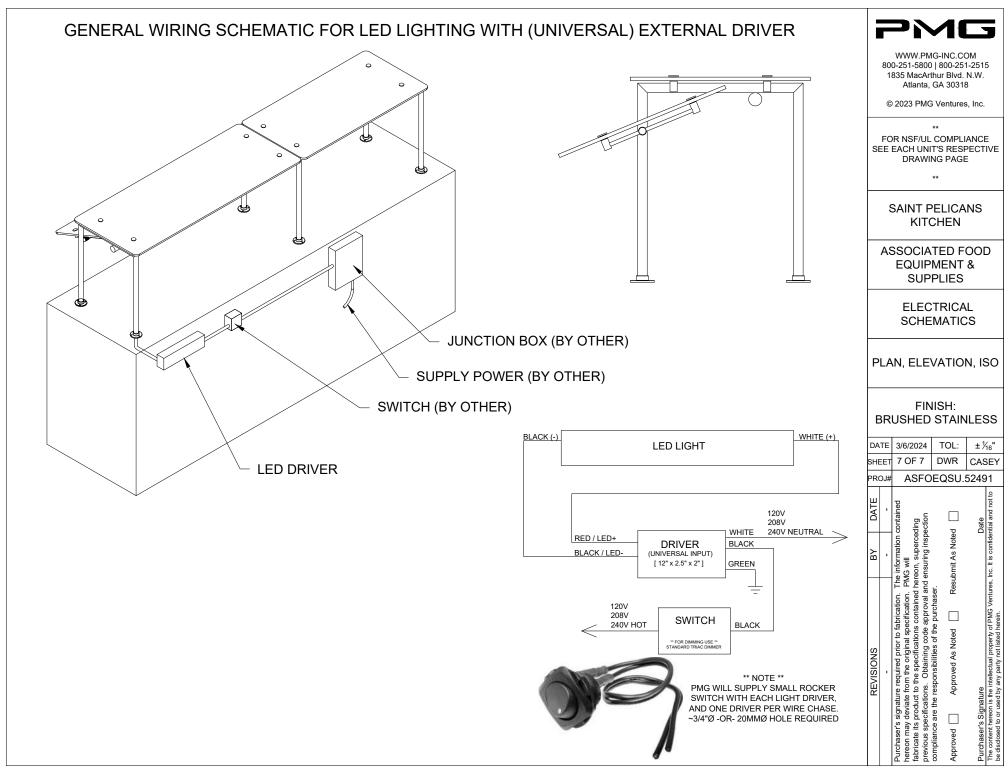


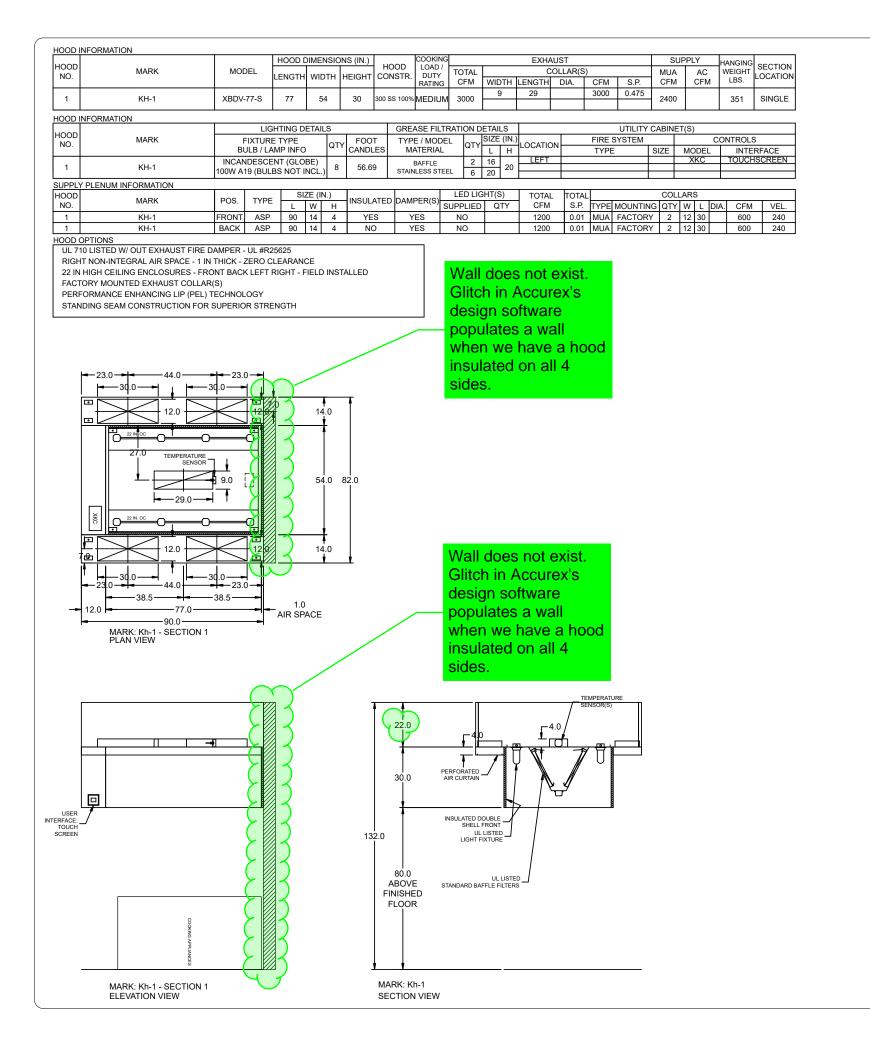


AFESCO Notes in Green

22" HIGH CLOSURE PANELS TO BE PROVIDED ON ALL 4 SIDES OF HOOD


MAKEUP AIR CHANGED TO ELECTRIC HEAT VS NATURAL GAS HEAT



AVAILABLE ON EXHAUST ONLY RECTANGULAR HOOD MODELS ONLY









HOOD HANGING HEIGHT FOR FIRE SYSTEMS

RIFICATION OF HOOD HANGING HEIGHT ABOVE FINISHED FLOOR (A.F.F.) IS REQUIRED FOR CORRECT PLACEMENT OF FIRE SYSTEM NOZZLES.

RECOMMENDED HANGING HEIGHT = 80" FROM FINISHED FLOOR TO LOWER FRONT EDGE OF HO

OTHER HANGING HEIGHT = "FROM FINISHED FLOOR TO LOWER EDGE OF HOOD."







UREX FL PANHANDLE AL MS LA - 1 CHAD LONG CHAD.LONG@ACCUREX.COM (985)290-3160

PELICANS EGG AND SAUTE HOOD ASSOC Belt Drive Upblast Centrifugal Roof Exhaust Fan

	Don	Bolt Bill o Ophilate Continuegai (Con Exhause) and												
[MARK INFORMATION FAN INFORMATION			MOTOR INFORMATION										
	QTY	MARK	MODEL	VOLUME (CFM)	TOTAL EXTERNAL SP (IN WG)		OPERATING POWER (HP)		SIZE (HP)	V/C/P	ENCLOSURE	MOTOR RPM	WINDINGS	NEC FLA*
[1	Kef-1	XCUBE-180-15	3,000	1.3	1,223	1.16	160	1.5	208/60/3	OP	1725	1	6.6

*NEC FLA - Based on table 430.250 or 430.248 of National Electrical Code 2020. Actual motor FLA may vary for sizing thermal overload, consult factory"

Kef-1: SELECTED OPTIONS AND ACCESSORIES	
One piece fully welded windband	
Tapered bushing wheel hub	
Breather tube outlet area min. 4.4 sq. in. (sizes 99-480)	

Min. windband material thickness: 0.051" aluminum (060-240), 0.064" aluminum (240HP, 240XP),

0.080" aluminum (sizes 300-480)

Standard Curb Cap Size - 30 Square

UL/cUL 705 Listed - Supplement SC - "Power Ventilators for Restaurant Exh. Appliances" (Formerly UL 762)

Switch, NEMA-3R, Toggle,

Curb Extension-Galv., VCE-30-G11, Shipped Loose From Factory


Hinge, Factory Installed

High Temp Curb Seal Rated for Continuous Duty at 1500 F (Factory Attached)


Grease Trap (PN 475538)


Heat Baffle (Attached)

Bearings with Grease Fittings, L10 life of 100,000 hrs (L50 avg. life 500,000 hrs)




	DUCT TYPE	SIZE				
	STANDARD	24 SQ				
	FIRE-WRAPPED	16 SQ				







DUCT DIMENSIONS ARE LARGEST POSSIBLE DUCT TO FIT THROUGH CURB. CONSULT SYSTEM DESIGN ENGINEER FOR RECOMMENDED DUCT SIZE.


OVERALL HEIGHT MAY BE GREATER DEPENDING ON MOTOR, ADAPTER, AND/OR HINGE BASE.





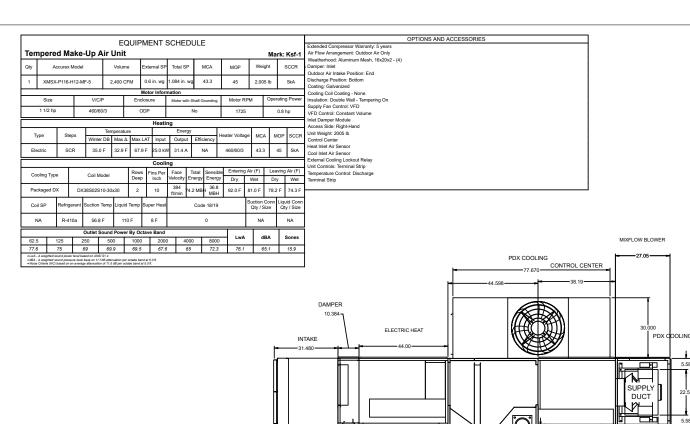

PLAN VIEW

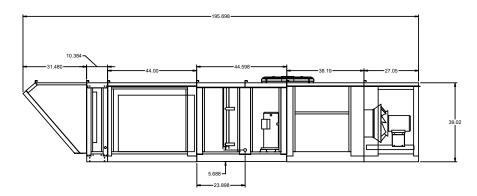




ACCESS SIDE

ACCESS SIDE

ELEVATION VIEW END VIEW





NOTE: Roof Opening Requirements:


Minimum Roof Opening: The minimum roof opening size is the illustrated duct diameter plus 0.25 in. on all sides. For example: If the duct size is 14 x 14 in. square, the minimum roof opening size is 14.5 x 14.5 in. square.

Maximum Roof Opening: There must be a minimum perimeter of 1.75 in. between the roof opening and the roof curb. For example: If the roof curb is 75 x 30 in. square, the maximum roof opening is 71.5 x 26.5 in. inches square.

NOTE: The weatherhood and filter sections of the make-up air unit are not supported by the curb. This is by design, in order to help alleviate water infiltration issues.

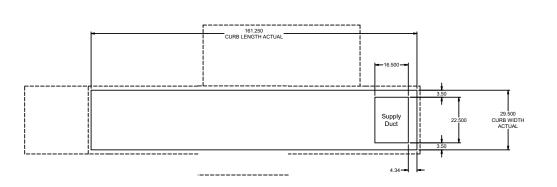

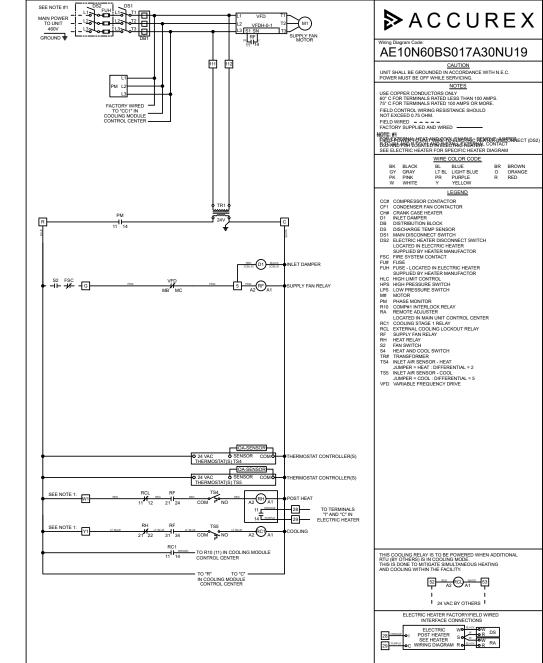



Template Drawing: U19 DOC NUMBER: ----

REV: ----

PELICANS EGG AND SAUTE HOOD ASSOC

MS LA -


UREX FL PANHANDLE AL N CHAD LONG CHAD.LONG@ACCUREX (985)290-3160


FOOTPRINT


CONTROL INFORMATION																
MADIZ	ELECTRICAL CONTROL PACKAGE		USER INTERFACE		FANS CONTROLLED											
MARK	MODEL	LOCATION	TYPE	LOCATION	FAN #	TYPE	FAN	FAN MARK	ZONE	CFM	MOTOR HP	MOTOR VOLT	CYCLE	MOTOR PHASE	MOTOR STARTER IN PANEL	VFD IN PANEL
ELEC1	XKC-CV-S-11-1-1-0	LEFT CABINET ON KH-1	FULL COLOR	. CABINET – LEFT CABINET ON KH-	1	EXHAUST	E1	KEF-1	1	3000	1.5	208	60	3	YES	NO
ELEC1	XKC-CV-3-11-1-1-0		TOUCHSCREEN	CABINET - LEFT CABINET ON KH-T	2	SUPPLY	S1	KSF-1	1	2400	1.5	460	60	3	NO	NO

CONTROL FEATURES HOOD LIGHT CONTROL TEMP SENSORS (FACTORY INSTALLED) - QTY. 1 DRY FIRE CONTACTS - QTY. 2 LIGHTS OFF DURING FIRE EXHAUST MAX DURING FIRE

SUPPLY OFF DURING FIRE

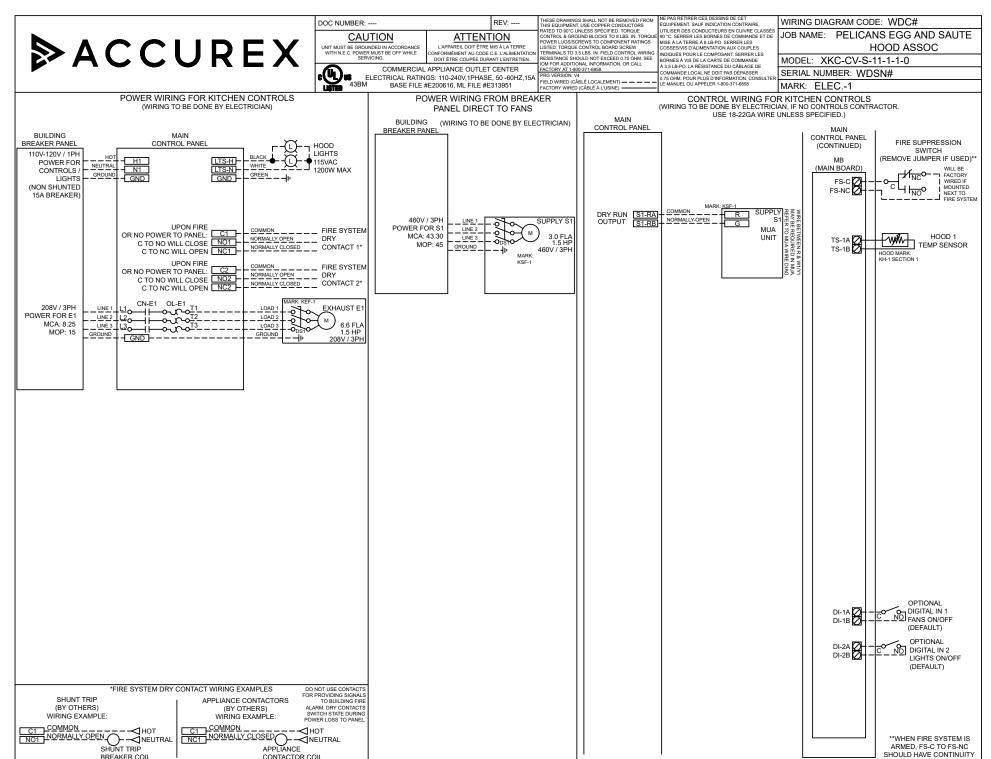

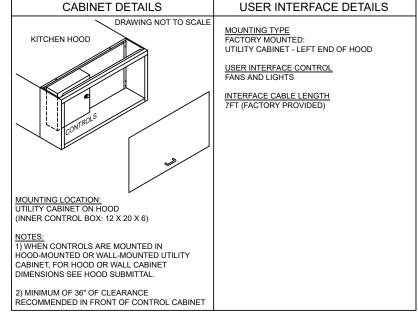

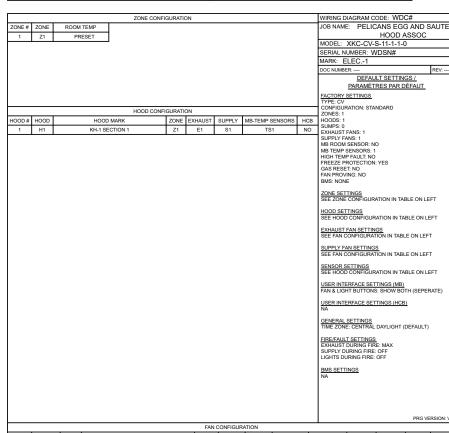

3

PELICANS EGG AND SAUTE HOOD ASSOC

MS LA :UREX FL PANHANDLE AL M CHAD LONG CHAD.LONG@ACCUREX. (985)290-3160 ACCU

